

GENERAL NOTES

DESIGN:
AASHTO LRFD Bridge Design Specifications,
4th Edition with California Amendments.

PRESTRESSING STEEL:

Bars - ASTM Designation: A722 Type II (150 ksi)

Strand Tendons-ASTM Designation: A416
(270 Ksi Low Relaxation steel)

FTL = Factored Test Load per anchor (Kips)

fpu = Minimum tensile strength of prestressing steel

As = Minimum cross sectional area of prestressing steel in ground anchor (square inch)

$$As(\text{Min}) = \frac{1.0 \text{ FTL}}{0.75 \text{ fpu}} \text{ (Strands)}$$

$$As(\text{Min}) = \frac{1.0 \text{ FTL}}{0.80 \text{ fpu}} \text{ (Bars)}$$

NOTES:

- (A) Level of initial grouting for drilled hole 6" in diameter or smaller
- (B) Level of secondary grouting
- (C) Level of initial grouting inside corrugated sheathing
- (D) Bonded length shall be determined by the contractor
- (E) For unbonded length, see PROJECT PLANS
- (F) For inclination, see PROJECT PLANS
- (G) Face of Wall Excavation

NOTES:

1. Anchorage enclosure shall only be used when anchor head assembly is not enclosed in concrete.
2. Anchorage enclosure shall have provisions to allow injecting grout at low end and venting at high end. Galvanize after fabrication.
3. Silicone sealant to cover full width of flange.
4. Steel tube (Min thickness = 1/4") welded to bearing plate. Galvanize assembly after fabrication
5. Steel tube welded to bearing plate. Inside diameter of steel tube (Min thickness = 1/4") to be 1" greater than outside diameter of smooth sheathing.
6. Galvanize assembly after fabrication.
7. For other wall details, see PROJECT PLANS.


DIST	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET No.	TOTAL SHEETS

REGISTERED CIVIL ENGINEER DATE _____


PLANS APPROVAL DATE _____

The State of California or its officers or agents shall not be responsible for the accuracy or completeness of scanned copies of this plan sheet.


The Registered Civil Engineer for the project is responsible for the selection and proper application of the component design and any modifications shown.

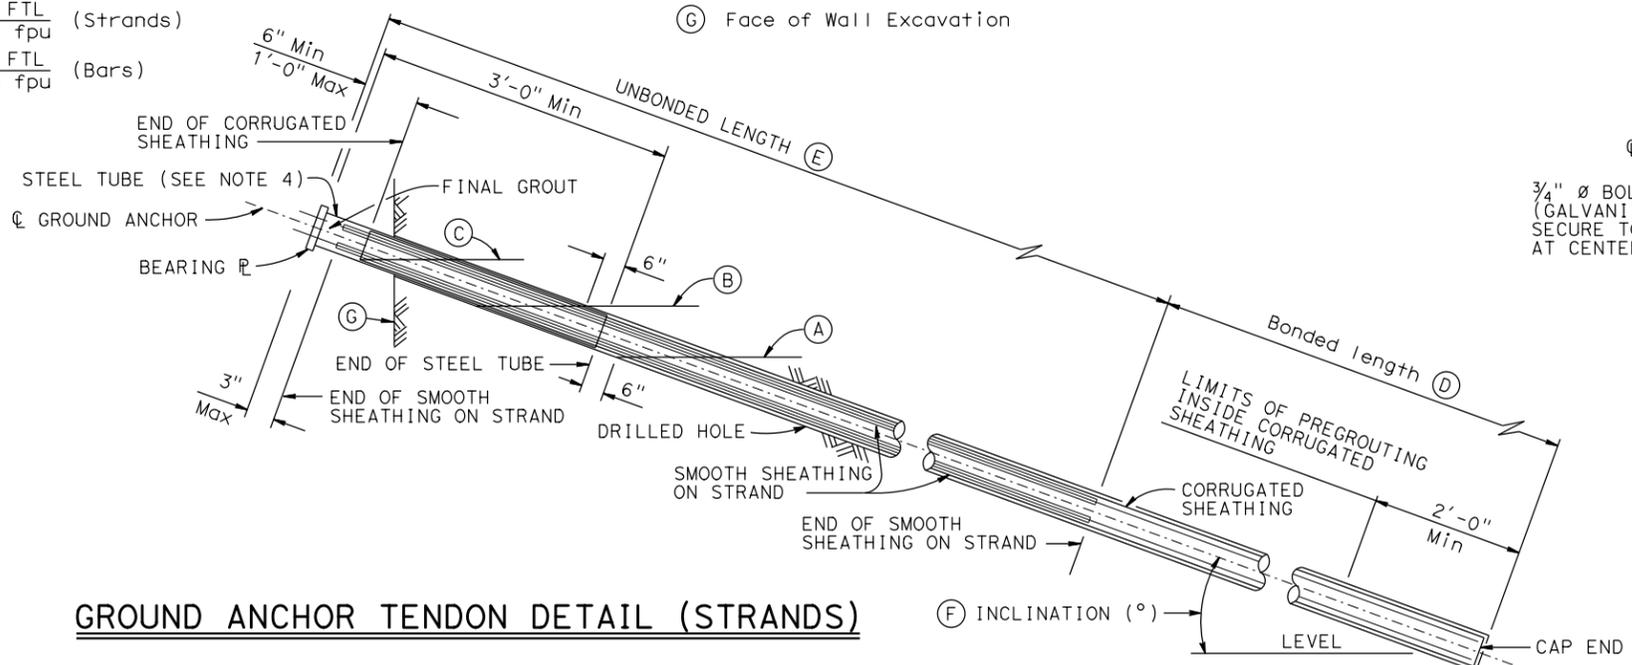


GROUND ANCHOR TENDON DETAIL (STRANDS)

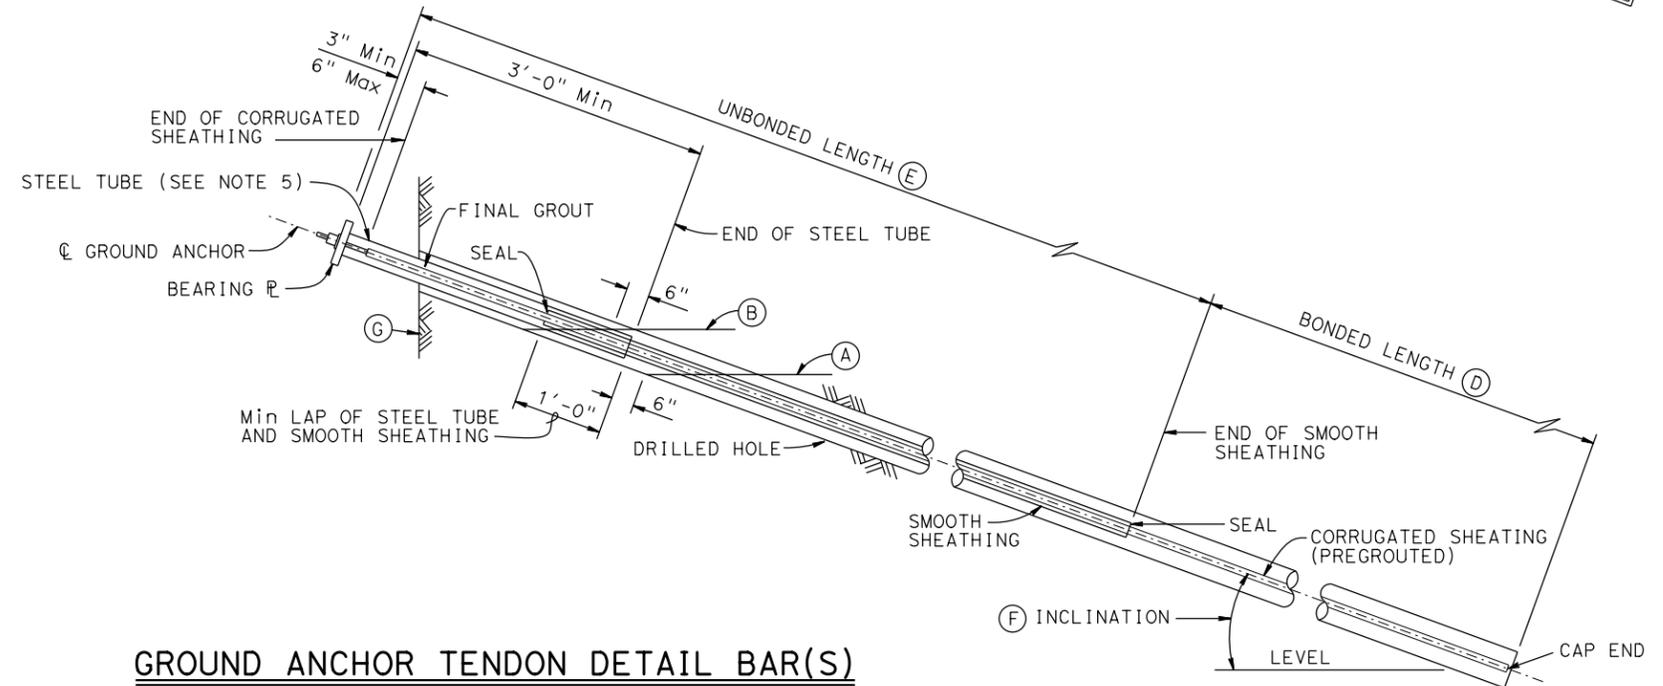

GROUND ANCHOR TENDON DETAIL BAR(S)

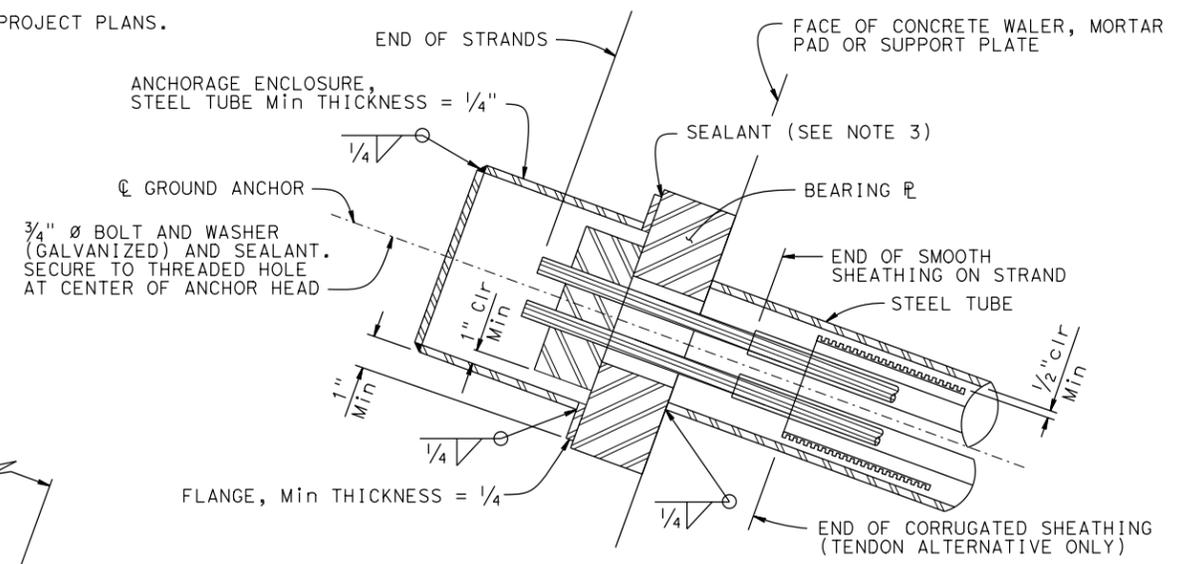

ALTERNATIVE X

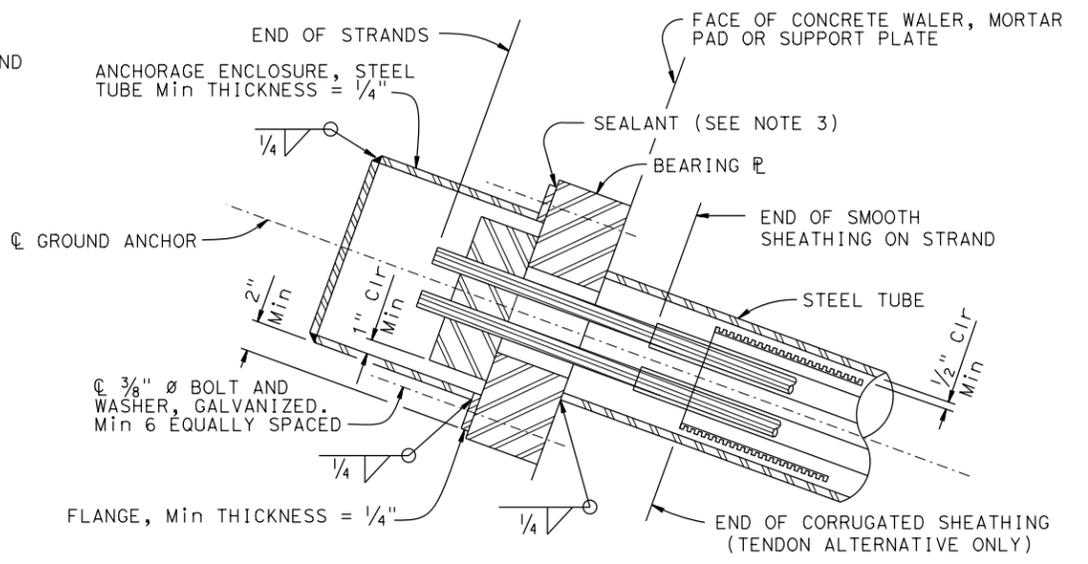

ALTERNATIVE Y

ANCHORAGE ENCLOSURE DETAILS

NO SCALE