
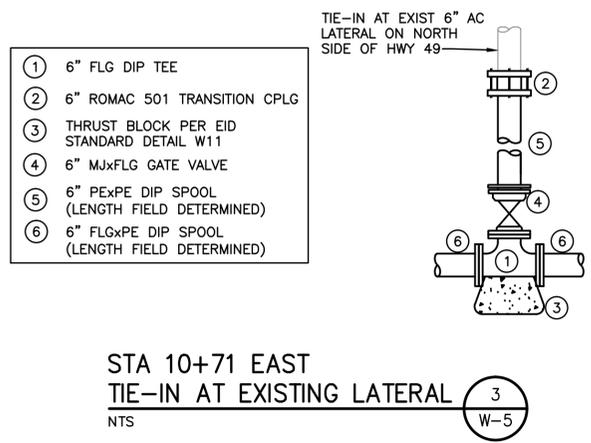
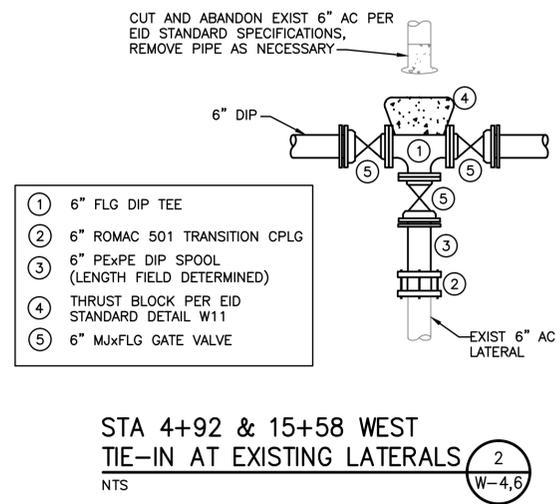




STATE OF CALIFORNIA - DEPARTMENT OF TRANSPORTATION
Caltrans
 CONSULTANT FUNCTIONAL SUPERVISOR: JOE W. DOMENICHELLI
 CHECKED BY: JOE W. DOMENICHELLI
 CALCULATED-DESIGNED BY: SARA M. ROGERS
 REVISED BY: SMR
 DATE REVISION: 9/15/16

Dist	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET No.	TOTAL SHEETS
03	ED	49	23.6 / 24.5	186	202

REGISTERED CIVIL ENGINEER: *Sara M. Rogers* DATE: 7/6/16
 PLANS APPROVAL DATE: 5/9/16
 REGISTERED PROFESSIONAL ENGINEER: SARA M. ROGERS
 NO. C64226 Exp. 6/30/17
 CIVIL ENGINEER
 STATE OF CALIFORNIA
 THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.
 DOMENICHELLI & ASSOCIATES CIVIL ENGINEERING
 1101 INVESTMENT BLVD, SUITE 115
 EL DORADO HILLS, CA 95762
 (916) 933-1997
 EL DORADO IRRIGATION DISTRICT
 2890 MOSQUITO ROAD
 PLACERVILLE, CA 95667
 (530) 622-4513 (916) 965-0930

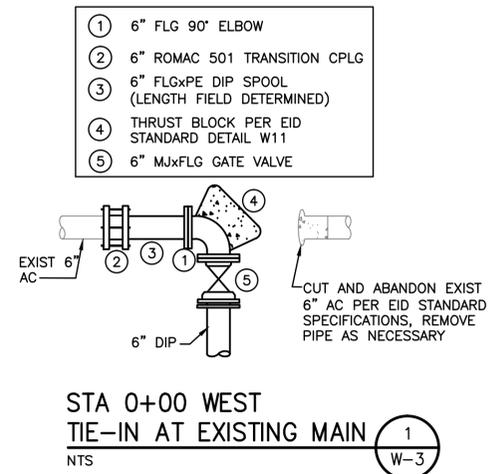

- TIE-IN DETAIL GENERAL NOTES:**
- CONTRACTOR SHALL POTHOLE ALL TIE-IN LOCATIONS TO VERIFY PIPE TYPES, SIZES AND FITTINGS REQUIRED IN ADVANCE OF MATERIAL PURCHASE AND CONSTRUCTION. FINAL TIE-IN MATERIALS AND CONFIGURATION SHALL BE APPROVED BY EID.
 - ALL MECHANICAL JOINTS SHALL BE OF THE RESTRAINED TYPE USING EBAA IRON, OR EQUAL.
 - THE CONTRACTOR IS MADE AWARE THAT THE EXISTING PIPELINE IS ASBESTOS CONCRETE (AC) MATERIAL. ALL AC PIPE SHALL BE PROPERLY DISPOSED OF PER ALL APPLICABLE REGULATIONS AND PER THE SPECIFICATIONS.
 - ALL MATERIALS SHALL BE PER APPROVED EID MATERIALS LIST STANDARD DETAILS W08A, W08B AND W08C.

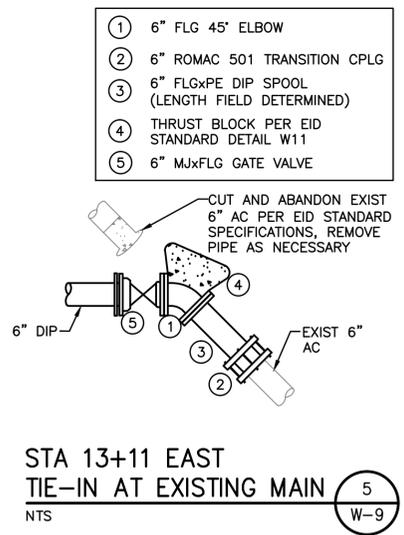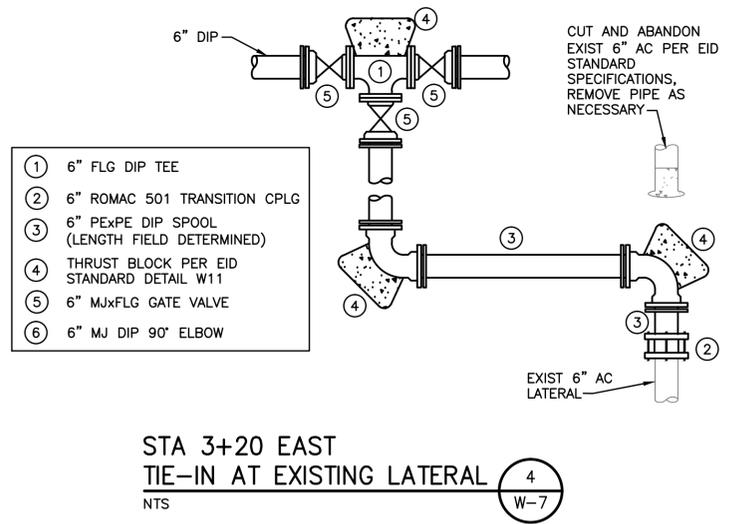

4 REPLACED PER ADDENDUM No. 4 DATED SEPTEMBER 15, 2016

POTABLE WATER
 TIE-IN DETAILS
 SCALES AS NOTED

APPROVED FOR POTABLE WATER WORK ONLY

W-12

LAST REVISION 00-00-00
 DATE PLOTTED =>
 TIME PLOTTED =>
 \$DATE
 \$TIME