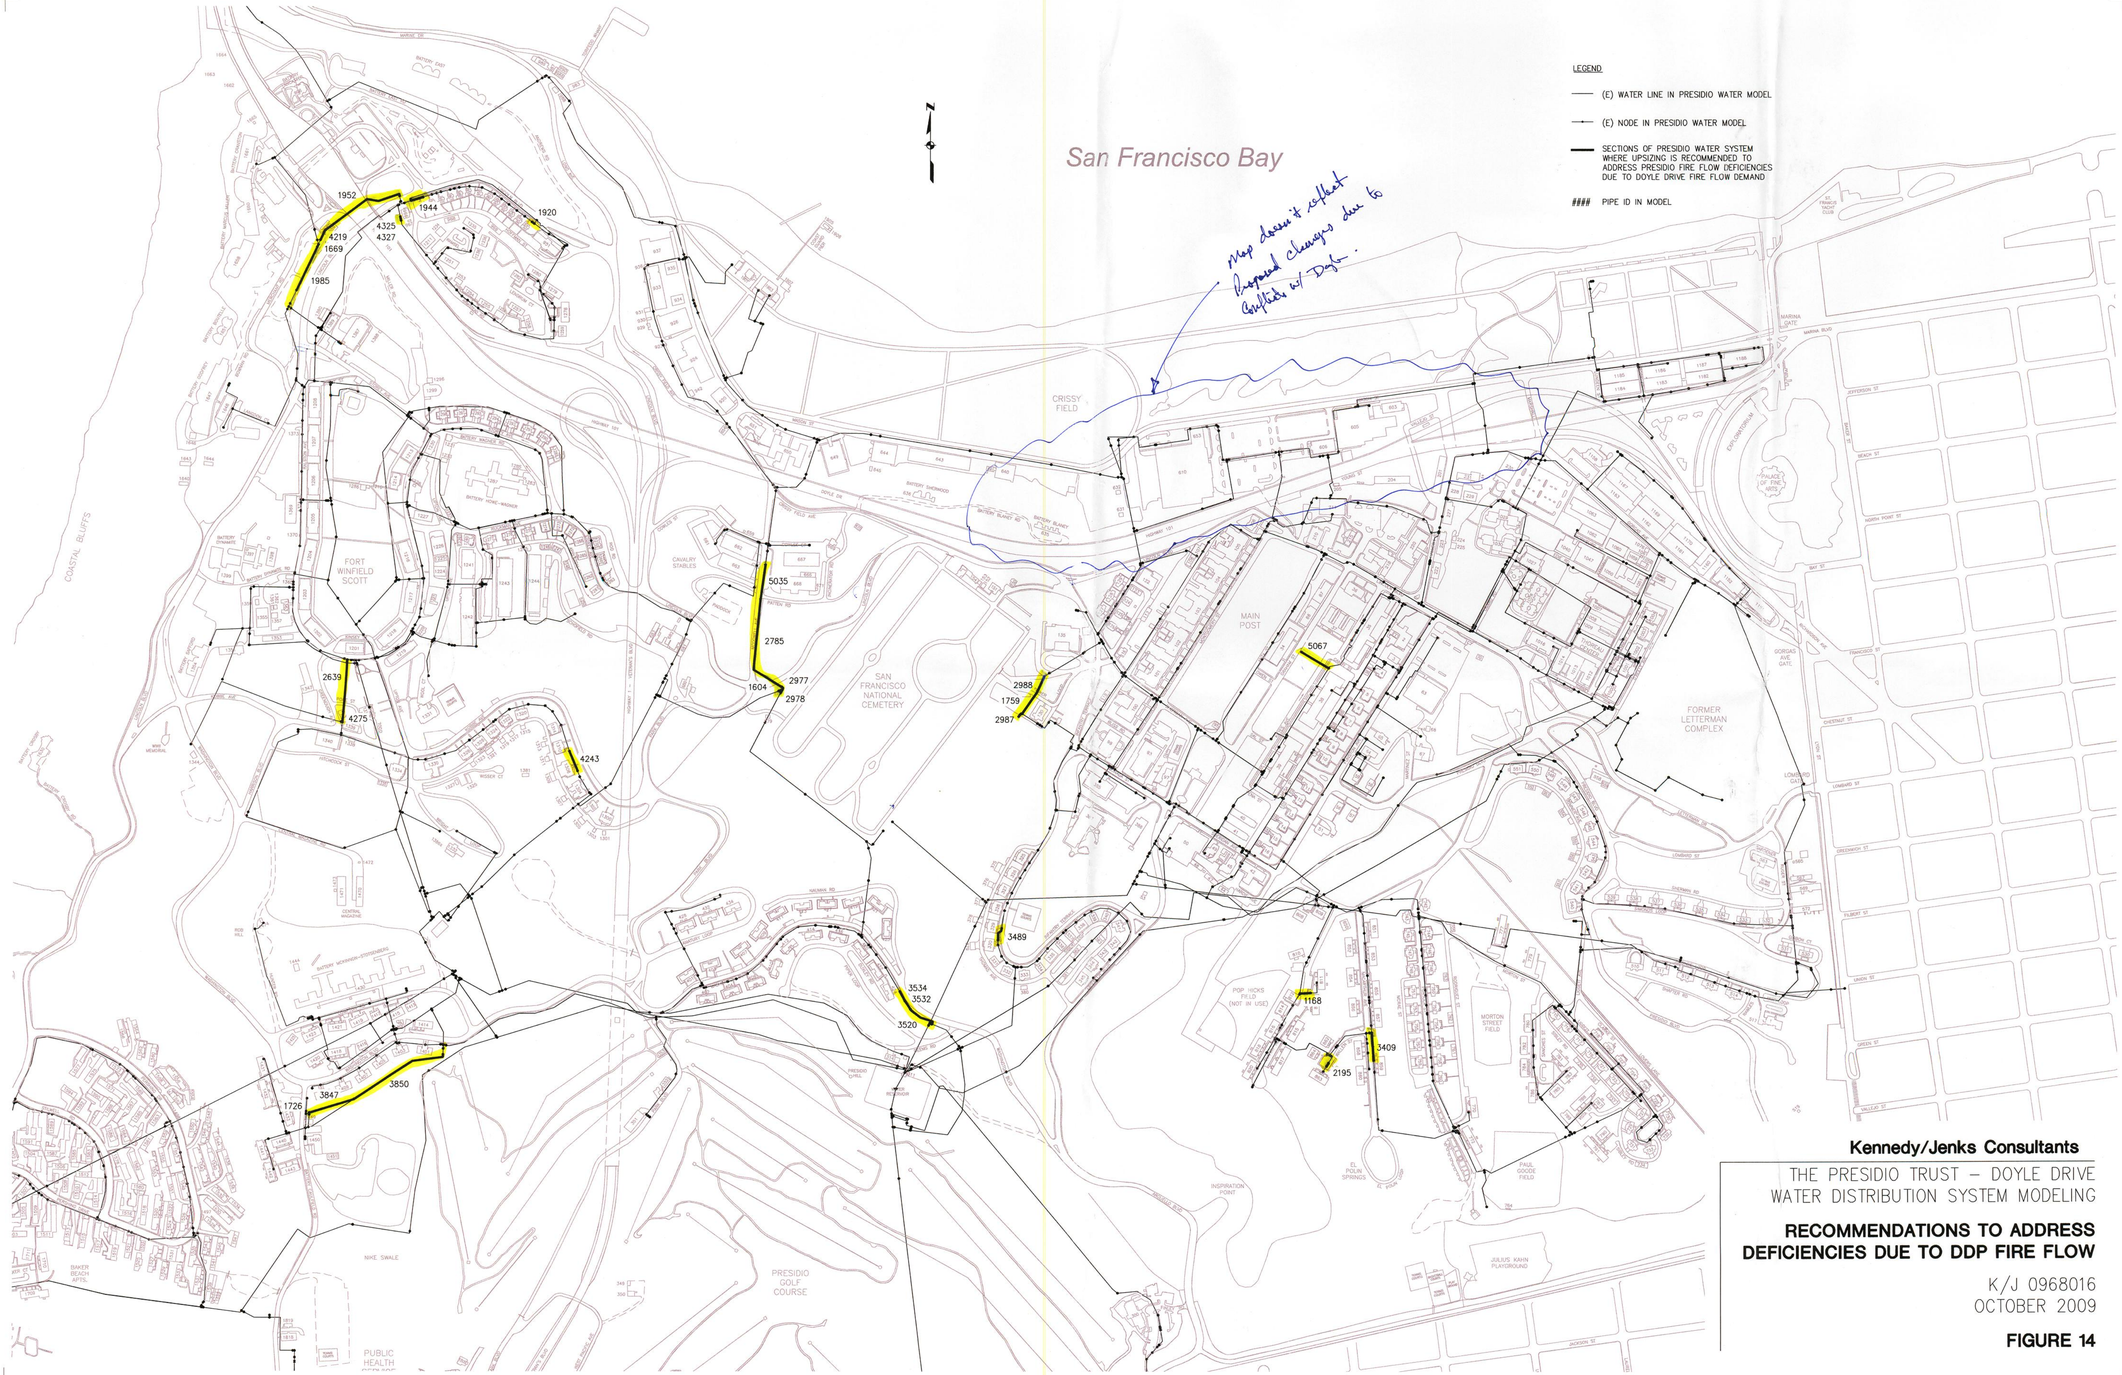

Kennedy/Jenks Consultants

THE PRESIDIO TRUST – DOYLE DRIVE
WATER DISTRIBUTION SYSTEM MODELING

RECOMMENDATIONS TO ADDRESS DEFICIENCIES DUE TO DDP FIRE FLOW

K/J 0968016
OCTOBER 2009

FIGURE 14