

DEPARTMENT OF TRANSPORTATION
DIVISION OF ENGINEERING SERVICES
OFFICE ENGINEER, MS 43
1727 30TH STREET
P.O. BOX 168041
SACRAMENTO, CA 95816-8041
FAX (916) 227-6214
TTY (916) 227-8454



*Flex your power!
Be energy efficient!*

May 5, 2007

04-Ala-580,880-46.5/46.9, 35.2/35.4
04-4A4104
ACSTP-43Z1(001)

Addendum No. 2

Dear Contractor:

This addendum is being issued to the contract for construction on State highway in ALAMEDA COUNTY IN OAKLAND AT THE ROUTE 580/880 SEPARATION.

Submit bids for this work with the understanding and full consideration of this addendum. The revisions declared in this addendum are an essential part of the contract.

Bids for this work will be opened on May 7, 2007.

This addendum is being issued to revise the Project Plans, the Notice to Contractors and Special Provisions, and the Proposal and Contract.

Project Plan Sheet 13, in the "QUANTITIES" table, the quantity for "COLUMN CASING" is revised from "3300 LB" to "4325 LB".

Project Plan Sheet 14, under the "General Notes" and the paragraph that relates to alternative plate sizes, the first and third bullets are revised as follows:

"* The steel weight may not be increased more than 50%.

* The top flange width divided by the top flange thickness shall not be greater than 36 for the I girders and for the box girders."

Project Plan Sheet 15, "BENT MB 18 AND BENT MB20 ELEVATION" view is revised as attached.

Project Plan Sheet 21, "DIAPHRAGM" section, the following note is added:

"The 5 open holes shown at each end of the MC 18 x 42.7 diaphragm members represent 7/8" HS Bolts."

Project Plan Sheet 26, the following note is added:

"Each elastomeric bearing pad is 24" X 24" X 3" with an 8" diameter hole for the pin. Either elastomeric or steel reinforced elastomeric bearing pads are acceptable."

04-Ala-580,880-46.5/46.9, 35.2/35.4
04-4A4104
ACSTP-43Z1(001)

In the Special Provisions, Section 10-1.26, "EXISTING HIGHWAY FACILITIES," subsection "BRIDGE REMOVAL (PORTION)," the first through fifth paragraphs are replaced with the following six paragraphs:

"Removing portions of the bridges shall conform to the provisions in Section 15-4, "Bridge Removal," of the Standard Specifications and these special provisions.

Bridge removal (portion) shall include cutting, removing and disposing of a section of the existing structural steel column casing, removing the existing concrete and grout, and grinding a beveled edge for welding a new structural steel column casing, to the limits as shown on the plan at the following location:

DISTRIBUTION STRUCTURE
(Bridge No. 33-0061L)
WB 80/EB 580 Connector
EB Route 580 to Castro Valley
"MB" Line
Bent 19 and Bent 20

Existing temporary supports are located at Bents MB 18 and MB 20. All operations involving the removal of temporary supports will be paid for as extra work as provided in Section 4-1.03D, "Extra Work," of the Standard Specifications.

After removal of existing concrete, concrete surfaces and bar reinforcement to remain shall be abrasive blast cleaned and flushed conforming to Section 51-1.13, "Bonding," of the Standard Specifications.

Removed materials that are not to be salvaged or used in the reconstruction shall become the property of the Contractor and shall be disposed of in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.

Full compensation for cutting, removing and the disposing of the section of column casing and grinding a beveled edge shall be considered as included in the contract lump sum price paid for bridge removal (portion) and no additional compensation will be made therefore."

In the Special Provisions, Section 10-1.35, "COLUMN CASINGS," is revised as attached.

In the Proposal and Contract, the Engineer's Estimate Item 23 is revised.

To Proposal and Contract book holders:

Replace page 4 of the Engineer's Estimate in the Proposal with the attached revised page 4 of the Engineer's Estimate. The revised Engineer's Estimate is to be used in the bid.

Inquiries or questions in regard to this addendum must be communicated as a bidder inquiry and must be made as noted in the NOTICE TO CONTRACTORS section of the Notice to Contractors and Special Provisions.

Indicate receipt of this addendum by filling in the number of this addendum in the space provided on the signature page of the proposal.

Submit bids in the Proposal and Contract book you now possess. Holders who have already mailed their book will be contacted to arrange for the return of their book.

Inform subcontractors and suppliers as necessary.

Addendum No. 2
Page 3
May 5, 2007

04-Ala-580,880-46.5/46.9, 35.2/35.4
04-4A4104
ACSTP-43Z1(001)

This office is sending this addendum by confirmed facsimile to Proposal and Contract book holders to ensure that each receives it. A copy of this addendum is available for the contractor's use on the Internet Site:

http://www.dot.ca.gov/hq/esc/oe/weekly_ads/addendum_page.html


If you are not a Proposal and Contract book holder, but request a book to bid on this project, you must comply with the requirements of this letter before submitting your bid.

Sincerely,

ORIGINAL SIGNED BY

REBECCA D. HARNAGEL, Chief
Office of Plans, Specifications & Estimates
Division of Engineering Services - Office Engineer

Attachments

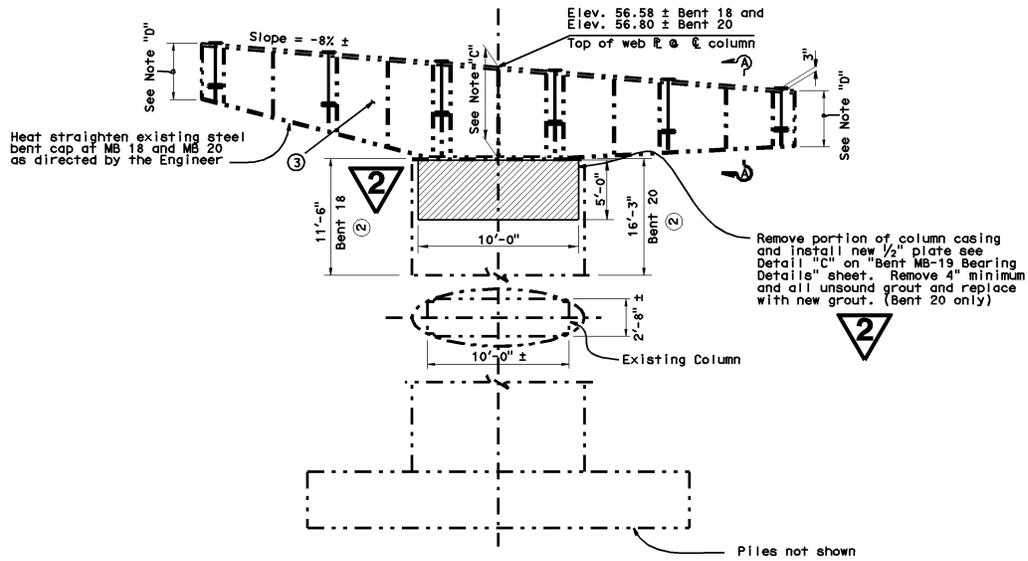

BENT MB 18 AND BENT MB20 ELEVATION

$\frac{1}{4}"=1'$

2 REVISED PER ADDENDUM No. 2 DATED MAY 5, 2007

10-1.35 COLUMN CASINGS

Column casings at Bent MB 19 and Bent MB 20 shall consist of cleaned and painted structural steel shells filled with structural concrete and grout as shown on the plans and conforming to the provisions in Section 55, "Steel Structures," of the Standard Specifications and these special provisions.

Attention is directed to "Welding Quality Control" of these special provisions.

Attention is directed to "Bridge Removal (Portion)" of these special provisions.

For field welding of column casings, only visual inspection will be required, and the requirements of the second sentence of paragraph 3.13.2 and the first sentence of paragraph 3.13.3 of AWS D1.5 will not apply.

Structural steel for column casings shall conform to the requirements in ASTM Designation: A 36/A 36M, or, at the Contractor's option, ASTM Designation: A 709/A 709M, Grade 36.

CLEAN AND PAINT COLUMN CASING

New metal surfaces, except where galvanized, shall be cleaned and painted in conformance with the provisions in Sections 59-2, "Painting Structural Steel," and 91, "Paint," of the Standard Specifications and these special provisions.

Prior to performing any painting or paint removal, the Contractor shall submit to the Engineer, in conformance with the provisions in Section 5-1.02, "Plans and Working Drawings," of the Standard Specifications, 3 copies of a separate Painting Quality Work Plan (PQWP) for each item of work for which painting or paint removal is to be performed. As a minimum, each PQWP shall include the following:

- A. The name of each Contractor or subcontractor to be used.
- B. One copy each of all current "SSPC: The Society for Protective Coatings" specifications or qualification procedures which are applicable to the painting or paint removal to be performed. These documents shall become the permanent property of the Department.
- C. A copy of the coating manufacturer's guidelines and recommendations for surface preparation, painting, drying, curing, handling, shipping, and storage of painted structural steel, including testing methods and maximum allowable levels for soluble salts.
- D. Proposed methods and equipment to be used for any paint application.
- E. Proof of each of any required certifications, SSPC-QP 1, SSPC-QP 3. Where SSPC-QP 3 certification is required, an enclosed shop facility shall be required. Certification of AISC Sophisticated Paint Endorsement Quality Program, P-1 Enclosed endorsement, will be considered equivalent to SSPC-QP 3.
 1. In lieu of certification in conformance with the requirements in SSPC-QP 1 for this project, the Contractor may submit written documentation showing conformance with the requirements in Section 3, "General Qualification Requirements," of SSPC-QP 1.
 2. In lieu of certification in conformance with the requirements in SSPC-QP 3 for this project, the Contractor may submit written documentation showing conformance with the requirements in Section 3, "General Qualification Requirements," of SSPC-QP 3.
- F. Proposed methods to control environmental conditions in accordance with the manufacturer's recommendations and these special provisions.
- G. Proposed methods to protect the coating during curing, shipping, handling, and storage.
- H. Proposed rinse water collection plan.
- I. A detailed paint repair plan for the repair of damaged areas.
- J. Procedures for containing blast media and water during application of coatings and coating repair of erected structural steel column casings.
- K. Examples of proposed daily reports for all testing to be performed, including type of testing, location, lot size, time, weather conditions, test personnel, and results.

Prior to submitting the PQWP, a pre-painting meeting between the Engineer, the Contractor, and a representative from each entity performing painting for this project shall be held to discuss the requirements for the PQWP.

The Contractor shall allow the Engineer 3 weeks to review the PQWP submittal after a complete plan has been received. No painting or paint removal shall be performed until the PQWP for that work is reviewed by the Engineer. Should the Engineer fail to complete the review within this time allowance and if, in the opinion of the Engineer, the Contractor's controlling operation is delayed or interfered with by reason of the delay in reviewing the PQWP, the delay will be considered a right of way delay in conformance with the provisions in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

The Engineer's approval of the Contractor's PQWP shall not relieve the Contractor of any responsibility under the contract for the successful completion of the work in conformity with the requirements of the plans and specifications.

The Contractor shall provide enclosures to permit cleaning and painting during inclement weather. Provisions shall be made to control atmospheric conditions inside the enclosures within specified limits during cleaning and painting operations, drying to solvent insolubility, and throughout the curing period in accordance with the manufacturer's recommendations and these special provisions. Full compensation for providing and maintaining such enclosures shall be considered as included in the prices paid for the various contract items of work requiring cleaning and painting, and no additional compensation will be allowed therefor.

Fresh, potable water with a maximum chloride content of 75 ppm and a maximum sulfate content of 200 ppm shall be used for water rinsing or pressure washing operations. No continuous recycling of rinse water will be permitted. If rinse water is collected into a tank and subsequent testing determines the collected water conforms to the specified requirements, reuse may be permitted by the Engineer if no collected water is added to the tank after sample collection for determination of conformance to specified requirements.

Column casing surfaces in contact with structural concrete shall not be considered embedded in concrete.

Column casing surfaces to be painted with inorganic zinc coating shall be blast cleaned and painted with the single undercoat prior to shipment to the job site.

Cleaning

The surfaces to be cleaned and painted shall be dry blast cleaned in conformance with the requirements of SSPC-SP 10, "Near White Blast Cleaning," of the "SSPC: The Society for Protective Coatings." Blast cleaning shall leave surfaces with a dense, uniform, angular anchor pattern of not less than 1.6 mils nor more than 3.5 mils as measured in conformance with the requirements in ASTM Designation: D 4417.

Mineral and slag abrasives used for blast cleaning steel surfaces shall conform to the requirements for Class A, Grade 2 to 3 abrasives contained in SSPC-AB 1, "Mineral and Slag Abrasives," of the "SSPC: The Society for Protective Coatings," and shall not contain hazardous material.

Steel abrasives used for blast cleaning steel surfaces shall comply with the requirements of SSPC-AB 3, "Ferrous Metallic Abrasive," of the "SSPC: The Society for Protective Coatings." If steel abrasive is recycled through shop or field abrasive blast cleaning units, the recycled abrasive shall conform to the requirements of SSPC-AB 2, "Specification for Cleanliness of Recycled Ferrous Metallic Abrasive," of the "SSPC: The Society for Protective Coatings."

A Certificate of Compliance conforming to the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications and a Material Safety Data Sheet shall be furnished prior to use for each shipment of blast cleaning material for steel.

Abrasive blast cleaned surfaces shall be tested by the Contractor for soluble salts using a Class A or B retrieval method as described in Technology Guide 15, "Field Methods for Retrieval and Analysis of Soluble Salts on Steel and Other Nonporous Substrates," of the "SSPC: The Society for Protective Coatings," and cleaned so the maximum level of soluble salts does not exceed the lesser of the coating manufacturer's written recommendations or 10 micrograms per square centimeter. Areas of abrasive blast cleaned steel shall be tested at the rate of 3 tests for the first 1000 square feet prepared per day, and one test for each additional 1000 square feet or portion thereof, at locations selected by the Engineer. When less than 1000 square feet of surface area is prepared in a shift, at least 2 tests shall be performed. If levels of soluble salts exceed the maximum allowed by these special provisions, the entire area represented by the testing will be rejected. The Contractor shall perform additional cleaning and testing of rejected areas until soluble salt levels conform to these requirements.

Corners shall be chamfered to remove sharp edges.

Thermal cut edges (TCEs) to be painted shall be conditioned before blast cleaning by shallow grinding or other method approved by the Engineer to remove the thin, hardened layer of material resulting from resolidification during cooling.

Visually evident base metal surface irregularities and defects shall be removed in accordance with ASTM Designation: A 6 or AASHTO Designation: M 160 prior to blast cleaning steel. When material defects exposed by blast cleaning are removed, the blast profile shall be restored by either blast cleaning or by using mechanical tools in accordance with SSPC-SP 11, "Power Tool Cleaning to Bare Metal," of the "SSPC: The Society for Protective Coatings."

Painting

Blast cleaned surfaces shall receive a single undercoat consisting of an inorganic zinc coating conforming to the requirements in AASHTO Designation: M 300, Type I or Type II, except that: 1) the first 3 sentences of Section 5.6, "Primer Field Performance Requirements," shall not apply for Type II coatings, and 2) the entire Section 4.7.1 shall not apply for either type of inorganic zinc coating.

The color of the final coat of inorganic zinc coating shall match Federal Standard 595B No. 36373.

If the Contractor proposes to use a Type II coating, the coating shall be selected from the qualified products list, which may be obtained from the Transportation Laboratory.

Inorganic zinc coating shall be used within 12 hours of initial mixing.

Application of inorganic zinc coating shall conform to the provisions for applying zinc-rich coating in Section 59-2.13, "Application of Zinc-Rich Primer," of the Standard Specifications.

The single undercoat of inorganic zinc coating shall be applied to the required dry film thickness in 2 or more applications within 8 hours of the start of blast cleaning. Abrasive blast cleaned steel shall not be exposed to relative humidity exceeding 85 percent prior to application of inorganic zinc coating.

The total dry film thickness of all applications of the single undercoat of inorganic zinc coating shall be not less than 4 mils nor more than 8 mils.

Damaged areas and areas where mudcracking occurs in the inorganic zinc coating shall be blast cleaned and repainted with inorganic zinc coating to the specified thickness.

Steel surfaces coated with Type II inorganic zinc coating shall be protected from conditions that may cause the coating film to dissolve. The Contractor, at the Contractor's expense, shall repair areas where the coating has dissolved by blast cleaning and repainting with inorganic zinc coating to the specified thickness.

Dry spray, or overspray, as defined in the Steel Structures Painting Manual, Volume 1, "Good Painting Practice," of the "SSPC: The Society for Protective Coatings," shall be removed prior to application of subsequent coats or final acceptance. Removal of dry spray shall be by screening or other methods that minimize polishing of the inorganic zinc surface. The dry film thickness of the coating after removal of dry spray shall be in conformance with the provisions for applying the single undercoat, as specified herein.

The Contractor shall test the inorganic zinc coating prior to application of final coats. The locations of the tests will be determined by the Engineer. The Contractor shall determine the sequence of the testing operations. The testing for adhesion and hardness will be performed no sooner than 72 hours after application of the single undercoat of inorganic zinc coating. At the Contractor's expense, satisfactory access shall be provided to allow the Engineer to determine the location of the tests.

The inorganic zinc coating shall pass the following tests:

- A. The inorganic zinc coating shall have a minimum adhesion to steel of 600 psi when measured using a self-aligning adhesion tester in conformance with the requirements in ASTM Designation: D 4541. The Engineer will select 3 locations per column casing section for adhesion testing. If 2 or more of the locations tested fail to meet adhesion requirements, the section will be rejected. If one of the locations tested fails to meet adhesion requirements, an additional 3 locations shall be tested. Should any of the additional locations fail to meet adhesion requirements, the column casing section will be rejected. The Contractor, at the Contractor's expense, shall repair the rejected area by blast cleaning and repainting with inorganic zinc to the specified thickness. Test locations for areas of inorganic zinc meeting adhesion testing requirements shall be repaired by application of organic zinc primer as specified in Section 91-1.04, "Materials," of the Standard Specifications to the specified minimum dry film thickness.
- B. The inorganic zinc coating shall exhibit a solid, hard, and polished metal surface when firmly scraped with the knurled edge of a quarter. Inorganic zinc coating that is powdery, soft, or does not exhibit a polished metal surface, as determined by the Engineer, shall be repaired by the Contractor, at the Contractor's expense, by blast cleaning and repainting with inorganic zinc coating to the specified thickness.

Additional Requirements for Water Borne Inorganic Zinc Primers

- A. The surface pH of the inorganic zinc primer shall be tested by wetting the surface with deionized water for a minimum of 15 minutes but no longer than 30 minutes and applying pH paper with a capability of measuring in increments of 0.5 pH units. At least 2 surface pH readings shall be taken for every 500 square feet or portion thereof. If less than 500 square feet of steel is coated in a single shift or day, at least 2 surface pH readings shall be taken for primer applied during that period.
- B. Dry to solvent insolubility for water borne inorganic zinc primers shall be determined in conformance with the requirements in ASTM Designation: D 4752, except that water shall be the solvent. The resistance rating shall be not less than 4. Areas of inorganic zinc coating shall be tested for solvent insolubility at the rate of one test per 500 square feet or portion thereof. Inorganic zinc coating represented by the tested area that does not meet the solvent insolubility requirements will be rejected. The Contractor, at the Contractor's expense, shall repair rejected areas by blast cleaning and repainting with inorganic zinc coating to the specified thickness.

Additional Requirements for Solvent Borne Inorganic Zinc Primers

- A. Dry to solvent insolubility for solvent borne inorganic zinc primers shall be determined in conformance with the requirements in ASTM Designation: D 4752. The resistance rating shall be not less than 4. Areas of inorganic zinc coating shall be tested for solvent insolubility at the rate of one test per 500 square feet or portion thereof. Inorganic zinc coating represented by the tested area that does not meet the solvent insolubility requirements will be rejected. The Contractor, at the Contractor's expense, shall repair rejected areas by blast cleaning and repainting with inorganic zinc coating to the specified thickness.
- B. Surface hardness of solvent borne inorganic zinc shall be a minimum 2H when measured in conformance with the requirements in ASTM Designation: D 3363. Areas of inorganic zinc coating shall be tested at the rate of one test per 500 square feet or portion thereof. Inorganic zinc coating that fails to meet the surface hardness requirements shall be repaired by the Contractor, at the Contractor's expense, by blast cleaning and repainting with inorganic zinc coating to the specified thickness.

The Contractor, at the Contractor's expense, shall retest all rejected areas of inorganic zinc coating after repairs have been completed.

Except as approved by the Engineer, a minimum curing time of 72 hours shall be allowed between application of inorganic zinc coating and water rinsing.

STRUCTURAL CONCRETE

Structural concrete shall conform to the provisions in Section, "Concrete Structures," in these special provisions.

GROUTING

Grouting shall conform to the provisions in Section 50-1.09, "Bonding and Grouting," in these special provisions.

For non-circular columns where the minimum gap to be filled with grout is one inch and the maximum gap is greater than 4 inches, aggregate shall be used to extend the grout, but only to the extent that the cement content of the grout is not less than 845 pounds per cubic yard of grout. California Test 541 will not be required nor will the grout be required to pass through a sieve with a 0.07-inch maximum clear opening prior to being introduced into the grout pump. Aggregate shall consist of at least 70 percent fine aggregate and approximately 30 percent pea gravel, by weight. Fine aggregate shall conform to the provisions of Section 90-2, "Materials," of the Standard Specifications. The size of pea gravel shall be such that 100 percent passes the 1/2-inch sieve, a minimum 90 percent passes the 3/8-inch sieve, and not more than 5 percent passes the No. 8 sieve.

The Contractor shall limit the height of each lift of grout to minimize undulations and displacements of the surface of the shell during grouting. Undulations in the shell surface, including undulations from fabrication and erection, shall not exceed 1/4-inch in one foot nor shall the total displacement from plan location exceed 2 inches at any point. At the Contractor's option, a bracing system or other means may be employed to restrain the casing within the specified tolerances. Except where shown on the plans, restraints shall not pass through the columns. The grout shall harden prior to placing the next lift of grout, unless a bracing system is used.

Casings shall be sealed at the bottom. Grout shall be pumped into the casing such that the grout head is maintained uniformly around the column, and no visible evidence of water or air is ejected at the top of the grout. The grout at the casing top shall be covered with mortar and sloped to drain. Mortar shall conform to the provisions in Section 51-1.135, "Mortar," of the Standard Specifications.

Grout shall not be permitted to flow across shoulders or lanes occupied by public traffic, or to flow into gutters or other drainage facilities.

MEASUREMENT AND PAYMENT

Column casings will be measured and paid for in conformance with the provisions in Section 55-4, "Measurement and Payment," of the Standard Specifications and these special provisions.

The contract price paid per pound for column casing shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in column casings filled with grout, complete in place, including cleaning and painting of structural steel, and testing, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

Full compensation for preparing the surface and welding the new column casing to the existing casing as shown on plans shall be considered as included in the contract price paid per pound for column casing and no additional compensation will be allowed therefore.

Structural concrete placed inside the column casing at Bent MB 19 shall be measured and paid for as specified in "Concrete Structures," of the special provisions.

**ENGINEER'S ESTIMATE
04-4A4104**

Item No.	Item Code	Item Description	Unit of Measure	Estimated Quantity	Unit Price	Item Total
21 (S)	519088	JOINT SEAL (MR 1")	LF	84		
22 (S-F)	520102	BAR REINFORCING STEEL (BRIDGE)	LB	49 000		
23 (S-F)	550110	COLUMN CASING	LB	4325		
24 (S-F)	550203	FURNISH STRUCTURAL STEEL (BRIDGE)	LB	240 000		
25 (S-F)	550204	ERECT STRUCTURAL STEEL (BRIDGE)	LB	240 000		
26 (S)	590106	CLEAN STRUCTURAL STEEL (EXISTING BRIDGE)	SQFT	6800		
27 (S)	590115	CLEAN AND PAINT STRUCTURAL STEEL	LS	LUMP SUM	LUMP SUM	
28 (S)	041045	CLEAN AND PAINT STRUCTURAL STEEL (EXISTING STEEL GIRDERS AND STEEL BENT CAPS)	SQFT	5500		
29 (S)	041046	SPOT BLAST CLEAN AND PAINT UNDERCOAT (EXISTING STEEL GIRDERS AND STEEL BENT CAPS)	SQFT	5500		
30 (S)	041047	SPOT BLAST CLEAN AND PAINT UNDERCOAT (EXISTING COLUMN CASING)	SQFT	2370		
31 (S-F)	750501	MISCELLANEOUS METAL (BRIDGE)	LB	1300		
32 (F)	839401	CONCRETE BARRIER	LF	320		
33 (S)	840504	4" THERMOPLASTIC TRAFFIC STRIPE	LF	800		
34 (S)	850101	PAVEMENT MARKER (NON-REFLECTIVE)	EA	70		
35 (S)	850111	PAVEMENT MARKER (RETROREFLECTIVE)	EA	30		
36 (S)	861504	MODIFY LIGHTING AND SIGN ILLUMINATION	LS	LUMP SUM	LUMP SUM	
37	999990	MOBILIZATION	LS	LUMP SUM	LUMP SUM	

TOTAL BID: _____