


**** WARNING ** WARNING ** WARNING ** WARNING ****

This document is intended for informational purposes only.

Users are cautioned that California Department of Transportation (Department) does not assume any liability or responsibility based on these electronic files or for any defective or incomplete copying, excerpting, scanning, faxing or downloading of the contract documents. As always, for the official paper versions of the bidders packages and non-bidder packages, including addenda write to the California Department of Transportation, Plans and Bid Documents, Room 0200, P.O. Box 942874, Sacramento, CA 94272-0001, telephone (916) 654-4490 or fax (916) 654-7028. Office hours are 7:30 a.m. to 4:15 p.m. When ordering bidder or non-bidder packages it is important that you include a telephone number and fax number, P.O. Box and street address so that you can receive addenda.

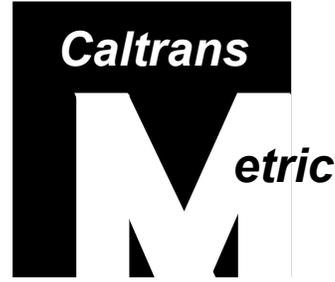

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION

**NOTICE TO CONTRACTORS
AND
SPECIAL PROVISIONS**

**FOR CONSTRUCTION ON STATE HIGHWAY IN
SAN DIEGO COUNTY IN SAN DIEGO AND ESCONDIDO FROM 0.7 KM NORTH OF POWAY ROAD
OVERCROSSING TO 0.1 KM SOUTH OF CLARENCE LANE UNDERCROSSING**

DISTRICT 11, ROUTE 15

**For Use in Connection with Standard Specifications Dated JULY 1999, Standard Plans Dated JULY 2004, and Labor
Surcharge and Equipment Rental Rates.**

CONTRACT NO. 11-080944

11-SD-15-M30.0/M44.6

Federal Aid Project

ACIM-015-4(201)N

CMSTPL-6211(050)

**Bids Open: April 13, 2006
Dated: February 14, 2006**

OSD

IMPORTANT SPECIAL NOTICES

- **Design Sequencing:**
This project is part of a pilot program for "Design Sequencing", per Section 217, et seq., of the Streets and Highways Code (Assembly Bill 405). The purpose of the pilot program is to evaluate Design Sequencing as a tool for acceleration of project completion. Design Sequencing is a method of contracting where bids are based on partial project design, and final design activities are sequenced to permit each construction phase to commence when the design for that phase is complete, before the design of the entire project is complete. The project plans for this project are not considered complete to construct the work anticipated by the contract, and the Engineer's Estimate may contain anticipated items of work that are not indicated on the project plans. Design, and final project plans, will be completed during construction.
- **Pre-Award Qualifications:**
The bidder's attention is directed to Section 2-1.03, "Pre-Award Qualification Questionnaire," and Section 3-1.01A, "Pre-Award Qualification Review," in the Special Provisions regarding review of the bidder's qualifications to perform the work of this project.
- **Escrow of Bid Documentation:**
The bidder's attention is directed to Section 2-1.04, "Escrow of Bid Documentation," of the special provisions.
- **Project Schedule (Critical Path Method):**
The bidder's attention is directed to "Project Schedule (Critical Path Method)" regarding additional requirements for Design Sequencing.
- Attention is directed to "Guarantee" of Section 5 of the special provisions regarding the Contractor's guarantee of contract work.
- Attention is directed to Section 2-1.02B, "Submission of DBE Information," of the special provisions, regarding submittal of the "CALTRANS BIDDER – DBE INFORMATION" form and GOOD FAITH EFFORT (GFE) DOCUMENTATION form with the bid or by THE FOURTH DAY following bid opening.
- Attention is directed to the revised internet reference for Federal minimum wage rates in the Notice to Contractors.

TABLE OF CONTENTS

NOTICE TO CONTRACTORS	1
COPY OF ENGINEER'S ESTIMATE	4
SPECIAL PROVISIONS	15
SECTION 1 SPECIFICATIONS AND PLANS	15
AMENDMENTS TO JULY 1999 STANDARD SPECIFICATIONS	16
SECTION 2. PROPOSAL REQUIREMENTS AND CONDITIONS	86
2-1.01 GENERAL	86
2-1.015 FEDERAL LOBBYING RESTRICTIONS	87
2-1.02 DISADVANTAGED BUSINESS ENTERPRISE (DBE)	87
2-1.02A DBE GOAL FOR THIS PROJECT	89
2-1.02B SUBMISSION OF DBE INFORMATION	89
2-1.03 PRE-AWARD QUALIFICATION QUESTIONNAIRE	91
2-1.04 ESCROW OF BID DOCUMENTATION	91
SECTION 3. PRE-AWARD QUALIFICATION REVIEW AND AWARD AND EXECUTION OF CONTRACT	93
3-1.01 GENERAL	93
3-1.01A PRE-AWARD QUALIFICATIONS REVIEW	93
3-1.01B AWARD AND EXECUTION OF CONTRACT	93
SECTION 4. BEGINNING OF WORK, TIME OF COMPLETION AND LIQUIDATED DAMAGES	93
INCENTIVES AND DISINCENTIVES FOR DESIGNATED PORTION OF WORK	94
DESIGNATED PORTION OF WORK	94
LIMITATIONS ON DESIGNATED WORK AREAS	94
INCENTIVE AND DISINCENTIVE	94
SECTION 5. GENERAL	95
SECTION 5-1. MISCELLANEOUS	95
5-1.01 PLANS AND WORKING DRAWINGS	95
5-1.013 LINES AND GRADES	95
5-1.015 LABORATORY	95
5-1.017 CONTRACT BONDS	95
5-1.018 GUARANTEE	95
5-1.019 COST REDUCTION INCENTIVE	96
5-1.02 LABOR NONDISCRIMINATION	96
5-1.022 EXCLUSION OF RETENTION	97
5-1.023 UNSATISFACTORY PROGRESS	97
5-1.03 INTEREST ON PAYMENTS	97
5-1.04 PUBLIC SAFETY	97
5-1.05 TESTING	98
5-1.06 REMOVAL OF ASBESTOS AND HAZARDOUS SUBSTANCES	99
5-1.065 SOLID WASTE DISPOSAL AND RECYCLING REPORT	99
5-1.07 (BLANK)	99
5-1.075 BUY AMERICA REQUIREMENTS	99
5-1.08 SUBCONTRACTOR AND DBE RECORDS	100
5-1.083 DBE CERTIFICATION STATUS	100
5-1.086 PERFORMANCE OF DBE SUBCONTRACTORS AND SUPPLIERS	100
5-1.09 SUBCONTRACTING	101
5-1.10 PROMPT PROGRESS PAYMENT TO SUBCONTRACTORS	101
5-1.103 RECORDS	101
5-1.104 INTERNET DAILY EXTRA WORK REPORT	102
5-1.11 PARTNERING	102
5-1.114 VALUE ANALYSIS	103
5-1.12 DISPUTE REVIEW BOARD	103
5-1.13 FORCE ACCOUNT PAYMENT	113
5-1.14 COMPENSATION ADJUSTMENTS FOR PRICE INDEX FLUCTUATIONS	114
5-1.15 AREAS FOR CONTRACTOR'S USE	115
5-1.16 PAYMENTS	115

5-1.17 PROJECT INFORMATION	116
5-1.18 MIGRATORY BIRDS	117
5-1.19 PALEONTOLOGY	117
5-1.20 SOUND CONTROL REQUIREMENTS	118
5-1.21 RELATIONS WITH U.S. FISH AND WILDLIFE SERVICE	118
5-1.22 ENVIRONMENTALLY SENSITIVE AREA	118
SECTION 6. (BLANK)	118
SECTION 7. (BLANK)	118
SECTION 8. MATERIALS	118
SECTION 8-1. MISCELLANEOUS	118
8-1.01 SUBSTITUTION OF NON-METRIC MATERIALS AND PRODUCTS	118
8-1.02 PREQUALIFIED AND TESTED SIGNING AND DELINEATION MATERIALS	125
8-1.03 STATE-FURNISHED MATERIALS	131
8-1.04 SLAG AGGREGATE	131
8-1.05 ENGINEERING FABRICS	132
SECTION 8-2. CONCRETE	132
8-2.01 PORTLAND CEMENT CONCRETE	132
8-2.02 CEMENT AND AIR CONTENT	134
8-2.03 PRECAST CONCRETE QUALITY CONTROL	134
GENERAL	134
PRECAST CONCRETE QUALIFICATION AUDIT	134
PRECAST CONCRETE QUALITY CONTROL PLAN	135
REPORTING	135
PAYMENT	136
SECTION 8-3. WELDING	136
8-3.01 WELDING	136
GENERAL	136
WELDING QUALITY CONTROL	139
WELDING FOR OVERHEAD SIGN AND POLE STRUCTURES	140
PAYMENT	141
SECTION 9. DESCRIPTION OF BRIDGE WORK	141
SECTION 10. CONSTRUCTION DETAILS	142
SECTION 10-1. GENERAL	142
10-1.00 CONSTRUCTION PROJECT INFORMATION SIGNS	142
10-1.01 ORDER OF WORK	142
10-1.02 WATER POLLUTION CONTROL	145
RETENTION OF FUNDS	146
STORM WATER POLLUTION PREVENTION PLAN PREPARATION, APPROVAL AND AMENDMENTS	146
COST BREAK-DOWN	148
SWPPP IMPLEMENTATION	151
MAINTENANCE	152
REPORTING REQUIREMENTS	152
WATER POLLUTION CONTROL TRAINING	153
SAMPLING AND ANALYTICAL REQUIREMENTS	153
PAYMENT	155
10-1.03 TEMPORARY EROSION CONTROL (TYPE 1) AND (TYPE 3)	156
MATERIALS	156
APPLICATION	157
MAINTENANCE	158
MEASUREMENT AND PAYMENT	158
10-1.04 STREET SWEEPING	159
MEASUREMENT AND PAYMENT	159
10-1.05 TEMPORARY EROSION CONTROL (TYPE 2) AND (TYPE 4)	159
10-1.06 TEMPORARY CULVERTS	162
10-1.07 TEMPORARY CONCRETE WASHOUT FACILITY	162
10-1.08 TEMPORARY CHECK DAM	164
10-1.09 TEMPORARY FENCE (TYPE ESA)	166
10-1.10 PRESERVATION OF PROPERTY	167

10-1.11	TEMPORARY CONSTRUCTION ENTRANCE	167
10-1.12	MOVE-IN/MOVE-OUT (TEMPORARY EROSION CONTROL)	169
10-1.13	TEMPORARY DRAINAGE INLET PROTECTION	170
	MATERIALS	170
	INSTALLATION	171
	REMOVAL	171
	MAINTENANCE	171
	MEASUREMENT	171
	PAYMENT	171
10-1.14	COOPERATION	172
10-1.15	PROGRESS SCHEDULE (CRITICAL PATH METHOD)	172
	DEFINITIONS	172
	GENERAL REQUIREMENTS	173
	EQUIPMENT AND SOFTWARE	174
	NETWORK DIAGRAMS, REPORTS AND DATA	175
	PRE-CONSTRUCTION SCHEDULING CONFERENCE	176
	BASELINE SCHEDULE	176
	UPDATE SCHEDULE	177
	DESIGN SEQUENCING	177
	TIME IMPACT ANALYSIS	177
	FINAL UPDATE SCHEDULE	178
	RETENTION	178
	PAYMENT	178
10-1.16	TIME-RELATED OVERHEAD	179
10-1.17	OBSTRUCTIONS	181
10-1.18	MOBILIZATION	182
10-1.19	CONSTRUCTION AREA TRAFFIC CONTROL DEVICES	182
10-1.20	CONSTRUCTION AREA SIGNS	183
10-1.21	MAINTAINING TRAFFIC	183
10-1.22	CLOSURE REQUIREMENTS AND CONDITIONS	199
	CLOSURE SCHEDULE	199
	CONTINGENCY PLAN	200
	LATE REOPENING OF CLOSURES	200
	COMPENSATION	200
10-1.23	TRAFFIC CONTROL SYSTEM FOR LANE CLOSURE	200
	STATIONARY LANE CLOSURE	201
	MOVING LANE CLOSURE	201
	PAYMENT	202
10-1.24	TEMPORARY PAVEMENT DELINEATION	202
	GENERAL	202
	TEMPORARY LANELINE AND CENTERLINE DELINEATION	202
	TEMPORARY EDGELINE DELINEATION	203
10-1.25	PORTABLE CHANGEABLE MESSAGE SIGN	203
10-1.26	TEMPORARY RAILING	203
10-1.27	TRAFFIC PLASTIC DRUMS	203
10-1.28	TEMPORARY CRASH CUSHION MODULE	204
10-1.29	EXISTING HIGHWAY FACILITIES	205
	ABANDON CULVERT	206
	ABANDON INLET	206
	ABANDON IRRIGATION CROSSOVER	206
	REMOVE DOUBLE THRIE BEAM BARRIER	207
	REMOVE METAL BEAM GUARD RAILING	207
	REMOVE CHAIN LINK FENCE	207
10-1.30	MAINTAIN TEMPORARY FENCE (TYPE ESA)	207
	MATERIALS	207
	INSTALLATION	208
	MAINTENANCE	208
	MEASUREMENT AND PAYMENT	208
	REMOVE METAL BEAM GUARD RAILING	208

REMOVE SIGN STRUCTURE.....	208
REMOVE PAVEMENT MARKER	209
REMOVE TRAFFIC STRIPE AND PAVEMENT MARKING	209
REMOVE DRAINAGE FACILITY	210
REMOVE ROADSIDE SIGN.....	210
RESET ROADSIDE SIGN	210
RELOCATE ROADSIDE SIGN.....	210
COLD PLANE ASPHALT CONCRETE PAVEMENT.....	210
CAP DRAINAGE FACILITY	211
BRIDGE REMOVAL	211
REMOVE CONCRETE.....	213
SALVAGE CRASH CUSHION (REACT 9SCBS).....	213
10-1.31 CLEARING AND GRUBBING	213
10-1.32 WATERING.....	213
10-1.33 EARTHWORK	213
TIEBACK WALL EARTHWORK.....	216
MEASUREMENT AND PAYMENT.....	218
10-1.34 EARTH RETAINING STRUCTURES.....	218
WORKING DRAWINGS	219
MATERIALS	220
CONSTRUCTION.....	223
MEASUREMENT AND PAYMENT.....	225
10-1.35 CONTROLLED LOW STRENGTH MATERIAL.....	225
10-1.36 DUFF.....	226
10-1.37 MOVE-IN/MOVE-OUT (EROSION CONTROL).....	226
10-1.38 EROSION CONTROL (TYPE 1 , TYPE 2 AND TYPE 3).....	227
MATERIALS	227
APPLICATION.....	229
MEASUREMENT AND PAYMENT.....	231
10-1.39 FIBER ROLLS.....	231
MATERIALS	231
INSTALLATION.....	232
MEASUREMENT AND PAYMENT.....	232
10-1.40 IRRIGATION CROSSOVERS.....	233
10-1.41 EXTEND IRRIGATION CROSSOVERS	233
10-1.42 IMPORTED TOPSOIL	234
10-1.43 FINISHING ROADWAY	234
10-1.44 AGGREGATE BASE	234
10-1.45 ASPHALT CONCRETE.....	234
10-1.46 JOINTED PLAIN CONCRETE PAVEMENT	237
10-1.47 CONCRETE PAVEMENT (RAPID STRENGTH CONCRETE).....	249
10-1.48 REPAIR SPALLED JOINTS.....	259
MATERIALS	259
SPALL REPAIR PROCEDURE.....	260
MEASUREMENT AND PAYMENT.....	261
10-1.49 GRIND EXISTING CONCRETE PAVEMENT	261
10-1.50 PILING.....	262
GENERAL.....	262
CAST-IN-DRILLED-HOLE CONCRETE PILES	262
10-1.51 TIEBACK ANCHORS.....	272
MATERIALS	272
CONSTRUCTION.....	273
MEASUREMENT AND PAYMENT.....	276
10-1.52 CONCRETE STRUCTURES	276
FALSEWORK.....	276
ELASTOMERIC BEARING PADS	277
DECK CRACK TREATMENT	277
MEASUREMENT AND PAYMENT.....	279
10-1.53 STRUCTURE APPROACH SLABS (TYPE N).....	279

GENERAL	279
STRUCTURE APPROACH DRAINAGE SYSTEM	279
ENGINEERING FABRICS	280
TREATED PERMEABLE BASE UNDER APPROACH SLAB	280
APPROACH SLABS	281
JOINTS	282
MEASUREMENT AND PAYMENT	282
10-1.54 DRILL AND BOND DOWELS	282
10-1.55 SEALING JOINTS	282
10-1.56 REFINISHING BRIDGE DECKS	282
PORTLAND CEMENT CONCRETE	283
RAPID SETTING CONCRETE	283
FINISHING REQUIREMENTS	284
MEASUREMENT AND PAYMENT	284
10-1.57 ARCHITECTURAL SURFACE (TEXTURED CONCRETE)	284
REFEREE SAMPLE	285
TEST PANEL	285
FORM LINERS	285
RELEASING FORM LINERS	286
ABRASIVE BLASTING	286
CURING	286
MEASUREMENT AND PAYMENT	286
10-1.58 REINFORCEMENT	286
MEASUREMENT AND PAYMENT	287
10-1.59 SHOTCRETE	287
PRECONSTRUCTION REQUIREMENTS	287
PLACING	288
TESTING AND ACCEPTANCE	288
MEASUREMENT AND PAYMENT	289
10-1.60 STEEL STRUCTURES	289
MATERIALS	289
ROTATIONAL CAPACITY TESTING PRIOR TO SHIPMENT TO JOB SITE	289
INSTALLATION TENSION TESTING AND ROTATIONAL CAPACITY TESTING AFTER ARRIVAL ON THE JOB SITE	294
SEALING	294
WELDING	294
MEASUREMENT AND PAYMENT	295
10-1.61 SIGN STRUCTURES	295
10-1.62 ROADSIDE SIGNS	296
10-1.63 INSTALL ROADSIDE SIGN PANEL ON EXISTING POST	296
10-1.64 SIGN PANELS	297
10-1.65 FURNISH SIGN	297
SHEET ALUMINUM	297
RETROREFLECTIVE SHEETING	298
PROCESS COLOR AND FILM	298
SINGLE SHEET ALUMINUM SIGN	298
FIBERGLASS REINFORCED PLASTIC PANEL SIGN	298
10-1.66 ROCK STAINING	299
10-1.67 REINFORCED CONCRETE PIPE	299
10-1.68 CORRUGATED METAL PIPE	300
10-1.69 OVERSIDE DRAIN	300
10-1.70 MISCELLANEOUS FACILITIES	300
10-1.71 GRATED LINE DRAIN	300
10-1.72 SLOPE PROTECTION	301
10-1.73 SLOPE PAVING	301
10-1.74 MINOR CONCRETE (GUTTER)	301
10-1.75 MISCELLANEOUS CONCRETE CONSTRUCTION	301
MINOR CONCRETE (TEXTURED PAVING) (GORE PAVING)	302
TEST PANEL	302

10-1.76	MISCELLANEOUS IRON AND STEEL	303
10-1.77	MISCELLANEOUS METAL (BRIDGE).....	303
10-1.78	CHAIN LINK FENCE	303
10-1.79	MARKERS AND DELINEATORS.....	303
10-1.80	METAL BEAM GUARD RAILING	303
	ALTERNATIVE IN-LINE TERMINAL SYSTEM.....	304
	ALTERNATIVE FLARED TERMINAL SYSTEM.....	304
10-1.81	CHAIN LINK RAILING	305
10-1.82	PERFORATED STEEL SCREEN	305
10-1.83	METAL BRIDGE RAILING	305
10-1.84	CABLE RAILING	305
10-1.85	CONCRETE BARRIER.....	306
10-1.86	TRANSITION RAILING (TYPE WB).....	306
10-1.87	CRASH CUSHION (REACT).....	306
10-1.88	CRASH CUSHION, SAND FILLED	307
10-1.89	THERMOPLASTIC TRAFFIC STRIPE AND PAVEMENT MARKING	308
10-1.90	PAINT TRAFFIC STRIPE AND PAVEMENT MARKING	308
10-1.91	PAVEMENT MARKERS	309
SECTION 10-2	HIGHWAY PLANTING AND IRRIGATION SYSTEMS	309
10-2.01	GENERAL	309
	COST BREAK-DOWN	309
10-2.02	EXISTING HIGHWAY PLANTING	314
	MAINTAIN EXISTING PLANTED AREAS	314
10-2.03	EXISTING HIGHWAY IRRIGATION FACILITIES.....	314
	LOCATE EXISTING CROSSOVERS AND CONDUITS.....	314
	CHECK AND TEST EXISTING IRRIGATION FACILITIES.....	314
	REMOVE EXISTING IRRIGATION FACILITIES	314
10-2.04	HIGHWAY PLANTING	315
	HIGHWAY PLANTING MATERIALS.....	315
	ROADSIDE CLEARING.....	315
	PESTICIDES.....	316
	CULTIVATE.....	317
	LINER PLANTS	317
	PLANT ESTABLISHMENT WORK	317
10-2.05	IRRIGATION SYSTEMS.....	317
	VALVE BOXES	318
	GATE VALVES.....	318
	ELECTRIC AUTOMATIC IRRIGATION COMPONENTS	318
	IRRIGATION CONTROLLER ENCLOSURE CABINET	320
	IRRIGATION SYSTEMS FUNCTIONAL TEST	320
	PIPE.....	320
	BACKFLOW PREVENTER ASSEMBLIES	321
	BACKFLOW PREVENTER ASSEMBLY ENCLOSURE	321
	TESTING NEW BACKFLOW PREVENTERS.....	322
	SPRINKLERS.....	322
	HOSE EXPANSION ASSEMBLY.....	322
	FINAL IRRIGATION SYSTEM CHECK.....	322
SECTION 10-3.	SIGNALS, LIGHTING AND ELECTRICAL SYSTEMS.....	322
10-3.01	DESCRIPTION	322
10-3.02	COST BREAK-DOWN	323
10-3.03	MAINTAINING EXISTING AND TEMPORARY ELECTRICAL SYSTEMS	332
10-3.04	FOUNDATIONS	332
10-3.05	STANDARDS, STEEL PEDESTALS AND POSTS	332
10-3.06	LIGHTING (CITY STREET)	332
10-3.07	CONDUIT.....	333
10-3.08	MULTIDUCT CONDUIT SYSTEM.....	333
10-3.09	HIGH DENSITY POLYETHYLENE CONDUIT	334
	GENERAL	334
	MATERIAL	334

CONDUIT	334
JOINING OF CONDUIT	335
INSTALLATION	335
CERTIFICATES OF COMPLIANCE, MATERIALS RECEIVING INSPECTION AND MANUFACTURER'S DATA	336
10-3.10 AIR BLOWN METHOD	336
10-3.11 SEALING PLUG	337
10-3.12 TRACER WIRE	337
10-3.13 WARNING TAPE	337
10-3.14 SLURRY CEMENT BACKFILL	337
10-3.15 DIRECTIONAL BORING METHOD	337
10-3.16 PULL BOXES	338
10-3.17 FIBER OPTIC VAULT	338
10-3.18 CONDUCTORS AND WIRING	338
SIGNAL INTERCONNECT CABLE	338
OPTICAL DETECTOR CABLE	338
CATEGORY 5E CABLE	339
10-3.19 CLOSED CIRCUIT TELEVISION CAMERA CABLE ASSEMBLY	339
10-3.20 FIBER OPTIC COMMUNICATION CABLE PLANT	341
FIBER OPTICS GLOSSARY	341
FIBER OPTIC OUTSIDE PLANT CABLE	342
FIBER CHARACTERISTICS	343
10-3.21 FIBER OPTIC LABELING	346
10-3.22 FIBER OPTIC CABLE INSTALLATION	347
10-3.23 SPLICING	347
10-3.24 FIBER OPTIC SPLICE CLOSURE	347
10-3.25 SPLICE TRAY	348
10-3.26 PASSIVE CABLE ASSEMBLIES AND COMPONENTS	348
10-3.27 FIBER OPTIC TESTING	348
10-3.28 BONDING AND GROUNDING	352
10-3.29 SERVICE	352
ELECTRIC SERVICE (IRRIGATION)	352
10-3.30 NUMBERING ELECTRICAL EQUIPMENT	352
10-3.31 STATE-FURNISHED CONTROLLER ASSEMBLIES	353
10-3.32 VEHICLE SIGNAL FACES AND SIGNAL HEADS	353
10-3.33 BATTERY BACKUP SYSTEM	353
DESCRIPTION	353
MATERIAL	353
MOUNTING AND CONFIGURATION	354
MEASUREMENT AND PAYMENT	354
10-3.34 LIGHT EMITTING DIODE SIGNAL MODULE	354
GENERAL	354
PHYSICAL AND MECHANICAL REQUIREMENTS	355
PHOTOMETRIC REQUIREMENTS	356
ELECTRICAL	357
QUALITY ASSURANCE PROGRAM	358
CERTIFICATE OF COMPLIANCE	358
QUALITY ASSURANCE TESTING	359
WARRANTY	359
10-3.35 LIGHT EMITTING DIODE PEDESTRIAN SIGNAL FACE MODULES	359
GENERAL	359
ELECTRICAL	360
QUALITY ASSURANCE PROGRAM	361
CERTIFICATE OF COMPLIANCE	361
QUALITY ASSURANCE TESTING	361
WARRANTY	361
10-3.36 ILLUMINATED PAVEMENT MARKER SYSTEM	362
GENERAL	362
ILLUMINATED PAVEMENT MARKER	362

IPM CONTROLLER ASSEMBLY	362
BACK-UP POWER SYSTEM.....	362
INSTALLATION	363
TESTING AND DOCUMENTATION.....	363
CERTIFICATE OF COMPLIANCE.....	363
WARRANTY	363
MEASUREMENT AND PAYMENT	363
10-3.37 AUTOMATIC TRAFFIC CHANNELIZER SYSTEM	363
MATERIALS	363
INSTALLATION	364
TESTING	365
CERTIFICATE OF COMPLIANCE.....	365
WARRANTY	365
MEASUREMENT AND PAYMENT	365
10-3.38 CLOSED CIRCUIT TELEVISION CAMERA ASSEMBLY	365
GENERAL	365
CAMERA.....	366
CLOSED CIRCUIT TELEVISION CAMERA LENS	366
ENVIRONMENTAL ENCLOSURE	367
PAN AND TILT UNIT	368
OVERALL REQUIREMENTS.....	369
CERTIFICATE OF COMPLIANCE.....	371
10-3.39 VARIABLE MESSAGE SIGN.....	371
10-3.40 MEDIA CONVERTER.....	371
10-3.41 SERIAL TO ETHERNET CONVERSION UNIT	372
10-3.42 CUSTOMER PREMISES EQUIPMENT	373
10-3.43 VERY HIGH SPEED DIGITAL SUBSCRIBER LINE SWITCH	374
10-3.44 CERTIFICATE OF COMPLIANCE	375
10-3.45 TESTING	375
10-3.46 VIDEO ENCODER.....	376
10-3.47 GUIDE WIRE SYSTEM.....	376
10-3.48 STATE-FURNISHED MOVABLE BARRIER	376
10-3.49 DETECTORS.....	376
10-3.50 VIDEO IMAGE VEHICLE DETECTION SYSTEM.....	377
MATERIALS LIST AND DRAWINGS.....	377
FUNCTIONAL REQUIREMENTS.....	377
TECHNICAL REQUIREMENTS.....	378
CONSTRUCTION AND TESTING	379
WARRANTY	380
TRAINING.....	381
10-3.51 LUMINAIRES	381
10-3.52 SIGN LIGHTING FIXTURES-INDUCTION	381
MATERIALS	381
10-3.53 FIBER DISTRIBUTION UNIT	382
10-3.54 PAYMENT.....	382
SECTION 11. (BLANK).....	383
SECTION 12. (BLANK).....	383
SECTION 13. (BLANK).....	383
SECTION 14 FEDERAL REQUIREMENTS FOR FEDERAL-AID CONSTRUCTION PROJECTS	384
FEDERAL REQUIREMENT TRAINING SPECIAL PROVISIONS	403

STANDARD PLANS LIST

The Standard Plan sheets applicable to this contract include, but are not limited to those indicated below. The Revised Standard Plans (RSP) and New Standard Plans (NSP) which apply to this contract are included as individual sheets of the project plans.

A10A	Acronyms and Abbreviations (A-L)
A10B	Acronyms and Abbreviations (M-Z)
A10C	Symbols (Sheet 1 of 2)
A10D	Symbols (Sheet 2 of 2)
A20A	Pavement Markers and Traffic Lines, Typical Details
A20B	Pavement Markers and Traffic Lines, Typical Details
A20C	Pavement Markers and Traffic Lines, Typical Details
A20D	Pavement Markers and Traffic Lines, Typical Details
A24A	Pavement Markings - Arrows
A24B	Pavement Markings - Arrows
A24C	Pavement Markings – Symbols and Numerals
A24D	Pavement Markings – Words
A24E	Pavement Markings – Words And Crosswalks
A62A	Excavation and Backfill – Miscellaneous Details
A62B	Limits of Payment for Excavation and Backfill – Bridge Surcharge and Wall
A62C	Limits of Payment for Excavation and Backfill - Bridge
A62D	Excavation and Backfill – Concrete Pipe Culverts
A62DA	Excavation and Backfill – Concrete Pipe Culverts
A62E	Excavation and Backfill – Cast-In-Place Reinforced Concrete Box and Arch Culverts
A62F	Excavation and Backfill – Metal And Plastic Culverts
A63A	Portable Concrete Barrier (Type 60K)
A63B	Portable Concrete Barrier (Type 60K)
A73A	Object Markers
A73B	Markers
A73C	Delineators, Channelizers and Barricades
A74	Survey Monuments
A76A	Concrete Barrier Type 60
A76B	Concrete Barrier Type 60
A76C	Concrete Barrier Type 60E
A76F	Concrete Barrier Type 60GE
A76G	Concrete Barrier Type 60S
A76H	Concrete Barrier Type 60S
A77A1	Metal Beam Guard Railing – Standard Railing Section (Wood Post With Wood Block)
A77A2	Metal Beam Guard Railing – Standard Railing Section (Steel Post With Notched Wood or Notched Plastic Block
A77B1	Metal Beam Guard Railing – Standard Hardware
A77C1	Metal Beam Guard Railing – Wood Post and Wood Block Details
A77C2	Metal Beam Guard Railing Steel Post, Notched Wood Block and Notched Plastic Block Details
A77C3	Metal Beam Guard Railing – Typical Line Post Embedment and Hinge Point Offset Details
A77C4	Metal Beam Guard Railing – Typical Railing Delineation and Dike Positioning Details
A77E1	Metal Beam Guard Railing – Typical Layouts for Embankments
A77E2	Metal Beam Guard Railing – Typical Layouts for Embankments
A77E3	Metal Beam Guard Railing – Typical Layouts for Embankments
A77E4	Metal Beam Guard Railing – Typical Layouts for Embankments
A77E5	Metal Beam Guard Railing – Typical Layouts for Embankments
A77E6	Metal Beam Guard Railing – Typical Layouts for Embankments

A77F1	Metal Beam Guard Railing – Typical Layouts for Structure Approach
A77F3	Metal Beam Guard Railing – Typical Layouts for Structure Approach
A77F4	Metal Beam Guard Railing – Typical Layouts for Structure Departure
A77F5	Metal Beam Guard Railing – Typical Layouts for Structure Departure
A77G1	Metal Beam Guard Railing – Typical Layouts for Fixed Objects Between Separate Roadbeds (Two-Way Traffic)
A77G2	Metal Beam Guard Railing – Typical Layouts for Fixed Objects Between Separate Roadbeds (One Way Traffic)
A77G3	Metal Beam Guard Railing – Typical Layouts for Roadside Fixed Objects
A77H1	Metal Railing End Anchor Assembly (Type SFT)
A77H2	Metal Railing Rail Tensioning Assembly
A77H3	Metal Railing Anchor Cable and Anchor Plate Details
A77I1	Metal Railing End Anchor Assembly (Type CA)
A77J1	Metal Beam Guard Railing Connections To Bridge Railings Without Sidewalks Details No.1
A77J2	Metal Beam Guard Railing Connections To Bridge Railings Without Sidewalks Details No2
A77J3	Metal Beam Guard Railing Connections to Abutments and Walls
A77K1	Metal Beam Guard Railing Connections to Bridge Railings with Sidewalks Details No. 1
A77K2	Metal Beam Guard Railing Connections to Bridge Railings with Sidewalks Details No. 2
A77L1	Metal Beam Railing Terminal System (Type SRT)
A77L2	Metal Beam Railing Terminal System (Type SKT)
A77L3	Metal Beam Railing Terminal System (Type ET)
A77L4	Metal Beam Railing Terminal System (Type CAT)
A78G	Thrie Beam Barrier Connections to Abutments and Walls
A81A	Crash Cushion, Sand Filled (Unidirectional)
A81B	Crash Cushion, Sand Filled (Unidirectional)
A81C	Crash Cushion, Sand Filled (Bidirectional)
A82B1	Crash Cushion (Type ADIEM)
A82D1	Crash Cushion (Type React 9SCBS)
A82D2	Crash Cushion (Type React 9SCBS) – Connection To Concrete Barrier
A82D3	Crash Cushion (Type React 9SCBS) – Alignment Offset Details
A85	Chain Link Fence
A87A	Curbs and Driveways
A87B	Asphalt Concrete Dikes
A88A	Curb Ramp Details
A88B	Curb Ramp and Island Passageway Details
P1	Jointed Plain Concrete Pavement
P2	Jointed Plain Concrete Pavement – Wide Panel Details
P5	Undoweled Jointed Plain Concrete Pavement
P10	Concrete Pavement – Dowel Bar Details
P12	Concrete Pavement – Dowel Bar Basket Details
P17	Concrete Pavement Tie Bar Basket Details
P18	Concrete Pavement – Lane Schematics and Isolation Joint Detail
P20	Concrete Pavement – Joint Details
P30	Concrete Pavement – End Panel Pavement Transitions
P35	Concrete Pavement – Ramp Gore Area Paving Details
P45	Concrete Pavement Drainage Inlet Details No. 1
P46	Concrete Pavement Drainage Inlet Details No. 2
P70	Asphalt Concrete Paving (Longitudinal Tapered Notched Wedge Joint)
D72	Drainage Inlets
D73	Drainage Inlets
D74A	Drainage Inlets
D74B	Drainage Inlets
D74C	Drainage Inlets Details
D75A	Pipe Inlets

D75B	Pipe Inlets
D75C	Pipe Inlets
D77A	Grate Details
D77B	Bicycle Proof Grate Details
D78B	Inlet Depressions – Portland Cement Concrete Shoulders
RSP D78C	Inlet Depressions – Asphalt Concrete Shoulders
D79	Precast Reinforced Concrete Pipe – Direct Design Method
D80	Cast-In-Place Reinforced Concrete Single Box Culvert
D82	Cast-In-Place Reinforced Concrete Box Culvert Miscellaneous Details
D84	Box Culvert Wingwalls-Types A, B and C
D85	Box Culvert Wingwalls-Type D and E
D86B	Pipe Culvert Headwalls, Endwalls and Warped Wingwalls
D87A	Corrugated Metal Pipe Downdrain Details
D87D	Overside Drains
D88	Construction Loads On Culverts
D89	Pipe Headwalls
D90	Pipe Culvert Headwalls, Endwalls and Wingwalls-Type A, B And C
D93A	Pipe Riser Connections
D93B	Drainage Inlet Riser Connections
D94B	Concrete Flared End Sections
D97A	Corrugated Metal Pipe Coupling Details No. 1- Annular Coupling Band Bar And Strap and Angle Connections
D97B	Corrugated Metal Pipe Coupling Details No. 2- Hat Band Coupler and Flange Details
D97C	Corrugated Metal Pipe Coupling Details No. 3- Helical and Universal Couplers
D97D	Corrugated Metal Pipe Coupling Details No. 4- Hugger Coupling Bands
D97E	Corrugated Metal Pipe Coupling Details No. 5- Standard Joint
D97F	Corrugated Metal Pipe Coupling Details No. 6- Positive Joint
D97G	Corrugated Metal Pipe Coupling Details No. 7- Positive Joints and Downdrain
D97H	Reinforced Concrete Pipe or Non-Reinforced Concrete Pipe-Standard and Positive Joints
D98C	Grated Line Drain Details
D102	Underdrains
H1	Planting and Irrigation – Abbreviations
H2	Planting and Irrigation – Symbols
H3	Planting and Irrigation Details
H4	Planting and Irrigation Details
H5	Planting and Irrigation Details
H6	Planting and Irrigation Details
H7	Planting and Irrigation Details
H8	Planting and Irrigation Details
H9	Planting and Irrigation Details
H10	Irrigation Controller Enclosure Cabinet
T1A	Temporary Crash Cushion, Sand Filled (Unidirectional)
T1B	Temporary Crash Cushion, Sand Filled (Bidirectional)
T2	Temporary Crash Cushion, Sand Filled (Shoulder Installations)
T3	Temporary Railing (Type K)
RSP T7	Construction Project Funding Identification Signs
RSP T10	Traffic Control System for Lane Closure On Freeways and Expressways
RSP T10A	Traffic Control System for Lane and Complete Closures On Freeways and Expressways
RSP T11	Traffic Control System for Lane Closure On Multilane Conventional Highways
RSP T12	Traffic Control System for Lane Closure On Multilane Conventional Highways
RSP T13	Traffic Control System for Lane Closure On Two lane Conventional Highways
RSP T14	Traffic Control System for Ramp Closure
T51	Temporary Water Pollution Control Details (Temporary Silt Fence)
T52	Temporary Water Pollution Control Details (Temporary Straw Bale Barrier)
T53	Temporary Water Pollution Control Details (Temporary Cover)
T54	Temporary Water Pollution Control Details (Temporary Erosion Control Blanket)

T55	Temporary Water Pollution Control Details (Temporary Erosion Control Blanket)
T56	Temporary Water Pollution Control Details (Temporary Fiber Roll)
T57	Temporary Water Pollution Control Details (Temporary Check Dam)
T58	Temporary Water Pollution Control Details (Temporary Construction Entrance)
T59	Temporary Water Pollution Control Details (Temporary Concrete Washout Facility)
B0-1	Bridge Details
B0-3	Bridge Details
B0-5	Bridge Details
B0-13	Bridge Details
B3-1	Retaining Wall Type 1 – H=1200 Through 9100 mm
B3-8	Retaining Wall Details No. 1
B3-9	Retaining Wall Details No. 2
B11-47	Cable Railing
B11-52	Chain Link Railing Type 7
B11-54	Concrete Barrier Type 26
B11-55	Concrete Barrier Type 732
B14-3	Communication and Sprinkler Control Conduits (Conduit Less Than Size 103)
RS1	Roadside Signs, Typical Installation Details No. 1
RS2	Roadside Signs - Wood Post, Typical Installation Details No. 2
RS3	Roadside Signs - Laminated Wood Box Post Typical Installation Details No. 3
RS4	Roadside Signs, Typical Installation Details No. 4
RSP S1	Overhead Signs – Truss, Instructions And Examples
RSP S6	Overhead Signs – Truss, Gusset Plate Details
RSP S9	Overhead Signs – Truss, Two Post Type – Post Types I-S Thru VII-S
RSP S10	Overhead Signs – Truss, Two Post Type – Base Plate and Anchorage Details
RSP S11	Overhead Signs – Truss, Two Post Type – Structural Frame Members
RSP S12	Overhead Signs – Truss, Structural Frame Details
RSP S13	Overhead Signs – Truss, Frame Juncture Details
RSP S14	Overhead Signs – Truss, Two Post Type – Square Pedestal Foundation
RSP S16	Overhead Signs – Walkway Details No. 1
RSP S17	Overhead Signs – Walkway Details No. 2
NSP S17A	Overhead Signs – Walkway Details No. 3
RSP S18	Overhead Signs – Walkway Safety Railing Details
RSP S30	Overhead Signs – Tubular, Instructions and Examples
RSP S31	Overhead Signs – Tubular, Single Post Type – Layout and Pipe Selection
RSP S32	Overhead Signs – Tubular, Two Post Type – Layout and Pipe Selection
RSP S33	Overhead Signs – Tubular, Structural Frame – Details No. 1
RSP S34	Overhead Signs – Tubular, Structural Frame – Details No. 2
RSP S35	Overhead Signs – Tubular, Single and Two Post Type – Base Plate and Anchorage Details
RSP S36	Overhead Signs – Tubular, Single Post and Two Post Type – Square Pedestal Pile Foundation
S81	Overhead Laminated Sign – Single or Multiple Panel, Type A (25.4 mm Thick)
RSP S87	Type A –1 Mounting Hardware – Overhead Laminated Type A Panel, Truss and Lightweight Sign Structures
S88	Type A – 2 Mounting Hardware – Overhead Laminated Type A Panel, Box Beam Closed Truss, Bridge Mounted and Tubular Sign Structures
S93	Framing Details for Framed Single Sheet Aluminum Signs, Rectangular Shape
S94	Roadside Single Sheet Aluminum Sign, Rectangular Shape
S95	Roadside Single Sheet Aluminum Sign, Diamond Shape
ES-1A	Electrical Systems (Symbols And Abbreviations)
ES-1B	Electrical Systems (Symbols And Abbreviations)
ES-1C	Electrical Systems (Symbols And Abbreviations)
ES-2C	Electrical Systems (Service Equipment Notes, Type III Series)
ES-2E	Electrical Systems (Service Equipment and Typical Wiring Diagram, Type III – B Series)
ES-3C	Electrical Systems (Controller Cabinet Details)
ES-3H	Electrical Systems (Irrigation Controller Enclosure Cabinet)

ES-4A	Electrical Systems (Signal Heads And Mountings)
ES-4B	Electrical Systems (Signal Heads And Mountings)
ES-4C	Electrical Systems (Signal Heads And Mountings)
ES-4D	Electrical Systems (Signal Heads And Mountings)
ES-4E	Electrical Systems (Signal Faces And Mountings)
ES-5A	Electrical Systems (Detectors)
ES-5B	Electrical Systems (Detectors)
ES-5C	Electrical Systems (Detectors)
ES-5D	Electrical Systems (Detectors)
ES-6A	Electrical Systems (Lighting Standards Types 15 and 21)
ES-6B	Electrical Systems (Lighting Standards Types 15 and 21, Barrier Rail Mounted Details)
ES-6C	Electrical Systems (Lighting Standards Type 15, Slip Base Insert)
ES-6D	Electrical Systems (Lighting Standards Type S 15D and 21D, Double Arm)
ES-6H	Electrical Systems (Lighting Standards Types 35 and 36-20A, 10 Degree Type)
ES-6I	Electrical Systems (Lighting Standards Types 35 and 36-20A, 10 Degree Type Details)
ES-7B	Electrical Systems (Signal And Lighting Standards – Type 1 Standards and Equipment Numbering)
RSP ES-7F	Electrical Systems (Signal and Lighting Standards – Case 4 Arm Loading, Wind Velocity = 161 km/h, Arm Lengths 7.6 m to 13.7 m)
RSP ES-7M	Electrical Systems (Signal and Lighting Standards – Details No. 1)
ES-7N	Electrical Systems (Signal and Lighting Standards – Details No. 2)
ES-8	Electrical Systems (Pull Box Details)
ES-9A	Electrical Systems (Electrical Details, Structure Installations)
ES-9B	Electrical Systems (Electrical Details, Structure Installations)
ES-9C	Electrical Systems (Electrical Details, Structure Installations)
ES-9D	Electrical Systems (Electrical Details, Structure Installations)
ES-10	Electrical Systems (Isolux Diagrams)
ES-11	Electrical Systems (Foundation Installations)
ES-13A	Electrical Systems (Splicing Details)
ES-13B	Electrical Systems (Wiring Details and Fuse Ratings)
ES-15A	Electrical Systems (Sign Illumination Equipment)
ES-15C	Electrical Systems (Sign Illumination Equipment)
RSP ES-15D	Electrical Systems (Lighting and Sign Illumination Control)
RSP ES-16A	Electrical Systems (Closed Circuit Television Pole Details)

DEPARTMENT OF TRANSPORTATION

NOTICE TO CONTRACTORS

CONTRACT NO. 11-080944

11-SD-15-M30.0/M44.6

Sealed proposals for the work shown on the plans entitled:

STATE OF CALIFORNIA; DEPARTMENT OF TRANSPORTATION; PROJECT PLANS FOR CONSTRUCTION ON STATE HIGHWAY IN SAN DIEGO COUNTY IN SAN DIEGO AND ESCONDIDO FROM 0.7 KM NORTH OF POWAY ROAD OVERCROSSING TO 0.1 KM SOUTH OF CLARENCE LANE UNDERCROSSING

will be received at the Department of Transportation, 3347 Michelson Drive, Suite 100, Irvine, CA 92612-1692, until 2 o'clock p.m. on April 13, 2006, at which time they will be publicly opened and read in Room C - 1116 at the same address.

Proposal forms for this work are included in a separate book entitled:

STATE OF CALIFORNIA; DEPARTMENT OF TRANSPORTATION; PROPOSAL AND CONTRACT FOR CONSTRUCTION ON STATE HIGHWAY IN SAN DIEGO COUNTY IN SAN DIEGO AND ESCONDIDO FROM 0.7 KM NORTH OF POWAY ROAD OVERCROSSING TO 0.1 KM SOUTH OF CLARENCE LANE UNDERCROSSING

General work description: Construct additional lanes, movable barriers, and replace bridges

This project has a goal of 12 percent disadvantaged business enterprise (DBE) participation. No prebid meeting is scheduled for this project.

THIS PROJECT IS SUBJECT TO THE "BUY AMERICA" PROVISIONS OF THE SURFACE TRANSPORTATION ASSISTANCE ACT OF 1982 AS AMENDED BY THE INTERMODAL SURFACE TRANSPORTATION EFFICIENCY ACT OF 1991.

Bids are required for the entire work described herein.

At the time this contract is awarded, the Contractor shall possess either a Class A license or a combination of Class C licenses which constitutes a majority of the work.

This contract is subject to state contract nondiscrimination and compliance requirements pursuant to Government Code, Section 12990.

Inquiries or questions based on alleged patent ambiguity of the plans, specifications or estimate must be communicated as a bidder inquiry prior to bid opening. Any such inquiries or questions, submitted after bid opening, will not be treated as a bid protest.

Bidder inquiries may be made as follows:

The Department will consider bidder inquiries only when a completed "Bidder Inquiry" form is submitted. A copy of the "Bidder Inquiry" form is available at the Internet address shown below. The bidder inquiry shall include the bidder's name and telephone number. Submit "Bidder Inquiry" forms to :

District 11 Construction Duty Senior
Location address: 2829 Juan Street, San Diego, CA 92110
Mailing address: P.O. Box 85406, San Diego, CA 92186-5406

Fax Number: (619) 688-6988
E-mail: Duty_Senior_Const_District11@dot.ca.gov
Tel. Number: (619) 688-6635

Contract No. 11-080944

To expedite processing, submittal of "Bidder Inquiry" forms via Fax or E-mail is preferred.

To the extent feasible and at the discretion of the Department, completed "Bidder Inquiry" forms submitted for consideration will be investigated, and responses will be posted on the Internet at:

<http://www.dot.ca.gov/dist11/construc/>

The responses to bidders' inquiries, unless incorporated into formal addenda to the contract, are not a part of the contract, and are provided for the bidder's convenience only. In some instances, the question and answer may represent a summary of the matters discussed rather than a word-for-word recitation. The availability or use of information provided in the responses to bidders' inquiries is not to be construed in any way as a waiver of the provisions of Section 2-1.03 of the Standard Specifications or any other provision of the contract, the plans, Standard Specifications or Special Provisions, nor to excuse the contractor from full compliance with those contract requirements. Bidders are cautioned that subsequent responses or contract addenda may affect or vary a response previously given.

Project plans, special provisions, and proposal forms for bidding this project can only be obtained at the Department of Transportation, Plans and Bid Documents, Room 0200, MS #26, Transportation Building, 1120 N Street, Sacramento, California 95814, FAX No. (916) 654-7028, Telephone No. (916) 654-4490. Use FAX orders to expedite orders for project plans, special provisions and proposal forms. FAX orders must include credit card charge number, card expiration date and authorizing signature. Project plans, special provisions, and proposal forms may be seen at the above Department of Transportation office and at the offices of the District Directors of Transportation at Irvine, Oakland, and the district in which the work is situated. Standard Specifications and Standard Plans are available through the State of California, Department of Transportation, Publications Unit, 1900 Royal Oaks Drive, Sacramento, CA 95815, Telephone No. (916) 445-3520.

The successful bidder shall furnish a payment bond and a performance bond.

The Department of Transportation hereby notifies all bidders that it will affirmatively ensure that in any contract entered into pursuant to this advertisement, disadvantaged business enterprises will be afforded full opportunity to submit bids in response to this invitation.

The U.S. Department of Transportation (DOT) provides a toll-free "hotline" service to report bid rigging activities. Bid rigging activities can be reported Mondays through Fridays, between 8:00 a.m. and 5:00 p.m., eastern time, Telephone No. 1-800-424-9071. Anyone with knowledge of possible bid rigging, bidder collusion, or other fraudulent activities should use the "hotline" to report these activities. The "hotline" is part of the DOT's continuing effort to identify and investigate highway construction contract fraud and abuse and is operated under the direction of the DOT Inspector General. All information will be treated confidentially and caller anonymity will be respected.

Pursuant to Section 1773 of the Labor Code, the general prevailing wage rates in the county, or counties, in which the work is to be done have been determined by the Director of the California Department of Industrial Relations. These wages are set forth in the General Prevailing Wage Rates for this project, available at the Labor Compliance Office at the offices of the District Director of Transportation for the district in which the work is situated, and available from the California Department of Industrial Relations' internet web site at: <http://www.dir.ca.gov>. The Federal minimum wage rates for this project as predetermined by the United States Secretary of Labor are available on the internet at <http://www.dot.ca.gov/hq/esc/oe/federal-wages/>. Addenda to modify the Federal minimum wage rates, if necessary, will be issued to holders of "Proposal and Contract" books. Future effective general prevailing wage rates which have been predetermined and are on file with the California Department of Industrial Relations are referenced but not printed in the general prevailing wage rates.

If there is a difference between the minimum wage rates predetermined by the United States Secretary of Labor and the general prevailing wage rates determined by the Director of the California Department of Industrial Relations for similar classifications of labor, the Contractor and subcontractors shall pay not less than the higher wage rate. The Department will not accept lower State wage rates not specifically included in the Federal minimum wage determinations. This includes "helper" (or other classifications based on hours of experience) or any other classification not appearing in the Federal wage determinations. Where Federal wage determinations do not contain the State wage rate determination otherwise available for use by the Contractor and subcontractors, the Contractor and subcontractors shall pay not less than the Federal minimum wage rate which most closely approximates the duties of the employees in question.

DEPARTMENT OF TRANSPORTATION

Deputy Director Transportation Engineering

Dated February 14, 2006

KM

**COPY OF ENGINEER'S ESTIMATE
(NOT TO BE USED FOR BIDDING PURPOSES)**

11-080944

Item No.	Item Code	Item Description	Unit of Measure	Estimated Quantity
1	070012	PROGRESS SCHEDULE (CRITICAL PATH METHOD)	LS	LUMP SUM
2	070018	TIME-RELATED OVERHEAD	WDAY	540
3	071325	TEMPORARY FENCE (TYPE ESA)	M	535
4	073000	TEMPORARY CULVERT	M	30
5 (S)	038412	TEMPORARY EROSION CONTROL (TYPE 1)	M2	19 600
6 (S)	038413	TEMPORARY EROSION CONTROL (TYPE 2)	M2	38 700
7 (S)	038414	TEMPORARY EROSION CONTROL (TYPE 3)	M2	19 600
8 (S)	038414	TEMPORARY EROSION CONTROL (TYPE 4)	M2	38 700
9	074019	PREPARE STORM WATER POLLUTION PREVENTION PLAN	LS	LUMP SUM
10	074020	WATER POLLUTION CONTROL	LS	LUMP SUM
11	074032	TEMPORARY CONCRETE WASHOUT FACILITY	EA	20
12	074033	TEMPORARY CONSTRUCTION ENTRANCE	EA	22
13	074035	TEMPORARY CHECK DAM	M	6000
14 (S)	074037	MOVE-IN/MOVE-OUT (TEMPORARY EROSION CONTROL)	EA	10
15	074038	TEMPORARY DRAINAGE INLET PROTECTION	EA	320
16 (S)	074041	STREET SWEEPING	LS	LUMP SUM
17 (S)	120090	CONSTRUCTION AREA SIGNS	LS	LUMP SUM
18 (S)	120100	TRAFFIC CONTROL SYSTEM	LS	LUMP SUM
19 (S)	128650	PORTABLE CHANGEABLE MESSAGE SIGN	EA	12
20 (S)	129000	TEMPORARY RAILING (TYPE K)	M	19 500

Item No.	Item Code	Item Description	Unit of Measure	Estimated Quantity
21 (S)	038416	TRAFFIC PLASTIC DRUMS	EA	270
22 (S)	129100	TEMPORARY CRASH CUSHION MODULE	EA	180
23	038417	TEMPORARY CRASH CUSHION (ABSORB 350)	EA	4
24	150206	ABANDON CULVERT	M	22
25 (S)	038418	ABANDON IRRIGATION CROSSOVER	EA	9
26	150608	REMOVE CHAIN LINK FENCE	M	290
27	038419	MAINTAIN TEMPORARY FENCE (TYPE ESA)	LS	LUMP SUM
28	150662	REMOVE METAL BEAM GUARD RAILING	M	290
29	038420	REMOVE DOUBLE THRIE BEAM BARRIER	M	1380
30	150701	REMOVE YELLOW PAINTED TRAFFIC STRIPE	M	5100
31	150717	REMOVE TRAFFIC STRIPE AND PAVEMENT MARKING	M2	1500
32	150742	REMOVE ROADSIDE SIGN	EA	28
33	150760	REMOVE SIGN STRUCTURE	EA	3
34	150767	REMOVE BRIDGE MOUNTED SIGN	EA	1
35	150805	REMOVE CULVERT	M	330
36	150820	REMOVE INLET	EA	9
37	150857	REMOVE ASPHALT CONCRETE SURFACING	M2	4110
38	152320	RESET ROADSIDE SIGN	EA	22
39	152390	RELOCATE ROADSIDE SIGN	EA	6
40 (S)	153103	COLD PLANE ASPHALT CONCRETE PAVEMENT	M2	690

Item No.	Item Code	Item Description	Unit of Measure	Estimated Quantity
41	153210	REMOVE CONCRETE	M3	140
42	153221	REMOVE CONCRETE BARRIER	M	4380
43	155003	CAP INLET	EA	15
44	155006	CAP RISER	EA	2
45	156585	REMOVE CRASH CUSHION	EA	2
46	157560	BRIDGE REMOVAL (PORTION)	LS	LUMP SUM
47	160101	CLEARING AND GRUBBING	LS	LUMP SUM
48	170101	DEVELOP WATER SUPPLY	LS	LUMP SUM
49	190101	ROADWAY EXCAVATION	M3	86 700
50	190110	LEAD COMPLIANCE PLAN	LS	LUMP SUM
51 (F)	192003	STRUCTURE EXCAVATION (BRIDGE)	M3	780
52	192037	STRUCTURE EXCAVATION (RETAINING WALL)	M3	8940
53 (F)	192050	STRUCTURE EXCAVATION (TIEBACK WALL)	M3	960
54 (F)	193003	STRUCTURE BACKFILL (BRIDGE)	M3	1080
55	193013	STRUCTURE BACKFILL (RETAINING WALL)	M3	7010
56 (F)	193026	STRUCTURE BACKFILL (TIEBACK WALL)	M3	70
57	193031	PERVIOUS BACKFILL MATERIAL (RETAINING WALL)	M3	670
58	193114	SAND BACKFILL	M3	4
59	194001	DITCH EXCAVATION	M3	270
60 (F)	197026	EARTH RETAINING STRUCTURE, LOCATION 1	M2	1020

Item No.	Item Code	Item Description	Unit of Measure	Estimated Quantity
61 (F)	197027	EARTH RETAINING STRUCTURE, LOCATION 2	M2	1100
62 (F)	197028	EARTH RETAINING STRUCTURE, LOCATION 3	M2	440
63 (F)	197029	EARTH RETAINING STRUCTURE, LOCATION 4	M2	440
64 (S)	200001	HIGHWAY PLANTING	LS	LUMP SUM
65 (S)	200101	IMPORTED TOPSOIL	M3	1240
66 (S)	202007	DUFF	M2	3890
67 (S)	038421	BONDED FIBER MATRIX (EROSION CONTROL)	KG	3680
68 (S)	203014	FIBER (EROSION CONTROL)	KG	9430
69	203021	FIBER ROLLS	M	8400
70 (S)	203024	COMPOST (EROSION CONTROL)	M3	23
71 (S)	203026	MOVE-IN/MOVE-OUT (EROSION CONTROL)	EA	6
72 (S)	038422	PURE LIVE SEED (EROSION CONTROL TYPE 1)	KG	64
73 (S)	038423	PURE LIVE SEED (EROSION CONTROL TYPE 2)	KG	64
74 (S)	038424	PURE LIVE SEED (EROSION CONTROL TYPE 3)	KG	23
75 (S)	203056	COMMERCIAL FERTILIZER (EROSION CONTROL)	KG	130
76 (S)	203061	STABILIZING EMULSION (EROSION CONTROL)	KG	1310
77 (S)	204099	PLANT ESTABLISHMENT WORK	LS	LUMP SUM
78 (S)	208000	IRRIGATION SYSTEM	LS	LUMP SUM
79 (S)	208731	200 MM CORRUGATED HIGH DENSITY POLYETHYLENE PIPE CONDUIT	M	76
80 (S)	208798	200 MM WELDED STEEL PIPE CONDUIT (6.35 MM THICK)	M	51

Item No.	Item Code	Item Description	Unit of Measure	Estimated Quantity
81 (S)	208910	EXTEND 250 MM CONDUIT	M	55
82	220101	FINISHING ROADWAY	LS	LUMP SUM
83	260201	CLASS 2 AGGREGATE BASE	M3	24 900
84	374002	ASPHALTIC EMULSION (FOG SEAL COAT)	TONN	3.5
85	390102	ASPHALT CONCRETE (TYPE A)	TONN	13 700
86	390108	ASPHALT CONCRETE BASE (TYPE A)	TONN	14 400
87	394001	PLACE ASPHALT CONCRETE DIKE	M	3880
88	394002	PLACE ASPHALT CONCRETE (MISCELLANEOUS AREA)	M2	10
89	397001	ASPHALTIC EMULSION (PAINT BINDER)	TONN	10
90	038425	CONCRETE PAVEMENT (DOWELED)	M3	9390
91	038426	CONCRETE PAVEMENT (UNDOWELED)	M3	3640
92	038427	CONCRETE PAVEMENT (RAPID STRENGTH CONCRETE)	M3	220
93	404092	SEAL PAVEMENT JOINT	M	24 500
94	404094	SEAL LONGITUDINAL ISOLATION JOINT	M	7180
95	413111	REPAIR SPALLED JOINTS	M2	4
96	420201	GRIND EXISTING CONCRETE PAVEMENT	M2	15 000
97 (S)	500050	TIEBACK ANCHOR	EA	242
98 (F)	510050	STRUCTURAL CONCRETE	M3	260
99 (F)	510051	STRUCTURAL CONCRETE, BRIDGE FOOTING	M3	220
100 (F)	510053	STRUCTURAL CONCRETE, BRIDGE	M3	660

Item No.	Item Code	Item Description	Unit of Measure	Estimated Quantity
101	510060	STRUCTURAL CONCRETE, RETAINING WALL	M3	3350
102 (F)	510072	STRUCTURAL CONCRETE, BARRIER SLAB	M3	630
103 (F)	510086	STRUCTURAL CONCRETE, APPROACH SLAB (TYPE N)	M3	90
104	510126	CLASS 2 CONCRETE (MINOR STRUCTURE)	M3	170
105 (F)	510314	CLASS 4 CONCRETE (BACKFILL)	M3	180
106	510502	MINOR CONCRETE (MINOR STRUCTURE)	M3	280
107	510504	MINOR CONCRETE (PIPE ENCASEMENT)	M3	92
108 (F)	511036	ARCHITECTURAL SURFACE (BARRIER)	M2	680
109	040153	SWIRLED PLASTER TEXTURE	M2	3550
110	038428	BARRIER TILE TEXTURE	M2	270
111	511106	DRILL AND BOND DOWEL	M	180
112	515020	REFINISH BRIDGE DECK	M2	90
113 (S)	519117	JOINT SEAL (MR 30 MM)	M	52
114 (S)	519120	JOINT SEAL (MR 15 MM)	M	34
115 (S-F)	520101	BAR REINFORCING STEEL	KG	172 000
116 (S-F)	520102	BAR REINFORCING STEEL (BRIDGE)	KG	98 000
117 (S)	520103	BAR REINFORCING STEEL (RETAINING WALL)	KG	218 500
118 (F)	530100	SHOTCRETE	M3	355
119 (S)	560203	FURNISH SIGN STRUCTURE (BRIDGE MOUNTED WITH WALKWAY)	KG	5000
120 (S)	560204	INSTALL SIGN STRUCTURE (BRIDGE MOUNTED WITH WALKWAY)	KG	5000

Item No.	Item Code	Item Description	Unit of Measure	Estimated Quantity
121 (S)	560208	FURNISH SIGN STRUCTURE (TUBULAR)	KG	127 200
122 (S)	560209	INSTALL SIGN STRUCTURE (TUBULAR)	KG	127 200
123 (S)	560218	FURNISH SIGN STRUCTURE (TRUSS)	KG	30 000
124 (S)	560219	INSTALL SIGN STRUCTURE (TRUSS)	KG	30 000
125 (S)	038429	1524 MM CAST-IN-DRILLED HOLE CONCRETE PILE	M	190
126	562004	METAL (RAIL MOUNTED SIGN)	KG	120
127	566011	ROADSIDE SIGN - ONE POST	EA	22
128	566012	ROADSIDE SIGN - TWO POST	EA	4
129	568001	INSTALL SIGN (STRAP AND SADDLE BRACKET METHOD)	EA	9
130	568017	INSTALL ROADSIDE SIGN PANEL ON EXISTING POST	EA	6
131	038430	INSTALL SIGN PANEL ON EXISTING SIGN STRUCTURE	M2	73
132	038431	ROCK STAINING	M2	7590
133	650075	600 MM REINFORCED CONCRETE PIPE	M	2320
134	650077	750 MM REINFORCED CONCRETE PIPE	M	190
135	650079	900 MM REINFORCED CONCRETE PIPE	M	110
136	664098	600 MM BITUMINOUS COATED CORRUGATED STEEL PIPE (3.51 MM THICK)	M	10
137	664106	750 MM BITUMINOUS COATED CORRUGATED STEEL PIPE (3.51 MM THICK)	M	10
138	664111	900 MM BITUMINOUS COATED CORRUGATED STEEL PIPE (3.51 MM THICK)	M	10
139	690277	450 MM BITUMINOUS COATED CORRUGATED STEEL PIPE DOWNDRAIN (2.77 MM THICK)	M	58
140	690281	600 MM BITUMINOUS COATED CORRUGATED STEEL PIPE DOWNDRAIN (2.77 MM THICK)	M	10

Item No.	Item Code	Item Description	Unit of Measure	Estimated Quantity
141	703233	GRATED LINE DRAIN	M	750
142	707471	900 MM PRECAST CONCRETE PIPE RISER	M	5
143	721008	ROCK SLOPE PROTECTION (LIGHT, METHOD B)	M3	50
144	721011	ROCK SLOPE PROTECTION (BACKING NO. 2, METHOD B)	M3	91
145	721024	ROCK SLOPE PROTECTION (1/4T, METHOD B)	M3	83
146	721431	CONCRETE (CONCRETE APRON)	M3	25
147	727901	MINOR CONCRETE (DITCH LINING)	M3	130
148	729010	ROCK SLOPE PROTECTION FABRIC	M2	170
149 (F)	731517	MINOR CONCRETE (GUTTER)	M	140
150	038432	MINOR CONCRETE (TEXTURED PAVING) (GORE PAVING)	M2	1570
151	731627	MINOR CONCRETE (CURB, SIDEWALK AND CURB RAMP)	M3	51
152 (S)	750001	MISCELLANEOUS IRON AND STEEL	KG	15 300
153 (S)	800391	CHAIN LINK FENCE (TYPE CL-1.8)	M	440
154	802595	3.0 M CHAIN LINK GATE (TYPE CL-1.8)	EA	1
155	820107	DELINEATOR (CLASS 1)	EA	170
156	820110	MILEPOST MARKER	EA	7
157	820118	GUARD RAILING DELINEATOR	EA	48
158 (S)	832001	METAL BEAM GUARD RAILING	M	410
159 (S)	833033	CHAIN LINK RAILING (TYPE 7 MODIFIED)	M	210
160 (F)	833080	CONCRETE BARRIER (TYPE K)	M	1110

Item No.	Item Code	Item Description	Unit of Measure	Estimated Quantity
161	040154	TUBULAR PIPE HANDRAILING	M	24
162 (S)	040155	PERFORATED STEEL SCREEN (SCONCE)	EA	4
163 (F)	833148	CONCRETE BARRIER (TYPE 26R MODIFIED)	M	70
164	839481	CONCRETE BARRIER (TYPE 50)	M	120
165 (S)	839521	CABLE RAILING	M	270
166 (S)	839541	TRANSITION RAILING (TYPE WB)	EA	4
167 (S)	839581	END ANCHOR ASSEMBLY (TYPE SFT)	EA	1
168 (S)	839584	ALTERNATIVE IN-LINE TERMINAL SYSTEM	EA	3
169 (S)	839585	ALTERNATIVE FLARED TERMINAL SYSTEM	EA	3
170 (S)	839591	CRASH CUSHION, SAND FILLED	EA	21
171 (S)	839605	CRASH CUSHION (REACT 9SCBS)	EA	4
172	839698	CONCRETE BARRIER (TYPE 60S MODIFIED)	M	407
173 (F)	040156	CONCRETE BARRIER (TYPE 60SC MODIFIED)	M	162
174 (F)	040157	CONCRETE BARRIER (TYPE 60SE MODIFIED)	M	716
175	040158	CONCRETE BARRIER (TYPE 60D)	M	377
176	839706	CONCRETE BARRIER (TYPE 60G)	M	26
177	839709	CONCRETE BARRIER (TYPE 60GE)	M	90
178	839710	CONCRETE BARRIER (TYPE 60S)	M	1480
179	839712	CONCRETE BARRIER (TYPE 60SC)	M	740
180	839713	CONCRETE BARRIER (TYPE 60SE)	M	10

Item No.	Item Code	Item Description	Unit of Measure	Estimated Quantity
181	038433	CONCRETE BARRIER (TYPE 60 MODIFIED)	M	310
182	839717	CONCRETE BARRIER (TYPE 732 MODIFIED)	M	621
183	040159	CONCRETE BARRIER (TYPE 732R MODIFIED)	M	70
184 (F)	040160	CONCRETE BARRIER (TYPE 732A MODIFIED)	M	782
185 (S)	840515	THERMOPLASTIC PAVEMENT MARKING	M2	500
186 (S)	840563	200 MM THERMOPLASTIC TRAFFIC STRIPE	M	12 400
187 (S)	840564	200 MM THERMOPLASTIC TRAFFIC STRIPE (BROKEN 3.66 M - 0.92 M)	M	4400
188 (S)	840567	100 MM THERMOPLASTIC TRAFFIC STRIPE (BROKEN 1.83 M - 0.30 M)	M	220
189 (S)	840571	100 MM THERMOPLASTIC TRAFFIC STRIPE (BROKEN 5.18 M - 2.14 M)	M	270
190 (S)	840656	PAINT TRAFFIC STRIPE (2-COAT)	M	137 000
191 (S)	840660	PAINT PAVEMENT MARKING	M	64
192 (S)	850101	PAVEMENT MARKER (NON-REFLECTIVE)	EA	25 500
193 (S)	850111	PAVEMENT MARKER (RETROREFLECTIVE)	EA	9480
194 (S)	860251	SIGNAL AND LIGHTING (LOCATION 1)	LS	LUMP SUM
195 (S)	860252	SIGNAL AND LIGHTING (LOCATION 2)	LS	LUMP SUM
196 (S)	860253	SIGNAL AND LIGHTING (LOCATION 3)	LS	LUMP SUM
197 (S)	860402	LIGHTING (CITY STREET)	LS	LUMP SUM
198 (S)	860460	LIGHTING AND SIGN ILLUMINATION	LS	LUMP SUM
199 (S-F)	860792	COMMUNICATION CONDUIT (BRIDGE)	M	830
200 (S-F)	860796	SPRINKLER CONTROL CONDUIT (BRIDGE)	M	220

Item No.	Item Code	Item Description	Unit of Measure	Estimated Quantity
201 (S)	860931	TRAFFIC MONITORING STATION (LOCATION 1)	LS	LUMP SUM
202 (S)	860932	TRAFFIC MONITORING STATION (LOCATION 2)	LS	LUMP SUM
203 (S)	861101	RAMP METERING SYSTEM (LOCATION 1)	LS	LUMP SUM
204 (S)	861102	RAMP METERING SYSTEM (LOCATION 2)	LS	LUMP SUM
205 (S)	038434	FIBER OPTIC COMMUNICATION SYSTEM	LS	LUMP SUM
206	038435	INSTALL CONCRETE BARRIER (MOVEABLE)	M	12 400
207 (S)	038436	HIGH OCCUPANCY VEHICLE SYSTEM	LS	LUMP SUM
208	999990	MOBILIZATION	LS	LUMP SUM

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION

SPECIAL PROVISIONS

Annexed to Contract No. 11-080944

SECTION 1 SPECIFICATIONS AND PLANS

The project plans for this project are not considered to be complete to construct the work anticipated by the contract. Design of the project, including preparation of final project plans, will be completed in phases after approval of the contract in conformance with the following:

Phase I shall consist of the following work north of Station 435+00 "SD-15M" Line:

- Title sheet
- Key map
- Profiles and Super Elevation Diagrams
- Temporary Water Pollution Control Details and Quantities
- Utility Plans
- Stage Construction and Traffic Handling Plans and Quantities
- Construction Area Signs
- Log of Test Borings

Complete design of Phase I, including final plans for Phase I, is included in the project plans for this project. Phase II shall consist of the following work north of Station 435+00 "SD-15M" Line:

- Layouts
- Detour Plans
- Construction Area Signs
- Construction Details
- Contour Grading and Drainage Plans
- Drainage Profiles
- Drainage Details
- Drainage Quantities
- Retaining Wall Plans and Details
- Retaining Wall Quantities
- Plant Removal and Irrigation Removal Plans
- Planting and Irrigation Plans
- Summary of Quantities
- Erosion Control Plans/Quantities
- Via Rancho Parkway Tie Back Walls,
- North County Fair Tie Back Walls

Complete design of Phase II, including final plans for Phase II, will be provided to the Contractor within 30 days after approval of the contract.

Phase III shall consist of the following work north of Station 435+00 "SD-15M" Line:

- North County Fair DAR Structures
- North County Fair DAR MSE and Type 1 Walls
- North County Fair Bridge Rails

Pavement Delineation Plans/Details/Quantities
Sign Plans,
Sign Detail Plans
Sign Quantity Plans
Signals, Lighting and Electrical Systems

Complete design of Phase III, including final plans for Phase III, will be provided to the Contractor within 120 days after approval of the contract.

Phase IV shall consist of the following work south of Station 435+00 "SD-15M" Line:

Typical Cross Sections
Layouts
Profiles with Super Diagrams
Temporary Water Pollution Control Plans/Details
Utility Plans/Profiles/Details
Stage Construction and Traffic Handling Plan
Construction Area Signs
Construction Details
Contour Grading and Drainage Plans
Drainage Profiles
Drainage Details
Drainage Quantities
Retaining Wall Plans and Details
Retaining Wall Quantities
Summary of Quantities
Log of Test Borings
Planting and Irrigation Plans
Pavement Delineation Plans
Sign Plans,
Sign Detail Plans
Sign Quantity Plans
Electrical Systems
High Occupancy Vehicle System

Complete design of Phase IV, including final plans for phase IV, will be provided to the Contractor within 200 days after approval of the contract.

The issuance of Phases II, III and IV shall be by change order in conformance with Section 4, "Scope of Work," of the Standard Specifications.

Project plan sheets marked, "Preliminary for Bidding Purposes Only," shall not be considered complete as to the design for any design sequencing package. These plan sheets are provided only to show the scope of the work to be performed, and shall only be used for the purpose of bid preparation.

Should the Department fail to provide the complete design, including final plans for any phase within the times specified and, in the opinion of the Engineer, the controlling operation or operations are delayed or interfered with by the delay in providing the complete design, the delay will be considered a right of way delay in conformance with the provisions in Section 8-1.09, "Right of Way Delays," of the Standard Specifications. Attention is directed to "Progress Schedule (Critical Path)" of these special provisions.

AMENDMENTS TO JULY 1999 STANDARD SPECIFICATIONS

UPDATED NOVEMBER 18, 2005

Amendments to the Standard Specifications set forth in these special provisions shall be considered as part of the Standard Specifications for the purposes set forth in Section 5-1.04, "Coordination and Interpretation of Plans, Standard Specifications and Special Provisions," of the Standard Specifications. Whenever either the term "Standard Specifications is amended" or the term "Standard Specifications are amended" is used in the special provisions, the text or table following the

term shall be considered an amendment to the Standard Specifications. In case of conflict between such amendments and the Standard Specifications, the amendments shall take precedence over and be used in lieu of the conflicting portions.

SECTION 1: DEFINITIONS AND TERMS

Issue Date: January 28, 2005

Section 1-1.265, "Manual of Traffic Controls," of the Standard Specifications is amended to read:

1-1.265 MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES

- The Manual on Uniform Traffic Control Devices for Streets and Highways, 2003 Edition (MUTCD) is administered by the Federal Highway Administration.

Section 1, "Definitions and Terms," of the Standard Specifications is amended by adding the following section:

1-1.266 MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES CALIFORNIA SUPPLEMENT

- The MUTCD 2003 California Supplement (MUTCD California Supplement) is issued by the Department of Transportation to provide amendments to the MUTCD. The MUTCD and MUTCD California Supplement supersede the Department's Manual of Traffic Controls.

SECTION 2: PROPOSAL REQUIREMENTS AND CONDITIONS

Issue Date: June 19, 2003

Section 2-1.03, "Examination of Plans, Specifications, Contract, and Site of Work," of the Standard Specifications is amended to read:

2-1.03 Examination of Plans, Specifications, Contract, and Site of Work

- The bidder shall examine carefully the site of the work contemplated, the plans and specifications, and the proposal and contract forms therefor. The submission of a bid shall be conclusive evidence that the bidder has investigated and is satisfied as to the general and local conditions to be encountered, as to the character, quality and scope of work to be performed, the quantities of materials to be furnished and as to the requirements of the proposal, plans, specifications and the contract.

- The submission of a bid shall also be conclusive evidence that the bidder is satisfied as to the character, quality and quantity of surface and subsurface materials or obstacles to be encountered insofar as this information was reasonably ascertainable from an inspection of the site and the records of exploratory work done by the Department as shown in the bid documents, as well as from the plans and specifications made a part of the contract.

- Where the Department has made investigations of site conditions including subsurface conditions in areas where work is to be performed under the contract, or in other areas, some of which may constitute possible local material sources, bidders or contractors may, upon written request, inspect the records of the Department as to those investigations subject to and upon the conditions hereinafter set forth.

- Where there has been prior construction by the Department or other public agencies within the project limits, records of the prior construction that are currently in the possession of the Department and which have been used by, or are known to, the designers and administrators of the project will be made available for inspection by bidders or contractors, upon written request, subject to the conditions hereinafter set forth. The records may include, but are not limited to, as-built drawings, design calculations, foundation and site studies, project reports and other data assembled in connection with the investigation, design, construction and maintenance of the prior projects.

- Inspection of the records of investigations and project records may be made at the office of the district in which the work is situated, or in the case of records of investigations related to structure work, at the Transportation Laboratory in Sacramento, California.

- When a log of test borings or other record of geotechnical data obtained by the Department's investigation of surface and subsurface conditions is included with the contract plans, it is furnished for the bidders' or Contractor's information and its use shall be subject to the conditions and limitations set forth in this Section 2-1.03.

- In some instances, information considered by the Department to be of possible interest to bidders or contractors has been compiled as "Materials Information." The use of the "Materials Information" shall be subject to the conditions and limitations set forth in this Section 2-1.03 and Section 6-2, "Local Materials."

- When cross sections are not included with the plans, but are available, bidders or contractors may inspect the cross sections and obtain copies for their use, at their expense.
- When cross sections are included with the contract plans, it is expressly understood and agreed that the cross sections do not constitute part of the contract, do not necessarily represent actual site conditions or show location, character, dimensions and details of work to be performed, and are included in the plans only for the convenience of bidders and their use is subject to the conditions and limitations set forth in this Section 2-1.03.
- When contour maps were used in the design of the project, the bidders may inspect those maps, and if available, they may obtain copies for their use.
- The availability or use of information described in this Section 2-1.03 is not to be construed in any way as a waiver of the provisions of the first paragraph in this Section 2-1.03 and bidders and contractors are cautioned to make independent investigations and examinations as they deem necessary to be satisfied as to conditions to be encountered in the performance of the work and, with respect to possible local material sources, the quality and quantity of material available from the property and the type and extent of processing that may be required in order to produce material conforming to the requirements of the specifications.
- The Department assumes no responsibility for conclusions or interpretations made by a bidder or contractor based on the information or data made available by the Department. The Department does not assume responsibility for representation made by its officers or agents before the execution of the contract concerning surface or subsurface conditions, unless that representation is expressly stated in the contract.
- No conclusions or interpretations made by a bidder or contractor from the information and data made available by the Department will relieve a bidder or contractor from properly fulfilling the terms of the contract.

SECTION 5: CONTROL OF WORK

Issue Date: December 31, 2001

Section 5-1.02A, "Trench Excavation Safety Plans," of the Standard Specifications is amended to read:

5-1.02A Excavation Safety Plans

- The Construction Safety Orders of the Division of Occupational Safety and Health shall apply to all excavations. For all excavations 1.5 m or more in depth, the Contractor shall submit to the Engineer a detailed plan showing the design and details of the protective systems to be provided for worker protection from the hazard of caving ground during excavation. The detailed plan shall include any tabulated data and any design calculations used in the preparation of the plan. Excavation shall not begin until the detailed plan has been reviewed and approved by the Engineer.
- Detailed plans of protective systems for which the Construction Safety Orders require design by a registered professional engineer shall be prepared and signed by an engineer who is registered as a Civil Engineer in the State of California, and shall include the soil classification, soil properties, soil design calculations that demonstrate adequate stability of the protective system, and any other design calculations used in the preparation of the plan.
- No plan shall allow the use of a protective system less effective than that required by the Construction Safety Orders.
- If the detailed plan includes designs of protective systems developed only from the allowable configurations and slopes, or Appendices, contained in the Construction Safety Orders, the plan shall be submitted at least 5 days before the Contractor intends to begin excavation. If the detailed plan includes designs of protective systems developed from tabulated data, or designs for which design by a registered professional engineer is required, the plan shall be submitted at least 3 weeks before the Contractor intends to begin excavation.
- Attention is directed to Section 7-1.01E, "Trench Safety."

SECTION 7: LEGAL RELATIONS AND RESPONSIBILITY

Issue Date: January 28, 2005

The eighth paragraph of Section 7-1.09, "Public Safety" of the Standard Specifications is amended to read:

- Signs, lights, flags, and other warning and safety devices and their use shall conform to the requirements set forth in Part 6 of the MUTCD and of the MUTCD California Supplement. Signs or other protective devices furnished and erected by the Contractor, at the Contractor's expense, as above provided, shall not obscure the visibility of, nor conflict in intent, meaning and function of either existing signs, lights and traffic control devices or any construction area signs and traffic control devices for which furnishing of, or payment for, is provided elsewhere in the specifications. Signs furnished and erected by the Contractor, at the Contractor's expense, shall be approved by the Engineer as to size, wording and location.

The fourteenth paragraph of Section 7-1.09, "Public Safety," of the Standard Specifications is amended to read:

- The Contractor shall notify the Engineer not less than 18 days and no more than 90 days prior to the anticipated start of an operation that will change the vertical or horizontal clearance available to public traffic (including shoulders).

The sixteenth paragraph of Section 7-1.09, "Public Safety," of the Standard Specifications is amended to read:

- When vertical clearance is temporarily reduced to 4.72 m or less, low clearance warning signs shall be placed in accordance with Part 2 of the MUTCD and the MUTCD California Supplement, and as directed by the Engineer. Signs shall conform to the dimensions, color, and legend requirements of the MUTCD, the MUTCD California Supplement, and these specifications except that the signs shall have black letters and numbers on an orange retroreflective background. W12-2P signs shall be illuminated so that the signs are clearly visible.

SECTION 9: MEASUREMENT AND PAYMENT

Issue Date: November 17, 2004

Section 9-1.04, "Notice of Potential Claim," of the Standard Specifications is amended to read:

9-1.04 NOTICE OF POTENTIAL CLAIM

- It is the intention of this section that disputes between the parties arising under and by virtue of the contract be brought to the attention of the Engineer at the earliest possible time in order that the matters may be resolved, if possible, or other appropriate action promptly taken.

- Disputes will not be considered unless the Contractor has first complied with specified notice or protest requirements, including Section 4-1.03, "Changes," Section 5-1.116, "Differing Site Conditions," Section 8-1.06, "Time of Completion," Section 8-1.07, "Liquidated Damages," and Section 8-1.10, "Utility and Non-Highway Facilities."

- For disputes arising under and by virtue of the contract, including an act or failure to act by the Engineer, the Contractor shall provide a signed written initial notice of potential claim to the Engineer within 5 days from the date the dispute first arose. The initial notice of potential claim shall provide the nature and circumstances involved in the dispute which shall remain consistent through the dispute. The initial notice of potential claim shall be submitted on Form CEM-6201A furnished by the Department and shall be certified with reference to the California False Claims Act, Government Code Sections 12650-12655. The Contractor shall assign an exclusive identification number for each dispute, determined by chronological sequencing, based on the date of the dispute.

- The exclusive identification number for each dispute shall be used on the following corresponding documents:

- A. Initial notice of potential claim.
- B. Supplemental notice of potential claim.
- C. Full and final documentation of potential claim.
- D. Corresponding claim included in the Contractor's written statement of claims.

- The Contractor shall provide the Engineer the opportunity to examine the site of work within 5 days from the date of the initial notice of potential claim. The Contractor shall proceed with the performance of contract work unless otherwise specified or directed by the Engineer.

- Throughout the disputed work, the Contractor shall maintain records that provide a clear distinction between the incurred direct costs of disputed work and that of undisputed work. The Contractor shall allow the Engineer access to the Contractor's project records deemed necessary by the Engineer to evaluate the potential claim within 20 days of the date of the Engineer's written request.

- Within 15 days of submitting the initial notice of potential claim, the Contractor shall provide a signed supplemental notice of potential claim to the Engineer that provides the following information:

- A. The complete nature and circumstances of the dispute which caused the potential claim.
- B. The contract provisions that provide the basis of claim.
- C. The estimated cost of the potential claim, including an itemized breakdown of individual costs and how the estimate was determined.
- D. A time impact analysis of the project schedule that illustrates the effect on the scheduled completion date due to schedule changes or disruptions where a request for adjustment of contract time is made.

- The information provided in items A and B above shall provide the Contractor's complete reasoning for additional compensation or adjustments.
- The supplemental notice of potential claim shall be submitted on Form CEM-6201B furnished by the Department and shall be certified with reference to the California False Claims Act, Government Code Sections 12650-12655. The Engineer will evaluate the information presented in the supplemental notice of potential claim and provide a written response to the Contractor within 20 days of its receipt. If the estimated cost or effect on the scheduled completion date changes, the Contractor shall update information in items C and D above as soon as the change is recognized and submit this information to the Engineer.
 - Within 30 days of the completion of work related to the potential claim, the Contractor shall provide the full and final documentation of potential claim to the Engineer that provides the following information:
 - A. A detailed factual narration of events fully describing the nature and circumstances that caused the dispute, including, but not limited to, necessary dates, locations, and items of work affected by the dispute.
 - B. The specific provisions of the contract that support the potential claim and a statement of the reasons these provisions support and provide a basis for entitlement of the potential claim.
 - C. When additional monetary compensation is requested, the exact amount requested calculated in conformance with Section 9-1.03, "Force Account Payment," or Section 8-1.09, "Right of Way Delays," including an itemized breakdown of individual costs. These costs shall be segregated into the following cost categories:
 1. Labor – A listing of individuals, classifications, regular hours and overtime hours worked, dates worked, and other pertinent information related to the requested reimbursement of labor costs.
 2. Materials – Invoices, purchase orders, location of materials either stored or incorporated into the work, dates materials were transported to the project or incorporated into the work, and other pertinent information related to the requested reimbursement of material costs.
 3. Equipment – Listing of detailed description (make, model, and serial number), hours of use, dates of use and equipment rates. Equipment rates shall be at the applicable State rental rate as listed in the Department of Transportation publication entitled "Labor Surcharge and Equipment Rental Rates," in effect when the affected work related to the dispute was performed.
 4. Other categories as specified by the Contractor or the Engineer.
 - D. When an adjustment of contract time is requested the following information shall be provided:
 1. The specific dates for which contract time is being requested.
 2. The specific reasons for entitlement to a contract time adjustment.
 3. The specific provisions of the contract that provide the basis for the requested contract time adjustment.
 4. A detailed time impact analysis of the project schedule. The time impact analysis shall show the effect of changes or disruptions on the scheduled completion date to demonstrate entitlement to a contract time adjustment.
 - E. The identification and copies of the Contractor's documents and the substance of oral communications that support the potential claim.
- The full and final documentation of the potential claim shall be submitted on Form CEM-6201C furnished by the Department and shall be certified with reference to the California False Claims Act, Government Code Sections 12650-12655.
 - Pertinent information, references, arguments, and data to support the potential claim shall be included in the full and final documentation of potential claim. Information submitted subsequent to the full and final documentation submittal will not be considered. Information required in the full and final documentation of potential claim, as listed in items A to E above, that is not applicable to the dispute may be exempted as determined by the Engineer. No full and final documentation of potential claim will be considered that does not have the same nature and circumstances, and basis of claim as those specified on the initial and supplemental notices of potential claim.
 - The Engineer will evaluate the information presented in the full and final documentation of potential claim and provide a written response to the Contractor within 30 days of its receipt unless otherwise specified. The Engineer's receipt of the full and final documentation of potential claim shall be evidenced by postal receipt or the Engineer's written receipt if delivered by hand. If the full and final documentation of potential claim is submitted by the Contractor after acceptance of the work by the Director, the Engineer need not provide a written response.
 - Provisions in this section shall not apply to those claims for overhead costs and administrative disputes that occur after issuance of the proposed final estimate. Administrative disputes are disputes of administrative deductions or retentions, contract item quantities, contract item adjustments, interest payments, protests of contract change orders as provided in

Section 4-1.03A, "Procedure and Protest," and protests of the weekly statement of working days as provided in Section 8-1.06, "Time of Completion." Administrative disputes that occur prior to issuance of the proposed final estimate shall follow applicable requirements of this section. Information listed in the supplemental notice and full and final documentation of potential claim that is not applicable to the administrative dispute may be exempted as determined by the Engineer.

- Unless otherwise specified in the special provisions, the Contractor may pursue the administrative claim process pursuant to Section 9-1.07B, "Final Payment and Claims," for any potential claim found by the Engineer to be without merit.
- Failure of the Contractor to conform to specified dispute procedures shall constitute a failure to pursue diligently and exhaust the administrative procedures in the contract, and is deemed as the Contractor's waiver of the potential claim and a waiver of the right to a corresponding claim for the disputed work in the administrative claim process in conformance with Section 9-1.07B, "Final Payment of Claims," and shall operate as a bar to arbitration pursuant to Section 10240.2 of the California Public Contract Code.

Section 9-1.07B, "Final Payment and Claims," of the Standard Specifications is amended to read:

9-1.07B Final Payment and Claims

- After acceptance by the Director, the Engineer will make a proposed final estimate in writing of the total amount payable to the Contractor, including an itemization of the total amount, segregated by contract item quantities, extra work and other bases for payment, and shall also show each deduction made or to be made for prior payments and amounts to be kept or retained under the provisions of the contract. Prior estimates and payments shall be subject to correction in the proposed final estimate. The Contractor shall submit written approval of the proposed final estimate or a written statement of claims arising under or by virtue of the contract so that the Engineer receives the written approval or statement of claims no later than close of business of the thirtieth day after receiving the proposed final estimate. If the thirtieth day falls on a Saturday, Sunday or legal holiday, then receipt of the written approval or statement of claims by the Engineer shall not be later than close of business of the next business day. The Contractor's receipt of the proposed final estimate shall be evidenced by postal receipt. The Engineer's receipt of the Contractor's written approval or statement of claims shall be evidenced by postal receipt or the Engineer's written receipt if delivered by hand.

- On the Contractor's approval, or if the Contractor files no claim within the specified period of 30 days, the Engineer will issue a final estimate in writing in conformance with the proposed final estimate submitted to the Contractor, and within 30 days thereafter the State will pay the entire sum so found to be due. That final estimate and payment thereon shall be conclusive and binding against both parties to the contract on all questions relating to the amount of work done and the compensation payable therefor, except as otherwise provided in Sections 9-1.03C, "Records," and 9-1.09, "Clerical Errors."

- If the Contractor within the specified period of 30 days files claims, the Engineer will issue a semifinal estimate in conformance with the proposed final estimate submitted to the Contractor and within 30 days thereafter the State will pay the sum found to be due. The semifinal estimate and corresponding payment shall be conclusive and binding against both parties to the contract on each question relating to the amount of work done and the compensation payable therefor, except insofar as affected by the claims filed within the time and in the manner required hereunder and except as otherwise provided in Sections 9-1.03C, "Records," and 9-1.09, "Clerical Errors."

- Except for claims for overhead costs and administrative disputes that occur after issuance of the proposed final estimate, the Contractor shall only provide the following two items of information for each claim:

- A. The exclusive identification number that corresponds to the supporting full and final documentation of potential claim.
- B. The final amount of requested additional compensation.

- If the final amount of requested additional compensation is different than the amount of requested compensation included in the full and final documentation of potential claim, the Contractor shall provide in the written statement of claims the reasons for the changed amount, the specific provisions of the contract which support the changed amount, and a statement of the reasons the provisions support and provide a basis for the changed amount. If the Contractor's claim fails to provide an exclusive identification number or if there is a disparity in the provided exclusive identification number, the Engineer will notify the Contractor of the omission or disparity. The Contractor shall have 15 days after receiving notification from the Engineer to correct the omission or disparity. If after the 15 days has elapsed, there is still an omission or disparity of the exclusive identification number assigned to the claim, the Engineer will assign the number. No claim will be considered that has any of the following deficiencies:

- A. The claim does not have the same nature, circumstances, and basis as the corresponding full and final documentation of potential claim.
- B. The claim does not have a corresponding full and final documentation of potential claim.
- C. The claim was not included in the written statement of claims.

D. The Contractor did not comply with applicable notice or protest requirements of Sections 4-1.03, "Changes," 5-1.116, "Differing Site Condition," 8-1.06, "Time of Completion," 8-1.07, "Liquidated Damages," 8-1.10, "Utility and Non-Highway Facilities," and 9-1.04, "Notice of Potential Claim."

- Administrative disputes that occur after issuance of the proposed final estimate shall be included in the Contractor's written statement of claims in sufficient detail to enable the Engineer to ascertain the basis and amounts of those claims.
- The Contractor shall keep full and complete records of the costs and additional time incurred for work for which a claim for additional compensation is made. The Engineer or designated claim investigators or auditors shall have access to those records and any other records as may be required by the Engineer to determine the facts or contentions involved in the claims. Failure to permit access to those records shall be sufficient cause for denying the claims.
- The written statement of claims submitted by the Contractor shall be accompanied by a notarized certificate containing the following language:

Under the penalty of law for perjury or falsification and with specific reference to the California False Claims Act, Government Code Section 12650 et. seq., the undersigned,

(name) _____ of
(title) _____
(company)

hereby certifies that the claim for the additional compensation and time, if any, made herein for the work on this contract is a true statement of the actual costs incurred and time sought, and is fully documented and supported under the contract between parties.

Dated _____
/s/ _____
Subscribed and sworn before me this _____ day
of _____

(Notary Public)
My Commission
Expires _____

- Failure to submit the notarized certificate will be sufficient cause for denying the claim.
- Claims for overhead type expenses or costs, in addition to being certified as stated above, shall be supported and accompanied by an audit report of an independent Certified Public Accountant. Omission of a supporting audit report of an independent Certified Public Accountant shall result in denial of the claim and shall operate as a bar to arbitration, as to the claim, in conformance with the requirements in Section 10240.2 of the California Public Contract Code. Claims for overhead type expenses or costs shall be subject to audit by the State at its discretion. The costs of performing an audit examination and submitting the report shall be borne by the Contractor. The Certified Public Accountant's audit examination shall be performed in conformance with the requirements of the American Institute of Certified Public Accountants Attestation Standards. The audit examination and report shall depict the Contractor's project and company-wide financial records and shall specify the actual overall average daily rates for both field and home office overhead for the entire duration of the project, and whether the costs have been properly allocated. The rates of field and home office overhead shall exclude unallowable costs as determined in Title 48 of the Federal Acquisition Regulations, Chapter 1, Part 31. The audit examination and report shall determine if the rates of field and home office overhead are:

- A. Allowable in conformance with the requirements in Title 48 of the Federal Acquisition Regulations, Chapter 1, Part 31.
- B. Adequately supported by reliable documentation.
- C. Related solely to the project under examination.

- Costs or expenses incurred by the State in reviewing or auditing claims that are not supported by the Contractor's cost accounting or other records shall be deemed to be damages incurred by the State within the meaning of the California False Claims Act.

- If the Engineer determines that a claim requires additional analysis, the Engineer will schedule a board of review meeting. The Contractor shall meet with the review board or person and make a presentation in support of the claim. Attendance by the Contractor at the board of review meeting shall be mandatory.

- The District Director of the District that administered the contract will make the final determination of any claims which remain in dispute after completion of claim review by the Engineer or board of review meeting.

The final determination of claims will be sent to the Contractor by hand delivery or deposit in the U.S. mail. The Engineer will then make and issue the Engineer's final estimate in writing and within 30 days thereafter the State will pay the entire sum, if any, found due thereon. That final estimate shall be conclusive and binding against both parties to the contract on all questions relating to the amount of work done and the compensation payable therefor, except as otherwise provided in Sections 9-1.03C, "Records," and 9-1.09, "Clerical Errors."

- Failure of the Contractor to conform to the specified dispute procedures shall constitute a failure to pursue diligently and exhaust the administrative procedures in the contract and shall operate as a bar to arbitration in conformance with the requirements in Section 10240.2 of the California Public Contract Code.

SECTION 12: CONSTRUCTION AREA TRAFFIC CONTROL DEVICES

Issue Date: November 2, 2004

The second paragraph of Section 12-1.01, "Description," of the Standard Specifications is amended to read:

- Attention is directed to Part 6 of the MUTCD and of the MUTCD California Supplement. Nothing in this Section 12 is to be construed as to reduce the minimum standards in these manuals.

Section 12-2.01, "Flaggers," of the Standard Specifications is amended to read:

- Flaggers while on duty and assigned to traffic control or to give warning to the public that the highway is under construction and of any dangerous conditions to be encountered as a result thereof, shall perform their duties and shall be provided with the necessary equipment in conformance with Part 6 of the MUTCD and of the MUTCD California Supplement. The equipment shall be furnished and kept clean and in good repair by the Contractor at the Contractor's expense.

The first paragraph of Section 12-3.01, "General," of the Standard Specifications is amended to read:

- In addition to the requirements in Part 6 of the MUTCD and of the MUTCD California Supplement, all devices used by the Contractor in the performance of the work shall conform to the provisions in this Section 12-3.

The first paragraph of Section 12-3.06, "Construction Area Signs," of the Standard Specifications is amended to read:

- The term "Construction Area Signs" shall include all temporary signs required for the direction of public traffic through or around the work during construction. Construction area signs are shown in or referred to in Part 6 of the MUTCD and of the MUTCD California Supplement.

The fourth paragraph of Section 12-3.06, "Construction Area Signs," of the Standard Specifications is amended to read:

- All construction area signs shall conform to the dimensions, color and legend requirements of the plans, Part 6 of the MUTCD, Part 6 of the MUTCD California Supplement, and these specifications. All sign panels shall be the product of a commercial sign manufacturer, and shall be as specified in these specifications.

The eighth paragraph of Section 12-3.06, "Construction Area Signs," of the Standard Specifications is amended to read:

- Used signs with the specified sheeting material will be considered satisfactory if they conform to the requirements for visibility and legibility and the colors conform to the requirements in Part 6 of the MUTCD and of the MUTCD California Supplement. A significant difference between day and nighttime retroreflective color will be grounds for rejecting signs.

Section 12-3.06A, "Stationary Mounted Signs," of the Standard Specifications is amended by deleting the third, fourth, fifth, and sixth paragraphs.

SECTION 15: EXISTING HIGHWAY FACILITIES

Issue Date: November 2, 2004

The sixth paragraph of Section 15-2.07, "Payment," of the Standard Specifications is amended to read:

- Full compensation for removing, salvaging, reconstructing, relocating or resetting end caps, return caps, terminal sections, and buried post anchors, for metal beam guard railings and thrie beam barriers, and for connecting reconstructed, relocated or reset railings and barriers to new and existing facilities, including connections to concrete, shall be considered as included in the contract price paid per meter for the type of railing or barrier work involved and no additional compensation will be allowed therefor.

SECTION 19: EARTHWORK

Issue Date: December 31, 2001

The third paragraph of Section 19-1.02, "Preservation of Property," of the Standard Specifications is amended to read:

- In addition to the provisions in Sections 5-1.02, "Plans and Working Drawings," and 5-1.02A, "Excavation Safety Plans," detailed plans of the protective systems for excavations on or affecting railroad property will be reviewed for adequacy of protection provided for railroad facilities, property, and traffic. These plans shall be submitted at least 9 weeks before the Contractor intends to begin excavation requiring the protective systems. Approval by the Engineer of the detailed plans for the protective systems will be contingent upon the plans being satisfactory to the railroad company involved.

SECTION 20: EROSION CONTROL AND HIGHWAY PLANTING

Issue Date: November 18, 2005

Section 20-2.25, "Backflow Preventers," of the Standard Specifications is amended to read:

20-2.25 BACKFLOW PREVENTERS

- Backflow preventers shall be one of the reduced pressure principle devices as specified in these specifications and the special provisions.
- Backflow preventers shall be factory assembled and shall include 2 check valves, one pressure differential relief valve, 2 shut-off valves and 4 test cocks. Backflow preventer and valves shall be the same size as the pipeline in which they are installed, unless otherwise shown on the plans.
- Backflow preventer shut-off valves shall be manufactured from iron or bronze and shall be either resilient wedged gate valves, resilient seated and fully ported ball valves, or resilient seated butterfly valves. Threaded type shut-off valves shall be provided with a union on one side of each valve. Unions shall be brass or malleable iron.

Section 20-5.03J, "Check and Test Backflow Preventers," of the Standard Specifications is amended to read:

20-5.03J Check and Test Backflow Preventers

- Backflow preventers shall be checked and tested for proper operation by a certified Backflow Preventer Tester. The tester shall hold a valid certification as a Backflow Preventer Tester from the local governing authority in which the device to be tested is located. The local governing authority shall be the county, city or water purveyor having the governing authority over testing of backflow preventers involved. If the local governing authority does not have a certification program for Backflow Preventer Testers, the tester shall have a certificate from one of the following:

- A. The American Water Works Association.
- B. A county which has a certification program for Backflow Preventer Testers.

- Tests for proper operation shall conform to the requirements of the governing authority.
- The Engineer shall be notified at least 5 days prior to testing backflow preventers.

- One copy of the test results for each backflow preventer tested shall be furnished to the Engineer.
- Backflow preventers, installed by the Contractor, failing required tests shall be repaired at the Contractor's expense.

SECTION 29: TREATED PERMEABLE BASES

Issue Date: November 18, 2005

The fourth paragraph of Section 29-1.02A, "Asphalt Treated Permeable Base," of the Standard Specifications is amended to read:

- The type and grade of asphalt binder to be mixed with aggregate will be specified in the special provisions.

SECTION 39: ASPHALT CONCRETE

Issue Date: November 18, 2005

The fifth paragraph of Section 39-2.01, "Asphalts," of the Standard Specifications is amended to read:

- Paving asphalt to be used as a binder for pavement reinforcing fabric shall be a steam-refined paving asphalt conforming to the provisions in Section 92, "Asphalts," and shall be Grade PG 70-10.

SECTION 42: GROOVE AND GRIND PAVEMENT

Issue Date: December 31, 2001

The last sentence of the first subparagraph of the third paragraph in Section 42-2.02, "Construction," of the Standard Specifications is amended to read:

- After grinding has been completed, the pavement shall conform to the straightedge and profile requirements specified in Section 40-1.10, "Final Finishing."

SECTION 49: PILING

Issue Date: November 2, 2004

The first paragraph in Section 49-1.03, "Determination of Length," of the Standard Specifications is amended to read:

- Foundation piles of any material shall be of such length as is required to obtain the specified penetration, and to extend into the cap or footing block as shown on the plans, or specified in the special provisions.

The fourth paragraph in Section 49-1.03, "Determination of Length," of the Standard Specifications is amended to read:

- Modification to the specified installation methods and specified pile tip elevation will not be considered at locations where tension or lateral load demands control design pile tip elevations or when the plans state that specified pile tip elevation shall not be revised.

The sixth and seventh paragraphs in Section 49-1.03, "Determination of Length," of the Standard Specifications are amended to read:

- Indicator compression pile load testing shall conform to the requirements in ASTM Designation: D 1143. The pile shall sustain the first compression test load applied which is equal to the nominal resistance in compression, as shown on the plans, with no more than 13 mm total vertical movement at the top of the pile measured relative to the top of the pile prior to the start of compression load testing.

- Indicator tension pile load testing shall conform to the requirements in ASTM Designation: D 3689. The loading apparatus described as "Load Applied to Pile by Hydraulic Jack(s) Acting at One End of Test Beam(s) Anchored to the Pile" shall not be used. The pile shall sustain the first tension test load applied which is equal to the nominal resistance in tension, as shown on the plans, with no more than 13 mm total vertical movement at the top of the pile measured relative to the top of the pile prior to the start of tension load testing.

The ninth paragraph in Section 49-1.03, "Determination of Length," of the Standard Specifications is amended to read:

- For driven piling, the Contractor shall furnish piling of sufficient length to obtain the specified tip elevation shown on the plans or specified in the special provisions. For cast-in-drilled-hole concrete piling, the Contractor shall construct piling of such length to develop the nominal resistance in compression and to obtain the specified tip elevation shown on the plans or specified in the special provisions.

The tenth paragraph in Section 49-1.03, "Determination of Length," of the Standard Specifications is deleted.

The fourth paragraph in Section 49-1.04, "Load Test Piles," of the Standard Specifications is amended to read:

- Load test piles and anchor piles which are not to be incorporated in the completed structure shall be removed in conformance with the provisions in Section 15-4.02, "Removal Methods," and the remaining holes shall be backfilled with earth or other suitable material approved by the Engineer.

The fifth paragraph in Section 49-1.04, "Load Test Piles," of the Standard Specifications is amended to read:

- Load test anchorages in piles used as anchor piles shall conform to the following requirements:
 - A. High strength threaded steel rods shall conform to the provisions for bars in Section 50-1.05, "Prestressing Steel," except Type II bars shall be used.
 - B. High strength steel plates shall conform to the requirements in ASTM Designation: A 709/A 709M, Grade 345.
 - C. Anchor nuts shall conform to the provisions in the second paragraph in Section 50-1.06, "Anchorages and Distribution."

The first paragraph in Section 49-1.05, "Driving Equipment," of the Standard Specifications is amended to read:

- Driven piles shall be installed with impact hammers that are approved in writing by the Engineer. Impact hammers shall be steam, hydraulic, air or diesel hammers. Impact hammers shall develop sufficient energy to drive the piles at a penetration rate of not less than 3 mm per blow at the specified nominal resistance.

The seventh paragraph in Section 49-1.05, "Driving Equipment," of the Standard Specifications is amended to read:

- When necessary to obtain the specified penetration and when authorized by the Engineer, the Contractor may supply and operate one or more water jets and pumps, or furnish the necessary drilling apparatus and drill holes not greater than the least dimension of the pile to the proper depth and drive the piles therein. Jets shall not be used at locations where the stability of embankments or other improvements would be endangered. In addition, for steel piles, steel shells, or steel casings, when necessary to obtain the specified penetration or to prevent damage to the pile during installation, the Contractor shall provide special driving tips or heavier pile sections or take other measures as approved by the Engineer.

- The use of followers or underwater hammers for driving piles will be permitted if authorized in writing by the Engineer. When a follower or underwater hammer is used, its efficiency shall be verified by furnishing the first pile in each bent or footing sufficiently long and driving the pile without the use of a follower or underwater hammer.

The second paragraph in Section 49-1.07, "Driving," of the Standard Specifications is amended to read:

- Timber piles shall be fresh-headed and square and when permitted by the Engineer, the heads of the piles may be protected by means of heavy steel or wrought iron rings. During driving operations timber piling shall be restrained from lateral movement at intervals not to exceed 6 m over the length between the driving head and the ground surface. During driving operations, the timber pile shall be kept moving by continuous operation of the hammer. When the blow count exceeds either 2 times the blow count required in 300 mm, or 3 times the blow count required in 75 mm for the nominal resistance as shown on the plans, computed in conformance with the provisions in Section 49-1.08, "Pile Driving Acceptance Criteria," additional aids shall be used to obtain the specified penetration. These aids may include the use of water jets or drilling, where permitted, or the use of a larger hammer employing a heavy ram striking with a low velocity.

Section 49-1.08, "Bearing Value and Penetration," of the Standard Specifications is amended to read:

49-1.08 PILE DRIVING ACCEPTANCE CRITERIA

- Except for piles to be load tested, driven piles shall be driven to a value of not less than the nominal resistance shown on the plans unless otherwise specified in the special provisions or permitted in writing by the Engineer. In addition, when a pile tip elevation is specified, driven piles shall penetrate at least to the specified tip elevation, unless otherwise permitted in writing by the Engineer. Piles to be load tested shall be driven to the specified tip elevation.

- When the pile nominal resistance is omitted from the plans or the special provisions, timber piles shall be driven to a nominal resistance of 800 kN, and steel and concrete piles shall be driven to a nominal resistance of 1250 kN.

- The nominal resistance for driven piles shall be determined from the following formula in which " R_u " is the nominal resistance in kilonewtons, " E_r " is the manufacturer's rating for joules of energy developed by the hammer at the observed field drop height, and " N " is the number of hammer blows in the last 300 millimeters. (maximum value to be used for N is 100):

$$R_u = (7 * (E_r)^{1/2} * \log_{10} (0.83 * N)) - 550$$

The first paragraph in Section 49-2.03, "Requirements," of the Standard Specifications is amended to read:

- When preservative treatment of timber piles is required by the plans or specified in the special provisions, the treatment shall conform to the provisions in Section 58, "Preservative Treatment of Lumber, Timber and Piling," and the applicable AWWA Use Category.

The first paragraph in Section 49-2.04, "Treatment of Pile Heads," of the Standard Specifications is amended to read:

- A. An application of wood preservative conforming to the provisions in Section 58-1.04, "Wood Preservative for Manual Treatment," shall first be applied to the head of the pile and a protective cap shall then be built up by applying alternate layers of loosely woven fabric and hot asphalt or tar similar to membrane waterproofing, using 3 layers of asphalt or tar and 2 layers of fabric. The fabric shall measure at least 150 mm more in each direction than the diameter of the pile and shall be turned down over the pile and the edges secured by binding with 2 turns of No. 10 galvanized wire. The fabric shall be wired in advance of the application of the final layer of asphalt or tar, which shall extend down over the wiring.
- B. The sawed surface shall be covered with 3 applications of a hot mixture of 60 percent creosote and 40 percent roofing pitch, or thoroughly brushcoated with 3 applications of hot creosote and covered with hot roofing pitch. A covering of 3.50-mm nominal thickness galvanized steel sheet shall be placed over the coating and bent down over the sides of each pile to shed water.

Section 49-3.01, "Description," of the Standard Specifications is amended by deleting the fifth paragraph.

The sixth and seventh paragraphs in Section 49-3.01, "Description," of the Standard Specifications are amended to read:

- Except for precast prestressed concrete piles in a corrosive environment, lifting anchors used in precast prestressed concrete piles shall be removed, and the holes filled in conformance with the provisions in Section 51-1.18A, "Ordinary Surface Finish."

- Lifting anchors used in precast prestressed concrete piles in a corrosive environment shall be removed to a depth of at least 25 mm below the surface of the concrete, and the resulting hole shall be filled with epoxy adhesive before the piles are delivered to the job site. The epoxy adhesive shall conform to the provisions in Sections 95-1, "General," and 95-2.01, "Binder (Adhesive), Epoxy Resin Base (State Specification 8040-03)."

The first and second paragraphs in Section 49-4.01, "Description," of the Standard Specifications are amended to read:

- Cast-in-place concrete piles shall consist of one of the following:

- A. Steel shells driven permanently to the required nominal resistance and penetration and filled with concrete.
- B. Steel casings installed permanently to the required penetration and filled with concrete.
- C. Drilled holes filled with concrete.
- D. Rock sockets filled with concrete.

- The drilling of holes shall conform to the provisions in these specifications. Concrete filling for cast-in-place concrete piles is designated by compressive strength and shall have a minimum 28-day compressive strength of 25 MPa. At the option of the Contractor, the combined aggregate grading for the concrete shall be either the 25-mm maximum grading,

the 12.5-mm maximum grading, or the 9.5-mm maximum grading. Concrete shall conform to the provisions in Section 90, "Portland Cement Concrete," and Section 51, "Concrete Structures." Reinforcement shall conform to the provisions in Section 52, "Reinforcement."

The fourth paragraph in Section 49-4.03, "Drilled Holes," of the Standard Specifications is amended to read:

- After placing reinforcement and prior to placing concrete in the drilled hole, if caving occurs or deteriorated foundation material accumulates on the bottom of the hole, the bottom of the drilled hole shall be cleaned. The Contractor shall verify that the bottom of the drilled hole is clean.

The first and second paragraphs in Section 49-4.04, "Steel Shells," of the Standard Specifications are amended to read:

- Steel shells shall be sufficiently watertight to exclude water during the placing of concrete. The shells may be cylindrical or tapered, step-tapered, or a combination of either, with cylindrical sections.

The first paragraph in Section 49-4.05, "Inspection," of the Standard Specifications is amended to read:

- After being driven and prior to placing reinforcement and concrete therein, the steel shells shall be examined for collapse or reduced diameter at any point. Any shell which is improperly driven or broken or shows partial collapse to such an extent as to materially decrease its nominal resistance will be rejected. Rejected shells shall be removed and replaced, or a new shell shall be driven adjacent to the rejected shell. Rejected shells which cannot be removed shall be filled with concrete by the Contractor at the Contractor's expense. When a new shell is driven to replace a rejected shell, the Contractor, at the Contractor's expense, shall enlarge the footing as determined necessary by the Engineer.

The third paragraph in Section 49-5.01, "Description," of the Standard Specifications is amended to read:

- Steel pipe piles shall conform to the following requirements:
 1. Steel pipe piles less than 360 mm in diameter shall conform to the requirements in ASTM Designation: A 252, Grade 2 or 3.
 2. Steel pipe piles 360 mm and greater in diameter shall conform to the requirements in ASTM Designation: A 252, Grade 3.
 3. Steel pipe piles shall be of the nominal diameter and nominal wall thickness shown on the plans or specified in the special provisions.
 4. The carbon equivalency (CE) of steel for steel pipe piles, as defined in AWS D 1.1, Section XI5.1, shall not exceed 0.45.
 5. The sulfur content of steel for steel pipe piles shall not exceed 0.05-percent.
 6. Seams in steel pipe piles shall be complete penetration welds.

The first paragraph in Section 49-6.01, "Measurement," of the Standard Specifications is amended to read:

- The length of timber, steel, and precast prestressed concrete piles, and of cast-in-place concrete piles consisting of driven shells filled with concrete, shall be the greater of the following:
 - A. The total length in place in the completed work, measured along the longest side, from the tip of the pile to the plane of pile cut-off.
 - B. The length measured along the longest side, from the tip elevation shown on the plans or the tip elevation ordered by the Engineer, to the plane of pile cut-off.

The third paragraph in Section 49-6.02, "Payment," of the Standard Specifications is amended to read:

- The contract price paid per meter for cast-in-drilled-hole concrete piling shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all work involved in drilling holes, disposing of material resulting from drilling holes, temporarily casing holes and removing water when necessary, furnishing and placing concrete and reinforcement, and constructing reinforced concrete extensions, complete in place, to the required penetration, as shown on the plans, as specified in these specifications and in the special provisions, and as directed by the Engineer.

The seventh paragraph in Section 49-6.02, "Payment," of the Standard Specifications is amended to read

- The contract unit price paid for drive pile shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in driving timber, concrete and steel piles, driving steel shells for cast-in-place concrete piles, placing filling materials for cast-in-place concrete piles and cutting off piles, all complete in place to the required nominal resistance and penetration as shown on the plans and as specified in these specifications and the special provisions, and as directed by the Engineer.

The ninth paragraph in Section 49-6.02, "Payment," of the Standard Specifications is amended to read:

- Full compensation for all jetting, drilling, providing special driving tips or heavier sections for steel piles or shells, or other work necessary to obtain the specified penetration and nominal resistance of the piles, for predrilling holes through embankment and filling the space remaining around the pile with sand or pea gravel, for disposing of material resulting from jetting, drilling or predrilling holes, and for all excavation and backfill involved in constructing concrete extensions as shown on the plans, and as specified in these specifications and the special provisions, and as directed by the Engineer shall be considered as included in the contract unit price paid for drive pile or in the contract price paid per meter for cast-in-drilled-hole concrete piling, and no additional compensation will be allowed therefor.

Section 49-6.02, "Payment," of the Standard Specifications is amended by adding the following paragraphs:

- Full compensation for furnishing and placing additional testing reinforcement, for load test anchorages, and for cutting off test piles, shall be considered as included in the contract price paid for piling of the type or class shown in the Engineer's Estimate, and no additional compensation will be allowed.
- No additional compensation or extension of time will be made for additional foundation investigation, installation and testing of indicator piling, cutting off piling and restoring the foundation investigation and indicator pile sites, and review of request by the Engineer.

SECTION 50: PRESTRESSING CONCRETE

Issue Date: November 18, 2002

Section 50-1.02, "Drawings," of the Standard Specifications is amended by adding the following paragraph after the second paragraph:

- Each working drawing submittal shall consist of plans for a single bridge or portion thereof. For multi-frame bridges, each frame shall require a separate working drawing submittal.

Section 50-1.05, "Prestressing Steel," of the Standard Specifications is amended to read:

- Prestressing steel shall be high-tensile wire conforming to the requirements in ASTM Designation: A 421, including Supplement I; high-tensile seven-wire strand conforming to the requirements in ASTM Designation: A 416; or uncoated high-strength steel bars conforming to the requirements in ASTM Designation: A 722, including all supplementary requirements. The maximum mass requirement of ASTM Designation: A 722 will not apply.

- In addition to the requirements of ASTM Designation: A 722, for deformed bars, the reduction of area shall be determined from a bar from which the deformations have been removed. The bar shall be machined no more than necessary to remove the deformations over a length of 300 mm, and reduction will be based on the area of the machined portion.

- In addition to the requirements specified herein, epoxy-coated seven-wire prestressing steel strand shall be grit impregnated and filled in conformance with the requirements in ASTM Designation: A 882/A 882M, including Supplement I, and the following:

- A. The coating material shall be on the Department's list of approved coating materials for epoxy-coated strand, available from the Transportation Laboratory.
- B. The film thickness of the coating after curing shall be 381 μm to 1143 μm .
- C. Prior to coating the strand, the Contractor shall furnish to the Transportation Laboratory a representative 230-g sample from each batch of epoxy coating material to be used. Each sample shall be packaged in an airtight container identified with the manufacturer's name and batch number.

- D. Prior to use of the epoxy-coated strand in the work, written certifications referenced in ASTM Designation: A 882/A 882M, including a representative load-elongation curve for each size and grade of strand to be used and a copy of the quality control tests performed by the manufacturer, shall be furnished to the Engineer.
- E. In addition to the requirements in Section 50-1.10, "Samples for Testing," four 1.5-m long samples of coated strand and one 1.5-m long sample of uncoated strand of each size and reel shall be furnished to the Engineer for testing. These samples, as selected by the Engineer, shall be representative of the material to be used in the work.
- F. Epoxy-coated strand shall be cut using an abrasive saw.
- G. All visible damage to coatings caused by shipping and handling, or during installation, including cut ends, shall be repaired in conformance with the requirements in ASTM Designation: A 882/A 882M. The patching material shall be furnished by the manufacturer of the epoxy powder and shall be applied in conformance with the manufacturer's written recommendations. The patching material shall be compatible with the original epoxy coating material and shall be inert in concrete.
- All bars in any individual member shall be of the same grade, unless otherwise permitted by the Engineer.
 - When bars are to be extended by the use of couplers, the assembled units shall have a tensile strength of not less than the manufacturer's minimum guaranteed ultimate tensile strength of the bars. Failure of any one sample to meet this requirement will be cause for rejection of the heat of bars and lot of couplers. The location of couplers in the member shall be subject to approval by the Engineer.
 - Wires shall be straightened if necessary to produce equal stress in all wires or wire groups or parallel lay cables that are to be stressed simultaneously or when necessary to ensure proper positioning in the ducts.
 - Where wires are to be button-headed, the buttons shall be cold formed symmetrically about the axes of the wires. The buttons shall develop the minimum guaranteed ultimate tensile strength of the wire. No cold forming process shall be used that causes indentations in the wire. Buttonheads shall not contain wide open splits, more than 2 splits per head, or splits not parallel with the axis of the wire.
 - Prestressing steel shall be protected against physical damage and rust or other results of corrosion at all times from manufacture to grouting or encasing in concrete. Prestressing steel that has sustained physical damage at any time shall be rejected. The development of visible rust or other results of corrosion shall be cause for rejection, when ordered by the Engineer.
 - Epoxy-coated prestressing steel strand shall be covered with an opaque polyethylene sheeting or other suitable protective material to protect the strand from exposure to sunlight, salt spray, and weather. For stacked coils, the protective covering shall be draped around the perimeter of the stack. The covering shall be adequately secured; however, it should allow for air circulation around the strand to prevent condensation under the covering. Epoxy-coated strand shall not be stored within 300 m of ocean or tidal water for more than 2 months.
 - Prestressing steel shall be packaged in containers or shipping forms for the protection of the steel against physical damage and corrosion during shipping and storage. Except for epoxy-coated strand, a corrosion inhibitor which prevents rust or other results of corrosion, shall be placed in the package or form, or shall be incorporated in a corrosion inhibitor carrier type packaging material, or when permitted by the Engineer, may be applied directly to the steel. The corrosion inhibitor shall have no deleterious effect on the steel or concrete or bond strength of steel to concrete. Packaging or forms damaged from any cause shall be immediately replaced or restored to original condition.
 - The shipping package or form shall be clearly marked with a statement that the package contains high-strength prestressing steel, and the type of corrosion inhibitor used, including the date packaged.
 - Prestressing steel for post-tensioning which is installed in members prior to placing and curing of the concrete, and which is not epoxy-coated, shall be continuously protected against rust or other results of corrosion, until grouted, by means of a corrosion inhibitor placed in the ducts or applied to the steel in the duct. The corrosion inhibitor shall conform to the provisions specified herein.
 - When steam curing is used, prestressing steel for post-tensioning shall not be installed until the steam curing is completed.
 - Water used for flushing ducts shall contain either quick lime (calcium oxide) or slaked lime (calcium hydroxide) in the amount of 0.01-kg/L. Compressed air used to blow out ducts shall be oil free.
 - When prestressing steel for post-tensioning is installed in the ducts after completion of concrete curing, and if stressing and grouting are completed within 10 days after the installation of the prestressing steel, rust which may form during those 10 days will not be cause for rejection of the steel. Prestressing steel installed, tensioned, and grouted in this manner, all within 10 days, will not require the use of a corrosion inhibitor in the duct following installation of the prestressing steel. Prestressing steel installed as above but not grouted within 10 days shall be subject to all the requirements in this section pertaining to corrosion protection and rejection because of rust. The requirements in this section pertaining to tensioning and grouting within 10 days shall not apply to epoxy-coated prestressing steel strand.
 - Any time prestressing steel for pretensioning is placed in the stressing bed and is exposed to the elements for more than 36 hours prior to encasement in concrete, adequate measures shall be taken by the Contractor, as approved by the Engineer, to protect the steel from contamination or corrosion.

- After final fabrication of the seven-wire prestressing steel strand, no electric welding of any form shall be performed on the prestressing steel. Whenever electric welding is performed on or near members containing prestressing steel, the welding ground shall be attached directly to the steel being welded.
- Pretensioned prestressing steel shall be cut off flush with the end of the member. For epoxy-coated prestressing steel, only abrasive saws shall be used to cut the steel. The exposed ends of the prestressing steel and a 25-mm strip of adjoining concrete shall be cleaned and painted. Cleaning shall be by wire brushing or abrasive blast cleaning to remove all dirt and residue on the metal or concrete surfaces. Immediately after cleaning, the surfaces shall be covered with one application of unthinned zinc-rich primer (organic vehicle type) conforming to the provisions in Section 91, "Paint," except that 2 applications shall be applied to surfaces which will not be covered by concrete or mortar. Aerosol cans shall not be used. The paint shall be thoroughly mixed at the time of application and shall be worked into any voids in the prestressing tendons.

The thirteenth paragraph in Section 50-1.08, "Prestressing," of the Standard Specifications is amended to read:

- Prestressing steel in pretensioned members shall not be cut or released until the concrete in the member has attained a compressive strength of not less than the value shown on the plans or 28 MPa, whichever is greater. In addition to these concrete strength requirements, when epoxy-coated prestressing steel strand is used, the steel shall not be cut or released until the temperature of the concrete surrounding the strand is less than 65°C, and falling.

The fifth paragraph in Section 50-1.10, "Samples for Testing," of the Standard Specifications is amended to read:

- The following samples of materials and tendons, selected by the Engineer from the prestressing steel at the plant or jobsite, shall be furnished by the Contractor to the Engineer well in advance of anticipated use:
 - A. For wire or bars, one 2-m long sample and for strand, one 1.5-m long sample, of each size shall be furnished for each heat or reel.
 - B. For epoxy-coated strand, one 1.5-m long sample of uncoated strand of each size shall be furnished for each reel.
 - C. If the prestressing tendon is a bar, one 2-m long sample shall be furnished and in addition, if couplers are to be used with the bar, two 1.25-m long samples of bar, equipped with one coupler and fabricated to fit the coupler, shall be furnished.

The second paragraph in Section 50-1.11, "Payment," of the Standard Specifications is amended to read:

- The contract lump sum prices paid for prestressing cast-in-place concrete of the types listed in the Engineer's Estimate shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all work involved in furnishing, placing, and tensioning the prestressing steel in cast-in-place concrete structures, complete in place, as shown on the plans, as specified in these specifications and the special provisions, and as directed by the Engineer.

SECTION 51: CONCRETE STRUCTURES

Issue Date: January 28, 2005

The eleventh paragraph in Section 51-1.05, "Forms," of the Standard Specifications is amended to read:

- Form panels for exposed surfaces shall be furnished and placed in uniform widths of not less than 0.9-m and in uniform lengths of not less than 1.8 m, except at the end of continuously formed surfaces where the final panel length required is less than 1.8 m. Where the width of the member formed is less than 0.9-m, the width of the panels shall be not less than the width of the member. Panels shall be arranged in symmetrical patterns conforming to the general lines of the structure. Except when otherwise provided herein or shown on the plans, panels for vertical surfaces shall be placed with the long dimension horizontal and with horizontal joints level and continuous. Form panels for curved surfaces of columns shall be continuous for a minimum of one quarter of the circumference, or 1.8 m. For walls with sloping footings which do not abut other walls, panels may be placed with the long dimension parallel to the footing. Form panels on each side of the panel joint shall be precisely aligned, by means of supports or fasteners common to both panels, to result in a continuous unbroken concrete plane surface. When prefabricated soffit panels are used, form filler panels joining prefabricated panels shall have a uniform minimum width of 0.3-m and shall produce a smooth uniform surface with consistent longitudinal joint lines between the prefabricated panels.

The first and second paragraph in Section 51-1.06A, "Falsework Design and Drawings," of the Standard Specifications are amended to read:

- The Contractor shall submit to the Engineer working drawings and design calculations for falsework proposed for use at bridges. For bridges where the height of any portion of the falsework, as measured from the ground line to the soffit of the superstructure, exceeds 4.25 m; or where any individual falsework clear span length exceeds 4.85 m; or where provision for vehicular, pedestrian, or railroad traffic through the falsework is made; the drawings shall be signed by an engineer who is registered as a Civil Engineer in the State of California. Six sets of the working drawings and 2 copies of the design calculations shall be furnished. Additional working drawings and design calculations shall be submitted to the Engineer when specified in "Railroad Relations and Insurance" of the special provisions.
- The falsework drawings shall include details of the falsework erection and removal operations showing the methods and sequences of erection and removal and the equipment to be used. The details of the falsework erection and removal operations shall demonstrate the stability of all or any portions of the falsework during all stages of the erection and removal operations.

The seventh paragraph in Section 51-1.06A, "Falsework Design and Drawings," of the Standard Specifications is amended to read:

- In the event that several falsework plans are submitted simultaneously, or an additional plan is submitted for review before the review of a previously submitted plan has been completed, the Contractor shall designate the sequence in which the plans are to be reviewed. In such event, the time to be provided for the review of any plan in the sequence shall be not less than the review time specified above for that plan, plus 2 weeks for each plan of higher priority which is still under review. A falsework plan submittal shall consist of plans for a single bridge or portion thereof. For multi-frame bridges, each frame shall require a separate falsework plan submittal.

Section 51-1.06A, "Falsework Design and Drawings," of the Standard Specifications is amended by adding the following paragraphs:

- If structural composite lumber is proposed for use, the falsework drawings shall clearly identify the structural composite lumber members by grade (E value), species, and type. The Contractor shall provide technical data from the manufacturer showing the tabulated working stress values of the composite lumber. The Contractor shall furnish a certificate of compliance as specified in Section 6-1.07, "Certificates of Compliance," for each delivery of structural composite lumber to the project site.
- For falsework piles with a calculated loading capacity greater than 900 kN, the falsework piles shall be designed by an engineer who is registered as either a Civil Engineer or a Geotechnical Engineer in the State of California, and the calculations shall be submitted to the Engineer.

The first paragraph in Section 51-1.06A(1), "Design Loads," of the Standard Specifications is amended to read:

- The design load for falsework shall consist of the sum of dead and live vertical loads, and an assumed horizontal load. The minimum total design load for any falsework, including members that support walkways, shall be not less than 4800 N/m² for the combined live and dead load regardless of slab thickness.

The eighth paragraph in Section 51-1.06A(1), "Design Loads," of the Standard Specifications is amended to read:

- In addition to the minimum requirements specified in this Section 51-1.06A, falsework for box girder structures with internal falsework bracing systems using flexible members capable of withstanding tensile forces only, shall be designed to include the vertical effects caused by the elongation of the flexible member and the design horizontal load combined with the dead and live loads imposed by concrete placement for the girder stems and connected bottom slabs. Falsework comprised of individual steel towers with bracing systems using flexible members capable of withstanding tensile forces only to resist overturning, shall be exempt from these additional requirements.

The third paragraph in Section 51-1.06B, "Falsework Construction," of the Standard Specifications is amended to read:

- When falsework is supported on piles, the piles shall be driven and the actual nominal resistance assessed in conformance with the provisions in Section 49, "Piling."

Section 51-1.06B, "Falsework Construction," of the Standard Specifications is amended by adding the following paragraphs:

- For falsework piles with a calculated nominal resistance greater than 1800 kN, the Contractor shall conduct dynamic monitoring of pile driving and generate field acceptance criteria based on a wave equation analysis. These analyses shall be signed by an engineer who is registered as a Civil Engineer in the State of California and submitted to the Engineer prior to completion of falsework erection.

- Prior to the placement of falsework members above the stringers, the final bracing system for the falsework shall be installed.

Section 51-1.06C, "Removing Falsework," of the Standard Specifications is amended by adding the following paragraph:

- The falsework removal operation shall be conducted in such a manner that any portion of the falsework not yet removed remains in a stable condition at all times.

The sixth paragraph in Section 51-1.09, "Placing Concrete," of the Standard Specifications is amended to read:

- Vibrators used to consolidate concrete containing epoxy-coated bar reinforcement or epoxy-coated prestressing steel shall have a resilient covering to prevent damage to the epoxy-coating on the reinforcement or prestressing steel.

The third sentence of the fourth paragraph in Section 51-1.12D, "Sheet Packing, Preformed Pads and Board Fillers," of the Standard Specifications is amended to read:

Surfaces of expanded polystyrene against which concrete is placed shall be faced with hardboard.

Section 51-1.12F, "Sealed Joints," of the Standard Specifications is amended by adding the following paragraph:

- The opening of the joints at the time of placing shall be that shown on the plans adjusted for temperature. Care shall be taken to avoid impairment of the clearance in any manner.

The first paragraph in Section 51-1.12F, "Sealed Joints," of the Standard Specifications is amended to read:

- Where shown on the plans, joints in structures shall be sealed with joint seals, joint seal assemblies, or seismic joints in conformance with the details shown on the plans, the provisions in these specifications, and the special provisions.

The fourth paragraph in Section 51-1.12F, "Sealed Joints," of the Standard Specifications is amended to read:

- Joint seal assemblies and seismic joints shall consist of metal or metal and elastomeric assemblies which are anchored or cast into a recess in the concrete over the joint. Strip seal joint seal assemblies consist of only one joint cell. Modular unit joint seal assemblies consist of more than one joint cell.

The fifth paragraph in Section 51-1.12F, "Sealed Joints," of the Standard Specifications is amended to read:

- The Movement Rating (MR) shall be measured normal to the longitudinal axis of the joint. The type of seal to be used for the MR shown on the plans shall be as follows:

Movement Rating (MR)	Seal Type
MR ≤ 15 mm	Type A or Type B
15 mm < MR ≤ 30 mm	Type A (silicone only) or Type B
30 mm < MR ≤ 50 mm	Type B
50 mm < MR ≤ 100 mm	Joint Seal Assembly (Strip Seal)
MR > 100 mm	Joint Seal Assembly (Modular Unit) or Seismic Joint

The second paragraph in Section 51-1.12F(3)(b), "Type B Seal," of the Standard Specifications is amended to read:

- The preformed elastomeric joint seal shall conform to the requirements in ASTM Designation: D 2628 and the following:

- A. The seal shall consist of a multi-channel, nonporous, homogeneous material furnished in a finished extruded form.
- B. The minimum depth of the seal, measured at the contact surface, shall be at least 95 percent of the minimum uncompressed width of the seal as designated by the manufacturer.
- C. When tested in conformance with the requirements in California Test 673 for Type B seals, joint seals shall provide a Movement Rating (MR) of not less than that shown on the plans.
- D. The top and bottom edges of the joint seal shall maintain continuous contact with the sides of the groove over the entire range of joint movement.
- E. The seal shall be furnished full length for each joint with no more than one shop splice in any 18-m length of seal.
- F. The Contractor shall demonstrate the adequacy of the procedures to be used in the work before installing seals in the joints.
- G. Shop splices and field splices shall have no visible offset of exterior surfaces, and shall show no evidence of bond failure.
- H. At all open ends of the seal that would admit water or debris, each cell shall be filled to a depth of 80 mm with commercial quality open cell polyurethane foam, or closed by other means subject to approval by the Engineer.

Section 51-1.12F(3)(c), "Joint Seal Assemblies," of the Standard Specifications is amended to read:

(c) Joint Seal Assemblies and Seismic Joints

- Joint seal assemblies and seismic joints shall be furnished and installed in joints in bridge decks as shown on the plans and as specified in the special provisions.

The eighth paragraph in Section 51-1.12H(1), "Plain and Fabric Reinforced Elastomeric Bearing Pads," of the Standard Specifications is amended to read:

- The elastomer, as determined from test specimens, shall conform to the following:

Test	ASTM Designation	Requirement
Tensile strength, MPa	D 412	15.5 Min.
Elongation at break, percent	D 412	350 Min.
Compression set, 22 h at 70°C, percent	D 395 (Method B)	25 Max.
Tear strength, kN/m	D 624 (Die C)	31.5 Min.
Hardness (Type A)	D 2240 with 2 kg. mass	55 ±5
Ozone resistance 20% strain, 100 h at 40°C ±2°C	D 1149 (except 100 ±20 parts per 100 000 000)	No cracks
Instantaneous thermal stiffening at -40°C	D 1043	Shall not exceed 4 times the stiffness measured at 23°C
Low temperature brittleness at -40°C	D 746 (Procedure B)	Pass

The table in the ninth paragraph of Section 51-1.12H(1), "Plain and Fabric Reinforced Elastomeric Bearing Pads," of the Standard Specifications is amended to read:

Tensile strength, percent	-15
Elongation at break, percent	-40; but not less than 300% total elongation of the material
Hardness, points	+10

The first paragraph in Section 51-1.12H(2), "Steel Reinforced Elastomeric Bearings," of the Standard Specifications is amended to read:

- Steel reinforced elastomeric bearings shall conform to the requirements for steel-laminated elastomeric bearings in ASTM Designation: D 4014 and the following:

- A. The bearings shall consist of alternating steel laminates and internal elastomer laminates with top and bottom elastomer covers. Steel laminates shall have a nominal thickness of 1.9 mm (14 gage). Internal elastomer laminates

shall have a thickness of 12 mm, and top and bottom elastomer covers shall each have a thickness of 6 mm. The combined thickness of internal elastomer laminates and top and bottom elastomer covers shall be equal to the bearing pad thickness shown on the plans. The elastomer cover to the steel laminates at the sides of the bearing shall be 3 mm. If guide pins or other devices are used to control the side cover over the steel laminates, any exposed portions of the steel laminates shall be sealed by vulcanized patching. The length, width, or diameter of the bearings shall be as shown on the plans.

- B. The total thickness of the bearings shall be equal to the thickness of elastomer laminates and covers plus the thickness of the steel laminates.
- C. Elastomer for steel reinforced elastomeric bearings shall conform to the provisions for elastomer in Section 51-1.12H(1), "Plain and Fabric Reinforced Elastomeric Bearing Pads."
- D. A Certificate of Compliance conforming to the provisions in Section 6-1.07, "Certificates of Compliance," shall be furnished to the Engineer certifying that the bearings to be furnished conform to all of the above provisions. The Certificate of Compliance shall be supported by a certified copy of the results of tests performed by the manufacturer on the bearings.
- E. One sample bearing shall be furnished to the Engineer from each lot of bearings to be furnished for the contract. Samples shall be available at least 3 weeks in advance of intended use. The sample bearing shall be one of the following:

Bearing Pad Thickness as Shown on the Plans	Sample Bearing
≤ 50 mm	Smallest complete bearing shown on the plans
> 50 mm	* 57 ± 3 mm thick sample not less than 200 mm x 305 mm in plan and cut by the manufacturer from the center of one of the thickest complete bearings

* The sample bearing plus remnant parts of the complete bearing shall be furnished to the Engineer.

- F. A test specimen taken from the sample furnished to the Engineer will be tested in conformance with the requirements in California Test 663. Specimens tested shall show no indication of loss of bond between the elastomer and steel laminates.

The fourth paragraph in Section 51-1.14, "Waterstops," of the Standard Specifications is amended to read:

- Neoprene shall be manufactured from a vulcanized elastomeric compound containing neoprene as the sole elastomer and shall conform to the following:

Test	ASTM Designation	Requirement
Tensile strength, MPa	D 412	13.8 Min.
Elongation at break, percent	D 412	300 Min.
Compression set, 22 h at 70°C, percent	D 395 (Method B)	30 Max.
Tear strength, kN/m	D 624 (Die C)	26.3 Min.
Hardness (Type A)	D 2240	55±5
Ozone resistance 20% strain, 100 h at 38°C ±1°C	D 1149 (except 100±20 parts per 100 000 000)	No cracks
Low temperature brittleness at -40°C	D 746 (Procedure B)	Pass
Flame resistance	C 542	Must not propagate flame
Oil Swell, ASTM Oil #3, 70 h at 100°C, volume change, percent	D 471	80 Max.
Water absorption, immersed 7 days at 70°C, change in mass, percent	D 471	15 Max.

The first sentence of the fourth paragraph in Section 51-1.17, "Finish Bridge Decks," of the Standard Specifications is amended to read:

- The smoothness of completed roadway surfaces of structures, approach slabs and the adjacent 15 m of approach pavement, and the top surfaces of concrete decks which are to be covered with another material, will be tested by the Engineer with a bridge profilograph in conformance with the requirements in California Test 547 and the requirements herein.

Section 51-1.17, "Finishing Bridge Decks," of the Standard Specifications is amended by deleting the seventh, thirteenth and fourteenth paragraphs.

The fourteenth paragraph in Section 51-1.23, "Payment," of the Standard Specifications is amended by deleting "and injecting epoxy in cracks".

SECTION 52: REINFORCEMENT

Issue Date: November 2, 2004

The first paragraph in Section 52-1.02A, "Bar Reinforcement," of the Standard Specifications is amended to read:

- Reinforcing bars shall be low-alloy steel deformed bars conforming to the requirements in ASTM Designation: A 706/A 706M, except that deformed or plain billet-steel bars conforming to the requirements in ASTM Designation: A 615/A 615M, Grade 280 or 420, may be used as reinforcement in the following 5 categories:

- A. Slope and channel paving,
- B. Minor structures,
- C. Sign and signal foundations (pile and spread footing types),
- D. Roadside rest facilities, and
- E. Concrete barrier Type 50 and Type 60 series and temporary railing.

The third paragraph in Section 52-1.04, "Inspection," of the Standard Specifications is amended to read:

- A Certificate of Compliance conforming to the provisions in Section 6-1.07, "Certificates of Compliance," shall also be furnished for each shipment of epoxy-coated bar reinforcement or wire reinforcement certifying that the coated reinforcement conforms to the requirements in ASTM Designation: A 775/A 775M or A 884/A 884M respectively, and the provisions in Section 52-1.02B, "Epoxy-coated Reinforcement." The Certificate of Compliance shall include all of the certifications specified in ASTM Designation: A 775/A 775M or A 884/A 884M respectively.

Section 52-1.07 "Placing," of the Standard Specifications is amended by deleting item C of the third paragraph.

The eleventh paragraph in Section 52-1.07, "Placing," of the Standard Specifications is amended to read:

- Attention is directed to the provisions in Section 7-1.09, "Public Safety." Whenever a portion of an assemblage of bar reinforcing steel that is not encased in concrete exceeds 6 m in height, the Contractor shall submit to the Engineer for approval, in accordance with the provisions in Section 5-1.02, "Plans and Working Drawings," working drawings and design calculations for the temporary support system to be used. The working drawings and design calculations shall be signed by an engineer who is registered as a Civil Engineer in the State of California. The temporary support system shall be designed to resist all expected loads and shall be adequate to prevent collapse or overturning of the assemblage. If the installation of forms or other work requires revisions to or temporary release of any portion of the temporary support system, the working drawings shall show the support system to be used during each phase of construction. The minimum horizontal wind load to be applied to the bar reinforcing steel assemblage, or to a combined assemblage of reinforcing steel and forms, shall be the sum of the products of the wind impact area and the applicable wind pressure value for each height zone. The wind impact area is the total projected area of the cage normal to the direction of the applied wind. Wind pressure values shall be determined from the following table:

Height Zone (Meters above ground)	Wind Pressure Value (Pa)
0-9.0	960
9.1-15.0	1200
15.1-30.0	1440
Over 30	1675

Section 52-1.08 "Splicing," of the Standard Specifications is amended to read:

52-1.08 SPLICING

- Splices of reinforcing bars shall consist of lap splices, service splices, or ultimate butt splices.
- Splicing of reinforcing bars will not be permitted at a location designated on the plans as a "No-Splice Zone." At the option of the Contractor, reinforcing bars may be continuous at locations where splices are shown on the plans. The location of splices, except where shown on the plans, shall be determined by the Contractor using available commercial lengths where practicable.
 - Unless otherwise shown on the plans, splices in adjacent reinforcing bars at any particular section shall be staggered. The minimum distance between staggered lap splices or mechanical lap splices shall be the same as the length required for a lap splice in the largest bar. The minimum distance between staggered butt splices shall be 600 mm, measured between the midpoints of the splices along a line which is centered between the axes of the adjacent bars.

52-1.08A Lap Splicing Requirements

- Splices made by lapping shall consist of placing reinforcing bars in contact and wiring them together, maintaining the alignment of the bars and the minimum clearances. Should the Contractor elect to use a butt welded or mechanical splice at a location not designated on the plans as requiring a service or ultimate butt splice, this splice shall conform to the testing requirements for service splice.
 - Reinforcing bars shall not be spliced by lapping at locations where the concrete section is not sufficient to provide a minimum clear distance of 50 mm between the splice and the nearest adjacent bar. The clearance to the surface of the concrete specified in Section 52-1.07, "Placing," shall not be reduced.
 - Reinforcing bars Nos. 43 and 57 shall not be spliced by lapping.
 - Where ASTM Designations: A 615/A 615M, Grade 420 or A 706/A 706M reinforcing bars are required, the length of lap splices shall be as follows: Reinforcing bars No. 25 or smaller shall be lapped at least 45 diameters of the smaller bar joined; and reinforcing bars Nos. 29, 32, and 36 shall be lapped at least 60 diameters of the smaller bar joined, except when otherwise shown on the plans.
 - Where ASTM Designation: A 615/A 615M, Grade 280 reinforcing bars are permitted, the length of lap splices shall be as follows: Reinforcing bars No. 25 or smaller shall be lapped at least 30 diameters of the smaller bar joined; and reinforcing bars Nos. 29, 32, and 36 shall be lapped at least 45 diameters of the smaller bar joined, except when otherwise shown on the plans.
 - Splices in bundled bars shall conform to the following:
 - A. In bundles of 2 bars, the length of the lap splice shall be the same as the length of a single bar lap splice.
 - B. In bundles of 3 bars, the length of the lap splice shall be 1.2 times the length of a single bar lap splice.
- Welded wire fabric shall be lapped such that the overlap between the outermost cross wires is not less than the larger of:
 - A. 150 mm,
 - B. The spacing of the cross wires plus 50 mm, or
 - C. The numerical value of the longitudinal wire size (MW-Size Number) times 370 divided by the spacing of the longitudinal wires in millimeters.

52-1.08B Service Splicing and Ultimate Butt Splicing Requirements

- Service splices and ultimate butt splices shall be either butt welded or mechanical splices, shall be used at the locations shown on the plans, and shall conform to the requirements of these specifications and the special provisions.

52-1.08B(1) Mechanical Splices

- Mechanical splices to be used in the work shall be on the Department's current prequalified list before use. The prequalified list can be obtained from the Department's internet site listed in the special provisions or by contacting the Transportation Laboratory directly.
- When tested in conformance with the requirements in California Test 670, the total slip shall not exceed the values listed in the following table:

Reinforcing Bar Number	Total Slip (µm)
13	250
16	250
19	250
22	350
25	350
29	350
32	450
36	450
43	600
57	750

- Slip requirements shall not apply to mechanical lap splices, splices that are welded, or splices that are used on hoops.
- Splicing procedures shall be in conformance with the manufacturer's recommendations, except as modified in this section. Splices shall be made using the manufacturer's standard equipment, jigs, clamps, and other required accessories.
- Splice devices shall have a clear coverage of not less than 40 mm measured from the surface of the concrete to the outside of the splice device. Stirrups, ties, and other reinforcement shall be adjusted or relocated, and additional reinforcement shall be placed, if necessary, to provide the specified clear coverage to reinforcement.
- The Contractor shall furnish the following information for each shipment of splice material in conformance with the provisions in Section 6-1.07, "Certificates of Compliance:"
 - A. The type or series identification of the splice material including tracking information for traceability.
 - B. The bar grade and size number to be spliced.
 - C. A copy of the manufacturer's product literature giving complete data on the splice material and installation procedures.
 - D. A statement that the splicing systems and materials used in conformance with the manufacturer's installation procedures will develop the required tensile strengths, based on the nominal bar area, and will conform to the total slip requirements and the other requirements in these specifications.
 - E. A statement that the splice material conforms to the type of mechanical splice in the Department's current prequalified list.

52-1.08B(2) Butt Welded Splices

- Except for resistance butt welds, butt welded splices of reinforcing bars shall be complete joint penetration butt welds conforming to the requirements in AWS D 1.4, and these specifications.
- Welders and welding procedures shall be qualified in conformance with the requirements in AWS D 1.4.
- Only the joint details and dimensions as shown in Figure 3.2, "Direct Butt Joints," of AWS D 1.4, shall be used for making complete joint penetration butt welds of bar reinforcement. Split pipe backing shall not be used.
- Butt welds shall be made with multiple weld passes using a stringer bead without an appreciable weaving motion. The maximum stringer bead width shall be 2.5 times the diameter of the electrode and slagging shall be performed between each weld pass. Weld reinforcement shall not exceed 4 mm in convexity.
- Electrodes used for welding shall meet the minimum Charpy V-notch impact requirement of 27°J at -20°C.
- For welding of bars conforming to the requirements of ASTM Designation: A 615/A 615M, Grade 280 or Grade 420, the requirements of Table 5.2, "Minimum Preheat and Interpass Temperatures," of AWS D 1.4 are superseded by the following:

The minimum preheat and interpass temperatures shall be 200°C for Grade 280 bars and 300°C for Grade 420 bars. Immediately after completing the welding, at least 150 mm of the bar on each side of the splice shall be covered by an insulated wrapping to control the rate of cooling. The insulated wrapping shall remain in place until the bar has cooled below 90°C.

- When welding different grades of reinforcing bars, the electrode shall conform to Grade 280 bar requirements and the preheat shall conform to the Grade 420 bar requirements.
- In the event that any of the specified preheat, interpass, and post weld cooling temperatures are not met, all weld and heat affected zone metal shall be removed and the splice rewelded.
- Welding shall be protected from air currents, drafts, and precipitation to prevent loss of heat or loss of arc shielding. The method of protecting the welding area from loss of heat or loss of arc shielding shall be subject to approval by the Engineer.
- Reinforcing bars shall not be direct butt spliced by thermite welding.
- Procedures to be used in making welded splices in reinforcing bars, and welders employed to make splices in reinforcing bars, shall be qualified by tests performed by the Contractor on sample splices of the type to be used, before making splices to be used in the work.

52-1.08B(3) Resistance Butt Welds

- Shop produced resistance butt welds shall be produced by a fabricator who is approved by the Transportation Laboratory. The list of approved fabricators can be obtained from the Department's internet site or by contacting the Transportation Laboratory directly.
- Before manufacturing hoops using resistance butt welding, the Contractor shall submit to the Engineer the manufacturer's Quality Control (QC) manual for the fabrication of hoops. As a minimum, the QC manual shall include the following:
 - A. The pre-production procedures for the qualification of material and equipment.
 - B. The methods and frequencies for performing QC procedures during production.
 - C. The calibration procedures and calibration frequency for all equipment.
 - D. The welding procedure specification (WPS) for resistance welding.
 - E. The method for identifying and tracking lots.

52-1.08C Service Splice and Ultimate Butt Splice Testing Requirements

- The Contractor shall designate in writing a splicing Quality Control Manager (QCM). The QCM shall be responsible directly to the Contractor for 1) the quality of all service and ultimate butt splicing including the inspection of materials and workmanship performed by the Contractor and all subcontractors; and 2) submitting, receiving, and approving all correspondence, required submittals, and reports regarding service and ultimate splicing to and from the Engineer.
- The QCM shall not be employed or compensated by any subcontractor, or by other persons or entities hired by subcontractors, who will provide other services or materials for the project. The QCM may be an employee of the Contractor.
- Testing on prequalification and production sample splices shall be performed at the Contractor's expense, at an independent qualified testing laboratory. The laboratory shall not be employed or compensated by any subcontractor, or by other persons or entities hired by subcontractors who will provide other services or materials for the project, and shall have the following:
 - A. Proper facilities, including a tensile testing machine capable of breaking the largest size of reinforcing bar to be tested with minimum lengths as shown in this section.
 - B. A device for measuring the total slip of the reinforcing bars across the splice to the nearest 25 μm , that, when placed parallel to the longitudinal axis of the bar is able to simultaneously measure movement across the splice at 2 locations 180 degrees apart.
 - C. Operators who have received formal training for performing the testing requirements of ASTM Designation: A 370 and California Test 670.
 - D. A record of annual calibration of testing equipment performed by an independent third party that has 1) standards that are traceable to the National Institute of Standards and Technology, and 2) a formal reporting procedure, including published test forms.
- The Contractor shall provide samples for quality assurance testing in conformance with the provisions in these specifications and the special provisions.
 - Prequalification and production sample splices shall be 1) a minimum length of 1.5 meters for reinforcing bars No. 25 or smaller, and 2 meters for reinforcing bars No. 29 or larger, with the splice located at mid-point; and 2) suitably identified before shipment with weatherproof markings that do not interfere with the Engineer's tamper-proof markings or seals. Splices that show signs of tampering will be rejected.
 - Shorter length sample splice bars may be furnished if approved in writing by the Engineer.

- The Contractor shall ensure that sample splices are properly secured and transported to the testing laboratory in such a manner that no alterations to the physical conditions occur during transportation. Sample splices shall be tested in the same condition as received. No modifications to the sample splices shall be made before testing.
- Each set or sample splice, as defined herein, shall be identified as representing either a prequalification or production test sample splice.
- For the purpose of production testing, a lot of either service splices or ultimate butt splices is defined as 1) 150, or fraction thereof, of the same type of mechanical splices used for each bar size and each bar deformation pattern that is used in the work, or 2) 150, or fraction thereof, of complete joint penetration butt welded splices or resistance butt welded splices for each bar size used in the work. If different diameters of hoop reinforcement are shown on the plans, separate lots shall be used for each different hoop diameter.
- Whenever a lot of splices is rejected, the rejected lot and subsequent lots of splices shall not be used in the work until 1) the QCM performs a complete review of the Contractor's quality control process for these splices, 2) a written report is submitted to the Engineer describing the cause of failure for the splices in this lot and provisions for preventing similar failures in future lots, and 3) the Engineer has provided the Contractor with written notification that the report is acceptable. The Engineer shall have 3 working days after receipt of the report to provide notification to the Contractor. In the event the Engineer fails to provide notification within the time allowed, and if, in the opinion of the Engineer, completion of the work is delayed or interfered with by reason of the Engineer's delay in providing notification, the Contractor will be compensated for any resulting loss, and an extension of time will be granted in the same manner as provided for in Section 8-1.09, "Right of Way Delays."

52-1.08C(1) Splice Prequalification Report

- Before using any service splices or ultimate butt splices in the work, the Contractor shall submit a Splice Prequalification Report. The report shall include splice material information, names of the operators who will be performing the splicing, and descriptions of the positions, locations, equipment, and procedures that will be used in the work.
- The Splice Prequalification Report shall also include certifications from the fabricator for prequalifications of operators and procedures based on sample tests performed no more than 2 years before submitting the report. Each operator shall be certified by performing 2 sample splices for each bar size of each splice type that the operator will be performing in the work. For deformation-dependent types of splice devices, each operator shall be certified by performing 2 additional samples for each bar size and deformation pattern that will be used in the work.
- Prequalification sample splices shall be tested by an independent qualified testing laboratory and shall conform to the appropriate production test criteria and slip requirements specified herein. When epoxy-coated reinforcement is required, resistance butt welded sample splices shall have the weld flash removed by the same procedure as will be used in the work, before coating and testing. The Splice Prequalification Report shall include the certified test results for all prequalification sample splices.
- The QCM shall review and approve the Splice Prequalification Report before submitting it to the Engineer for approval. The Contractor shall allow 2 weeks for the review and approval of a complete report before performing any service splicing or ultimate butt splicing in the work. In the event the Engineer fails to complete the review within the time allowed, and in the opinion of the Engineer, completion of the work is delayed or interfered with by reason of the Engineer's delay in completing the review, the Contractor will be compensated for any resulting loss, and an extension of time will be granted, in the same manner as provided for in Section 8-1.09, "Right of Way Delays."

52-1.08C(2) Service Splice Test Criteria

- Service production and quality assurance sample splices shall be tensile tested in conformance with the requirements in ASTM Designation: A 370 and California Test 670 and shall develop a minimum tensile strength of not less than 550 MPa.

52-1.08C(2)(a) Production Test Requirements for Service Splices

- Production tests shall be performed by the Contractor's independent laboratory for all service splices used in the work. A production test shall consist of testing 4 sample splices prepared for each lot of completed splices. The samples shall be prepared by the Contractor using the same splice material, position, operators, location, and equipment, and following the same procedure as used in the work.
- At least one week before testing, the Contractor shall notify the Engineer in writing of the date when and the location where the testing of the samples will be performed.
- The 4 samples from each production test shall be securely bundled together and identified with a completed sample identification card before shipment to the independent laboratory. The card will be furnished by the Engineer. Bundles of samples containing fewer than 4 samples of splices shall not be tested.
- Before performing any tensile tests on production test sample splices, one of the 4 samples shall be tested for, and shall conform to, the requirements for total slip. Should this sample not meet the total slip requirements, one retest, in which

the 3 remaining samples are tested for total slip, will be allowed. Should any of the 3 remaining samples not conform to the total slip requirements, all splices in the lot represented by this production test will be rejected.

- If 3 or more sample splices from a production test conform to the provisions in this Section 52-1.08C(2), "Service Splice Test Criteria," all splices in the lot represented by this production test will be considered acceptable, provided each of the 4 samples develop a minimum tensile strength of not less than 420 MPa.

- Should only 2 sample splices from a production test conform to the provisions in this Section 52-1.08C(2), "Service Splice Test Criteria," one additional production test shall be performed on the same lot of splices. This additional production test shall consist of testing 4 sample splices that have been randomly selected by the Engineer and removed by the Contractor from the actual completed lot of splices. Should any of the 4 splices from this additional test fail to conform to these provisions, all splices in the lot represented by these production tests will be rejected.

- If only one sample splice from a production test conforms to the provisions in this Section 52-1.08C(2), "Service Splice Test Criteria," all splices in the lot represented by this production test will be rejected.

- If a production test for a lot fails, the Contractor shall repair or replace all reinforcing bars from which sample splices were removed before the Engineer selects additional splices from this lot for further testing.

52-1.08C(2)(b) Quality Assurance Test Requirements for Service Splices

- For the first production test performed, and for at least one, randomly selected by the Engineer, of every 5 subsequent production tests, or portion thereof, the Contractor shall concurrently prepare 4 additional service quality assurance sample splices. These service quality assurance sample splices shall be prepared in the same manner as specified herein for service production sample splices.

- These 4 additional quality assurance sample splices shall be shipped to the Transportation Laboratory for quality assurance testing. The 4 sample splices shall be securely bundled together and identified by location and contract number with weatherproof markings before shipment. Bundles containing fewer than 4 samples of splices will not be tested. Sample splices not accompanied by the supporting documentation required in Section 52-1.08B(1), for mechanical splices, or in Section 52-1.08B(3), for resistance butt welds, will not be tested.

- Quality assurance testing will be performed in conformance with the requirements for service production sample splices in Section 52-1.08C(2)(a), "Production Test Requirements for Service Splices."

52-1.08C(3) Ultimate Butt Splice Test Criteria

- Ultimate production and quality assurance sample splices shall be tensile tested in conformance with the requirements described in ASTM Designation: A 370 and California Test 670.

- A minimum of one control bar shall be removed from the same bar as, and adjacent to, all ultimate prequalification, production, and quality assurance sample splices. Control bars shall be 1) a minimum length of one meter for reinforcing bars No. 25 or smaller and 1.5 meters for reinforcing bars No. 29 or larger, and 2) suitably identified before shipment with weatherproof markings that do not interfere with the Engineer's tamper-proof markings or seals. The portion of adjacent bar remaining in the work shall also be identified with weatherproof markings that correspond to its adjacent control bar.

- Each sample splice and its associated control bar shall be identified and marked as a set. Each set shall be identified as representing a prequalification, production, or quality assurance sample splice.

- The portion of hoop reinforcing bar, removed to obtain a sample splice and control bar, shall be replaced using a prequalified ultimate mechanical butt splice, or the hoop shall be replaced in kind.

- Reinforcing bars, other than hoops, from which sample splices are removed, shall be repaired using ultimate mechanical butt splices conforming to the provisions in Section 52-1.08C(1), "Splice Prequalification Report," or the bars shall be replaced in kind. These bars shall be repaired or replaced such that no splices are located in any "No Splice Zone" shown on the plans.

- Ultimate production and quality assurance sample splices shall rupture in the reinforcing bar either: 1) outside of the affected zone or 2) within the affected zone, provided that the sample splice has achieved at least 95 percent of the ultimate tensile strength of the control bar associated with the sample splice. In addition, necking of the bar, as defined in California Test 670, shall be evident at rupture regardless of whether the bar breaks inside or outside the affected zone.

- The affected zone is the portion of the reinforcing bar where any properties of the bar, including the physical, metallurgical, or material characteristics, have been altered by fabrication or installation of the splice.

- The ultimate tensile strength shall be determined for all control bars by tensile testing the bars to rupture, regardless of where each sample splice ruptures. If 2 control bars are tested for one sample splice, the bar with the lower ultimate tensile strength shall be considered the control bar.

52-1.08C(3)(a) Production Test Requirements for Ultimate Butt Splices

- Production tests shall be performed for all ultimate butt splices used in the work. A production test shall consist of testing 4 sets of sample splices and control bars removed from each lot of completed splices, except when quality assurance tests are performed.

- After the splices in a lot have been completed, and the bars have been epoxy-coated when required, the QCM shall notify the Engineer in writing that the splices in this lot conform to the specifications and are ready for testing. Except for hoops, sample splices will be selected by the Engineer at the job site. Sample splices for hoops will be selected by the Engineer either at the job site or a fabrication facility.
- After notification has been received, the Engineer will randomly select the 4 sample splices to be removed from the lot and place tamper-proof markings or seals on them. The Contractor shall select the adjacent control bar for each sample splice bar, and the Engineer will place tamper-proof markings or seals on them. These ultimate production sample splices and control bars shall be removed by the Contractor, and tested by an independent qualified testing laboratory.
 - At least one week before testing, the Contractor shall notify the Engineer in writing of the date when and the location where the testing of the samples will be performed.
 - A sample splice or control bar from any set will be rejected if a tamper-proof marking or seal is disturbed before testing.
 - The 4 sets from each production test shall be securely bundled together and identified with a completed sample identification card before shipment to the independent laboratory. The card will be furnished by the Engineer. Bundles of samples containing fewer than 4 sets of splices shall not be tested.
 - Before performing any tensile tests on production test sample splices, one of the 4 sample splices shall be tested for, and shall conform to, the requirements for total slip. Should this sample splice not meet these requirements, one retest, in which the 3 remaining sample splices are tested for total slip, will be allowed. Should any of the 3 remaining sample splices not conform to these requirements, all splices in the lot represented by this production test will be rejected.
 - If 3 or more sample splices from a production test conform to the provisions in Section 52-1.08C(3), "Ultimate Butt Splice Test Criteria," all splices in the lot represented by this production test will be considered acceptable.
 - Should only 2 sample splices from a production test conform to the provisions in Section 52-1.08C(3), "Ultimate Butt Splice Test Criteria," one additional production test shall be performed on the same lot of splices. Should any of the 4 sample splices from this additional test fail to conform to these provisions, all splices in the lot represented by these production tests will be rejected.
 - If only one sample splice from a production test conforms to the provisions in Section 52-1.08C(3), "Ultimate Butt Splice Test Criteria," all splices in the lot represented by this production test will be rejected.
 - If a production test for a lot fails, the Contractor shall repair or replace all reinforcing bars from which sample splices were removed, complete in place, before the Engineer selects additional splices from this lot for further testing.
 - Production tests will not be required on repaired splices from a lot, regardless of the type of prequalified ultimate mechanical butt splice used to make the repair. However, should an additional production test be required, the Engineer may select any repaired splice for the additional production test.

52-1.08C(3)(b) Quality Assurance Test Requirements for Ultimate Butt Splices

- For the first production test performed, and for at least one, randomly selected by the Engineer, of every 5 subsequent production tests, or portion thereof, the Contractor shall concurrently prepare 4 additional ultimate quality assurance sample splices along with associated control bars.
 - Each time 4 additional ultimate quality assurance sample splices are prepared, 2 of these quality assurance sample splice and associated control bar sets and 2 of the production sample splice and associated control bar sets, together, shall conform to the requirements for ultimate production sample splices in Section 52-1.08C(3)(a), "Production Test Requirements for Ultimate Butt Splices."
 - The 2 remaining quality assurance sample splice and associated control bar sets, along with the 2 remaining production sample splice and associated control bar sets shall be shipped to the Transportation Laboratory for quality assurance testing. The 4 sets shall be securely bundled together and identified by location and contract number with weatherproof markings before shipment. Bundles containing fewer than 4 sets will not be tested.
 - Quality assurance testing will be performed in conformance with the requirements for ultimate production sample splices in Section 52-1.08C(3)(a), "Production Test Requirements for Ultimate Butt Splices."

52-1.08C(3)(c) Nondestructive Splice Tests

- When the specifications allow for welded sample splices to be taken from other than the completed lot of splices, the Contractor shall meet the following additional requirements.
 - Except for resistance butt welded splices, radiographic examinations shall be performed on 25 percent of all complete joint penetration butt welded splices from a production lot. The size of a production lot will be a maximum of 150 splices. The Engineer will select the splices which will compose the production lot and also the splices within each production lot to be radiographically examined.
 - All required radiographic examinations of complete joint penetration butt welded splices shall be performed by the Contractor in conformance with the requirements in AWS D 1.4 and these specifications.
 - Before radiographic examination, welds shall conform to the requirements in Section 4.4, "Quality of Welds," of AWS D 1.4.

- Should more than 12 percent of the splices which have been radiographically examined in any production lot be defective, an additional 25 percent of the splices, selected by the Engineer from the same production lot, shall be radiographically examined. Should more than 12 percent of the cumulative total of splices tested from the same production lot be defective, all remaining splices in the lot shall be radiographically examined.

- Additional radiographic examinations performed due to the identification of defective splices shall be at the Contractor's expense.

- All defects shall be repaired in conformance with the requirements in AWS D 1.4.
- The Contractor shall notify the Engineer in writing 48 hours before performing any radiographic examinations.
- The radiographic procedure used shall conform to the requirements in AWS D1.1, AWS D1.4, and the following:

Two exposures shall be made for each complete joint penetration butt welded splice. For each of the 2 exposures, the radiation source shall be centered on each bar to be radiographed. The first exposure shall be made with the radiation source placed at zero degrees from the top of the weld and perpendicular to the weld root and identified with a station mark of "0." The second exposure shall be at 90 degrees to the "0" station mark and shall be identified with a station mark of "90." When obstructions prevent a 90 degree placement of the radiation source for the second exposure, and when approved in writing by the Engineer, the source may be rotated, around the centerline of the reinforcing bar, a maximum of 25 degrees.

For field produced complete joint penetration butt welds, no more than one weld shall be radiographed during one exposure. For shop produced complete joint penetration butt welds, if more than one weld is to be radiographed during one exposure, the angle between the root line of each weld and the direction to the radiation source shall be not less than 65 degrees.

Radiographs shall be made by either X-ray or gamma ray. Radiographs made by X-ray or gamma rays shall have densities of not less than 2.3 nor more than 3.5 in the area of interest. A tolerance of 0.05 in density is allowed for densitometer variations. Gamma rays shall be from the iridium 192 isotope and the emitting specimen shall not exceed 4.45 mm in the greatest diagonal dimension.

The radiographic film shall be placed perpendicular to the radiation source at all times; parallel to the root line of the weld unless source placement determines that the film must be turned; and as close to the root of the weld as possible.

The minimum source to film distance shall be maintained so as to ensure that all radiographs maintain a maximum geometric unsharpness of 0.020 at all times, regardless of the size of the reinforcing bars.

Penetrators shall be placed on the source side of the bar and perpendicular to the radiation source at all times. One penetrator shall be placed in the center of each bar to be radiographed, perpendicular to the weld root, and adjacent to the weld. Penetrator images shall not appear in the weld area.

When radiography of more than one weld is being performed per exposure, each exposure shall have a minimum of one penetrator per bar, or 3 penetrators per exposure. When 3 penetrators per exposure are used, one penetrator shall be placed on each of the 2 outermost bars of the exposure, and the remaining penetrator shall be placed on a centrally located bar.

An allowable weld buildup of 4 mm may be added to the total material thickness when determining the proper penetrator selection. No image quality indicator equivalency will be accepted. Wire penetrators or penetrator blocks shall not be used.

Penetrators shall be sufficiently shimmed using a radiographically identical material. Penetrator image densities shall be a minimum of 2.0 and a maximum of 3.6.

Radiographic film shall be Class 1, regardless of the size of reinforcing bars.

Radiographs shall be free of film artifacts and processing defects, including, but not limited to, streaks, scratches, pressure marks or marks made for the purpose of identifying film or welding indications.

Each splice shall be clearly identified on each radiograph and the radiograph identification and marking system shall be established between the Contractor and the Engineer before radiographic inspection begins. Film shall be identified by lead numbers only; etching, flashing or writing in identifications of any type will not be permitted. Each piece of film identification information shall be legible and shall include, as a minimum, the following information: Contractor's name, date, name of nondestructive testing firm, initials of radiographer, contract number, part number and weld number. The letter "R" and repair number shall be placed directly after the weld number to designate a radiograph of a repaired weld.

Radiographic film shall be developed within a time range of one minute less to one minute more than the film manufacturer's recommended maximum development time. Sight development will not be allowed.

Processing chemistry shall be done with a consistent mixture and quality, and processing rinses and tanks shall be clean to ensure proper results. Records of all developing processes and any chemical changes to the developing processes shall be kept and furnished to the Engineer upon request. The Engineer may request, at any time, that a sheet of unexposed film be processed in the presence of the Engineer to verify processing chemical and rinse quality.

The results of all radiographic interpretations shall be recorded on a signed certification and a copy kept with the film packet.

Technique sheets prepared in conformance with the requirements in ASME Boiler and Pressure Vessels Code, Section V, Article 2 Section T-291 shall also contain the developer temperature, developing time, fixing duration and all rinse times.

52-1.08D Reporting Test Results

- A Production Test Report for all testing performed on each lot shall be prepared by the independent testing laboratory performing the testing and submitted to the QCM for review and approval. The report shall be signed by an engineer who represents the laboratory and is registered as a Civil Engineer in the State of California. The report shall include, as a minimum, the following information for each test: contract number, bridge number, lot number and location, bar size, type of splice, length of mechanical splice, length of test specimen, physical condition of test sample splice and any associated control bar, any notable defects, total measured slip, ultimate tensile strength of each splice, and for ultimate butt splices, limits of affected zone, location of visible necking area, ultimate tensile strength and 95 percent of this ultimate tensile strength for each control bar, and a comparison between 95 percent of the ultimate tensile strength of each control bar and the ultimate tensile strength of its associated splice.

- The QCM must review, approve, and forward each Production Test Report to the Engineer for review before the splices represented by the report are encased in concrete. The Engineer will have 3 working days to review each Production Test Report and respond in writing after a complete report has been received. Should the Contractor elect to encase any splices before receiving notification from the Engineer, it is expressly understood that the Contractor will not be relieved of the responsibility for incorporating material in the work that conforms to the requirements of the plans and specifications. Material not conforming to these requirements will be subject to rejection. Should the Contractor elect to wait to encase splices pending notification by the Engineer, and in the event the Engineer fails to complete the review and provide notification within the time allowed, and if, in the opinion of the Engineer, the work is delayed or interfered with by reason of the Engineer's delay in completing the review, the Contractor will be compensated for any resulting loss, and an extension of time will be granted, in the same manner as provided for in Section 8-1.09, "Right of Way Delays."

- Quality assurance test results for each bundle of 4 sets or 4 samples of splices will be reported in writing to the Contractor within 3 working days after receipt of the bundle by the Transportation Laboratory. In the event that more than one bundle is received on the same day, 2 additional working days shall be allowed for providing test results for each additional bundle received. A test report will be made for each bundle received. Should the Contractor elect to encase splices before receiving notification from the Engineer, it is expressly understood that the Contractor will not be relieved of the responsibility for incorporating material in the work that conforms to the requirements of the plans and specifications. Material not conforming to these requirements will be subject to rejection. Should the Contractor elect to wait to encase splices pending notification by the Engineer, and in the event the Engineer fails to complete the review within the time allowed, and in the opinion of the Engineer, completion of the work is delayed or interfered with by reason of the Engineer's delay in completing the review, the Contractor will be compensated for any resulting loss, and an extension of time will be granted, in the same manner as provided for in Section 8-1.09, "Right of Way Delays."

Section 52-1.11, "Payment," of the Standard Specifications is amended by adding the following paragraph after the seventh paragraph:

- If a portion or all of the reinforcing steel is epoxy-coated more than 480 air line kilometers from both Sacramento and Los Angeles, additional shop inspection expenses will be sustained by the State. Whereas it is and will be impracticable and extremely difficult to ascertain and determine the actual increase in these expenses, it is agreed that payment to the Contractor for furnishing the epoxy-coated reinforcement will be reduced \$5000 for each epoxy-coating facility located more than 480 air line kilometers from both Sacramento and Los Angeles and an additional \$3000 (\$8000 total) for each epoxy-coating facility located more than 4800 air line kilometers from both Sacramento and Los Angeles.

SECTION 55: STEEL STRUCTURES

Issue Date: December 31, 2001

Section 55-3.14, "Bolted Connections," of the Standard Specifications is amended by adding the following after the ninth paragraph:

- If a torque multiplier is used in conjunction with a calibrated wrench as a method for tightening fastener assemblies to the required tension, both the multiplier and the wrench shall be calibrated together as a system. The same length input and output sockets and extensions that will be used in the work shall also be included in the calibration of the system. The manufacturer's torque multiplication ratio shall be adjusted during calibration of the system, such that when this adjusted ratio is multiplied by the actual input calibrated wrench reading, the product is a calculated output torque that is within 2 percent of

the true output torque. When this system is used in the work to perform any installation tension testing, rotational capacity testing, fastener tightening, or tension verification, it shall be used, intact as calibrated.

The sixth paragraph of Section 55-4.02, "Payment," of the Standard Specifications is amended to read:

- If a portion or all of the structural steel is fabricated more than 480 air line kilometers from both Sacramento and Los Angeles, additional shop inspection expenses will be sustained by the State. Whereas it is and will be impracticable and extremely difficult to ascertain and determine the actual increase in these expenses, it is agreed that payment to the Contractor for furnishing the structural steel from each fabrication site located more than 480 air line kilometers from both Sacramento and Los Angeles will be reduced \$5000 or by an amount computed at \$0.044 per kilogram of structural steel fabricated, whichever is greater, or in the case of each fabrication site located more than 4800 air line kilometers from both Sacramento and Los Angeles, payment will be reduced \$8000 or by \$0.079 per kilogram of structural steel fabricated, whichever is greater.

SECTION 56: SIGNS

Issue Date: November 2, 2004

Section 56-1.01, "Description," of the Standard Specifications is amended by deleting the third paragraph.

Section 56-1.02A, "Bars, Plates and Shapes," of the Standard Specifications is amended to read:

56-1.02A Bars, Plates, Shapes, and Structural Tubing

- Bars, plates, and shapes shall be structural steel conforming to the requirements in ASTM Designation: A 36/A 36M, except, at the option of the Contractor, the light fixture mounting channel shall be continuous-slot steel channel conforming to the requirements in ASTM Designation: A 1011/A 1011M, Designation SS, Grade 33[230], or aluminum Alloy 6063-T6 extruded aluminum conforming to the requirements in ASTM Designation: B 221 or B 221M.

- Structural tubing shall be structural steel conforming to the requirements in ASTM Designation: A 500, Grade B.
- Removable sign panel frames shall be constructed of structural steel conforming to the requirements in ASTM Designation: A 36/A 36M.

Section 56-1.02B, "Sheets," of the Standard Specifications is amended to read:

56-1.02B Sheets

- Sheets shall be carbon-steel sheets conforming to the requirements in ASTM Designation: A 1011/A 1011M, Designation SS, Grade 33[230].

- Ribbed sheet metal for box beam-closed truss sign structures shall be fabricated from galvanized sheet steel conforming to the requirements in ASTM Designation: A 653/A 653M, Designation SS, Grade 33[230]. Sheet metal panels shall be G 165 coating designation in conformance with the requirements in ASTM Designation: A 653/A 653M.

Section 56-1.02F, "Steel Walkway Gratings," of the Standard Specifications is amended to read:

56-1.02F Steel Walkway Gratings

- Steel walkway gratings shall be furnished and installed in conformance with the details shown on the plans and the following provisions:

- A. Gratings shall be the standard product of an established grating manufacturer.
- B. Material for gratings shall be structural steel conforming to the requirements in ASTM Designation: A 1011/A 1011M, Designation CS, Type B.
- C. For welded type gratings, each joint shall be full resistance welded under pressure, to provide a sound, completely beaded joint.
- D. For mechanically locked gratings, the method of fabrication and interlocking of the members shall be approved by the Engineer, and the fabricated grating shall be equal in strength to the welded type.
- E. Gratings shall be accurately fabricated and free from warps, twists, or other defects affecting their appearance or serviceability. Ends of all rectangular panels shall be square. The tops of the bearing bars and cross members shall be in the same plane. Gratings distorted by the galvanizing process shall be straightened.

The sixth through the thirteenth paragraphs in Section 56-1.03, "Fabrication," of the Standard Specifications are amended to read:

- High-strength bolted connections, where shown on the plans, shall conform to the provisions in Section 55-3.14, "Bolted Connections," except that only fastener assemblies consisting of a high-strength bolt, nut, hardened washer, and direct tension indicator shall be used.
- High-strength fastener assemblies, and any other bolts, nuts, and washers attached to sign structures shall be zinc-coated by the mechanical deposition process.
- Nuts for high-strength bolts designated as snug-tight shall not be lubricated.
- An alternating snugging and tensioning pattern for anchor bolts and high-strength bolted splices shall be used. Once tensioned, high-strength fastener components and direct tension indicators shall not be reused.
- For bolt diameters less than 10 mm, the diameter of the bolt hole shall be not more than 0.80-mm larger than the nominal bolt diameter. For bolt diameters greater than or equal to 10 mm, the diameter of the bolt hole shall be not more than 1.6 mm larger than the nominal bolt diameter.
- Sign structures shall be fabricated into the largest practical sections prior to galvanizing.
- Ribbed sheet metal panels for box beam closed truss sign structures shall be fastened to the truss members by cap screws or bolts as shown on the plans, or by 4.76 mm stainless steel blind rivets conforming to Industrial Fasteners Institute, Standard IFI-114, Grade 51. The outside diameter of the large flange rivet head shall be not less than 15.88 mm in diameter. Web splices in ribbed sheet metal panels may be made with similar type blind rivets of a size suitable for the thickness of material being connected.
- Spalling or chipping of concrete structures shall be repaired by the Contractor at the Contractor's expense.
- Overhead sign supports shall have an aluminum identification plate permanently attached near the base, adjacent to the traffic side on one of the vertical posts, using either stainless steel rivets or stainless steel screws. As a minimum, the information on the plate shall include the name of the manufacturer, the date of manufacture and the contract number.

The fifth paragraph of Section 56-2.02B, "Wood Posts," of the Standard Specifications is amended to read:

- Douglas fir and Hem-Fir posts shall be treated in conformance with the provisions in Section 58, "Preservative Treatment of Lumber, Timber and Piling," and in conformance with AWPA Use Category System: UC4A, Commodity Specification A. Posts shall be incised and the minimum retention of preservative shall be as specified in AWPA Standards.

SECTION 57: TIMBER STRUCTURES

Issue Date: October 12, 2004

The second paragraph of Section 57-1.02A, "Structural Timber and Lumber," of the Standard Specifications is amended to read:

- When preservative treatment of timber and lumber is required, the treatment shall conform to the provisions in Section 58, "Preservative Treatment of Lumber, Timber and Piling," and AWPA's Use Category 4B. The type of treatment to be used will be shown on the plans or specified in the special provisions.

SECTION 58: PRESERVATIVE TREATMENT OF LUMBER, TIMBER AND PILING

Issue Date: November 18, 2005

The first paragraph of Section 58-1.02, "Treatment and Retention," of the Standard Specifications is amended to read:

- Timber, lumber, and piling shall be pressure treated after millwork is completed. Preservatives, treatment, and results of treatment shall conform to the requirements in AWPA Standards U1 and T1. Treatment of lumber and timber shall conform to the specified AWPA Use Category cited in the special provisions, on the plans, or elsewhere in these specifications.

The second paragraph of Section 58-1.02, "Treatment and Retention," of the Standard Specifications is deleted.

SECTION 59: PAINTING

Issue Date: December 31, 2001

Section 59-2.01, "General," of the Standard Specifications is amended by adding the following paragraphs after the first paragraph:

- Unless otherwise specified, no painting Contractors or subcontractors will be permitted to commence work without having the following current "SSPC: The Society for Protective Coatings" (formerly the Steel Structures Painting Council) certifications in good standing:
 - A. For cleaning and painting structural steel in the field, certification in conformance with the requirements in Qualification Procedure No. 1, "Standard Procedure For Evaluating Painting Contractors (Field Application to Complex Industrial Structures)" (SSPC-QP 1).
 - B. For removing paint from structural steel, certification in conformance with the requirements in Qualification Procedure No. 2, "Standard Procedure For Evaluating Painting Contractors (Field Removal of Hazardous Coatings from Complex Structures)" (SSPC-QP 2).
 - C. For cleaning and painting structural steel in a permanent painting facility, certification in conformance with the requirements in Qualification Procedure No. 3, "Standard Procedure For Evaluating Qualifications of Shop Painting Applicators" (SSPC-QP 3). The AISC's Sophisticated Paint Endorsement (SPE) quality program will be considered equivalent to SSPC-QP 3.

The third paragraph of Section 59-2.03, "Blast Cleaning," of the Standard Specifications is amended to read:

- Exposed steel or other metal surfaces to be blast cleaned shall be cleaned in conformance with the requirements in Surface Preparation Specification No. 6, "Commercial Blast Cleaning," of the "SSPC: The Society for Protective Coatings." Blast cleaning shall leave all surfaces with a dense, uniform, angular anchor pattern of not less than 35 μm as measured in conformance with the requirements in ASTM Designation: D 4417.

The first paragraph of Section 59-2.06, "Hand Cleaning," of the Standard Specifications is amended to read:

- Dirt, loose rust and mill scale, or paint which is not firmly bonded to the surfaces shall be removed in conformance with the requirements in Surface Preparation Specification No. 2, "Hand Tool Cleaning," of the "SSPC: The Society for Protective Coatings." Edges of old remaining paint shall be feathered.

The fourth paragraph of Section 59-2.12, "Painting," of the Standard Specifications is amended to read:

- The dry film thickness of the paint will be measured in place with a calibrated Type 2 magnetic film thickness gage in conformance with the requirements of specification SSPC-PA2 of the "SSPC: The Society for Protective Coatings."

SECTION 72: SLOPE PROTECTION

Issue Date: November 18, 2005

The sixth paragraph of Section 72-4.04, "Construction," of the Standard Specifications is amended to read:

- Pervious backfill material, if required by the plans, shall be placed as shown. A securely tied sack containing 0.03-m³ of pervious backfill material shall be placed at each weep hole and drain hole. The sack material shall conform to the provisions in Section 88-1.03, "Filter Fabric."

SECTION 75: MISCELLANEOUS METAL

Issue Date: November 2, 2004

The table in the tenth paragraph of Section 75-1.02, "Miscellaneous Iron and Steel," of the Standard Specifications is amended to read:

Material	Specification
Steel bars, plates and shapes	ASTM Designation: A 36/A 36M or A 575, A 576 (AISI or M Grades 1016 through 1030)
Steel fastener components for general applications:	
Bolts and studs	ASTM Designation: A 307
Headed anchor bolts	ASTM Designation: A 307, Grade B, including S1 supplementary requirements
Nonheaded anchor bolts	ASTM Designation: A 307, Grade C, including S1 supplementary requirements and S1.6 of AASHTO Designation: M 314 supplementary requirements or AASHTO Designation: M 314, Grade 36 or 55, including S1 supplementary requirements
High-strength bolts and studs, threaded rods, and nonheaded anchor bolts	ASTM Designation: A 449, Type 1
Nuts	ASTM Designation: A 563, including Appendix X1*
Washers	ASTM Designation: F 844
Components of high-strength steel fastener assemblies for use in structural steel joints:	
Bolts	ASTM Designation: A 325, Type 1
Tension control bolts	ASTM Designation: F 1852, Type 1
Nuts	ASTM Designation: A 563, including Appendix X1*
Hardened washers	ASTM Designation: F 436, Type 1, Circular, including S1 supplementary requirements
Direct tension indicators	ASTM Designation: F 959, Type 325, zinc-coated
Stainless steel fasteners (Alloys 304 & 316) for general applications:	
Bolts, screws, studs, threaded rods, and nonheaded anchor bolts	ASTM Designation: F 593 or F 738M
Nuts	ASTM Designation: F 594 or F 836M
Washers	ASTM Designation: A 240/A 240M and ANSI B 18.22M
Carbon-steel castings	ASTM Designation: A 27/A 27M, Grade 65-35 [450-240], Class 1
Malleable iron castings	ASTM Designation: A 47, Grade 32510 or A 47M, Grade 22010
Gray iron castings	ASTM Designation: A 48, Class 30B
Ductile iron castings	ASTM Designation: A 536, Grade 65-45-12
Cast iron pipe	Commercial quality
Steel pipe	Commercial quality, welded or extruded
Other parts for general applications	Commercial quality

* Zinc-coated nuts that will be tightened beyond snug or wrench tight shall be furnished with a dyed dry lubricant conforming to Supplementary Requirement S2 in ASTM Designation: A 563.

The second paragraph in Section 75-1.03, "Miscellaneous Bridge Metal," of the Standard Specifications is amended to read:

- Miscellaneous bridge metal shall consist of the following, except as further provided in Section 51-1.19, "Utility Facilities," and in the special provisions:

- A. Bearing assemblies, equalizing bolts and expansion joint armor in concrete structures.
- B. Expansion joint armor in steel structures.
- C. Manhole frames and covers, frames and grates, ladder rungs, guard posts and access door assemblies.
- D. Deck drains, area drains, retaining wall drains, and drainage piping, except drainage items identified as "Bridge Deck Drainage System" in the special provisions.

The table in the eighteenth paragraph of Section 75-1.03, "Miscellaneous Bridge Metal," of the Standard Specifications is amended to read:

Stud Diameter (millimeters)	Sustained Tension Test Load (kilonewtons)
29.01-33.00	137.9
23.01-29.00	79.6
21.01-23.00	64.1
* 18.01-21.00	22.2
15.01-18.00	18.2
12.01-15.00	14.2
9.01-12.00	9.34
6.00-9.00	4.23

* Maximum stud diameter permitted for mechanical expansion anchors.

The table in the nineteenth paragraph of Section 75-1.03, "Miscellaneous Bridge Metal," of the Standard Specifications is amended to read:

Stud Diameter (millimeters)	Ultimate Tensile Load (kilonewtons)
30.01-33.00	112.1
27.01-30.00	88.1
23.01-27.00	71.2
20.01-23.00	51.6
16.01-20.00	32.0
14.01-16.00	29.4
12.00-14.00	18.7

The table in the twenty-second paragraph of Section 75-1.03, "Miscellaneous Bridge Metal," of the Standard Specifications is amended to read:

Stud Diameter (millimeters)	Shell Type Mechanical Expansion Anchors	Integral Stud Type Mechanical Expansion Anchors	Resin Capsule Anchors and Cast-in-Place Inserts
29.01-33.00	—	—	540
23.01-29.00	—	—	315
21.01-23.00	—	—	235
18.01-21.00	110	235	200
15.01-18.00	45	120	100
12.01-15.00	30	65	40
9.01-12.00	15	35	24
6.00-9.00	5	10	—

The third paragraph in Section 75-1.035, "Bridge Joint Restrainer Units," of the Standard Specifications is amended to read:

- Cables shall be 19 mm preformed, 6 x 19, wire strand core or independent wire rope core (IWRC), galvanized, and in conformance with the requirements in Federal Specification RR-W-410D, right regular lay, manufactured of improved plow steel with a minimum breaking strength of 200 kN. Two certified copies of mill test reports of each manufactured length of cable used shall be furnished to the Engineer.

The second paragraph in Section 75-1.05, "Galvanizing," of the Standard Specifications is amended to read:

- At the option of the Contractor, material thinner than 3.2 mm shall be galvanized either before fabrication in conformance with the requirements of ASTM Designation: A 653/A 653M, Coating Designation Z600, or after fabrication in conformance with the requirements of ASTM Designation: A 123, except that the weight of zinc coating shall average not less than 365 g per square meter of actual surface area with no individual specimen having a coating weight of less than 305 g per square meter.

SECTION 80: FENCES

Issue Date: October 12, 2004

The second paragraph of Section 80-3.01B(2), "Treated Wood Posts and Braces," of the Standard Specifications is amended to read:

- Posts and braces to be treated shall be pressure treated in conformance with the provisions in Section 58, "Preservative Treatment of Lumber, Timber and Piling," and AWPA Use Category System: UC4A, Commodity Specification A or B.

SECTION 83: RAILINGS AND BARRIERS

Issue Date: January 28, 2005

The first paragraph of Section 83-1.02B, "Metal Beam Guard Railing," of the Standard Specifications is amended to read:

- The rail elements, backup plates, terminal sections, end and return caps, bolts, nuts and other fittings shall conform to the requirements in AASHTO Designation: M 180, except as modified in this Section 83-1.02B and as specified in Section 83-1.02. The rail elements, backup plates, terminal sections, end and return caps shall conform to Class A, Type 1 W-Beam guard railing as shown in AASHTO Designation: M 180. The edges and center of the rail element shall contact each post block. Rail element joints shall be lapped not less than 316 mm and bolted. The rail metal, in addition to conforming to the requirements in AASHTO Designation: M 180, shall withstand a cold bend, without cracking, of 180 degrees around a mandrel of a diameter equal to 2.5 times the thickness of the plate.

The ninth paragraph in Section 83-1.02B, "Metal Beam Guard Railing," of the Standard Specifications is amended to read:

- The grades and species of wood posts and blocks shall be No. 1 timbers (also known as No. 1 structural) Douglas fir or No. 1 timbers Southern yellow pine. Wood posts and blocks shall be graded in conformance with the provisions in Section 57-2, "Structural Timber," of the Standard Specifications, except allowances for shrinkage after mill cutting shall in no case exceed 5 percent of the American Lumber Standards minimum sizes, at the time of installation.

The eleventh paragraph in Section 83-1.02B, "Metal Beam Guard Railing," of the Standard Specifications is amended to read:

- After fabrication, wood posts and blocks shall be pressure treated in conformance with Section 58, "Preservative Treatment of Lumber, Timber and Piling," and AWPA Use Category System: UC4A, Commodity Specification A.

The twelfth paragraph in Section 83-1.02B, "Metal Beam Guard Railing," of the Standard Specifications is amended to read:

- If copper naphthenate, ammoniacal copper arsenate, chromated copper arsenate, ammoniacal copper zinc arsenate, ammoniacal copper quat or copper azole is used to treat the wood posts and blocks, the bolt holes shall be treated as follows:
 - A. Before the bolts are inserted, bolt holes shall be filled with a grease, recommended by the manufacturer for corrosion protection, which will not melt or run at a temperature of 65°C.

The twenty-fourth paragraph of Section 83-1.02B, "Metal Beam Guard Railing," of the Standard Specifications is amended to read:

- End anchor assemblies and rail tensioning assemblies for metal beam guard railing shall be constructed as shown on the plans and shall conform to the following provisions:

An end anchor assembly (Type SFT) for metal beam guard railing shall consist of an anchor cable, an anchor plate, a wood post, a steel foundation tube, a steel soil plate and hardware.

An end anchor assembly (Type CA) for metal beam guard railing shall consist of an anchor cable, an anchor plate, a single anchor rod or double anchor rods, hardware and one concrete anchor.

A rail tensioning assembly for metal beam guard railing shall consist of an anchor cable, an anchor plate, and hardware.

The anchor plate, metal plates, steel foundation tubes and steel soil plate shall be fabricated of steel conforming to the requirements in ASTM Designation: A 36/A 36M.

The anchor rods shall be fabricated of steel conforming to the requirements in ASTM Designation: A 36/A 36M, A 441 or A 572, or ASTM Designation: A 576, Grades 1018, 1019, 1021 or 1026. The eyes shall be hot forged or formed with full penetration welds. After fabrication, anchor rods with eyes that have been formed with any part of the eye below 870°C during the forming operation or with eyes that have been closed by welding shall be thermally stress relieved prior to galvanizing. The completed anchor rod, after galvanizing, shall develop a strength of 220 kN.

In lieu of built-up fabrication of anchor plates as shown on the plans, anchor plates may be press-formed from steel plate, with or without welded seams.

All bolts and nuts shall conform to the requirements in ASTM Designation: A 307, unless otherwise specified in the special provisions or shown on the plans.

Anchor cable shall be 19-mm preformed, 6 x 19, wire strand core or independent wire rope core (IWRC), galvanized in conformance with the requirements in Federal Specification RR-W-410D, right regular lay, manufactured of improved plow steel with a minimum breaking strength of 200 kN. Two certified copies of mill test reports of each manufactured length of cable used shall be furnished to the Engineer. The overall length of each cable anchor assembly shall be as shown on the plans, but shall be a minimum of 2 m.

Where shown on the plans, cable clips and a cable thimble shall be used to attach cable to the anchor rod. Thimbles shall be commercial quality, galvanized steel. Cable clips shall be commercial quality drop forged galvanized steel.

The swaged fitting shall be machined from hot-rolled bars of steel conforming to AISI Designation: C 1035, and shall be annealed suitable for cold swaging. The swaged fitting shall be galvanized before swaging. A lock pin hole to accommodate a 6-mm, plated, spring steel pin shall be drilled through the head of the swage fitting to retain the stud in proper position. The manufacturer's identifying mark shall be stamped on the body of the swage fitting.

The 25-mm nominal diameter stud shall conform to the requirements in ASTM Designation: A 449 after galvanizing. Prior to galvanizing, a 10-mm slot for the locking pin shall be milled in the stud end.

The swaged fittings, stud and nut assembly shall develop the specified breaking strength of the cable.

The cable assemblies shall be shipped as a complete unit including stud and nut.

Clevises shall be drop forged galvanized steel and shall develop the specified breaking strength of the cable.

One sample of cable properly fitted with swaged fitting and right hand thread stud at both ends as specified above, including a clevis when shown on the plans, one meter in total length, shall be furnished the Engineer for testing.

The portion of the anchor rod to be buried in earth shall be coated with a minimum 0.5-mm thickness of coal tar enamel conforming to AWWA Standard: C203 or a coal tar epoxy conforming to the requirements in Steel Structures Painting Council Paint Specification No. 16, Coal-Tar Epoxy-Polyimide Black Paint or Corps of Engineers Specification, Formula C-200a, Coal-Tar Epoxy Paint.

Metal components of the anchor assembly shall be fabricated in conformance with good shop practice and shall be hot-dip galvanized in conformance with the provisions in Section 75-1.05, "Galvanizing."

Anchor cables shall be tightened after the concrete anchor has cured for at least 5 days.

Concrete used to construct anchors for end anchor assemblies shall be Class 3 or minor concrete conforming to the provisions in Section 90, "Portland Cement Concrete."

Concrete shall be placed against undisturbed material of the excavated holes for end anchors. The top 300 mm of holes shall be formed, if required by the Engineer.

Reinforcing steel in concrete anchors for end anchor assemblies shall conform to the provisions in Section 52, "Reinforcement."

The second paragraph in Section 83-1.02D, "Steel Bridge Railing," of the Standard Specifications is amended to read:

- Structural shapes, tubing, plates, bars, bolts, nuts, and washers shall be structural steel conforming to the provisions in Section 55-2, "Materials." Other fittings shall be commercial quality.

The second and third paragraphs in Section 83-1.02E, "Cable Railing," of the Standard Specifications are replaced with the following paragraph:

- Pipe for posts and braces shall be standard steel pipe or pipe that conforms to the provisions in Section 80-4.01A, "Posts and Braces."

The fourteenth paragraph in Section 83-1.02I, "Chain Link Railing," of the Standard Specifications is amended to read:

- Chain link fabric shall be either 11-gage Type I zinc coated fabric conforming to the requirements in AASHTO Designation: M 181 or 11-gage Type IV polyvinyl chloride (PVC) coated fabric conforming to the requirements in Federal Specification RR-F-191/1D.

The second paragraph of Section 83-1.03, "Measurement," of the Standard Specifications is amended to read:

- Except for metal beam guard railing within the pay limits of a terminal system end treatment or transition railing (Type WB), metal beam guard railing will be measured by the meter along the face of the rail element from end post to end post of the completed railing at each installation. The point of measurement at each end post will be the center of the bolt attaching the rail element to the end post.

The seventh paragraph of Section 83-1.03, "Measurement," of the Standard Specifications is amended to read:

- The quantities of end anchor assemblies (Type SFT or Type CA) and rail tensioning assemblies will be measured as units determined from actual count. An end anchor assembly (Type CA) with 2 cables attached to one concrete anchor will be counted as one terminal anchor assembly (Type CA) for measurement and payment.

The eighth paragraph of Section 83-1.03, "Measurement," of the Standard Specifications is amended to read:

- The quantities of return and end caps and the various types of terminal sections for metal beam guard railing will be determined as units from actual count.

The third paragraph of Section 83-1.04, "Payment," of the Standard Specifications is amended to read:

- The contract unit prices paid for end anchor assembly (Type SFT), end anchor assembly (Type CA), and rail tensioning assembly shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all work involved in constructing the end anchor assemblies, complete in place, including drilling anchor plate bolt holes in rail elements, driving steel foundation tubes, excavating for concrete anchor holes and disposing of surplus material, as shown on the plans, as specified in these specifications and the special provisions, and as directed by the Engineer.

The fourth paragraph of Section 83-1.04, "Payment," of the Standard Specifications is amended to read:

- The contract unit prices paid for return caps, end caps, and the various types of terminal sections for metal beam guard railing shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in installing terminal sections, return and end caps, complete in place, as shown on the plans, as specified in these specifications and the special provisions, and as directed by the Engineer.

The second paragraph of Section 83-2.02B, "Thrie Beam Barrier," of the Standard Specifications is amended to read:

- Rail elements, backup plates, terminal connectors, terminal sections, and return caps shall conform to Class A, Type 1 thrie beam guard railing as shown in AASHTO Designation: M 180.

The fourteenth paragraph of Section 83-2.02B, "Thrie Beam Barrier," of the Standard Specifications is amended to read:

- All metal work shall be fabricated in the shop, and no punching, cutting or welding will be permitted in the field. Rail elements shall be lapped so that the exposed ends will not face approaching traffic. Terminal sections and return caps shall be installed in conformance with the manufacturer's recommendation.

The first paragraph in Section 83-2.02D(2), "Materials," of the Standard Specifications is amended to read:

- Type 50 and 60 series concrete barriers shall be constructed of minor concrete conforming to the provisions in Section 90-10, "Minor Concrete," except as follows:
 - a. The maximum size of aggregate used for extruded or slip-formed concrete barriers shall be at the option of the Contractor, but in no case shall the maximum size be larger than 37.5-mm or smaller than 9.5-mm.
 - b. If the 9.5-mm maximum size aggregate grading is used to construct extruded or slip-formed concrete barriers, the cementitious material content of the minor concrete shall be not less than 400 kg/m³.

The third paragraph in Section 83-2.02D(2), "Materials," of the Standard Specifications is amended to read:

- The concrete paving between the tops of the 2 walls of concrete barrier (Types 50E, 60E, 60GE, and 60SE) and the optional concrete slab at the base between the 2 walls of concrete barrier (Types 50E, 60E, 60GE, and 60SE) shall be constructed of minor concrete conforming to the provisions of Section 90-10, except that the minor concrete shall contain not less than 300 kg of cementitious material per cubic meter.

The first paragraph of Section 83-2.03, "Measurement," of the Standard Specifications is amended to read:

- Except for single thrie beam barrier within the pay limits of transition railing (Type STB), single thrie beam barrier will be measured by the meter from end post to end post along the face of the rail element of the installed barrier. Single thrie beam barriers constructed on each side of piers under structures or other obstructions will be measured for payment along each line of the installed barrier.

The second paragraph of Section 83-2.03, "Measurement," of the Standard Specifications is amended to read:

- Except for double thrie beam barrier within the pay limits of transition railing (Type DTB), double thrie beam barrier will be measured by the meter from end post to end post along the center line of the installed barrier.

The fifth paragraph of Section 83-2.03, "Measurement," of the Standard Specifications is amended to read:

- The quantity of return caps, terminal connectors and the various types of terminal sections for single and double thrie beam barriers will be determined as units from actual count.

The sixth paragraph of Section 83-2.03, "Measurement," of the Standard Specifications is amended to read:

- The quantity of end anchor assemblies will be paid for as units determined from actual count.

The first paragraph of Section 83-2.04, "Payment," of the Standard Specifications is amended to read:

- The various types of thrie beam barrier, measured as specified in Section 83-2.03, "Measurement," will be paid for at the contract price per meter for single or double thrie beam barrier, whichever applies, and the contract unit price or prices for end anchor assemblies, return caps, terminal connectors and the various types of terminal sections.

The second paragraph of Section 83-2.04, "Payment," of the Standard Specifications is amended to read:

- The above prices and payments shall include full compensation for furnishing all labor, materials, tools, equipment and incidentals, and for doing all the work involved in constructing the barrier, complete in place, including drilling holes for wood posts, driving posts, backfilling the space around posts, excavating and backfilling end anchor assembly holes, connecting thrie beam barrier to concrete surfaces and disposing of surplus excavated material, and for furnishing, placing, removing and disposing of the temporary railing for closing the gap between existing barrier and the barrier being

constructed as shown on the plans, and as specified in these specifications and the special provisions, and as directed by the Engineer.

The fourth paragraph in Section 83-2.04, "Payments," of the Standard Specifications is amended to read:

- Steel plate barrier attached to concrete barrier at overhead sign foundations, electroliers, drainage structures, and other locations shown on the plans will be measured and paid for as the type of concrete barrier attached thereto.

SECTION 85: PAVEMENT MARKERS

Issue Date: May 16, 2003

The second through fifth paragraphs in Section 85-1.03, "Sampling, Tolerances and Packaging," of the Standard Specifications are amended to read:

Sampling

- Twenty markers selected at random will constitute a representative sample for each lot of markers.
- The lot size shall not exceed 25 000 markers.

Tolerances

- Three test specimens will be randomly selected from the sample for each test and tested in conformance with these specifications. Should any one of the 3 specimens fail to conform with the requirements in these specifications, 6 additional specimens will be tested. The failure of any one of these 6 specimens shall be cause for rejection of the entire lot or shipment represented by the sample.
- The entire sample of retroreflective pavement markers will be tested for reflectance. The failure of 10 percent or more of the original sampling shall be cause for rejection.

Section 85-1.04, "Non-Reflective Pavement Markers," of the Standard Specifications is amended to read:

85-1.04 Non-Reflective Pavement Markers

- Non-reflective pavement markers (Types A and AY) shall be, at the option of the Contractor, either ceramic or plastic conforming to these specifications.
- The top surface of the marker shall be convex with a gradual change in curvature. The top, bottom and sides shall be free of objectionable marks or discoloration that will affect adhesion or appearance.
- The bottom of markers shall have areas of integrally formed protrusions or indentations, which will increase the effective bonding surface area of adhesive. The bottom surface of the marker shall not deviate more than 1.5 mm from a flat surface. The areas of protrusion shall have faces parallel to the bottom of the marker and shall project approximately one mm from the bottom.

The second through fourth paragraphs of Section 85-1.04A, "Non-Reflective Pavement Markers (Ceramic)," of the Standard Specifications are deleted.

The table in the fifth paragraph in Section 85-1.04A, "Non-Reflective Pavement Markers (Ceramic)," of the Standard Specifications is amended to read:

Testing

- Tests shall be performed in conformance with the requirements in California Test 669.

Test	Test Description	Requirement
a	Bond strength	4.8 MPa, min.
b	Glaze thickness	180 μm, min.
c	Hardness	6 Moh, min.
d	Luminance factor, Type A, white markers only, glazed surface	75, min.
e	Yellowness index, Type A, white markers only, glazed surface	7, max.
f	Color-yellow, Type AY, yellow markers only. The chromaticity coordinates shall be within a color box defined in CTM 669	Pass
g	Compressive strength	6700 N, min.
h	Water absorption	2.0 %, max.
i	Artificial weathering, 500 hours exposure, yellowness index	20, max.

Section 85-1.04B, "Non-Reflective Pavement Markers (Plastic)," of the Standard Specifications is amended to read:

85-1.04B Non-Reflective Pavement Markers (Plastic)

- Plastic non-reflective pavement markers Types A and AY shall be, at the option of the Contractor, either polypropylene or acrylonitrile-butadiene-styrene (ABS) plastic type.
- Plastic markers shall conform to the testing requirements specified in Section 85-1.04A, "Non-Reflective Pavement Markers (Ceramic)," except that Tests a, b, c, and h shall not apply. The plastic markers shall not be coated with substances that interfere with the ability of the adhesive bonding to the marker.

The sixth and seventh paragraphs in Section 85-1.05, "Retroreflective Pavement Markers," of the Standard Specifications are amended to read:

Testing

- Tests shall be performed in conformance with the requirements in California Test 669.

Test Description	Requirement		
Bond strength ^a	3.4 MPa, min.		
Compressive strength ^b	8900 N, min.		
Abrasion resistance, marker must meet the respective specific intensity minimum requirements after abrasion.	Pass		
Water Soak Resistance	No delamination of the body or lens system of the marker nor loss of reflectance		
Reflectance	Specific Intensity		
	Clear	Yellow	Red
0° Incidence Angle, min.	3.0	1.5	0.75
20° Incidence Angle, min.	1.2	0.60	0.30
After one year field evaluation	0.30	0.15	0.08

- Failure of the marker body or filler material prior to reaching 3.4 MPa shall constitute a failing bond strength test.
- Deformation of the marker of more than 3 mm at a load of less than 8900 N or delamination of the shell and the filler material of more than 3 mm regardless of the load required to break the marker shall be cause for rejection of the markers as specified in Section 85-1.03, "Sampling, Tolerances and Packaging."

- Pavement markers to be placed in pavement recesses shall conform to the above requirements for retroreflective pavement markers except that the minimum compressive strength requirement shall be 5338 N.

The eighth paragraph of Section 85-1.05, "Retroreflective Pavement Markers" of the Standard Specifications is deleted.

The eighth paragraph in Section 85-1.06, "Replacement," of the Standard Specifications is amended to read:

- Epoxy adhesive shall not be used to apply non-reflective plastic pavement markers.

SECTION 86: SIGNALS, LIGHTING AND ELECTRICAL SYSTEMS

Issue Date: January 28, 2005

The first paragraph of Section 86-2.03, "Foundations," of the Standard Specifications is amended to read:

- Except for concrete for cast-in-drilled-hole concrete pile foundations, portland cement concrete shall conform to Section 90-10, "Minor Concrete."

The fifth paragraph of Section 86-2.03, "Foundations," of the Standard Specifications is amended to read:

- Reinforced cast-in-drilled-hole concrete pile foundations for traffic signal and lighting standards shall conform to the provisions in Section 49, "Piling," with the following exceptions: 1) Material resulting from drilling holes shall be disposed of in conformance with the provisions in Section 86-2.01, "Excavating and Backfilling," and 2) Concrete filling for cast-in-drilled-hole concrete piles will not be considered as designated by compressive strength.

The seventh paragraph of Section 86-2.03, "Foundations," of the Standard Specifications is amended to read:

- Forms shall be true to line and grade. Tops of foundations for posts and standards, except special foundations, shall be finished to curb or sidewalk grade or as directed by the Engineer. Forms shall be rigid and securely braced in place. Conduit ends and anchor bolts shall be placed in proper position and to proper height, and anchor bolts shall be held in place by means of rigid top and bottom templates. The bottom template shall be made of steel. The bottom template shall provide proper spacing and alignment of the anchor bolts near their bottom embedded end. The bottom template shall be installed before placing footing concrete. Anchor bolts shall not be installed more than 1:40 from vertical.

Section 86-2.03, "Foundations," of the Standard Specifications is amended by deleting the eighth paragraph.

The twelfth paragraph of Section 86-2.03, "Foundations," of the Standard Specifications is amended to read:

- Plumbing of the standards shall be accomplished by adjusting the leveling nuts before placing the mortar or before the foundation is finished to final grade. Shims or other similar devices shall not be used for plumbing or raking of posts, standards, or pedestals. After final adjustments of both top nuts and leveling nuts on anchorage assemblies have been made, firm contact shall exist between all bearing surfaces of the anchor bolt nuts, washers, and the base plates.

The first paragraph of Section 86-2.04, "Standards, Steel Pedestals and Posts," of the Standard Specifications is amended to read:

86-2.04 STANDARDS, STEEL PEDESTALS, AND POSTS

- Standards for traffic signals and lighting, and steel pedestals for cabinets and other similar equipment, shall be located as shown on the plans. Bolts, nuts and washers, and anchor bolts for use in signal and lighting support structures shall conform to the provisions in Section 55-2, "Materials." Except when bearing-type connections or slipbases are specified, high-strength bolted connections shall conform to the provisions in Section 55-3.14, "Bolted Connections." Welding, nondestructive testing (NDT) of welds, and acceptance and repair criteria for NDT of steel members shall conform to the requirements of AWS D1.1 and the contract special provisions.

The second paragraph of Section 86-2.04, "Standards, Steel Pedestals and Posts," of the Standard Specifications is amended to read:

- On each lighting standard except Type 1, one rectangular corrosion resistant metal identification tag shall be permanently attached above the hand hole, near the base of the standard, using stainless steel rivets. On each signal pole support, two corrosion resistant metal identification tags shall be attached, one above the hand hole near the base of the

vertical standard and one on the underside of the signal mast arm near the arm plate. As a minimum, the information on each identification tag shall include the name of the manufacturer, the date of manufacture, the identification number as shown on the plans, the contract number, and a unique identification code assigned by the fabricator. This number shall be traceable to a particular contract and the welds on that component, and shall be readable after the support structure is coated and installed. The lettering shall be a minimum of 7 mm high. The information may be either depressed or raised, and shall be legible.

The fourth paragraph of Section 86-2.04, "Standards, Steel Pedestals and Posts," of the Standard Specifications is amended to read:

- Ferrous metal parts of standards, with shaft length of 4.6 m and longer, shall conform to the details shown on the plans, the provisions in Section 55-2, "Materials," except as otherwise noted, and the following requirements:

Except as otherwise specified, standards shall be fabricated from sheet steel of weldable grade having a minimum yield strength, after fabrication, of 276 MPa.

Certified test reports which verify conformance to the minimum yield strength requirements shall be submitted to the Engineer. The test reports may be the mill test reports for the as-received steel or, when the as-received steel has a lower yield strength than required, the Contractor shall provide supportive test data which provides assurance that the Contractor's method of cold forming will consistently increase the tensile properties of the steel to meet the specified minimum yield strength. The supportive test data shall include tensile properties of the steel after cold forming for specific heats and thicknesses.

When a single-ply 8-mm thick pole is specified, a 2-ply pole with equivalent section modulus may be substituted.

Standards may be fabricated of full-length sheets or shorter sections. Each section shall be fabricated from not more than 2 pieces of sheet steel. Where 2 pieces are used, the longitudinal welded seams shall be directly opposite one another. When the sections are butt-welded together, the longitudinal welded seams on adjacent sections shall be placed to form continuous straight seams from base to top of standard.

Butt-welded circumferential joints of tubular sections requiring CJP groove welds shall be made using a metal sleeve backing ring inside each joint. The sleeve shall be 3-mm nominal thickness, or thicker, and manufactured from steel having the same chemical composition as the steel in the tubular sections to be joined. When the sections to be joined have different specified minimum yield strengths, the steel in the sleeve shall have the same chemical composition as the tubular section having the higher minimum yield strength. The width of the metal sleeve shall be consistent with the type of NDT chosen and shall be a minimum width of 25 mm. The sleeve shall be centered at the joint and be in contact with the tubular section at the point of the weld at time of fit-up.

Welds shall be continuous.

The weld metal at the transverse joint shall extend to the sleeve, making the sleeve an integral part of the joint.

During fabrication, longitudinal seams on vertical tubular members of cantilevered support structures shall be centered on and along the side of the pole that the pole plate is located. Longitudinal seams on horizontal tubular members, including signal and luminaire arms, shall be within +/-45 degrees of the bottom of the arm.

The longitudinal seam welds in steel tubular sections may be made by the electric resistance welding process.

Longitudinal seam welds shall have 60 percent minimum penetration, except that within 150 mm of circumferential welds, longitudinal seam welds shall be CJP groove welds. In addition, longitudinal seam welds on lighting support structures having telescopic pole segment splices shall be CJP groove welds on the female end for a length on each end equal to the designated slip fit splice length plus 150 mm.

Exposed circumferential welds, except fillet and fatigue-resistant welds, shall be ground flush (-0, +2mm) with the base metal prior to galvanizing or painting.

Circumferential welds and base plate-to-pole welds may be repaired only one time without written permission from the Engineer.

Exposed edges of the plates that make up the base assembly shall be finished smooth and exposed corners of the plates shall be broken unless otherwise shown on the plans. Shafts shall be provided with slip-fitter shaft caps.

Flatness of surfaces of 1) base plates that are to come in contact with concrete, grout, or washers and leveling nuts; 2) plates in high-strength bolted connections; 3) plates in joints where cap screws are used to secure luminaire and signal arms; and 4) plates used for breakaway slip base assemblies shall conform to the requirements in ASTM A6.

Standards shall be straight, with a permissive variation not to exceed 25 mm measured at the midpoint of a 9-m or 11-m standard and not to exceed 20 mm measured at the midpoint of a 5-m through 6-m standard. Variation shall not exceed 25 mm at a point 4.5 m above the base plate for Type 35 and Type 36 standards.

Zinc-coated nuts used on fastener assemblies having a specified preload (obtained by specifying a prescribed tension, torque value, or degree of turn) shall be provided with a colored lubricant that is clean and dry to the touch. The color of the lubricant shall be in contrast to the zinc coating on the nut so that the presence of the lubricant is visually obvious. In addition, either the lubricant shall be insoluble in water, or fastener components shall be shipped to the job site in a sealed container.

No holes shall be made in structural members unless the holes are shown on the plans or are approved in writing by the Engineer.

Standards with an outside diameter of 300 mm or less shall be round. Standards with an outside diameter greater than 300 mm shall be round or multisided. Multisided standards shall have a minimum of 12 sides which shall be convex and shall have a minimum bend radius of 100 mm.

Mast arms for standards shall be fabricated from material as specified for standards, and shall conform to the dimensions shown on the plans.

The cast steel option for slip bases shall be fabricated from material conforming to the requirements in ASTM Designation: A 27/A 27M, Grade 70-40. Other comparable material may be used if written permission is given by the Engineer. The casting tolerances shall be in conformance with the Steel Founder's Society of America recommendations (green sand molding).

One casting from each lot of 50 castings or less shall be subject to radiographic inspection, in conformance with the requirements in ASTM Designation: E 94. The castings shall comply with the acceptance criteria severity level 3 or better for the types and categories of discontinuities in conformance with the requirements in ASTM Designations: E 186 and E 446. If the one casting fails to pass the inspection, 2 additional castings shall be radiographed. Both of these castings shall pass the inspection, or the entire lot of 50 will be rejected.

Material certifications, consisting of physical and chemical properties, and radiographic films of the castings shall be filed at the manufacturer's office. These certifications and films shall be available for inspection upon request.

High-strength bolts, nuts, and flat washers used to connect slip base plates shall conform to the requirements in ASTM Designation: A 325 or A 325M and shall be galvanized in conformance with the provisions in Section 75-1.05, "Galvanizing."

Plate washers shall be fabricated by saw cutting and drilling steel plate conforming to the requirements in AISI Designation: 1018, and be galvanized in conformance with the provisions in Section 75-1.05, "Galvanizing." Prior to galvanizing, burrs and sharp edges shall be removed and holes shall be chamfered sufficiently on each side to allow the bolt head to make full contact with the washer without tension on the bolt.

High-strength cap screws shown on the plans for attaching arms to standards shall conform to the requirements in ASTM Designation: A 325, A 325M, or A 449, and shall comply with the mechanical requirements in ASTM Designation: A 325 or A 325M after galvanizing. The cap screws shall be galvanized in conformance with the provisions in Section 75-1.05, "Galvanizing." The threads of the cap screws shall be coated with a colored lubricant that is clean and dry to the touch. The color of the lubricant shall be in contrast to the color of the zinc coating on the cap screw so that presence of the lubricant is visually obvious. In addition, either the lubricant shall be insoluble in water, or fastener components shall be shipped to the job site in a sealed container.

Unless otherwise specified, bolted connections attaching signal or luminaire arms to poles shall be considered slip critical. Galvanized faying surfaces on plates on luminaire and signal arms and matching plate surfaces on poles shall be roughened by hand using a wire brush prior to assembly and shall conform to the requirements for Class C surface conditions for slip-critical connections in "Specification for Structural Joints Using ASTM A 325 or A 490 Bolts," a specification approved by the Research Council on Structural Connections (RCSC) of the Engineering Foundation. For faying surfaces required to be painted, the paint shall be an approved type, brand, and thickness that has been tested and approved according to the RCSC Specification as a Class B coating.

Samples of fastener components will be randomly taken from each production lot by the Engineer and submitted, along with test reports required by appropriate ASTM fastener specifications, for QA testing and evaluation. Sample sizes for each fastener component shall be as determined by the Engineer.

The seventh paragraph of Section 86-2.04, "Standards, Steel Pedestals and Posts," of the Standard Specifications is amended to read:

- To avoid interference of arm plate-to-tube welds with cap screw heads, and to ensure cap screw heads can be turned using conventional installation tools, fabricators shall make necessary adjustments to details prior to fabrication and properly locate the position of arm tubes on arm plates during fabrication.

The sixth and seventh paragraphs of 86-2.12, "Wood Poles," of the Standard Specifications are amended to read:

- After fabrication, wood poles shall be pressure treated in conformance with the provisions in Section 58, "Preservative Treatment of Lumber, Timber and Piling," and AWPAC Use Category System: UC4B, Commodity Specification D.
- Wood poles, when specified in the special provisions to be painted, shall be treated with waterborne wood preservatives.

The first paragraph of Section 86-2.15, "Galvanizing," of the Standard Specifications is amended to read:

- Galvanizing shall be in conformance with the provisions in Section 75-1.05, "Galvanizing," except that cabinets may be constructed of material galvanized prior to fabrication in conformance with the requirements in ASTM Designation: A 653/653M, Coating Designation G 90, in which case all cut or damaged edges shall be painted with at least 2 applications of approved unthinned zinc-rich primer (organic vehicle type) conforming to the provisions in Section 91, "Paint." Aerosol cans shall not be used. Other types of protective coating must be approved by the Engineer prior to installation.

The first paragraph of Section 86-4.06, "Pedestrian Signal Faces" of the Standard Specifications is amended to read:

- Message symbols for pedestrian signal faces shall be white WALKING PERSON and Portland orange UPRAISED HAND conforming to the requirements in the Institute of Transportation Engineers Standards: "Pedestrian Traffic Control Signal Indications," "Manual on Uniform Traffic Control Devices," and "MUTCD California Supplement." The height of each symbol shall be not less than 250 mm and the width of each symbol shall be not less than 165 mm.

The tenth paragraph of Section 86-4.07, "Light Emitting Diode Pedestrian Signal Face 'Upraised Hand' Module" of the Standard Specifications is amended to read:

- The luminance of the "UPRAISED HAND" symbol shall be 3750 cd/m² minimum. The color of "UPRAISED HAND" shall be Portland orange conforming to the requirements of the Institute of Transportation Engineers Standards: "Pedestrian Traffic Control Signal Indications," "Manual on Uniform Traffic Control Devices," and "MUTCD California Supplement." The height of each symbol shall be not less than 250 mm and the width of each symbol shall be not less than 165 mm.

Section 86-8.01, "Payment," of the Standard Specifications is amended by adding the following paragraph after the first paragraph:

- If a portion or all of the poles for signal, lighting and electrical systems pursuant to Standard Specification Section 86, "Signals, Lighting and Electrical Systems," is fabricated more than 480 air line kilometers from both Sacramento and Los Angeles, additional shop inspection expenses will be sustained by the State. Whereas it is and will be impracticable and extremely difficult to ascertain and determine the actual increase in such expenses, it is agreed that payment to the Contractor for furnishing such items from each fabrication site located more than 480 air line kilometers from both Sacramento and Los Angeles will be reduced \$5000; in addition, in the case where a fabrication site is located more than 4800 air line kilometers from both Sacramento and Los Angeles, payment will be reduced an additional \$3000 per each fabrication site (\$8000 total per site).

SECTION 88: ENGINEERING FABRIC

Issue Date: January 15, 2002

Section 88-1.02, "Pavement Reinforcing Fabric," of the Standard Specifications is amended to read:

- Pavement reinforcing fabric shall be 100 percent polypropylene staple fiber fabric material, needle-punched, thermally bonded on one side, and conform to the following:

Specification	Requirement
Weight, grams per square meter ASTM Designation: D 5261	140
Grab tensile strength (25-mm grip), kilonewtons, min. in each direction ASTM Designation: D 4632	0.45
Elongation at break, percent min. ASTM Designation: D 4632	50
Asphalt retention by fabric, grams per square meter. (Residual Minimum) ASTM Designation: D 6140	900

Note: Weight, grab, elongation and asphalt retention are based on Minimum Average Roll Value (MARV)

SECTION 90: PORTLAND CEMENT CONCRETE

Issue Date: November 2, 2004

Section 90, "Portland Cement Concrete," of the Standard Specifications is amended to read:

SECTION 90: PORTLAND CEMENT CONCRETE

90-1 GENERAL

90-1.01 DESCRIPTION

- Portland cement concrete shall be composed of cementitious material, fine aggregate, coarse aggregate, admixtures if used, and water, proportioned and mixed as specified in these specifications.
- The Contractor shall determine the mix proportions for concrete in conformance with these specifications. Unless otherwise specified, cementitious material shall be a combination of cement and mineral admixture. Cementitious material shall be either:
 1. "Type IP (MS) Modified" cement; or
 2. A combination of "Type II Modified" portland cement and mineral admixture; or
 3. A combination of Type V portland cement and mineral admixture.
- Type III portland cement shall be used only as allowed in the special provisions or with the approval of the Engineer.
 - Class 1 concrete shall contain not less than 400 kg of cementitious material per cubic meter.
 - Class 2 concrete shall contain not less than 350 kg of cementitious material per cubic meter.
 - Class 3 concrete shall contain not less than 300 kg of cementitious material per cubic meter.
 - Class 4 concrete shall contain not less than 250 kg of cementitious material per cubic meter.
 - Minor concrete shall contain not less than 325 kg of cementitious material per cubic meter unless otherwise specified in these specifications or the special provisions.
 - Unless otherwise designated on the plans or specified in these specifications or the special provisions, the amount of cementitious material used per cubic meter of concrete in structures or portions of structures shall conform to the following:

Use	Cementitious Material Content (kg/m ³)
Concrete designated by compressive strength:	
Deck slabs and slab spans of bridges	400 min., 475 max.
Roof sections of exposed top box culverts	400 min., 475 max.
Other portions of structures	350 min., 475 max.
Concrete not designated by compressive strength:	
Deck slabs and slab spans of bridges	400 min.
Roof sections of exposed top box culverts	400 min.
Prestressed members	400 min.
Seal courses	400 min.
Other portions of structures	350 min.
Concrete for precast members	350 min., 550 max.

- Whenever the 28-day compressive strength shown on the plans is greater than 25 MPa, the concrete shall be designated by compressive strength. If the plans show a 28-day compressive strength that is 28 MPa or greater, an additional 14 days will be allowed to obtain the specified strength. The 28-day compressive strengths shown on the plans that are 25 MPa or less are shown for design information only and are not a requirement for acceptance of the concrete.
- Concrete designated by compressive strength shall be proportioned such that the concrete will attain the strength shown on the plans or specified in the special provisions.
 - Before using concrete for which the mix proportions have been determined by the Contractor, or in advance of revising those mix proportions, the Contractor shall submit in writing to the Engineer a copy of the mix design.
 - Compliance with cementitious material content requirements will be verified in conformance with procedures described in California Test 518 for cement content. For testing purposes, mineral admixture shall be considered to be cement. Batch proportions shall be adjusted as necessary to produce concrete having the specified cementitious material content.
 - If any concrete has a cementitious material, portland cement, or mineral admixture content that is less than the minimum required, the concrete shall be removed. However, if the Engineer determines that the concrete is structurally adequate, the concrete may remain in place and the Contractor shall pay to the State \$0.55 for each kilogram of cementitious material, portland cement, or mineral admixture that is less than the minimum required. The Department may deduct the amount from any moneys due, or that may become due, the Contractor under the contract. The deductions will not be made unless the difference between the contents required and those actually provided exceeds the batching tolerances permitted by Section 90-5, "Proportioning." No deductions will be made based on the results of California Test 518.
 - The requirements of the preceding paragraph shall not apply to minor concrete or commercial quality concrete.

90-2 MATERIALS

90-2.01 CEMENT

- Unless otherwise specified, cement shall be either "Type IP (MS) Modified" cement, "Type II Modified" portland cement or Type V portland cement.
- "Type IP (MS) Modified" cement shall conform to the requirements for Type IP (MS) cement in ASTM Designation: C 595, and shall be comprised of an intimate and uniform blend of Type II cement and not more than 35 percent by mass of mineral admixture. The type and minimum amount of mineral admixture used in the manufacture of "Type IP (MS) Modified" cement shall be in conformance with the provisions in Section 90-4.08, "Required Use of Mineral Admixtures."
- "Type II Modified" portland cement shall conform to the requirements for Type II portland cement in ASTM Designation: C 150-02a.
- In addition, "Type IP (MS) Modified" cement and "Type II Modified" portland cement shall conform to the following requirements:
 - A. The cement shall not contain more than 0.60-percent by mass of alkalis, calculated as the percentage of Na₂O plus 0.658 times the percentage of K₂O, when determined by either direct intensity flame photometry or by the atomic absorption method. The instrument and procedure used shall be qualified as to precision and accuracy in conformance with the requirements in ASTM Designation: C 114;
 - B. The autoclave expansion shall not exceed 0.50-percent; and
 - C. Mortar, containing the cement to be used and Ottawa sand, when tested in conformance with California Test 527, shall not expand in water more than 0.010 percent and shall not contract in air more than 0.048 percent, except that

when cement is to be used for precast prestressed concrete piling, precast prestressed concrete members, or steam cured concrete products, the mortar shall not contract in air more than 0.053 percent.

- Type III and Type V portland cements shall conform to the requirements in ASTM Designation: C 150-02a and the additional requirements listed above for "Type II Modified" portland cement, except that when tested in conformance with California Test 527, mortar containing Type III portland cement shall not contract in air more than 0.075 percent.

- Cement used in the manufacture of cast-in-place concrete for exposed surfaces of like elements of a structure shall be from the same cement mill.

- Cement shall be protected from exposure to moisture until used. Sacked cement shall be piled to permit access for tally, inspection, and identification of each shipment.

- Adequate facilities shall be provided to assure that cement meeting the provisions specified in this Section 90-2.01 shall be kept separate from other cement in order to prevent any but the specified cement from entering the work. Safe and suitable facilities for sampling cement shall be provided at the weigh hopper or in the feed line immediately in advance of the hopper, in conformance with California Test 125.

- If cement is used prior to sampling and testing as provided in Section 6-1.07, "Certificates of Compliance," and the cement is delivered directly to the site of the work, the Certificate of Compliance shall be signed by the cement manufacturer or supplier of the cement. If the cement is used in ready-mixed concrete or in precast concrete products purchased as such by the Contractor, the Certificate of Compliance shall be signed by the manufacturer of the concrete or product.

- Cement furnished without a Certificate of Compliance shall not be used in the work until the Engineer has had sufficient time to make appropriate tests and has approved the cement for use.

90-2.02 AGGREGATES

- Aggregates shall be free from deleterious coatings, clay balls, roots, bark, sticks, rags, and other extraneous material.

- Natural aggregates shall be thoroughly and uniformly washed before use.

- The Contractor, at the Contractor's expense, shall provide safe and suitable facilities, including necessary splitting devices for obtaining samples of aggregates, in conformance with California Test 125.

- Aggregates shall be of such character that it will be possible to produce workable concrete within the limits of water content provided in Section 90-6.06, "Amount of Water and Penetration."

- Aggregates shall have not more than 10 percent loss when tested for soundness in conformance with the requirements in California Test 214. The soundness requirement for fine aggregate will be waived, provided that the durability index, D_f , of the fine aggregate is 60, or greater, when tested for durability in conformance with California Test 229.

- If the results of any one or more of the Cleanness Value, Sand Equivalent, or aggregate grading tests do not meet the requirements specified for "Operating Range" but all meet the "Contract Compliance" requirements, the placement of concrete shall be suspended at the completion of the current pour until tests or other information indicate that the next material to be used in the work will comply with the requirements specified for "Operating Range."

- If the results of either or both the Cleanness Value and coarse aggregate grading tests do not meet the requirements specified for "Contract Compliance," the concrete that is represented by the tests shall be removed. However, if the Engineer determines that the concrete is structurally adequate, the concrete may remain in place, and the Contractor shall pay to the State \$4.60 per cubic meter for paving concrete and \$7.20 per cubic meter for all other concrete for the concrete represented by these tests and left in place. The Department may deduct the amount from any moneys due, or that may become due, the Contractor under the contract.

- If the results of either or both the Sand Equivalent and fine aggregate grading tests do not meet the requirements specified for "Contract Compliance," the concrete which is represented by the tests shall be removed. However, if the Engineer determines that the concrete is structurally adequate, the concrete may remain in place, and the Contractor shall pay to the State \$4.60 per cubic meter for paving concrete and \$7.20 per cubic meter for all other concrete for the concrete represented by these tests and left in place. The Department may deduct the amount from any moneys due, or that may become due, the Contractor under the contract.

- The 2 preceding paragraphs apply individually to the "Contract Compliance" requirements for coarse aggregate and fine aggregate. When both coarse aggregate and fine aggregate do not conform to the "Contract Compliance" requirements, both paragraphs shall apply. The payments specified in those paragraphs shall be in addition to any payments made in conformance with the provisions in Section 90-1.01, "Description."

- No single Cleanness Value, Sand Equivalent or aggregate grading test shall represent more than 250 m³ of concrete or one day's pour, whichever is smaller.

- When the source of an aggregate is changed, the Contractor shall adjust the mix proportions and submit in writing to the Engineer a copy of the mix design before using the aggregates.

90-2.02A Coarse Aggregate

- Coarse aggregate shall consist of gravel, crushed gravel, crushed rock, crushed air-cooled iron blast furnace slag or combinations thereof. Crushed air-cooled blast furnace slag shall not be used in reinforced or prestressed concrete.
- Coarse aggregate shall conform to the following quality requirements:

Tests	California Test	Requirements
Loss in Los Angeles Rattler (after 500 revolutions)	211	45% max.
Cleanness Value		
Operating Range	227	75 min.
Contract Compliance	227	71 min.

- In lieu of the above Cleanness Value requirements, a Cleanness Value "Operating Range" limit of 71, minimum, and a Cleanness Value "Contract Compliance" limit of 68, minimum, will be used to determine the acceptability of the coarse aggregate if the Contractor furnishes a Certificate of Compliance, as provided in Section 6-1.07, "Certificates of Compliance," certifying that:

1. coarse aggregate sampled at the completion of processing at the aggregate production plant had a Cleanness Value of not less than 82 when tested by California Test 227; and
2. prequalification tests performed in conformance with the requirements in California Test 549 indicated that the aggregate would develop a relative strength of not less than 95 percent and would have a relative shrinkage not greater than 105 percent, based on concrete.

90-2.02B Fine Aggregate

- Fine aggregate shall consist of natural sand, manufactured sand produced from larger aggregate or a combination thereof. Manufactured sand shall be well graded.

- Fine aggregate shall conform to the following quality requirements:

Test	California Test	Requirements
Organic Impurities	213	Satisfactory ^a
Mortar Strengths Relative to Ottawa Sand	515	95%, min.
Sand Equivalent:		
Operating Range	217	75, min.
Contract Compliance	217	71, min.

a Fine aggregate developing a color darker than the reference standard color solution may be accepted if it is determined by the Engineer, from mortar strength tests, that a darker color is acceptable.

- In lieu of the above Sand Equivalent requirements, a Sand Equivalent "Operating Range" limit of 71 minimum and a Sand Equivalent "Contract Compliance" limit of 68 minimum will be used to determine the acceptability of the fine aggregate if the Contractor furnishes a Certificate of Compliance, as provided in Section 6-1.07, "Certificates of Compliance," certifying that:

1. fine aggregate sampled at the completion of processing at the aggregate production plant had a Sand Equivalent value of not less than 82 when tested by California Test 217; and
2. prequalification tests performed in conformance with California Test 549 indicated that the aggregate would develop a relative strength of not less than 95 percent and would have a relative shrinkage not greater than 105 percent, based on concrete.

90-2.03 WATER

- In conventionally reinforced concrete work, the water for curing, for washing aggregates, and for mixing shall be free from oil and shall not contain more than 1000 parts per million of chlorides as Cl, when tested in conformance with California Test 422, nor more than 1300 parts per million of sulfates as SO₄, when tested in conformance with California Test 417. In prestressed concrete work, the water for curing, for washing aggregates, and for mixing shall be free from oil

and shall not contain more than 650 parts per million of chlorides as Cl, when tested in conformance with California Test 422, nor more than 1300 parts per million of sulfates as SO₄, when tested in conformance with California Test 417. In no case shall the water contain an amount of impurities that will cause either: 1) a change in the setting time of cement of more than 25 percent when tested in conformance with the requirements in ASTM Designation: C 191 or ASTM Designation: C 266 or 2) a reduction in the compressive strength of mortar at 14 days of more than 5 percent, when tested in conformance with the requirements in ASTM Designation: C 109, when compared to the results obtained with distilled water or deionized water, tested in conformance with the requirements in ASTM Designation: C 109.

- In non-reinforced concrete work, the water for curing, for washing aggregates and for mixing shall be free from oil and shall not contain more than 2000 parts per million of chlorides as Cl, when tested in conformance with California Test 422, or more than 1500 parts per million of sulfates as SO₄, when tested in conformance with California Test 417.

- In addition to the above provisions, water for curing concrete shall not contain impurities in a sufficient amount to cause discoloration of the concrete or produce etching of the surface.

- Water reclaimed from mixer wash-out operations may be used in mixing concrete. The water shall not contain coloring agents or more than 300 parts per million of alkalis (Na₂O + 0.658 K₂O) as determined on the filtrate. The specific gravity of the water shall not exceed 1.03 and shall not vary more than ±0.010 during a day's operations.

90-2.04 ADMIXTURE MATERIALS

- Admixture materials shall conform to the requirements in the following ASTM Designations:

- A. Chemical Admixtures—ASTM Designation: C 494.
- B. Air-entraining Admixtures—ASTM Designation: C 260.
- C. Calcium Chloride—ASTM Designation: D 98.
- D. Mineral Admixtures—Coal fly ash; raw or calcined natural pozzolan as specified in ASTM Designation: C 618; silica fume conforming to the requirements in ASTM Designation: C 1240, with reduction of mortar expansion of 80 percent, minimum, using the cement from the proposed mix design.

- Unless otherwise specified in the special provisions, mineral admixtures shall be used in conformance with the provisions in Section 90-4.08, "Required Use of Mineral Admixtures."

90-3 AGGREGATE GRADINGS

90-3.01 GENERAL

- Before beginning concrete work, the Contractor shall submit in writing to the Engineer the gradation of the primary aggregate nominal sizes that the Contractor proposes to furnish. If a primary coarse aggregate or the fine aggregate is separated into 2 or more sizes, the proposed gradation shall consist of the gradation for each individual size, and the proposed proportions of each individual size, combined mathematically to indicate one proposed gradation. The proposed gradation shall meet the grading requirements shown in the table in this section, and shall show the percentage passing each of the sieve sizes used in determining the end result.

- The Engineer may waive, in writing, the gradation requirements in this Section 90-3.01 and in Sections 90-3.02, "Coarse Aggregate Grading," 90-3.03, "Fine Aggregate Grading," and 90-3.04, "Combined Aggregate Gradings," if, in the Engineer's opinion, furnishing the gradation is not necessary for the type or amount of concrete work to be constructed.

- Gradations proposed by the Contractor shall be within the following percentage passing limits:

Primary Aggregate Nominal Size	Sieve Size	Limits of Proposed Gradation
37.5-mm x 19-mm	25-mm	19 - 41
25-mm x 4.75-mm	19-mm	52 - 85
25-mm x 4.75-mm	9.5-mm	15 - 38
12.5-mm x 4.75-mm	9.5-mm	40 - 78
9.5-mm x 2.36-mm	9.5-mm	50 - 85
Fine Aggregate	1.18-mm	55 - 75
Fine Aggregate	600-µm	34 - 46
Fine Aggregate	300-µm	16 - 29

- Should the Contractor change the source of supply, the Contractor shall submit in writing to the Engineer the new gradations before their intended use.

90-3.02 COARSE AGGREGATE GRADING

- The grading requirements for coarse aggregates are shown in the following table for each size of coarse aggregate:

Sieve Sizes	Percentage Passing Primary Aggregate Nominal Sizes							
	37.5-mm x 19-mm		25-mm x 4.75-mm		12.5-mm x 4.75-mm		9.5-mm x 2.36-mm	
	Operating Range	Contract Compliance	Operating Range	Contract Compliance	Operating Range	Contract Compliance	Operating Range	Contract Compliance
50-mm	100	100	—	—	—	—	—	—
37.5-mm	88-100	85-100	100	100	—	—	—	—
25-mm	x ± 18	X ± 25	88-100	86-100	—	—	—	—
19-mm	0-17	0-20	X ± 15	X ± 22	100	100	—	—
12.5-mm	—	—	—	—	82-100	80-100	100	100
9.5-mm	0-7	0-9	X ± 15	X ± 22	X ± 15	X ± 22	X ± 15	X ± 20
4.75-mm	—	—	0-16	0-18	0-15	0-18	0-25	0-28
2.36-mm	—	—	0-6	0-7	0-6	0-7	0-6	0-7

- In the above table, the symbol X is the gradation that the Contractor proposes to furnish for the specific sieve size as provided in Section 90-3.01, "General."
- Coarse aggregate for the 37.5-mm, maximum, combined aggregate grading as provided in Section 90-3.04, "Combined Aggregate Gradings," shall be furnished in 2 or more primary aggregate nominal sizes. Each primary aggregate nominal size may be separated into 2 sizes and stored separately, provided that the combined material conforms to the grading requirements for that particular primary aggregate nominal size.
- When the 25-mm, maximum, combined aggregate grading as provided in Section 90-3.04, "Combined Aggregate Gradings," is to be used, the coarse aggregate may be separated into 2 sizes and stored separately, provided that the combined material shall conform to the grading requirements for the 25-mm x 4.75-mm primary aggregate nominal size.

90-3.03 FINE AGGREGATE GRADING

- Fine aggregate shall be graded within the following limits:

Sieve Sizes	Percentage Passing	
	Operating Range	Contract Compliance
9.5-mm	100	100
4.75-mm	95-100	93-100
2.36-mm	65-95	61-99
1.18-mm	X ± 10	X ± 13
600-µm	X ± 9	X ± 12
300-µm	X ± 6	X ± 9
150-µm	2-12	1-15
75-µm	0-8	0-10

- In the above table, the symbol X is the gradation that the Contractor proposes to furnish for the specific sieve size as provided in Section 90-3.01, "General."
- In addition to the above required grading analysis, the distribution of the fine aggregate sizes shall be such that the difference between the total percentage passing the 1.18-mm sieve and the total percentage passing the 600-µm sieve shall be between 10 and 40, and the difference between the percentage passing the 600-µm and 300-µm sieves shall be between 10 and 40.
- Fine aggregate may be separated into 2 or more sizes and stored separately, provided that the combined material conforms to the grading requirements specified in this Section 90-3.03.

90-3.04 COMBINED AGGREGATE GRADINGS

- Combined aggregate grading limits shall be used only for the design of concrete mixes. Concrete mixes shall be designed so that aggregates are combined in proportions that shall produce a mixture within the grading limits for combined aggregates as specified herein.
- The combined aggregate grading, except when otherwise specified in these specifications or the special provisions, shall be either the 37.5-mm, maximum grading, or the 25-mm, maximum grading, at the option of the Contractor.

Grading Limits of Combined Aggregates

Sieve Sizes	Percentage Passing			
	37.5-mm Max.	25-mm Max.	12.5-mm Max.	9.5-mm Max.
50-mm	100	—	—	—
37.5-mm	90-100	100	—	—
25-mm	50-86	90-100	—	—
19-mm	45-75	55-100	100	—
12.5-mm	—	—	90-100	100
9.5-mm	38-55	45-75	55-86	50 - 100
4.75-mm	30-45	35-60	45-63	45 - 63
2.36-mm	23-38	27-45	35-49	35 - 49
1.18-mm	17-33	20-35	25-37	25 - 37
600- μ m	10-22	12-25	15-25	15 - 25
300- μ m	4-10	5-15	5-15	5 - 15
150- μ m	1-6	1-8	1-8	1 - 8
75- μ m	0-3	0-4	0-4	0 - 4

- Changes from one grading to another shall not be made during the progress of the work unless permitted by the Engineer.

90-4 ADMIXTURES

90-4.01 GENERAL

- Admixtures used in portland cement concrete shall conform to and be used in conformance with the provisions in this Section 90-4 and the special provisions. Admixtures shall be used when specified or ordered by the Engineer and may be used at the Contractor's option as provided herein.
- Chemical admixtures and air-entraining admixtures containing chlorides as Cl in excess of one percent by mass of admixture, as determined by California Test 415, shall not be used in prestressed or reinforced concrete.
- Calcium chloride shall not be used in concrete except when otherwise specified.
- Mineral admixture used in concrete for exposed surfaces of like elements of a structure shall be from the same source and of the same percentage.
- Admixtures shall be uniform in properties throughout their use in the work. Should it be found that an admixture as furnished is not uniform in properties, its use shall be discontinued.
- If more than one admixture is used, the admixtures shall be compatible with each other so that the desirable effects of all admixtures used will be realized.

90-4.02 MATERIALS

- Admixture materials shall conform to the provisions in Section 90-2.04, "Admixture Materials."

90-4.03 ADMIXTURE APPROVAL

- No admixture brand shall be used in the work unless it is on the Department's current list of approved brands for the type of admixture involved.
- Admixture brands will be considered for addition to the approved list if the manufacturer of the admixture submits to the Transportation Laboratory a sample of the admixture accompanied by certified test results demonstrating that the admixture complies with the requirements in the appropriate ASTM Designation and these specifications. The sample shall be sufficient to permit performance of all required tests. Approval of admixture brands will be dependent upon a determination as to compliance with the requirements, based on the certified test results submitted, together with tests the Department may elect to perform.
- When the Contractor proposes to use an admixture of a brand and type on the current list of approved admixture brands, the Contractor shall furnish a Certificate of Compliance from the manufacturer, as provided in Section 6-1.07, "Certificates of Compliance," certifying that the admixture furnished is the same as that previously approved. If a previously approved admixture is not accompanied by a Certificate of Compliance, the admixture shall not be used in the work until the Engineer has had sufficient time to make the appropriate tests and has approved the admixture for use. The Engineer may take samples for testing at any time, whether or not the admixture has been accompanied by a Certificate of Compliance.
- If a mineral admixture is delivered directly to the site of the work, the Certificate of Compliance shall be signed by the manufacturer or supplier of the mineral admixture. If the mineral admixture is used in ready-mix concrete or in precast

concrete products purchased as such by the Contractor, the Certificate of Compliance shall be signed by the manufacturer of the concrete or product.

90-4.04 REQUIRED USE OF CHEMICAL ADMIXTURES AND CALCIUM CHLORIDE

- When the use of a chemical admixture or calcium chloride is specified, the admixture shall be used at the dosage specified, except that if no dosage is specified, the admixture shall be used at the dosage normally recommended by the manufacturer of the admixture.
- Calcium chloride shall be dispensed in liquid, flake, or pellet form. Calcium chloride dispensed in liquid form shall conform to the provisions for dispensing liquid admixtures in Section 90-4.10, "Proportioning and Dispensing Liquid Admixtures."

90-4.05 OPTIONAL USE OF CHEMICAL ADMIXTURES

- The Contractor will be permitted to use Type A or F, water-reducing; Type B, retarding; or Type D or G, water-reducing and retarding admixtures as described in ASTM Designation: C 494 to conserve cementitious material or to facilitate any concrete construction application subject to the following conditions:

- A. When a water-reducing admixture or a water-reducing and retarding admixture is used, the cementitious material content specified or ordered may be reduced by a maximum of 5 percent by mass, except that the resultant cementitious material content shall be not less than 300 kilograms per cubic meter; and
- B. When a reduction in cementitious material content is made, the dosage of admixture used shall be the dosage used in determining approval of the admixture.

- Unless otherwise specified, a Type C accelerating chemical admixture conforming to the requirements in ASTM Designation: C 494, may be used in portland cement concrete. Inclusion in the mix design submitted for approval will not be required provided that the admixture is added to counteract changing conditions that contribute to delayed setting of the portland cement concrete, and the use or change in dosage of the admixture is approved in writing by the Engineer.

90-4.06 REQUIRED USE OF AIR-ENTRAINING ADMIXTURES

- When air-entrainment is specified or ordered by the Engineer, the air-entraining admixture shall be used in amounts to produce a concrete having the specified air content as determined by California Test 504.

90-4.07 OPTIONAL USE OF AIR-ENTRAINING ADMIXTURES

- When air-entrainment has not been specified or ordered by the Engineer, the Contractor will be permitted to use an air-entraining admixture to facilitate the use of any construction procedure or equipment provided that the average air content, as determined by California Test 504, of 3 successive tests does not exceed 4 percent, and no single test value exceeds 5.5 percent. If the Contractor elects to use an air-entraining admixture in concrete for pavement, the Contractor shall so indicate at the time the Contractor designates the source of aggregate as provided in Section 40-1.015, "Cement Content."

90-4.08 REQUIRED USE OF MINERAL ADMIXTURES

- Unless otherwise specified, mineral admixture shall be combined with cement to make cementitious material.
- The calcium oxide content shall not exceed 10 percent when determined in conformance with the requirements in ASTM Designation: C 114. The available alkali content (as sodium oxide equivalent) shall not exceed 1.5 percent when determined in conformance with the requirements in ASTM Designation: C 311, or the total alkali content (as sodium oxide equivalent) shall not exceed 5.0 percent when determined in conformance with the requirements in ASTM Designation: D 4326.
- The amounts of cement and mineral admixture used in cementitious material shall be sufficient to satisfy the minimum cementitious material content requirements specified in Section 90-1.01, "Description," or Section 90-4.05, "Optional Use of Chemical Admixtures," and shall conform to the following:

- A. The minimum amount of cement shall not be less than 75 percent by mass of the specified minimum cementitious material content;
- B. The minimum amount of mineral admixture to be combined with cement shall be determined using one of the following criteria:
 1. When the calcium oxide content of a mineral admixture is equal to or less than 2 percent by mass, the amount of mineral admixture shall not be less than 15 percent by mass of the total amount of cementitious material to be used in the mix;

2. When the calcium oxide content of a mineral admixture is greater than 2 percent, the amount of mineral admixture shall not be less than 25 percent by mass of the total amount of cementitious material to be used in the mix;
 3. When a mineral admixture that conforms to the provisions for silica fume in Section 90-2.04, "Admixture Materials," is used, the amount of mineral admixture shall not be less than 10 percent by mass of the total amount of cementitious material to be used in the mix
- C. The total amount of mineral admixture shall not exceed 35 percent by mass of the total amount of cementitious material to be used in the mix. Where Section 90-1.01, "Description," specifies a maximum cementitious content in kilograms per cubic meter, the total mass of cement and mineral admixture per cubic meter shall not exceed the specified maximum cementitious material content.

90-4.09 BLANK

90-4.10 PROPORTIONING AND DISPENSING LIQUID ADMIXTURES

- Chemical admixtures and air-entraining admixtures shall be dispensed in liquid form. Dispensers for liquid admixtures shall have sufficient capacity to measure at one time the prescribed quantity required for each batch of concrete. Each dispenser shall include a graduated measuring unit into which liquid admixtures are measured to within ± 5 percent of the prescribed quantity for each batch. Dispensers shall be located and maintained so that the graduations can be accurately read from the point at which proportioning operations are controlled to permit a visual check of batching accuracy prior to discharge. Each measuring unit shall be clearly marked for the type and quantity of admixture.
 - Each liquid admixture dispensing system shall be equipped with a sampling device consisting of a valve located in a safe and readily accessible position such that a sample of the admixture may be withdrawn slowly by the Engineer.
 - If more than one liquid admixture is used in the concrete mix, each liquid admixture shall have a separate measuring unit and shall be dispensed by injecting equipment located in such a manner that the admixtures are not mixed at high concentrations and do not interfere with the effectiveness of each other. When air-entraining admixtures are used in conjunction with other liquid admixtures, the air-entraining admixture shall be the first to be incorporated into the mix.
 - When automatic proportioning devices are required for concrete pavement, dispensers for liquid admixtures shall operate automatically with the batching control equipment. The dispensers shall be equipped with an automatic warning system in good operating condition that will provide a visible or audible signal at the point at which proportioning operations are controlled when the quantity of admixture measured for each batch of concrete varies from the preselected dosage by more than 5 percent, or when the entire contents of the measuring unit are not emptied from the dispenser into each batch of concrete.
 - Unless liquid admixtures are added to premeasured water for the batch, their discharge into the batch shall be arranged to flow into the stream of water so that the admixtures are well dispersed throughout the batch, except that air-entraining admixtures may be dispensed directly into moist sand in the batching bins provided that adequate control of the air content of the concrete can be maintained.
 - Liquid admixtures requiring dosages greater than 2.5 L/m^3 shall be considered to be water when determining the total amount of free water as specified in Section 90-6.06, "Amount of Water and Penetration."
 - Special admixtures, such as "high range" water reducers that may contribute to a high rate of slump loss, shall be measured and dispensed as recommended by the admixture manufacturer and as approved by the Engineer.

90-4.11 STORAGE, PROPORTIONING, AND DISPENSING OF MINERAL ADMIXTURES

- Mineral admixtures shall be protected from exposure to moisture until used. Sacked material shall be piled to permit access for tally, inspection and identification for each shipment.
- Adequate facilities shall be provided to assure that mineral admixtures meeting the specified requirements are kept separate from other mineral admixtures in order to prevent any but the specified mineral admixtures from entering the work. Safe and suitable facilities for sampling mineral admixtures shall be provided at the weigh hopper or in the feed line immediately in advance of the hopper.
 - Mineral admixtures shall be incorporated into concrete using equipment conforming to the requirements for cement weigh hoppers, and charging and discharging mechanisms in ASTM Designation: C 94, in Section 90-5.03, "Proportioning," and in this Section 90-4.11.
 - When concrete is completely mixed in stationary paving mixers, the mineral admixture shall be weighed in a separate weigh hopper conforming to the provisions for cement weigh hoppers and charging and discharging mechanisms in Section 90-5.03A, "Proportioning for Pavement," and the mineral admixture and cement shall be introduced simultaneously into the mixer proportionately with the aggregate. If the mineral admixture is not weighed in a separate weigh hopper, the Contractor shall provide certification that the stationary mixer is capable of mixing the cement, admixture, aggregates and water uniformly prior to discharge. Certification shall contain the following:

- A. Test results for 2 compressive strength test cylinders of concrete taken within the first one-third and 2 compressive strength test cylinders of concrete taken within the last one-third of the concrete discharged from a single batch from the stationary paving mixer. Strength tests and cylinder preparation will be in conformance with the provisions of Section 90-9, "Compressive Strength;"
- B. Calculations demonstrating that the difference in the averages of 2 compressive strengths taken in the first one-third is no greater than 7.5 percent different than the averages of 2 compressive strengths taken in the last one-third of the concrete discharged from a single batch from the stationary paving mixer. Strength tests and cylinder preparation will be in conformance with the provisions of Section 90-9, "Compressive Strength;" and
- C. The mixer rotation speed and time of mixing prior to discharge that are required to produce a mix that meets the requirements above.

90-5 PROPORTIONING

90-5.01 STORAGE OF AGGREGATES

- Aggregates shall be stored or stockpiled in such a manner that separation of coarse and fine particles of each size shall be avoided and also that the various sizes shall not become intermixed before proportioning.
- Aggregates shall be stored or stockpiled and handled in a manner that shall prevent contamination by foreign materials. In addition, storage of aggregates at batching or mixing facilities that are erected subsequent to the award of the contract and that furnish concrete to the project shall conform to the following:
 - A. Intermingling of the different sizes of aggregates shall be positively prevented. The Contractor shall take the necessary measures to prevent intermingling. The preventive measures may include, but are not necessarily limited to, physical separation of stockpiles or construction of bulkheads of adequate length and height; and
 - B. Contamination of aggregates by contact with the ground shall be positively prevented. The Contractor shall take the necessary measures to prevent contamination. The preventive measures shall include, but are not necessarily limited to, placing aggregates on wooden platforms or on hardened surfaces consisting of portland cement concrete, asphalt concrete, or cement treated material.
- In placing aggregates in storage or in moving the aggregates from storage to the weigh hopper of the batching plant, any method that may cause segregation, degradation, or the combining of materials of different gradings that will result in any size of aggregate at the weigh hopper failing to meet the grading requirements, shall be discontinued. Any method of handling aggregates that results in excessive breakage of particles shall be discontinued. The use of suitable devices to reduce impact of falling aggregates may be required by the Engineer.

90-5.02 PROPORTIONING DEVICES

- Weighing, measuring, or metering devices used for proportioning materials shall conform to the requirements in Section 9-1.01, "Measurement of Quantities," and this Section 90-5.02. In addition, automatic weighing systems shall comply with the requirements for automatic proportioning devices in Section 90-5.03A, "Proportioning for Pavement." Automatic devices shall be automatic to the extent that the only manual operation required for proportioning the aggregates, cement, and mineral admixture for one batch of concrete is a single operation of a switch or starter.
- Proportioning devices shall be tested at the expense of the Contractor as frequently as the Engineer may deem necessary to ensure their accuracy.
- Weighing equipment shall be insulated against vibration or movement of other operating equipment in the plant. When the plant is in operation, the mass of each batch of material shall not vary from the mass designated by the Engineer by more than the tolerances specified herein.
- Equipment for cumulative weighing of aggregate shall have a zero tolerance of ± 0.5 percent of the designated total batch mass of the aggregate. For systems with individual weigh hoppers for the various sizes of aggregate, the zero tolerance shall be ± 0.5 percent of the individual batch mass designated for each size of aggregate. Equipment for cumulative weighing of cement and mineral admixtures shall have a zero tolerance of ± 0.5 percent of the designated total batch mass of the cement and mineral admixture. Equipment for weighing cement or mineral admixture separately shall have a zero tolerance of ± 0.5 percent of their designated individual batch masses. Equipment for measuring water shall have a zero tolerance of ± 0.5 percent of its designated mass or volume.
- The mass indicated for any batch of material shall not vary from the preselected scale setting by more than the following:
 - A. Aggregate weighed cumulatively shall be within 1.0 percent of the designated total batch mass of the aggregate. Aggregates weighed individually shall be within 1.5 percent of their respective designated batch masses; and

- B. Cement shall be within 1.0 percent of its designated batch mass. When weighed individually, mineral admixture shall be within 1.0 percent of its designated batch mass. When mineral admixture and cement are permitted to be weighed cumulatively, cement shall be weighed first to within 1.0 percent of its designated batch mass, and the total for cement and mineral admixture shall be within 1.0 percent of the sum of their designated batch masses; and
- C. Water shall be within 1.5 percent of its designated mass or volume.

- Each scale graduation shall be approximately 0.001 of the total capacity of the scale. The capacity of scales for weighing cement, mineral admixture, or cement plus mineral admixture and aggregates shall not exceed that of commercially available scales having single graduations indicating a mass not exceeding the maximum permissible mass variation above, except that no scale shall be required having a capacity of less than 500 kg, with 0.5-kg graduations.

90-5.03 PROPORTIONING

- Proportioning shall consist of dividing the aggregates into the specified sizes, each stored in a separate bin, and combining them with cement, mineral admixture, and water as provided in these specifications. Aggregates shall be proportioned by mass.

- At the time of batching, aggregates shall have been dried or drained sufficiently to result in a stable moisture content such that no visible separation of water from aggregate will take place during transportation from the proportioning plant to the point of mixing. In no event shall the free moisture content of the fine aggregate at the time of batching exceed 8 percent of its saturated, surface-dry mass.

- Should separate supplies of aggregate material of the same size group, but of different moisture content or specific gravity or surface characteristics affecting workability, be available at the proportioning plant, withdrawals shall be made from one supply exclusively and the materials therein completely exhausted before starting upon another.

- Bulk "Type IP (MS) Modified" cement shall be weighed in an individual hopper and shall be kept separate from the aggregates until the ingredients are released for discharge into the mixer.

- Bulk cement and mineral admixture may be weighed in separate, individual weigh hoppers or may be weighed in the same weigh hopper and shall be kept separate from the aggregates until the ingredients are released for discharge into the mixer. If the cement and mineral admixture are weighed cumulatively, the cement shall be weighed first.

- When cement and mineral admixtures are weighed in separate weigh hoppers, the weigh systems for the proportioning of the aggregate, the cement, and the mineral admixture shall be individual and distinct from all other weigh systems. Each weigh system shall be equipped with a hopper, a lever system, and an indicator to constitute an individual and independent material weighing device. The cement and the mineral admixture shall be discharged into the mixer simultaneously with the aggregate.

- The scales and weigh hoppers for bulk weighing cement, mineral admixture, or cement plus mineral admixture shall be separate and distinct from the aggregate weighing equipment.

- For batches with a volume of one cubic meter or more, the batching equipment shall conform to one of the following combinations:

- A. Separate boxes and separate scale and indicator for weighing each size of aggregate.
- B. Single box and scale indicator for all aggregates.
- C. Single box or separate boxes and automatic weighing mechanism for all aggregates.

- In order to check the accuracy of batch masses, the gross mass and tare mass of batch trucks, truck mixers, truck agitators, and non-agitating hauling equipment shall be determined when ordered by the Engineer. The equipment shall be weighed at the Contractor's expense on scales designated by the Engineer.

90-5.03A Proportioning for Pavement

- Aggregates and bulk cement, mineral admixture, and cement plus mineral admixture for use in pavement shall be proportioned by mass by means of automatic proportioning devices of approved type conforming to these specifications.

- The Contractor shall install and maintain in operating condition an electronically actuated moisture meter that will indicate, on a readily visible scale, changes in the moisture content of the fine aggregate as it is batched within a sensitivity of 0.5 percent by mass of the fine aggregate.

- The batching of cement, mineral admixture, or cement plus mineral admixture and aggregate shall be interlocked so that a new batch cannot be started until all weigh hoppers are empty, the proportioning devices are within zero tolerance, and the discharge gates are closed. The interlock shall permit no part of the batch to be discharged until all aggregate hoppers and the cement and mineral admixture hoppers or the cement plus mineral admixture hopper are charged with masses that are within the tolerances specified in Section 90-5.02, "Proportioning Devices."

- When interlocks are required for cement and mineral admixture charging mechanisms and cement and mineral admixtures are weighed cumulatively, their charging mechanisms shall be interlocked to prevent the introduction of mineral

admixture until the mass of cement in the cement weigh hopper is within the tolerances specified in Section 90-5.02, "Proportioning Devices."

- The discharge gate on the cement and mineral admixture hoppers or the cement plus mineral admixture hopper shall be designed to permit regulating the flow of cement, mineral admixture, or cement plus mineral admixture into the aggregate as directed by the Engineer.
- When separate weigh boxes are used for each size of aggregate, the discharge gates shall permit regulating the flow of each size of aggregate as directed by the Engineer.
- Material discharged from the several bins shall be controlled by gates or by mechanical conveyors. The means of withdrawal from the several bins, and of discharge from the weigh box, shall be interlocked so that not more than one bin can discharge at a time, and so that the weigh box cannot be tripped until the required quantity from each of the several bins has been deposited therein. Should a separate weigh box be used for each size of aggregate, all may be operated and discharged simultaneously.
- When the discharge from the several bins is controlled by gates, each gate shall be actuated automatically so that the required mass is discharged into the weigh box, after which the gate shall automatically close and lock.
- The automatic weighing system shall be designed so that all proportions required may be set on the weighing controller at the same time.

90-6 MIXING AND TRANSPORTING

90-6.01 GENERAL

- Concrete shall be mixed in mechanically operated mixers, except that when permitted by the Engineer, batches not exceeding 0.25 m³ may be mixed by hand methods in conformance with the provisions in Section 90-6.05, "Hand-Mixing."
- Equipment having components made of aluminum or magnesium alloys that would have contact with plastic concrete during mixing, transporting, or pumping of portland cement concrete shall not be used.
- Concrete shall be homogeneous and thoroughly mixed, and there shall be no lumps or evidence of undispersed cement, mineral admixture, or cement plus mineral admixture.
- Uniformity of concrete mixtures will be determined by differences in penetration as determined by California Test 533, or slump as determined by ASTM Designation: C 143, and by variations in the proportion of coarse aggregate as determined by California Test 529.
- When the mix design specifies a penetration value, the difference in penetration, determined by comparing penetration tests on 2 samples of mixed concrete from the same batch or truck mixer load, shall not exceed 10 mm. When the mix design specifies a slump value, the difference in slump, determined by comparing slump tests on 2 samples of mixed concrete from the same batch or truck mixer load, shall not exceed the values given in the table below. Variation in the proportion of coarse aggregate will be determined by comparing the results of tests of 2 samples of mixed concrete from the same batch or truck mixer load and the difference between the 2 results shall not exceed 100 kg per cubic meter of concrete.

Average Slump	Maximum Permissible Difference
Less than 100-mm	25-mm
100-mm to 150-mm	38-mm
Greater than 150-mm to 225-mm	50-mm

- The Contractor, at the Contractor's expense, shall furnish samples of the freshly mixed concrete and provide satisfactory facilities for obtaining the samples.

90-6.02 MACHINE MIXING

- Concrete mixers may be of the revolving drum or the revolving blade type, and the mixing drum or blades shall be operated uniformly at the mixing speed recommended by the manufacturer. Mixers and agitators that have an accumulation of hard concrete or mortar shall not be used.
- The temperature of mixed concrete, immediately before placing, shall be not less than 10°C or more than 32°C. Aggregates and water shall be heated or cooled as necessary to produce concrete within these temperature limits. Neither aggregates nor mixing water shall be heated to exceed 65°C. If ice is used to cool the concrete, discharge of the mixer will not be permitted until all ice is melted.
- The batch shall be so charged into the mixer that some water will enter in advance of cementitious materials and aggregates. All water shall be in the drum by the end of the first one-fourth of the specified mixing time.
- Cementitious materials shall be batched and charged into the mixer by means that will not result either in loss of cementitious materials due to the effect of wind, in accumulation of cementitious materials on surfaces of conveyors or hoppers, or in other conditions that reduce or vary the required quantity of cementitious material in the concrete mixture.

- Paving and stationary mixers shall be operated with an automatic timing device. The timing device and discharge mechanism shall be interlocked so that during normal operation no part of the batch will be discharged until the specified mixing time has elapsed.
 - The total elapsed time between the intermingling of damp aggregates and all cementitious materials and the start of mixing shall not exceed 30 minutes.
 - The size of batch shall not exceed the manufacturer's guaranteed capacity.
 - When producing concrete for pavement or base, suitable batch counters shall be installed and maintained in good operating condition at jobsite batching plants and stationary mixers. The batch counters shall indicate the exact number of batches proportioned and mixed.
 - Concrete shall be mixed and delivered to the jobsite by means of one of the following combinations of operations:
 - A. Mixed completely in a stationary mixer and the mixed concrete transported to the point of delivery in truck agitators or in non-agitating hauling equipment (central-mixed concrete).
 - B. Mixed partially in a stationary mixer, and the mixing completed in a truck mixer (shrink-mixed concrete).
 - C. Mixed completely in a truck mixer (transit-mixed concrete).
 - D. Mixed completely in a paving mixer.
- Agitators may be truck mixers operating at agitating speed or truck agitators. Each mixer and agitator shall have attached thereto in a prominent place a metal plate or plates on which is plainly marked the various uses for which the equipment is designed, the manufacturer's guaranteed capacity of the drum or container in terms of the volume of mixed concrete and the speed of rotation of the mixing drum or blades.
 - Truck mixers shall be equipped with electrically or mechanically actuated revolution counters by which the number of revolutions of the drum or blades may readily be verified.
 - When shrink-mixed concrete is furnished, concrete that has been partially mixed at a central plant shall be transferred to a truck mixer and all requirements for transit-mixed concrete shall apply. No credit in the number of revolutions at mixing speed shall be allowed for partial mixing in a central plant.

90-6.03 TRANSPORTING MIXED CONCRETE

- Mixed concrete may be transported to the delivery point in truck agitators or truck mixers operating at the speed designated by the manufacturer of the equipment as agitating speed, or in non-agitating hauling equipment, provided the consistency and workability of the mixed concrete upon discharge at the delivery point is suitable for adequate placement and consolidation in place, and provided the mixed concrete after hauling to the delivery point conforms to the provisions in Section 90-6.01, "General."
 - Truck agitators shall be loaded not to exceed the manufacturer's guaranteed capacity and shall maintain the mixed concrete in a thoroughly mixed and uniform mass during hauling.
 - Bodies of non-agitating hauling equipment shall be constructed so that leakage of the concrete mix, or any part thereof, will not occur at any time.
 - Concrete hauled in open-top vehicles shall be protected during hauling against rain or against exposure to the sun for more than 20 minutes when the ambient temperature exceeds 24°C.
 - No additional mixing water shall be incorporated into the concrete during hauling or after arrival at the delivery point, unless authorized by the Engineer. If the Engineer authorizes additional water to be incorporated into the concrete, the drum shall be revolved not less than 30 revolutions at mixing speed after the water is added and before discharge is commenced.
 - The rate of discharge of mixed concrete from truck mixer-agitators shall be controlled by the speed of rotation of the drum in the discharge direction with the discharge gate fully open.
 - When a truck mixer or agitator is used for transporting concrete to the delivery point, discharge shall be completed within 1.5 hours or before 250 revolutions of the drum or blades, whichever occurs first, after the introduction of the cement to the aggregates. Under conditions contributing to quick stiffening of the concrete, or when the temperature of the concrete is 30°C or above, the time allowed may be less than 1.5 hours.
 - When non-agitating hauling equipment is used for transporting concrete to the delivery point, discharge shall be completed within one hour after the addition of the cement to the aggregates. Under conditions contributing to quick stiffening of the concrete, or when the temperature of the concrete is 30°C or above, the time between the introduction of cement to the aggregates and discharge shall not exceed 45 minutes.
 - Each load of concrete delivered at the jobsite shall be accompanied by a weighmaster certificate showing the mix identification number, non-repeating load number, date and time at which the materials were batched, the total amount of water added to the load, and for transit-mixed concrete, the reading of the revolution counter at the time the truck mixer is charged with cement. This weighmaster certificate shall also show the actual scale masses (kilograms) for the ingredients batched. Theoretical or target batch masses shall not be used as a substitute for actual scale masses.

- Weighmaster certificates shall be provided in printed form, or if approved by the Engineer, the data may be submitted in electronic media. Electronic media shall be presented in a tab-delimited format on a 90 mm diskette with a capacity of at least 1.4 megabytes. Captured data, for the ingredients represented by each batch shall be "line feed, carriage return" (LFCR) and "one line, separate record" with allowances for sufficient fields to satisfy the amount of data required by these specifications.

- The Contractor may furnish a weighmaster certificate accompanied by a separate certificate that lists the actual batch masses or measurements for a load of concrete provided that both certificates are imprinted with the same non-repeating load number that is unique to the contract and delivered to the jobsite with the load.

- Weighmaster certificates furnished by the Contractor shall conform to the provisions in Section 9-1.01, "Measurement of Quantities."

90-6.04 TIME OR AMOUNT OF MIXING

- Mixing of concrete in paving or stationary mixers shall continue for the required mixing time after all ingredients, except water and admixture, if added with the water, are in the mixing compartment of the mixer before any part of the batch is released. Transfer time in multiple drum mixers shall not be counted as part of the required mixing time.

- The required mixing time, in paving or stationary mixers, of concrete used for concrete structures, except minor structures, shall be not less than 90 seconds or more than 5 minutes, except that when directed by the Engineer in writing, the requirements of the following paragraph shall apply.

- The required mixing time, in paving or stationary mixers, except as provided in the preceding paragraph, shall be not less than 50 seconds or more than 5 minutes.

- The minimum required revolutions at the mixing speed for transit-mixed concrete shall not be less than that recommended by the mixer manufacturer, but in no case shall the number of revolutions be less than that required to consistently produce concrete conforming to the provisions for uniformity in Section 90-6.01, "General."

90-6.05 HAND-MIXING

- Hand-mixed concrete shall be made in batches of not more than 0.25 m³ and shall be mixed on a watertight, level platform. The proper amount of coarse aggregate shall be measured in measuring boxes and spread on the platform and the fine aggregate shall be spread on this layer, the 2 layers being not more than 0.3 meters in total depth. On this mixture shall be spread the dry cement and mineral admixture and the whole mass turned no fewer than 2 times dry; then sufficient clean water shall be added, evenly distributed, and the whole mass again turned no fewer than 3 times, not including placing in the carriers or forms.

90-6.06 AMOUNT OF WATER AND PENETRATION

- The amount of water used in concrete mixes shall be regulated so that the penetration of the concrete as determined by California Test 533 or the slump of the concrete as determined by ASTM Designation: C 143 is within the "Nominal" values shown in the following table. When the penetration or slump of the concrete is found to exceed the nominal values listed, the mixture of subsequent batches shall be adjusted to reduce the penetration or slump to a value within the nominal range shown. Batches of concrete with a penetration or slump exceeding the maximum values listed shall not be used in the work. When Type F or Type G chemical admixtures are added to the mix, the penetration requirements shall not apply and the slump shall not exceed 225 mm after the chemical admixtures are added.

Type of Work	Nominal		Maximum	
	Penetration (mm)	Slump (mm)	Penetration (mm)	Slump (mm)
Concrete Pavement	0-25	—	40	—
Non-reinforced concrete facilities	0-35	—	50	—
Reinforced concrete structures				
Sections over 300-mm thick	0-35	—	65	—
Sections 300-mm thick or less	0-50	—	75	—
Concrete placed under water	—	150-200	—	225
Cast-in-place concrete piles	65-90	130-180	100	200

- The amount of free water used in concrete shall not exceed 183 kg/m³, plus 20 kg for each required 100 kg of cementitious material in excess of 325 kg/m³.

- The term free water is defined as the total water in the mixture minus the water absorbed by the aggregates in reaching a saturated surface-dry condition.

- Where there are adverse or difficult conditions that affect the placing of concrete, the above specified penetration and free water content limitations may be exceeded providing the Contractor is granted permission by the Engineer in writing to increase the cementitious material content per cubic meter of concrete. The increase in water and cementitious material shall be at a ratio not to exceed 30 kg of water per added 100 kg of cementitious material per cubic meter. The cost of additional cementitious material and water added under these conditions shall be at the Contractor's expense and no additional compensation will be allowed therefor.

- The equipment for supplying water to the mixer shall be constructed and arranged so that the amount of water added can be measured accurately. Any method of discharging water into the mixer for a batch shall be accurate within 1.5 percent of the quantity of water required to be added to the mix for any position of the mixer. Tanks used to measure water shall be designed so that water cannot enter while water is being discharged into the mixer and discharge into the mixer shall be made rapidly in one operation without dribbling. All equipment shall be arranged so as to permit checking the amount of water delivered by discharging into measured containers.

90-7 CURING CONCRETE

90-7.01 METHODS OF CURING

- Newly placed concrete shall be cured by the methods specified in this Section 90-7.01 and the special provisions.

90-7.01A Water Method

- The concrete shall be kept continuously wet by the application of water for a minimum curing period of 7 days after the concrete has been placed.

- When a curing medium consisting of cotton mats, rugs, carpets, or earth or sand blankets is to be used to retain the moisture, the entire surface of the concrete shall be kept damp by applying water with a nozzle that so atomizes the flow that a mist and not a spray is formed, until the surface of the concrete is covered with the curing medium. The moisture from the nozzle shall not be applied under pressure directly upon the concrete and shall not be allowed to accumulate on the concrete in a quantity sufficient to cause a flow or wash the surface. At the expiration of the curing period, the concrete surfaces shall be cleared of all curing mediums.

- At the option of the Contractor, a curing medium consisting of white opaque polyethylene sheeting extruded onto burlap may be used to cure concrete structures. The polyethylene sheeting shall have a minimum thickness of 100 μm , and shall be extruded onto 283.5 gram burlap.

- At the option of the Contractor, a curing medium consisting of polyethylene sheeting may be used to cure concrete columns. The polyethylene sheeting shall have a minimum thickness of 250 μm achieved in a single layer of material.

- If the Contractor chooses to use polyethylene sheeting or polyethylene sheeting on burlap as a curing medium as specified above, these mediums and any joints therein shall be secured as necessary to provide moisture retention and shall be within 75 mm of the concrete at all points along the surface being cured. When these mediums are used, the temperature of the concrete shall be monitored during curing. If the temperature of the concrete cannot be maintained below 60°C, this method of curing shall be discontinued, and one of the other curing methods allowed for the concrete shall be used.

- When concrete bridge decks and flat slabs are to be cured without the use of a curing medium, the entire surface of the bridge deck or slab shall be kept damp by the application of water with an atomizing nozzle as specified in the preceding paragraph, until the concrete has set, after which the entire surface of the concrete shall be sprinkled continuously with water for a period of not less than 7 days.

90-7.01B Curing Compound Method

- Surfaces of the concrete that are exposed to the air shall be sprayed uniformly with a curing compound.
- Curing compounds to be used shall be as follows:

1. Pigmented curing compound conforming to the requirements in ASTM Designation: C 309, Type 2, Class B, except the resin type shall be poly-alpha-methylstyrene.
2. Pigmented curing compound conforming to the requirements in ASTM Designation: C 309, Type 2, Class B.
3. Pigmented curing compound conforming to the requirements in ASTM Designation: C 309, Type 2, Class A.
4. Non-pigmented curing compound conforming to the requirements in ASTM Designation: C 309, Type 1, Class B.
5. Non-pigmented curing compound conforming to the requirements in ASTM Designation: C 309, Type 1, Class A.
6. Non-pigmented curing compound with fugitive dye conforming to the requirements in ASTM Designation: C 309, Type 1-D, Class A.

- The infrared scan for the dried vehicle from curing compound (1) shall match the infrared scan on file at the Transportation Laboratory.

- The loss of water for each type of curing compound, when tested in conformance with the requirements in California Test 534, shall not be more than 0.15-kg/m² in 24 hours.
- The curing compound to be used will be specified elsewhere in these specifications or in the special provisions.
- When the use of curing compound is required or permitted elsewhere in these specifications or in the special provisions and no specific kind is specified, any of the curing compounds listed above may be used.
 - Curing compound shall be applied at a nominal rate of 3.7 m²/L, unless otherwise specified.
 - At any point, the application rate shall be within ±1.2 m²/L of the nominal rate specified, and the average application rate shall be within ±0.5 m²/L of the nominal rate specified when tested in conformance with the requirements in California Test 535. Runs, sags, thin areas, skips, or holidays in the applied curing compound shall be evidence that the application is not satisfactory.
 - Curing compounds shall be applied using power operated spray equipment. The power operated spraying equipment shall be equipped with an operational pressure gage and a means of controlling the pressure. Hand spraying of small and irregular areas that are not reasonably accessible to mechanical spraying equipment, in the opinion of the Engineer, may be permitted.
 - The curing compound shall be applied to the concrete following the surface finishing operation, immediately before the moisture sheen disappears from the surface, but before any drying shrinkage or craze cracks begin to appear. In the event of any drying or cracking of the surface, application of water with an atomizing nozzle as specified in Section 90-7.01A, "Water Method," shall be started immediately and shall be continued until application of the compound is resumed or started; however, the compound shall not be applied over any resulting freestanding water. Should the film of compound be damaged from any cause before the expiration of 7 days after the concrete is placed in the case of structures and 72 hours in the case of pavement, the damaged portion shall be repaired immediately with additional compound.
 - At the time of use, compounds containing pigments shall be in a thoroughly mixed condition with the pigment uniformly dispersed throughout the vehicle. A paddle shall be used to loosen all settled pigment from the bottom of the container, and a power driven agitator shall be used to disperse the pigment uniformly throughout the vehicle.
 - Agitation shall not introduce air or other foreign substance into the curing compound.
 - The manufacturer shall include in the curing compound the necessary additives for control of sagging, pigment settling, leveling, de-emulsification, or other requisite qualities of a satisfactory working material. Pigmented curing compounds shall be manufactured so that the pigment does not settle badly, does not cake or thicken in the container, and does not become granular or curdled. Settlement of pigment shall be a thoroughly wetted, soft, mushy mass permitting the complete and easy vertical penetration of a paddle. Settled pigment shall be easily redispersed, with minimum resistance to the sideways manual motion of the paddle across the bottom of the container, to form a smooth uniform product of the proper consistency.
 - Curing compounds shall remain sprayable at temperatures above 4°C and shall not be diluted or altered after manufacture.
 - The curing compound shall be packaged in clean 1040-L totes, 210-L barrels or 19-L pails shall be supplied from a suitable storage tank located at the jobsite. The containers shall comply with "Title 49, Code of Federal Regulations, Hazardous Materials Regulations." The 1040-L totes and the 210-L barrels shall have removable lids and airtight fasteners. The 19-L pails shall be round and have standard full open head and bail. Lids with bungholes shall not be permitted. Settling or separation of solids in containers, except tanks, must be completely redispersed with low speed mixing prior to use, in conformance with these specifications and the manufacturer's recommendations. Mixing shall be accomplished either manually by use of a paddle or by use of a mixing blade driven by a drill motor, at low speed. Mixing blades shall be the type used for mixing paint. On site storage tanks shall be kept clean and free of contaminants. Each tank shall have a permanent system designed to completely redisperse settled material without introducing air or other foreign substances.
 - Steel containers and lids shall be lined with a coating that will prevent destructive action by the compound or chemical agents in the air space above the compound. The coating shall not come off the container or lid as skins. Containers shall be filled in a manner that will prevent skinning. Plastic containers shall not react with the compound.
 - Each container shall be labeled with the manufacturer's name, kind of curing compound, batch number, volume, date of manufacture, and volatile organic compound (VOC) content. The label shall also warn that the curing compound containing pigment shall be well stirred before use. Precautions concerning the handling and the application of curing compound shall be shown on the label of the curing compound containers in conformance with the Construction Safety Orders and General Industry Safety Orders of the State of California.
 - Containers of curing compound shall be labeled to indicate that the contents fully comply with the rules and regulations concerning air pollution control in the State of California.
 - When the curing compound is shipped in tanks or tank trucks, a shipping invoice shall accompany each load. The invoice shall contain the same information as that required herein for container labels.
 - Curing compound will be sampled by the Engineer at the source of supply or at the jobsite or at both locations.

- Curing compound shall be formulated so as to maintain the specified properties for a minimum of one year. The Engineer may require additional testing before use to determine compliance with these specifications if the compound has not been used within one year or whenever the Engineer has reason to believe the compound is no longer satisfactory.
- Tests will be conducted in conformance with the latest ASTM test methods and methods in use by the Transportation Laboratory.

90-7.01C Waterproof Membrane Method

- The exposed finished surfaces of concrete shall be sprayed with water, using a nozzle that so atomizes the flow that a mist and not a spray is formed, until the concrete has set, after which the curing membrane shall be placed. The curing membrane shall remain in place for a period of not less than 72 hours.
- Sheeting material for curing concrete shall conform to the requirements in AASHTO Designation: M 171 for white reflective materials.
- The sheeting material shall be fabricated into sheets of such width as to provide a complete cover for the entire concrete surface. Joints in the sheets shall be securely cemented together in such a manner as to provide a waterproof joint. The joint seams shall have a minimum lap of 100 mm.
- The sheets shall be securely weighted down by placing a bank of earth on the edges of the sheets or by other means satisfactory to the Engineer.
- Should any portion of the sheets be broken or damaged before the expiration of 72 hours after being placed, the broken or damaged portions shall be immediately repaired with new sheets properly cemented into place.
- Sections of membrane that have lost their waterproof qualities or have been damaged to such an extent as to render them unfit for curing the concrete shall not be used.

90-7.01D Forms-In-Place Method

- Formed surfaces of concrete may be cured by retaining the forms in place. The forms shall remain in place for a minimum period of 7 days after the concrete has been placed, except that for members over 0.5-m in least dimension the forms shall remain in place for a minimum period of 5 days.
- Joints in the forms and the joints between the end of forms and concrete shall be kept moisture tight during the curing period. Cracks in the forms and cracks between the forms and the concrete shall be resealed by methods subject to the approval of the Engineer.

90-7.02 CURING PAVEMENT

- The entire exposed area of the pavement, including edges, shall be cured by the waterproof membrane method, or curing compound method using curing compound (1) or (2) as the Contractor may elect. Should the side forms be removed before the expiration of 72 hours following the start of curing, the exposed pavement edges shall also be cured. If the pavement is cured by means of the curing compound method, the sawcut and all portions of the curing compound that have been disturbed by sawing operations shall be restored by spraying with additional curing compound.
- Curing shall commence as soon as the finishing process provided in Section 40-1.10, "Final Finishing," has been completed. The method selected shall conform to the provisions in Section 90-7.01, "Methods of Curing."
- When the curing compound method is used, the compound shall be applied to the entire pavement surface by mechanical sprayers. Spraying equipment shall be of the fully atomizing type equipped with a tank agitator that provides for continual agitation of the curing compound during the time of application. The spray shall be adequately protected against wind, and the nozzles shall be so oriented or moved mechanically transversely as to result in the minimum specified rate of coverage being applied uniformly on exposed faces. Hand spraying of small and irregular areas, and areas inaccessible to mechanical spraying equipment, in the opinion of the Engineer, will be permitted. When the ambient air temperature is above 15°C, the Contractor shall fog the surface of the concrete with a fine spray of water as specified in Section 90-7.01A, "Water Method." The surface of the pavement shall be kept moist between the hours of 10:00 a.m. and 4:30 p.m. on the day the concrete is placed. However, the fogging done after the curing compound has been applied shall not begin until the compound has set sufficiently to prevent displacement. Fogging shall be discontinued if ordered in writing by the Engineer.

90-7.03 CURING STRUCTURES

- Newly placed concrete for cast-in-place structures, other than highway bridge decks, shall be cured by the water method, the forms-in-place method, or, as permitted herein, by the curing compound method, in conformance with the provisions in Section 90-7.01, "Methods of Curing."
- The curing compound method using a pigmented curing compound may be used on concrete surfaces of construction joints, surfaces that are to be buried underground, and surfaces where only Ordinary Surface Finish is to be applied and on which a uniform color is not required and that will not be visible from a public traveled way. If the Contractor elects to use the curing compound method on the bottom slab of box girder spans, the curing compound shall be curing compound (1).

- The top surface of highway bridge decks shall be cured by both the curing compound method and the water method. The curing compound shall be curing compound (1).
- Concrete surfaces of minor structures, as defined in Section 51-1.02, "Minor Structures," shall be cured by the water method, the forms-in-place method or the curing compound method.
- When deemed necessary by the Engineer during periods of hot weather, water shall be applied to concrete surfaces being cured by the curing compound method or by the forms-in-place method, until the Engineer determines that a cooling effect is no longer required. Application of water for this purpose will be paid for as extra work as provided in Section 4-1.03D, "Extra Work."

90-7.04 CURING PRECAST CONCRETE MEMBERS

• Precast concrete members shall be cured in conformance with any of the methods specified in Section 90-7.01, "Methods of Curing." Curing shall be provided for the minimum time specified for each method or until the concrete reaches its design strength, whichever is less. Steam curing may also be used for precast members and shall conform to the following provisions:

- A. After placement of the concrete, members shall be held for a minimum 4-hour presteaming period. If the ambient air temperature is below 10°C, steam shall be applied during the presteaming period to hold the air surrounding the member at a temperature between 10°C and 32°C.
- B. To prevent moisture loss on exposed surfaces during the presteaming period, members shall be covered as soon as possible after casting or the exposed surfaces shall be kept wet by fog spray or wet blankets.
- C. Enclosures for steam curing shall allow free circulation of steam about the member and shall be constructed to contain the live steam with a minimum moisture loss. The use of tarpaulins or similar flexible covers will be permitted, provided they are kept in good repair and secured in such a manner as to prevent the loss of steam and moisture.
- D. Steam at the jets shall be at low pressure and in a saturated condition. Steam jets shall not impinge directly on the concrete, test cylinders, or forms. During application of the steam, the temperature rise within the enclosure shall not exceed 22°C per hour. The curing temperature throughout the enclosure shall not exceed 65°C and shall be maintained at a constant level for a sufficient time necessary to develop the required transfer strength. Control cylinders shall be covered to prevent moisture loss and shall be placed in a location where temperature is representative of the average temperature of the enclosure.
- E. Temperature recording devices that will provide an accurate, continuous, permanent record of the curing temperature shall be provided. A minimum of one temperature recording device per 60 m of continuous bed length will be required for checking temperature.
- F. Members in pretension beds shall be detensioned immediately after the termination of steam curing while the concrete and forms are still warm, or the temperature under the enclosure shall be maintained above 15°C until the stress is transferred to the concrete.
- G. Curing of precast concrete will be considered completed after termination of the steam curing cycle.

90-7.05 CURING PRECAST PRESTRESSED CONCRETE PILES

• Newly placed concrete for precast prestressed concrete piles shall be cured in conformance with the provisions in Section 90-7.04, "Curing Precast Concrete Members," except that piles in a corrosive environment shall be cured as follows:

- A. Piles shall be either steam cured or water cured. If water curing is used, the piles shall be kept continuously wet by the application of water in conformance with the provisions in Section 90-7.01A, "Water Method."
- B. If steam curing is used, the steam curing provisions in Section 90-7.04, "Curing Precast Concrete Members," shall apply except that the piles shall be kept continuously wet for their entire length for a period of not less than 3 days, including the holding and steam curing periods.

90-7.06 CURING SLOPE PROTECTION

- Concrete slope protection shall be cured in conformance with any of the methods specified in Section 90-7.01, "Methods of Curing."
- Concreted-rock slope protection shall be cured in conformance with any of the methods specified in Section 90-7.01, "Methods of Curing," or with a blanket of earth kept wet for 72 hours, or by sprinkling with a fine spray of water every 2 hours during the daytime for a period of 3 days.

90-7.07 CURING MISCELLANEOUS CONCRETE WORK

- Exposed surfaces of curbs shall be cured by pigmented curing compounds as specified in Section 90-7.01B, "Curing Compound Method."

- Concrete sidewalks, gutter depressions, island paving, curb ramps, driveways, and other miscellaneous concrete areas shall be cured in conformance with any of the methods specified in Section 90-7.01, "Methods of Curing."
- Shotcrete shall be cured for at least 72 hours by spraying with water, or by a moist earth blanket, or by any of the methods provided in Section 90-7.01, "Methods of Curing."
- Mortar and grout shall be cured by keeping the surface damp for 3 days.
- After placing, the exposed surfaces of sign structure foundations, including pedestal portions, if constructed, shall be cured for at least 72 hours by spraying with water, or by a moist earth blanket, or by any of the methods provided in Section 90-7.01, "Methods of Curing."

90-8 PROTECTING CONCRETE

90-8.01 GENERAL

- In addition to the provisions in Section 7-1.16, "Contractor's Responsibility for the Work and Materials," the Contractor shall protect concrete as provided in this Section 90-8.
- Concrete shall not be placed on frozen or ice-coated ground or subgrade nor on ice-coated forms, reinforcing steel, structural steel, conduits, precast members, or construction joints.
- Under rainy conditions, placing of concrete shall be stopped before the quantity of surface water is sufficient to damage surface mortar or cause a flow or wash of the concrete surface, unless the Contractor provides adequate protection against damage.
- Concrete that has been frozen or damaged by other causes, as determined by the Engineer, shall be removed and replaced by the Contractor at the Contractor's expense.

90-8.02 PROTECTING CONCRETE STRUCTURES

- Structure concrete and shotcrete used as structure concrete shall be maintained at a temperature of not less than 7°C for 72 hours after placing and at not less than 4°C for an additional 4 days. When required by the Engineer, the Contractor shall submit a written outline of the proposed methods for protecting the concrete.

90-8.03 PROTECTING CONCRETE PAVEMENT

- Pavement concrete shall be maintained at a temperature of not less than 4°C for 72 hours. When required by the Engineer, the Contractor shall submit a written outline of the proposed methods for protecting the concrete.
- Except as provided in Section 7-1.08, "Public Convenience," the Contractor shall protect concrete pavement against construction and other activities that abrade, scar, discolor, reduce texture depth, lower coefficient of friction, or otherwise damage the surface. Stockpiling, drifting, or excessive spillage of soil, gravel, petroleum products, and concrete or asphalt mixes on the surface of concrete pavement is prohibited unless otherwise specified in these specifications, the special provisions or permitted by the Engineer.
- When ordered by the Engineer or shown on the plans or specified in the special provisions, pavement crossings shall be constructed for the convenience of public traffic. The material and work necessary for the construction of the crossings, and their subsequent removal and disposal, will be paid for at the contract unit prices for the items of work involved and if there are no contract items for the work involved, payment for pavement crossings will be made by extra work as provided in Section 4-1.03D, "Extra Work." Where public traffic will be required to cross over the new pavement, Type III portland cement may be used in concrete, if permitted in writing by the Engineer. The pavement may be opened to traffic as soon as the concrete has developed a modulus of rupture of 3.8 MPa. The modulus of rupture will be determined by California Test 523.
- No traffic or Contractor's equipment, except as hereinafter provided, will be permitted on the pavement before a period of 10 days has elapsed after the concrete has been placed, nor before the concrete has developed a modulus of rupture of at least 3.8 MPa. Concrete that fails to attain a modulus of rupture of 3.8 MPa within 10 days shall not be opened to traffic until directed by the Engineer.
- Equipment for sawing weakened plane joints will be permitted on the pavement as specified in Section 40-1.08B, "Weakened Plane Joints."
- When requested in writing by the Contractor, the tracks on one side of paving equipment will be permitted on the pavement after a modulus of rupture of 2.4 MPa has been attained, provided that:
 - A. Unit pressure exerted on the pavement by the paver shall not exceed 135 kPa;
 - B. Tracks with cleats, grousers, or similar protuberances shall be modified or shall travel on planks or equivalent protective material, so that the pavement is not damaged; and
 - C. No part of the track shall be closer than 0.3-m from the edge of pavement.

- In case of visible cracking of, or other damage to the pavement, operation of the paving equipment on the pavement shall be immediately discontinued.
- Damage to the pavement resulting from early use of pavement by the Contractor's equipment as provided above shall be repaired by the Contractor at the Contractor's expense.
- The State will furnish the molds and machines for testing the concrete for modulus of rupture, and the Contractor, at the Contractor's expense, shall furnish the material and whatever labor the Engineer may require.

90-9 COMPRESSIVE STRENGTH

90-9.01 GENERAL

- Concrete compressive strength requirements consist of a minimum strength that shall be attained before various loads or stresses are applied to the concrete and, for concrete designated by strength, a minimum strength at the age of 28 days or at the age otherwise allowed in Section 90-1.01, "Description." The various strengths required are specified in these specifications or the special provisions or are shown on the plans.
- The compressive strength of concrete will be determined from test cylinders that have been fabricated from concrete sampled in conformance with the requirements of California Test 539. Test cylinders will be molded and initially field cured in conformance with California Test 540. Test cylinders will be cured and tested after receipt at the testing laboratory in conformance with the requirements of California Test 521. A strength test shall consist of the average strength of 2 cylinders fabricated from material taken from a single load of concrete, except that, if any cylinder should show evidence of improper sampling, molding, or testing, that cylinder shall be discarded and the strength test shall consist of the strength of the remaining cylinder.
- When concrete compressive strength is specified as a prerequisite to applying loads or stresses to a concrete structure or member, test cylinders for other than steam cured concrete will be cured in conformance with Method 1 of California Test 540. The compressive strength of concrete determined for these purposes will be evaluated on the basis of individual tests.
- When concrete is designated by 28-day compressive strength rather than by cementitious material content, the concrete strength to be used as a basis for acceptance of other than steam cured concrete will be determined from cylinders cured in conformance with Method 1 of California Test 540. If the result of a single compressive strength test at the maximum age specified or allowed is below the specified strength but is 95 percent or more of the specified strength, the Contractor shall, at the Contractor's expense, make corrective changes, subject to approval of the Engineer, in the mix proportions or in the concrete fabrication procedures, before placing additional concrete, and shall pay to the State \$14 for each in-place cubic meter of concrete represented by the deficient test. If the result of a single compressive strength test at the maximum age specified or allowed is below 95 percent of the specified strength, but is 85 percent or more of the specified strength, the Contractor shall make the corrective changes specified above, and shall pay to the State \$20 for each in place cubic meter of concrete represented by the deficient test. In addition, such corrective changes shall be made when the compressive strength of concrete tested at 7 days indicates, in the judgment of the Engineer, that the concrete will not attain the required compressive strength at the maximum age specified or allowed. Concrete represented by a single test that indicates a compressive strength of less than 85 percent of the specified 28-day compressive strength will be rejected in conformance with the provisions in Section 6-1.04, "Defective Materials."
- If the test result indicates that the compressive strength at the maximum curing age specified or allowed is below the specified strength, but is 85 percent or more of the specified strength, payments to the State as required above shall be made, unless the Contractor, at the Contractor's expense, obtains and submits evidence acceptable to the Engineer that the strength of the concrete placed in the work meets or exceeds the specified 28-day compressive strength. If the test result indicates a compressive strength at the maximum curing age specified or allowed below 85 percent, the concrete represented by that test will be rejected, unless the Contractor, at the Contractor's expense, obtains and submits evidence acceptable to the Engineer that the strength and quality of the concrete placed in the work are acceptable. If the evidence consists of tests made on cores taken from the work, the cores shall be obtained and tested in conformance with the requirements in ASTM Designation: C 42.
- No single compressive strength test shall represent more than 250 m³.
- When a precast concrete member is steam cured, the compressive strength of the concrete will be determined from test cylinders that have been handled and stored in conformance with Method 3 of California Test 540. The compressive strength of steam cured concrete will be evaluated on the basis of individual tests representing specific portions of production. When the concrete is designated by 28-day compressive strength rather than by cementitious material content, the concrete shall be considered to be acceptable whenever its compressive strength reaches the specified 28-day compressive strength provided that strength is reached in not more than the maximum number of days specified or allowed after the member is cast.
- When concrete is specified by compressive strength, prequalification of materials, mix proportions, mixing equipment, and procedures proposed for use will be required prior to placement of the concrete. Prequalification shall be

accomplished by the submission of acceptable certified test data or trial batch reports by the Contractor. Prequalification data shall be based on the use of materials, mix proportions, mixing equipment, procedures, and size of batch proposed for use in the work.

- Certified test data, in order to be acceptable, shall indicate that not less than 90 percent of at least 20 consecutive tests exceed the specified strength at the maximum number of cure days specified or allowed, and none of those tests are less than 95 percent of specified strength. Strength tests included in the data shall be the most recent tests made on concrete of the proposed mix design and all shall have been made within one year of the proposed use of the concrete.

- Trial batch test reports, in order to be acceptable, shall indicate that the average compressive strength of 5 consecutive concrete cylinders, taken from a single batch, at not more than 28 days (or the maximum age allowed) after molding shall be at least 4 MPa greater than the specified 28-day compressive strength, and no individual cylinder shall have a strength less than the specified strength at the maximum age specified or allowed. Data contained in the report shall be from trial batches that were produced within one year of the proposed use of specified strength concrete in the project. Whenever air-entrainment is required, the air content of trial batches shall be equal to or greater than the air content specified for the concrete without reduction due to tolerances.

- Tests shall be performed in conformance with either the appropriate California Test methods or the comparable ASTM test methods. Equipment employed in testing shall be in good condition and shall be properly calibrated. If the tests are performed during the life of the contract, the Engineer shall be notified sufficiently in advance of performing the tests in order to witness the test procedures.

- The certified test data and trial batch test reports shall include the following information:

- A. Date of mixing.
- B. Mixing equipment and procedures used.
- C. The size of batch in cubic meters and the mass, type, and source of all ingredients used.
- D. Penetration of the concrete.
- E. The air content of the concrete if an air-entraining admixture is used.
- F. The age at time of testing and strength of all concrete cylinders tested.

- Certified test data and trial batch test reports shall be signed by an official of the firm that performed the tests.

- When approved by the Engineer, concrete from trial batches may be used in the work at locations where concrete of a lower quality is required and the concrete will be paid for as the type or class of concrete required at that location.

- After materials, mix proportions, mixing equipment, and procedures for concrete have been prequalified for use, additional prequalification by testing of trial batches will be required prior to making changes that, in the judgment of the Engineer, could result in a strength of concrete below that specified.

- The Contractor's attention is directed to the time required to test trial batches and the Contractor shall be responsible for production of trial batches at a sufficiently early date so that the progress of the work is not delayed.

- When precast concrete members are manufactured at the plant of an established manufacturer of precast concrete members, the mix proportions of the concrete shall be determined by the Contractor, and a trial batch and prequalification of the materials, mix proportions, mixing equipment, and procedures will not be required.

90-10 MINOR CONCRETE

90-10.01 GENERAL

- Concrete for minor structures, slope paving, curbs, sidewalks and other concrete work, when designated as minor concrete on the plans, in the specifications, or in the contract item, shall conform to the provisions specified herein.

- The Engineer, at the Engineer's discretion, will inspect and test the facilities, materials and methods for producing the concrete to ensure that minor concrete of the quality suitable for use in the work is obtained.

90-10.02 MATERIALS

- Minor concrete shall conform to the following requirements:

90-10.02A Cementitious Material

- Cementitious material shall conform to the provisions in Section 90-1.01, "Description."

90-10.02B Aggregate

- Aggregate shall be clean and free from deleterious coatings, clay balls, roots, and other extraneous materials.

- The Contractor shall submit to the Engineer for approval, a grading of the combined aggregate proposed for use in the minor concrete. After acceptance of the grading, aggregate furnished for minor concrete shall conform to that grading, unless a change is authorized in writing by the Engineer.

- The Engineer may require the Contractor to furnish periodic test reports of the aggregate grading furnished. The maximum size of aggregate used shall be at the option of the Contractor, but in no case shall the maximum size be larger than 37.5 mm or smaller than 19 mm.

- The Engineer may waive, in writing, the gradation requirements in this Section 90-10.02B, if, in the Engineer's opinion, the furnishing of the gradation is not necessary for the type or amount of concrete work to be constructed.

90-10.02C Water

- Water used for washing, mixing, and curing shall be free from oil, salts, and other impurities that would discolor or etch the surface or have an adverse affect on the quality of the concrete.

90-10.02D Admixtures

- The use of admixtures shall conform to the provisions in Section 90-4, "Admixtures."

90-10.03 PRODUCTION

- Cementitious material, water, aggregate, and admixtures shall be stored, proportioned, mixed, transported, and discharged in conformance with recognized standards of good practice that will result in concrete that is thoroughly and uniformly mixed, that is suitable for the use intended, and that conforms to requirements specified herein. Recognized standards of good practice are outlined in various industry publications such as are issued by American Concrete Institute, AASHTO, or the Department.

- The cementitious material content of minor concrete shall conform to the provisions in Section 90-1.01, "Description."

- The amount of water used shall result in a consistency of concrete conforming to the provisions in Section 90-6.06, "Amount of Water and Penetration." Additional mixing water shall not be incorporated into the concrete during hauling or after arrival at the delivery point, unless authorized by the Engineer.

- Discharge of ready-mixed concrete from the transporting vehicle shall be made while the concrete is still plastic and before stiffening occurs. An elapsed time of 1.5 hours (one hour in non-agitating hauling equipment), or more than 250 revolutions of the drum or blades, after the introduction of the cementitious material to the aggregates, or a temperature of concrete of more than 32°C will be considered conditions contributing to the quick stiffening of concrete. The Contractor shall take whatever action is necessary to eliminate quick stiffening, except that the addition of water will not be permitted.

- The required mixing time in stationary mixers shall be not less than 50 seconds or more than 5 minutes.

- The minimum required revolutions at mixing speed for transit-mixed concrete shall be not less than that recommended by the mixer manufacturer, and shall be increased, if necessary, to produce thoroughly and uniformly mixed concrete.

- Each load of ready-mixed concrete shall be accompanied by a weighmaster certificate that shall be delivered to the Engineer at the discharge location of the concrete, unless otherwise directed by the Engineer. The weighmaster certificate shall be clearly marked with the date and time of day when the load left the batching plant and, if hauled in truck mixers or agitators, the time the mixing cycle started.

- A Certificate of Compliance conforming to the provisions in Section 6-1.07, "Certificates of Compliance," shall be furnished to the Engineer, prior to placing minor concrete from a source not previously used on the contract, stating that minor concrete to be furnished meets contract requirements, including minimum cementitious material content specified.

90-10.04 CURING MINOR CONCRETE

- Curing minor concrete shall conform to the provisions in Section 90-7, "Curing Concrete."

90-10.05 PROTECTING MINOR CONCRETE

- Protecting minor concrete shall conform to the provisions in Section 90-8, "Protecting Concrete," except the concrete shall be maintained at a temperature of not less than 4°C for 72 hours after placing.

90-10.06 MEASUREMENT AND PAYMENT

- Minor concrete will be measured and paid for in conformance with the provisions specified in the various sections of these specifications covering concrete construction when minor concrete is specified in the specifications, shown on the plans, or indicated by contract item in the Engineer's Estimate.

90-11 MEASUREMENT AND PAYMENT

90-11.01 MEASUREMENT

- Portland cement concrete will be measured in conformance with the provisions specified in the various sections of these specifications covering construction requiring concrete.
- When it is provided that concrete will be measured at the mixer, the volume in cubic meters shall be computed as the total mass of the batch in kilograms divided by the density of the concrete in kilograms per cubic meter. The total mass of the batch shall be calculated as the sum of all materials, including water, entering the batch. The density of the concrete will be determined in conformance with the requirements in California Test 518.

90-11.02 PAYMENT

- Portland cement concrete will be paid for in conformance with the provisions specified in the various sections of these specifications covering construction requiring concrete.
- Full compensation for furnishing and incorporating admixtures required by these specifications or the special provisions will be considered as included in the contract prices paid for the concrete involved and no additional compensation will be allowed therefor.
- Should the Engineer order the Contractor to incorporate any admixtures in the concrete when their use is not required by these specifications or the special provisions, furnishing the admixtures and adding them to the concrete will be paid for as extra work as provided in Section 4-1.03D, "Extra Work."
- Should the Contractor use admixtures in conformance with the provisions in Section 90-4.05, "Optional Use of Chemical Admixtures," or Section 90-4.07, "Optional Use of Air-entraining Admixtures," or should the Contractor request and obtain permission to use other admixtures for the Contractor's benefit, the Contractor shall furnish those admixtures and incorporate them into the concrete at the Contractor's expense and no additional compensation will be allowed therefor.

SECTION 91: PAINT

Issue Date: November 18, 2005

Section 91-3, "Paints for Timber," of the Standard Specifications is amended to read:

91-3 PAINTS FOR TIMBER

91-3.01 WOOD PRIMER, LATEX-BASE

Classification:

- This specification covers a ready-mixed priming paint for use on unpainted wood or exterior woodwork. It shall conform with the requirements in the Detailed Performance Standards of the Master Painters Institute (MPI) for exterior wood primers, and be listed on the Exterior Latex Wood Primer MPI List Number 6.

91-3.02 PAINT; LATEX-BASE FOR EXTERIOR WOOD, WHITE AND TINTS

Classification:

- This specification covers a ready-mixed paint for use on wood surfaces subject to outside exposures. This paint shall conform to the requirements in the Detailed Performance Standards of the Master Painters Institute (MPI) for Paint, Latex, Exterior, and shall be listed on the following MPI Approved Products List:

- A. Exterior Latex, Flat MPI Gloss Level 1, MPI List Number 10.
- B. Exterior Latex, Semi-Gloss, MPI Gloss Level 5, MPI List Number 11.
- C. Exterior Latex, Gloss, MPI Gloss Level 6, MPI List Number 119.

- Unpainted wood shall first be primed with wood primer conforming to the provisions in Section 91-3.01, "Wood Primer, Latex-Base."

Section 91-4, "Miscellaneous Paints," of the Standard Specifications is amended to read:

91-4 MISCELLANEOUS PAINTS

91-4.01 THROUGH 91-4.04 (BLANK)

91-4.05 PAINT; ACRYLIC EMULSION, EXTERIOR WHITE AND LIGHT AND MEDIUM TINTS

Classification:

- This specification covers an acrylic emulsion paint designed for use on exterior masonry. This paint shall conform to the requirements in the Detailed Performance Standards of the Master Painters Institute (MPI) for Paint, Latex, Exterior, and shall be listed on the following MPI Approved Products Lists:

- A. Exterior Latex, Flat MPI Gloss Level 1, MPI List Number 10.
- B. Exterior Latex, Semi-Gloss, MPI Gloss Level 5, MPI List Number 11.
- C. Exterior Latex, Gloss, MPI Gloss Level 6, MPI List Number 119.

- This paint may be tinted by using "universal" or "all purpose" concentrates.

SECTION 92: ASPHALTS

Issue Date: November 18, 2005

Section 92, "Asphalts," of the Standard Specifications is amended to read:

92-1.01 DESCRIPTION

- Asphalt shall consist of refined petroleum or a mixture of refined liquid asphalt and refined solid asphalt, prepared from crude petroleum. Asphalt shall be:

- A. Free from residues caused by the artificial distillation of coal, coal tar, or paraffin.
- B. Free from water.
- C. Homogeneous.

92-1.02 MATERIALS

92-1.02(A) General

- The Contractor shall furnish asphalt under the Department's "Certification Program for Suppliers of Asphalt." The Department maintains the program requirements, procedures, and a list of approved suppliers at:

<http://www.dot.ca.gov/hq/esc/Translab/fpmcoc.htm>

- The Contractor shall ensure the safe transportation, storage, use, and disposal of asphalt.
- The Contractor shall prevent the formation of carbonized particles caused by overheating asphalt during manufacturing or construction.

92-1.02(B) Grades

- Performance graded (PG) asphalt binder shall conform to the following:

Performance Graded Asphalt Binder

Property	AASHTO Test Method	Specification				
		Grade				
		PG 58-22 ^a	PG 64-10	PG 64-16	PG 64-28	PG 70-10
Original Binder						
Flash Point, Minimum °C	T48	230	230	230	230	230
Solubility, Minimum % ^b	T44	99	99	99	99	99
Viscosity at 135°C, ^c Maximum, Pa·s	T316	3.0	3.0	3.0	3.0	3.0
Dynamic Shear, Test Temp. at 10 rad/s, °C Minimum G*/sin(delta), kPa	T315	58 1.00	64 1.00	64 1.00	64 1.00	70 1.00
RTFO Test, ^e Mass Loss, Maximum, %	T240	1.00	1.00	1.00	1.00	1.00
RTFO Test Aged Binder						
Dynamic Shear, Test Temp. at 10 rad/s, °C Minimum G*/sin(delta), kPa	T315	58 2.20	64 2.20	64 2.20	64 2.20	70 2.20
Ductility at 25°C Minimum, cm	T51	75	75	75	75	75
PAV ^f Aging, Temperature, °C	R28	100	100	100	100	110
RTFO Test and PAV Aged Binder						
Dynamic Shear, Test Temp. at 10 rad/s, °C Maximum G*/sin(delta), kPa	T315	22 ^d 5000	31 ^d 5000	28 ^d 5000	22 ^d 5000	34 ^d 5000
Creep Stiffness, Test Temperature, °C Maximum S-value, Mpa Minimum M-value	T313	-12 300 0.300	0 300 0.300	-6 300 0.300	-18 300 0.300	0 300 0.300

Notes:

- a. For use as asphalt rubber base stock for high mountain and high desert area.
 - b. The Engineer will waive this specification if the supplier is a Quality Supplier as defined by the Department's "Certification Program for Suppliers of Asphalt."
 - c. The Engineer will waive this specification if the supplier certifies the asphalt binder can be adequately pumped and mixed at temperatures meeting applicable safety standards.
 - d. Test the sample at 3°C higher if it fails at the specified test temperature. G*/sin(delta) shall remain 5000 kPa maximum.
 - e. "RTFO Test" means the asphaltic residue obtained using the Rolling Thin Film Oven Test, AASHTO Test Method T240 or ASTM Designation: D 2872.
 - f. "PAV" means Pressurized Aging Vessel.
- Performance based asphalt (PBA) binder shall conform to the following:

Performance Based Asphalt Binder

Property	AASHTO Test Method	Specification			
		Grade			
		PBA 6a	PBA 6a(mod)	PBA 6b	PBA 7
Absolute Viscosity (60°C), Pa·s(x10 ⁻¹) ^a Original Binder, Minimum RTFO Aged Residue ^b , Minimum	T202	2000 5000	2000 5000	2000 5000	1100 3000
Kinematic Viscosity (135°C), m ² /s(x10 ⁻⁶) Original Binder, Maximum RTFO Aged Residue, Minimum	T201	2000 275	2000 275	2000 275	2000 275
Absolute Viscosity Ratio (60°C), Maximum RTFO Test Visc./Orig. Visc.	—	4.0	4.0	4.0	4.0
Flash Point, Cleveland Open Cup, °C, ^d Original Binder, Minimum	T48	232	232	232	232
Mass Loss After RTFO Test, %	T240	0.60	0.60	0.60	0.60
Solubility in Trichloroethylene, % ^c Original Binder, Minimum	T44	Report	Report	Report	Report
Ductility (25°C, 5 cm/min), cm RTFO Test Aged Residue ^b , Minimum	T51	60	60	60	75
On RTFO Test Aged Residue, °C: 1 to 10 rad/sec: SSD ≥ 0 and Phase Angle (at 1 rad/sec) < 72°	r	—	35	—	—
On Residue from PAV ^g at temp., °C Or Residue from Tilt Oven ^f (@113°C), hours	R28	100 36	100 36	100 36	110 72
^e SSD ≥ -115(SSV)-50.6, °C	r	—	—	—	25
Stiffness, Test Temperature, °C Maximum S-value, MPa Minimum M-value	T313	-24 300 0.300	-24 300 0.300	-30 300 0.300	-6 300 0.300

Notes:

- a. Absolute viscosity (60°C) will be determined at one sec⁻¹ using ASTM Designation: D 4957 with Asphalt Institute vacuum capillary viscometers.
- b. "RTFO Aged Residue" means the asphaltic residue obtained using the Rolling Thin Film Oven Test (RTFO Test), AASHTO Test Method T240 or ASTM Designation: D 2872.
- c. There is no requirement; however results of the test shall be part of the certified copy of test results furnished with the Certificate of Compliance.
- d. "Residue from Tilt Oven " means the asphalt obtained using California Test 374, Method B, "Method for Determining Asphalt Durability Using the California Tilt-Oven Durability Test."
- e. "SSD" means Shear Susceptibility of Delta; "SSV" means Shear Susceptibility of Viscosity.
- f. California Test 381.
- g. "PAV" means Pressurized Aging Vessel.

92-1.02(C) Sampling

- The Contractor shall provide a sampling device in the asphalt feed line connecting the plant storage tanks to the asphalt weighing system or spray bar. The sampling device shall be accessible between 600 mm and 750 mm above the platform. The Contractor shall provide a receptacle for flushing the sampling device.
 - The sampling device shall include a valve:
 - A. With a diameter between 10 mm and 20 mm.
 - B. Manufactured in a manner that a one-liter sample may be taken slowly at any time during plant operations.
 - C. Maintained in good condition.

- The Contractor shall replace failed valves.
- In the presence of the Engineer, the Contractor will take 2 one-liter samples per operating day. The Contractor shall provide round, friction top, one-liter containers for storing samples.

92-1.03 APPLYING ASPHALT

- Unless otherwise specified, the Contractor shall heat and apply asphalt in conformance with the provisions in Section 93, "Liquid Asphalts."
- The Contractor shall apply paving asphalt at a temperature between 120°C and 190°C. The Engineer will determine the exact temperature of paving asphalt.

92-1.04 MEASUREMENT

- If asphalt is paid as a contract work item on a mass basis, the Department will measure asphalt by the tonne under the provisions for determining the mass for payment of liquid asphalt in Section 93, "Liquid Asphalt."
- The Engineer will determine the mass of asphalt from volumetric measurements if the Contractor:

A. Uses partial loads of asphalt.

B. Uses asphalt at locations other than a mixing plant and no suitable scales are available within 35 km.

C. Delivers asphalt meeting either of the following:

1. In calibrated trucks and each tank is accompanied by its measuring stick and calibration card.
2. In trucks equipped with a calibrated thermometer that determines the asphalt temperature at the time of delivery and equipped with a vehicle tank meter meeting Section 9-1.01, "Measurement of Quantities," for weighing, measuring, and metering devices.

- If the Contractor furnishes asphalt concrete from a mixing plant producing material for only one project, the Department will determine the amount of asphalt from volumetric measurements by measuring the amount in the tank at the start and the end of the project provided the tank is calibrated and equipped with its measuring stick and calibration card. The Engineer will determine pay quantities in conformance with the following:

- A. Before converting the volume to mass, the Engineer will reduce the volume measured to that which the asphalt would occupy at 15°C.
- B. The Engineer will use 981 L/tonne and 1020 g/L for the average weight and volume for both PG and PBA grades of asphalt at 15°C.
- C. The Engineer will use the Conversion Table in Section 93, "Liquid Asphalts."

SECTION 93: LIQUID ASPHALTS

Issue Date: November 18, 2005

The ninth paragraph of Section 93-1.04, "Measurement," of the Standard Specifications is amended to read:

- The following Legend and Conversion Table is to be used for converting volumes of liquid asphalt products, Grades 70 to 3000, inclusive, and paving asphalt Grades PG 58-22, PG 64-10, PG 64-16, PG 64-28, and PG 70-10, and Grades PBA 6a, PBA 6a (mod), PBA 6b, and PBA 7.

END OF AMENDMENTS

SECTION 2. PROPOSAL REQUIREMENTS AND CONDITIONS

2-1.01 GENERAL

The bidder's attention is directed to the provisions in Section 2, "Proposal Requirements and Conditions," of the Standard Specifications and these special provisions for the requirements and conditions which the bidder must observe in the preparation of the Proposal form and the submission of the bid.

In addition to the subcontractors required to be listed in conformance with Section 2-1.054, "Required Listing of Proposed Subcontractors," of the Standard Specifications, each proposal shall have listed therein the portion of work that will be performed by each subcontractor listed.

The Bidder's Bond form mentioned in the last paragraph in Section 2-1.07, "Proposal Guaranty," of the Standard Specifications will be found following the signature page of the Proposal.

Submit request for substitution of an "or equal" item, and the data substantiating the request to the Department of Transportation, District 11, Construction Duty Senior MS 73, P.O. Box 85406, San Diego, CA. 92186-5400, so that the request is received by the Department by close of business on the fourth day, not including Saturdays, Sundays and legal holidays, following bid opening.

In conformance with Public Contract Code Section 7106, a Noncollusion Affidavit is included in the Proposal. Signing the Proposal shall also constitute signature of the Noncollusion Affidavit.

The contractor, sub recipient or subcontractor shall not discriminate on the basis of race, color, national origin, or sex in the performance of this contract. The contractor shall carry out applicable requirements of 49 CFR part 26 in the award and administration of DOT-assisted contracts. Failure by the contractor to carry out these requirements is a material breach of this contract, which may result in the termination of this contract or such other remedy as the recipient deems appropriate. Each subcontract signed by the bidder must include this assurance.

Failure of the bidder to fulfill the requirements of the Special Provisions for submittals required to be furnished after bid opening, including but not limited to DBE or DVBE submittals, or escrowed bid documents, where applicable, may subject the bidder to a determination of the bidder's responsibility in the event it is the apparent low bidder on a future public works contracts.

2-1.015 FEDERAL LOBBYING RESTRICTIONS

Section 1352, Title 31, United States Code prohibits Federal funds from being expended by the recipient or any lower tier subrecipient of a Federal-aid contract to pay for any person for influencing or attempting to influence a Federal agency or Congress in connection with the awarding of any Federal-aid contract, the making of any Federal grant or loan, or the entering into of any cooperative agreement.

If any funds other than Federal funds have been paid for the same purposes in connection with this Federal-aid contract, the recipient shall submit an executed certification and, if required, submit a completed disclosure form as part of the bid documents.

A certification for Federal-aid contracts regarding payment of funds to lobby Congress or a Federal agency is included in the Proposal. Standard Form - LLL, "Disclosure of Lobbying Activities," with instructions for completion of the Standard Form is also included in the Proposal. Signing the Proposal shall constitute signature of the Certification.

The above-referenced certification and disclosure of lobbying activities shall be included in each subcontract and any lower-tier contracts exceeding \$100,000. All disclosure forms, but not certifications, shall be forwarded from tier to tier until received by the Engineer.

The Contractor, subcontractors and any lower-tier contractors shall file a disclosure form at the end of each calendar quarter in which there occurs any event that requires disclosure or that materially affects the accuracy of the information contained in any disclosure form previously filed by the Contractor, subcontractors and any lower-tier contractors. An event that materially affects the accuracy of the information reported includes:

- A. A cumulative increase of \$25,000 or more in the amount paid or expected to be paid for influencing or attempting to influence a covered Federal action; or
- B. A change in the person(s) or individual(s) influencing or attempting to influence a covered Federal action; or,
- C. A change in the officer(s), employee(s), or Member(s) contacted to influence or attempt to influence a covered Federal action.

2-1.02 DISADVANTAGED BUSINESS ENTERPRISE (DBE)

This project is subject to Part 26, Title 49, Code of Federal Regulations entitled "Participation by Disadvantaged Business Enterprises in Department of Transportation Financial Assistance Programs." The Regulations in their entirety are incorporated herein by this reference.

Bidders shall be fully informed respecting the requirements of the Regulations and the Department's Disadvantaged Business Enterprise (DBE) program developed pursuant to the Regulations; particular attention is directed to the following matters:

- A. A DBE must be a small business concern as defined pursuant to Section 3 of U.S. Small Business Act and relevant regulations promulgated pursuant thereto.
- B. A DBE may participate as a prime contractor, subcontractor, joint venture partner with a prime or subcontractor, vendor of material or supplies, or as a trucking company.
- C. A DBE bidder, not bidding as a joint venture with a non-DBE, will be required to document one or a combination of the following:

1. The bidder will meet the goal by performing work with its own forces.
 2. The bidder will meet the goal through work performed by DBE subcontractors, suppliers or trucking companies.
 3. The bidder, prior to bidding, made adequate good faith efforts to meet the goal.
- D. A DBE joint venture partner must be responsible for specific contract items of work, or portions thereof. Responsibility means actually performing, managing and supervising the work with its own forces. The DBE joint venture partner must share in the capital contribution, control, management, risks and profits of the joint venture. The DBE joint venturer must submit the joint venture agreement with the proposal or the DBE Information form required in the Section entitled "Submission of DBE Information" of these special provisions.
- E. A DBE must perform a commercially useful function, i.e., must be responsible for the execution of a distinct element of the work and must carry out its responsibility by actually performing, managing and supervising the work.
- F. DBEs must be certified by the California Unified Certification Program (CUCP).
- G. Credit for materials or supplies purchased from DBEs will be as follows:
1. If the materials or supplies are obtained from a DBE manufacturer, 100 percent of the cost of the materials or supplies will count toward the DBE goal. A DBE manufacturer is a firm that operates or maintains a factory or establishment that produces, on the premises, the materials, supplies, articles, or equipment required under the contract and of the general character described by the specifications.
 2. If the materials or supplies are purchased from a DBE regular dealer, 60 percent of the cost of the materials or supplies will count toward the DBE goal. A DBE regular dealer is a firm that owns, operates, or maintains a store, warehouse, or other establishment in which the materials, supplies, articles or equipment of the general character described by the specifications and required under the contract are bought, kept in stock, and regularly sold or leased to the public in the usual course of business. To be a DBE regular dealer, the firm must be an established, regular business that engages, as its principal business and under its own name, in the purchase and sale or lease of the products in question. A person may be a DBE regular dealer in such bulk items as petroleum products, steel, cement, gravel, stone, or asphalt without owning, operating, or maintaining a place of business as provided in this paragraph G.2. if the person both owns and operates distribution equipment for the products. Any supplementing of regular dealers' own distribution equipment shall be by a long-term lease agreement and not on an ad hoc or contract-by-contract basis. Packagers, brokers, manufacturers' representatives, or other persons who arrange or expedite transactions are not DBE regular dealers within the meaning of this paragraph G.2.
 3. Credit for materials or supplies purchased from a DBE which is neither a manufacturer nor a regular dealer will be limited to the entire amount of fees or commissions charged for assistance in the procurement of the materials and supplies, or fees or transportation charges for the delivery of materials or supplies required on a job site, provided the fees are reasonable and not excessive as compared with fees charged for similar services.
- H. Credit for DBE trucking companies will be as follows:
1. The DBE must be responsible for the management and supervision of the entire trucking operation for which it is responsible on a particular contract, and there cannot be a contrived arrangement for the purpose of meeting the DBE goal.
 2. The DBE must itself own and operate at least one fully licensed, insured, and operational truck used on the contract.
 3. The DBE receives credit for the total value of the transportation services it provides on the contract using trucks its owns, insures, and operates using drivers it employs.
 4. The DBE may lease trucks from another DBE firm, including an owner-operator who is certified as a DBE. The DBE who leases trucks from another DBE receives credit for the total value of the transportation services the lessee DBE provides on the contract.
 5. The DBE may also lease trucks from a non-DBE firm, including an owner-operator. The DBE who leases trucks from a non-DBE is entitled to credit only for the fee or commission it receives as a result of the lease arrangement. The DBE does not receive credit for the total value of the transportation services provided by the lessee, since these services are not provided by a DBE.
 6. For the purposes of this paragraph H, a lease must indicate that the DBE has exclusive use of and control over the truck. This does not preclude the leased truck from working for others during the term of the lease with the consent of the DBE, so long as the lease gives the DBE absolute priority for use of the leased truck. Leased trucks must display the name and identification number of the DBE.

- I. Noncompliance by the Contractor with the requirements of the regulations constitutes a breach of this contract and may result in termination of the contract or other appropriate remedy for a breach of this contract.
- J. Bidders are encouraged to use services offered by financial institutions owned and controlled by DBEs.

The following firms provide assistance to DBEs:

- 1. GCAP Sacramento Service Center
1326 North Market Blvd.
Sacramento, CA 95834-1912
Phone: (916) 565-4164
FAX: (916) 565-4356
Email: lheringer@gcapservices.com
- 2. GCAP Oakland Service Center
1330 Broadway, Suite 930
Oakland, CA 94612-2508
Phone: (510) 874-7877
FAX: (510) 832-2829
Email: bdiplanroom@aol.com
- 3. Padilla & Associates - Commerce
5675 East Telegraph Rd., Suite A-260
Commerce, CA 90040
Phone: (323) 728-8847
FAX: (323) 728-8867
- 4. Padilla & Associates – San Diego
2725 Congress Street, Suite 1D
San Diego, CA 92110
Phone: (619) 725-0843
FAX: (619) 725-0854

2-1.02A DBE GOAL FOR THIS PROJECT

The Department has established the following goal for Disadvantaged Business Enterprise (DBE) participation for this project:

Disadvantaged Business Enterprise (DBE): 12 percent

It is the bidder's responsibility to confirm that the firm is DBE certified as of the date of bid opening. Listings of DBEs certified by the CUCP are available from the following sources:

- 1. The Department's DBE Directory. This Directory may be obtained from the Department of Transportation, Materiel Operations Branch, Publication Distribution Unit, 1900 Royal Oaks Drive, Sacramento, California 95815, Telephone: (916) 445-3520.
- 2. The Department's web site at <http://www.dot.ca.gov/hq/bep>.

2-1.02B SUBMISSION OF DBE INFORMATION

The required DBE information shall be submitted on the "CALTRANS BIDDER - DBE INFORMATION" forms included in the Proposal. If the DBE information is not submitted with the bid, the DBE information forms shall be removed from the Proposal prior to submitting the bid.

Failure to submit the required DBE information within the time specified herein will be grounds for finding the bid nonresponsive.

Where the bidder has not met the designated DBE goal, it must submit good faith efforts (GFE) documentation within the time specified herein to establish that, prior to the bid, it made adequate good faith efforts to meet the goal.

Bidders are cautioned that even though their "CALTRANS BIDDER - DBE INFORMATION" form indicates they will meet the stated DBE goal, they should also submit their GFE documentation, within the time specified herein, to protect their eligibility for award of the contract in the event the Department, in its review, finds that the goal has not been met.

If DBE information is not submitted with the bid, the apparent successful bidder (low bidder), the second low bidder and the third low bidder shall complete and submit DBE information to the Department of Transportation, 1120 N Street, Room 0200, MS #26, Sacramento, California 95814 so the information is received by the Department no later than 4:00 p.m. ON THE FOURTH DAY, not including Saturdays, Sundays and legal holidays, following bid opening. DBE information sent by U.S. Postal Service certified mail with return receipt and certificate of mailing and mailed on or before the third day, not including Saturdays, Sundays and legal holidays, following bid opening will be accepted even if it is received after the fourth day following bid opening. Other bidders need not submit DBE information unless requested to do so by the Department. When a request is made by the Department, the DBE information of the other bidders shall be received by the Department within 4 days of the request, not including Saturdays, Sundays and legal holidays, unless a later time is authorized by the Department.

If it is determined that GFE documentation is needed to determine a bidder's eligibility for award, failure of the bidder to have submitted the GFE documentation by the time specified herein will be grounds for finding the bid or proposal nonresponsive.

It is the bidder's responsibility to make enough work available to DBEs and to select those portions of the work or material needs consistent with the available DBEs to meet the goal for DBE participation.

The bidder's "CALTRANS BIDDER - DBE INFORMATION" form shall include the names, addresses and phone numbers of DBE firms that will participate, with a complete description of work or supplies to be provided by each, and the dollar value of each DBE transaction. When 100 percent of a contract item of work is not to be performed or furnished by a DBE, a description of the exact portion of that work to be performed or furnished by that DBE shall be included in the DBE information, including the planned location of that work. The work that a DBE prime contractor has committed to performing with its own forces as well as the work that it has committed to be performed by DBE subcontractors, suppliers and trucking companies will count toward the goal.

The bidder shall submit written confirmation from each DBE that the DBE is participating in the contract, and include the confirmation with the submittal of the bid or with the submittal of the required DBE information. A copy of a DBE's quote will serve as written confirmation that the DBE is participating in the contract.

The bidder's good faith effort (GFE) documentation shall establish that good faith efforts to meet the DBE goal have been made.

In order to establish the bidder's good faith efforts to meet the DBE goal, the bidder should include the following information and supporting documents, as necessary:

- A. Items of work the bidder has made available to DBE firms. Identify those items of work the bidder might otherwise perform with its own forces and those items that have been broken down into economically feasible units to facilitate DBE participation. For each item listed, show the dollar value and percentage of the total contract. It is the bidder's responsibility to demonstrate that sufficient work to meet the goal was made available to DBE firms.
- B. The names of certified DBEs and the dates on which they were solicited to bid on the project. Include the items of work offered. Describe the methods used for following up initial solicitations to determine with certainty if the DBEs were interested, and the dates of the follow-up. Attach supporting documents such as copies of letters, memos, facsimiles sent, telephone logs, telephone billing statements, and other evidence of solicitation. Bidders are reminded to solicit certified DBEs through all reasonable and available means and provide sufficient time to allow DBEs to respond.
- C. For each item of work made available, the DBEs that provided quotes, the selected firm and its status as a DBE, the price quote for each firm, and the name, address and telephone number for each firm. If the firm selected for the item is not a DBE, provide the reasons for the selection.
- D. The names and dates of each publication in which a request for DBE participation for the project was placed by the bidder. Attach copies of the published advertisements.
- E. The names of agencies and the dates on which they were contacted to provide assistance in contacting, recruiting and using DBE firms. If the agencies were contacted in writing, provide copies of supporting documents.
- F. Descriptions of the efforts made to provide interested DBEs with adequate information about the plans, specifications and requirements of the contract to assist them in responding to a solicitation. Where the bidder has provided information, identify the name of the DBE assisted, the nature of the information provided, and date of contact. Provide copies of supporting documents, as appropriate.
- G. Descriptions of any and all efforts made to assist interested DBEs in obtaining bonding, lines of credit, insurance, necessary equipment, supplies, and materials (excluding supplies and equipment which the DBE subcontractor purchases or leases from the prime contractor or its affiliate). Where such assistance was provided by the bidder, identify the name of the DBE assisted, nature of the assistance offered, and date. Provide copies of supporting documents, as appropriate.
- H. Any additional data to support a demonstration of good faith efforts.

2-1.03 PRE-AWARD QUALIFICATION QUESTIONNAIRE

The Department has established the need to obtain information regarding each bidder's qualifications for performing the work to be done.

Bidders shall submit responses to the "Pre-Award Qualification Questionnaire" included in the Proposal. The responses to the Questionnaire shall be submitted with the bid.

Joint venture contractors shall submit a combined "Pre-Award Qualification Questionnaire" providing separate responses for each joint venture partner.

In signing the signature page of the Proposal, the bidder certifies that the information and answers on the "Pre-Award Qualification Questionnaire" are complete and accurate.

Upon approval of the contract, the completed "Pre-Award Qualification Questionnaire" of each unsuccessful bidder will be returned, unless a determination of non-qualification has been made by the Department, or the award of the contract has been challenged.

2-1.04 ESCROW OF BID DOCUMENTATION

Bid documentation shall consist of all documentary and calculated information generated by the Contractor in preparation of the bid. The bid documentation shall conform to the requirements in these special provisions, and shall be submitted to the Department and held in escrow for the duration of the contract.

The escrowed bid documents will be the only documents accepted from the Contractor regarding preparation of the bid.

In signing the proposal, the bidder certifies that the material submitted for escrow constitutes all the documentary information used in preparation of the bid and that he has personally examined the contents of the container and that they are complete.

The first, second and third apparent low bidders shall submit to the Department of Transportation, District 11 Construction Duty Senior 2829 Juan Street San Diego, CA 92110 (619) 688-6635, fax (619) 688-6988 the identification of the bidder's representative authorized to present the bid documentation and the persons responsible for preparing the bidder's estimate before the close of business on the first Monday after bid opening.

Nothing in the bid documentation shall be construed to change or modify the terms or conditions of the contract.

Escrowed bid documentation will not be used for pre-award evaluation of the Contractor's anticipated methods of construction, nor to assess the Contractor's qualifications for performing the work.

Bid documentation shall clearly itemize the Contractor's estimated costs of performing the work. The documentation submitted shall be complete and so detailed as to allow for an in-depth analysis of the Contractor's estimate.

The bid documentation shall include, but not be limited to: quantity takeoffs; rate schedules for the direct costs and the time- and nontime-related indirect costs for labor (by craft), plant and equipment ownership and operation, permanent and expendable materials, insurance and subcontracted work; estimated construction schedules, including sequence and duration and development of production rates; quotations, scoping documents and subcontracts related to subcontractors, manufacturers and suppliers; estimates of field and home office overhead; contingency and margin for each contract item of work; names of the persons responsible for preparing the bidder's estimate, and other reports, calculations, assumptions and information used by the bidder to arrive at the estimate submitted with the proposal.

The Contractor shall also submit bid documentation for each subcontractor, manufacturer and supplier whose total subcontract or purchase orders exceeds or is expected to exceed one-half of one percent of the total bid or \$10,000.00 whichever is greater. Subcontractor, manufacturer and supplier bid documentation shall be enclosed with the Contractor's submittal regardless of whether or not subcontracts or purchase orders have been executed or entered into on the date that bid documentation is submitted for escrow. The examination of subcontractors', manufacturers' and suppliers' bid documentation will be accomplished in the same manner as for the Contractor's bid documentation. If a subcontractor, manufacturer or supplier is replaced, bid documentation for the new subcontractor, manufacturer or supplier shall be submitted for review and escrow before authorization for the substitution will be granted. Upon written request of a subcontractor, manufacturer or supplier, the bid documentation from that subcontractor, manufacturer or supplier shall be reviewed only by the subcontractor, manufacturer or supplier and the Department and shall be placed in a separate container within the Contractor's container. The written request from the subcontractor, manufacturer or supplier shall be included with the bid documentation.

If the bidder is a joint venture, the bid documentation shall include the joint venture agreement, the joint venture estimate comparison and final reconciliation of the joint venture estimate.

Copies of the proposals submitted by the first, second and third low bidders will be provided to the respective bidders for inclusion in the bid documentation to be escrowed.

The first, second, and third apparent low bidders shall present the bid documentation for escrow at the District 11 Office, Construction Duty Senior (619) 688-6635, 2829 Juan Street, San Diego, CA 92110, on the first Wednesday between 1:00 p.m. and 2:00 p.m., following the time indicated in the "Notice to Contractors" for the opening of bids. The fourth and subsequent apparent low bidders shall present the bid documentation for escrow if requested by the Department to do so.

Bid documentation shall be submitted as a paper copy in a sealed container, clearly marked with the bidder's name, date of submittal, project contract number and the words, "Bid Documentation for Escrow."

Failure to submit the actual and complete bid documentation as specified herein within the time specified shall be cause for rejection of the proposal.

Upon submittal, the bid documentation of the apparent low bidder will be examined and inventoried by the duly designated representatives of the Contractor and the Department to ensure that the bid documentation is authentic, legible, and in accordance with the terms of this section "Escrow of Bid Documentation." The examination will not include review of, nor will it constitute approval of, proposed construction methods, estimating assumptions or interpretation of the contract. The examination will not alter any conditions or terms of the contract. The acceptance or rejection by the Department that the submitted bid documents are in compliance with this section "Escrow of Bid Documentation" shall be completed within 48 hours of the time the bid documentation is submitted by the Contractor.

At the completion of the examination, the bid documents will be sealed and jointly deposited at an agreed commercial business.

Bid documentation submitted by the second and third apparent low bidders will be jointly deposited at an agreed commercial businesses. If the apparent low bid is withdrawn or rejected, the bid documentation of the second low bidder will be examined and inventoried in the manner specified above, then sealed and deposited again in escrow. If the second low bid is withdrawn or rejected, the bid documentation of the third low bidder will be examined and inventoried in the manner specified above, then sealed and deposited again in escrow. Bid documentation from subsequent bidders, if requested, will be examined and inventoried in the same manner as specified above, then sealed and deposited in escrow. Upon execution and final approval of the contract or rejection of all bids, the bid documentation will be returned to any remaining unsuccessful bidders.

Any and all components of the escrowed bid documentation may be examined by the designated representatives of both the Department and the Contractor, at any time deemed necessary by either the Department or the Contractor to assist in the negotiation of price adjustments and change orders, or to assist in the potential resolution or in the settlement of claims or disputes. Such a joint review shall be performed within 15 days of receipt of a written request to do so by either party. If the Contractor refuses to participate in the joint examination of any and all components of the escrowed bid documentation as provided herein, such refusal shall be considered as a failure by the Contractor to exhaust administrative claim remedies with respect to the particular protest, notice of potential claim, or claim. In addition, this refusal by the Contractor shall constitute a bar to future arbitration with respect to the protest, potential claim or claim as provided by Section 10240.2 of the California Public Contract Code.

If requested by a Disputes Review Board, the escrowed bid documentation may be utilized to assist the Board in its recommendations.

The bid documentation submitted by the Contractor will be held in escrow until the contract has been completed, the ultimate resolution of all disputes and claims has been achieved and receipt of final payment has been accepted by the Contractor. The escrowed bid documentation will then be released from escrow to the Contractor.

The bid documentation submitted by the bidder is, and shall remain, the property of the bidder, and is subject to only joint review by the Department and the bidder or upon written request of a subcontractor, manufacturer or supplier shall be reviewed only by the subcontractor, supplier or manufacturer and the Department unless it involves a dispute or claim. The Department stipulates and expressly acknowledges that the submitted bid documentation constitutes trade secrets and will not be deemed public records. This acknowledgment is based on the Department's express understanding that the information contained in the bid documentation is not known outside the bidder's business, is known only to a limited extent and only by a limited number of employees of the bidder, is safeguarded while in the bidder's possession, is extremely valuable to the bidder and could be extremely valuable to the bidder's competitors by virtue of it reflecting the bidder's contemplated techniques of construction. The Department acknowledges that the bid documentation includes a compilation of information used in the bidder's business, intended to give the bidder an opportunity to obtain an advantage over competitors who do not know of or use the contents of the documentation. The Department agrees to safeguard the bid documentation, and all information contained therein, against disclosure, including disclosure of subcontractor bid documentation to the Contractor and other subcontractors to the fullest extent permitted by law. However, in the event of arbitration or litigation, the bid documentation shall be subject to discovery, and the Department assumes no responsibility for safeguarding the bid documentation unless the Contractor has obtained an appropriate protective order issued by the arbitrator or the court.

Full compensation for preparing the bid documentation, presenting it for escrow, and reviewing it for escrow and upon request of the Engineer, shall be considered as included in the contract prices paid for the various items of work, and no additional compensation will be allowed therefor.

The direct cost of depositing the bid documentation in escrow at the agreed commercial business will be paid by the State.

SECTION 3. PRE-AWARD QUALIFICATION REVIEW AND AWARD AND EXECUTION OF CONTRACT

3-1.01 GENERAL

The bidder's attention is directed to the provisions in Section 3, "Award and Execution of Contract," of the Standard Specifications, and these special provisions for the requirements and conditions concerning the Pre-Award Qualifications Review and the award and execution of contract.

Bid protests are to be delivered to the following address: Department of Transportation, MS 43, Attn: Office Engineer, 1727 30th Street, Sacramento, CA 95816 or by facsimile to the Office Engineer at (916) 227-6282.

3-1.01A PRE-AWARD QUALIFICATIONS REVIEW

The Engineer will review the responses to the "Pre-Award Qualification Questionnaire" submitted by the apparent low bidder and the Engineer will make a determination on the bidder's qualifications for performing the work in a manner that is safe for the workers and the public, based on the bidder's experience, qualifications of the on-site supervisory personnel, equipment, conceptual approach to the work, and safety history of the bidder and its supervisory personnel.

If the Engineer determines it necessary, a pre-award qualifications review meeting will be conducted by an agent of the Director, and the apparent low bidder shall participate. Notification of whether a meeting will be conducted will be provided on or before the first Thursday following the time indicated in the "Notice to Contractors" for the opening of bids. The meeting, if held, will be on second Thursday following the time indicated in the "Notice to Contractors" for the opening of bids at 10:00 a.m. in the third floor conference room, 1727 30th Street, Sacramento, Ca. 95816. Non-attendance by the apparent low bidder at the pre-award qualifications review meeting shall be just cause for rejection of the bid and forfeiture of the proposal guaranty.

At the pre-award qualifications review meeting, the low bidder shall be prepared to discuss and answer questions relative to the responses to the "Pre-Award Qualification Questionnaire." The Director's agent will prepare written findings and recommendations to the Engineer regarding award of the contract to the apparent low bidder based on the "Pre-Award Qualification Questionnaire" and responses submitted, and on the information provided at the pre-award qualifications review meeting, if held. The decision of the Engineer regarding the bidder's qualifications shall be final.

The second and third apparent bidders shall participate in pre-award qualifications review meetings if requested to do so by the Department. Notification by the Department will be provided a least 48 hours prior to the pre-award qualifications review meeting. Non-attendance by the second or third apparent low bidder at any such requested meeting shall be just cause for rejection of bid and forfeiture of the proposal guaranty.

3-1.01B AWARD AND EXECUTION OF CONTRACT

The award of the contract, if it be awarded, will be to the lowest responsible bidder whose proposal complies with all the requirements prescribed and who has met the goal for DBE participation or has demonstrated, to the satisfaction of the Department, adequate good faith efforts to do so and who has established to the satisfaction of the Engineer, the qualifications to complete the work on this project. Meeting the goal for DBE participation or demonstrating, to the satisfaction of the Department, adequate good faith efforts to do so is a condition for being eligible for award of contract.

The contract shall be executed by the successful bidder and shall be returned, together with the contract bonds, to the Department so that it is received within 10 days, not including Saturdays, Sundays and legal holidays, after the bidder has received the contract for execution. Failure to do so shall be just cause for forfeiture of the proposal guaranty. The executed contract documents shall be delivered to the following address: Department of Transportation MS 43, Attn: Office Engineer, 1727 30th Street, Sacramento, CA 95816.

A "Payee Data Record" form will be included in the contract documents to be executed by the successful bidder. The purpose of the form is to facilitate the collection of taxpayer identification data. The form shall be completed and returned to the Department by the successful bidder with the executed contract and contract bonds. For the purposes of the form, payee shall be deemed to mean the successful bidder. The form is not to be completed for subcontractors or suppliers. Failure to complete and return the "Payee Data Record" form to the Department as provided herein will result in the retention of 31 percent of payments due the contractor and penalties of up to \$20,000. This retention of payments for failure to complete the "Payee Data Record" form is in addition to any other retention of payments due the Contractor.

SECTION 4. BEGINNING OF WORK, TIME OF COMPLETION AND LIQUIDATED DAMAGES

Attention is directed to the provisions in Sections 8-1.03, "Beginning of Work," 8-1.06, "Time of Completion," 8-1.07, "Liquidated Damages," and 20-4.08, "Plant Establishment Work," of the Standard Specifications and these special provisions.

Attention is directed to "Incentives and Disincentives for Designated Portion of Work" of these special provisions.

The Contractor shall begin work within 15 calendar days after the contract has been approved by the Attorney General or the attorney appointed and authorized to represent the Department of Transportation.

The work (except plant establishment work) shall be diligently prosecuted to completion before the expiration of **540 WORKING DAYS** beginning on the fifteenth calendar day after approval of the contract.

The Contractor shall pay to the State of California the sum of \$9,100 per day, for each and every calendar day's delay in finishing the work (except plant establishment work) in excess of **540 WORKING DAYS**.

The Contractor shall diligently prosecute all work (including plant establishment) to completion before the expiration of **790 WORKING DAYS** beginning on the fifteenth calendar day after approval of the contract.

The Contractor shall pay to the State of California the sum of \$600 per day, for each and every calendar day's delay in completing the work in excess of **790 WORKING DAYS**.

In no case will liquidated damages of more than \$9,100 per day be assessed.

INCENTIVES AND DISINCENTIVES FOR DESIGNATED PORTION OF WORK

For purposes of determining incentive payments and disincentive deductions, the work shall be considered complete when all the managed lanes are permanently open for traffic from Station 309+40 SD-15M to 396+00 SD-15M and all designated work is complete in all respects and in accordance with the plans, Standard Specifications and these special provisions.

DESIGNATED PORTION OF WORK

The designated portion of work shall include all work involved to permanently open managed lanes in each direction of travel on Route 15 to through traffic from Station 309+40 SD-15M to 396+00 SD-15M and include the following:

- A. Guide wire system installation; Station 316+50 SD-15M to 396+00 SD-15M
- B. Install Moveable Barrier; 319+20 SD-15M to 396+00 SD-15M
- C. Pavement delineation 309+40 SD-15M to 396+00 SD-15M
- D. Complete Construction Stage 1A, 1B, 1C and 1D as shown on the plans

The designated portion of work shall not be subject to change by any of the phased project plan completion schedule in accordance with Section 1 "Specifications and Plans" of these Special Provisions. The designated portion of work is subject to change in accordance with Section 4-1.03 "Changes" of the Standard Specification.

The following work can be completed after the managed lanes are open to traffic and is not included in the designated work for incentives and disincentives purposes.

- A. North County Fair DAR South (Br. No. 57-1196).
- B. North County Fair DAR North (Br. No. 57-1199).
- C. RW446R, RW446L, RW450R, and RW450L.
- D. Median work north of 437+50 SD-15M.
- E. Install sign structures 309+40 SD-15M to 437+50 SD-15M

LIMITATIONS ON DESIGNATED WORK AREAS

A portion of the Designated Work Area from 309+40 SD-15M to 396+00 SD-15M will only be available for the designated work between July 1, 2007 and December 31, 2007. If the designated work is delayed by other on-going contracts and if, in the opinion of the Engineer, this delay causes the contractor to delay the completion of the designated work related to incentive and disincentive purposes, the Contractor shall be granted non-compensatory working days. These working days only relate to this section for incentive and disincentive purposes and will not extend the contract and will not be eligible for Time Related Overhead.

Attention is directed to "Cooperation" of these special provisions.

INCENTIVE AND DISINCENTIVE

For each and every working day the designated portion of work is completed prior to the expiration of 360 working days beginning on the fifteenth calendar day after approval of the contract, the Contractor will receive an incentive payment of \$25,000 per calendar day. The total incentive payment will not exceed \$1,000,000.

For each and every working day delay in completion of the designated portion of work in excess of 360 working days beginning on the fifteenth calendar day after approval of the contract, a disincentive deduction of \$25,000 per calendar day will be deducted from any monies due the Contractor under the contract. The total disincentive deduction will not exceed \$1,000,000.

Contractual obligations required by the Engineer such as; performing normal inspection, testing and review duties to complete the designated portion of work shall be considered as included in the 360 working days for the completion of that

portion of the contract and no extensions of time will be allowed for such actions in determining incentive payments or disincentive deductions.

Liquidated damages shall accrue separately and independently of disincentive deductions.

SECTION 5. GENERAL

SECTION 5-1. MISCELLANEOUS

5-1.01 PLANS AND WORKING DRAWINGS

When the specifications require working drawings to be submitted to the Division of Structure Design, the drawings shall be submitted to: Division of Structure Design, Documents Unit, Mail Station 9, 1801 30th Street, Sacramento, CA 95816, Telephone 916 227-8252.

5-1.013 LINES AND GRADES

Attention is directed to Section 5-1.07, "Lines and Grades," of the Standard Specifications.

Stakes or marks will be set by the Engineer in conformance with the requirements in Chapter 12, "Construction Surveys," of the Department's Surveys Manual.

5-1.015 LABORATORY

When a reference is made in the specifications to the "Laboratory," the reference shall mean Division of Engineering Services - Materials Engineering and Testing Services and Division of Engineering Services - Geotechnical Services of the Department of Transportation, or established laboratories of the various Districts of the Department, or other laboratories authorized by the Department to test materials and work involved in the contract. When a reference is made in the specifications to the "Transportation Laboratory," the reference shall mean Division of Engineering Services - Materials Engineering and Testing Services and Division of Engineering Services - Geotechnical Services, located at 5900 Folsom Boulevard, Sacramento, CA 95819, Telephone (916) 227-7000.

5-1.017 CONTRACT BONDS

Attention is directed to Section 3-1.02, "Contract Bonds," of the Standard Specifications and these special provisions.

The payment bond shall be in a sum not less than one hundred percent of the total amount payable by the terms of the contract.

5-1.018 GUARANTEE

GENERAL

The Contractor shall guarantee the work is in accordance with contract requirements and remains free from substantial defects in materials and workmanship for a period of one year after contract acceptance. For certain portions of the work where the Director relieves the Contractor of responsibility in accordance with Section 7-1.15, "Relief from Maintenance and Responsibility," of the Standard Specifications, the guarantee period starts on the relief date and ends one year therefrom.

Substantial defects in materials and workmanship means defective work objectively manifested by damaged, displaced, or missing parts or components; and workmanship resulting in improper function of materials, components, equipment, or systems, as installed or manufactured by the Contractor, subcontractor, supplier, or manufacturer.

During the guarantee period, the Contractor shall repair or replace contract work and associated work which is not in accordance with contract requirements or has substantial defects in materials and workmanship. The Contractor shall perform the corrective work with no expense to the Department other than State-provided field inspection services.

The guarantee of work excludes damage or displacement that is outside the control of the Contractor and caused by normal wear and tear, improper operation, insufficient maintenance, abuse, unauthorized modification, or natural disaster as described in Section 7-1.165, "Damage by Storm, Flood, Tsunami or Earthquake," of the Standard Specifications.

The Contractor shall have the same insurance coverage during corrective work operations as prior to contract acceptance, in accordance with Section 7-1.12, "Indemnification and Insurance," of the Standard Specifications.

The contract bonds furnished in accordance with Section 3-1.02, "Contract Bonds," of the Standard Specifications must remain in full force and effect during the guarantee period and until all corrective work is complete.

In the case of conflict between this guarantee provision and any warranty provision included in the contract, the warranty provision shall govern for the specific construction product or feature covered.

CORRECTIVE WORK

During the guarantee period, the Department will monitor performance of the highway facilities completed by the Contractor and will perform a thorough review of the contract work at least 60 days before the expiration of the one-year guarantee.

If the Engineer discovers contract work not in compliance with contract requirements or that has substantial defects in materials and workmanship, at any time during the guarantee period, a list of items that require corrective work will be developed and forwarded to the Contractor. Within 15 days of receipt of a list, the Contractor shall submit to the Engineer a detailed plan for performing corrective work. The work plan shall include a start to finish schedule. It shall include a list of labor, equipment, materials, and any special services intended to be used. It shall clearly show related work including traffic control, temporary delineation, and permanent delineation.

The Contractor shall start the corrective and related work within 15 days of receiving notice from the Engineer that the Contractor's work plan is approved. The corrective work shall be diligently prosecuted and completed within the time allotted in the approved work plan.

If the Engineer determines that corrective work, covered by the guarantee, is urgently needed to prevent injury or property damage, the Engineer will give the Contractor a request to start emergency repair work and a list of items that require repair work. The Contractor shall mobilize within 24 hours and diligently perform emergency repair work on the damaged highway facilities. The Contractor shall submit a work plan within 5 days of starting emergency repair work.

If the Contractor fails to commence and execute, with due diligence, corrective work and related work required under the guarantee in the time allotted, the Engineer may proceed to have the work performed by State forces or other forces at the Contractor's expense. Upon demand, the Contractor shall pay all costs incurred by the Department for work performed by State forces or other forces including labor, equipment, material, and special services.

PAYMENT

Full compensation for performing corrective work; and related work such as traffic control, temporary delineation, and permanent delineation, and to maintain insurance coverage and bonds, shall be considered as included in the contract prices paid for the various contract items of work and no separate payment will be made therefore.

5-1.019 COST REDUCTION INCENTIVE

Attention is directed to Section 5-1.14, "Cost Reduction Incentive," of the Standard Specifications.

Prior to preparing a written cost reduction proposal, the Contractor shall request a meeting with the Engineer to discuss the proposal in concept. Items of discussion will also include permit issues, impact on other projects, impact on the project schedule, peer reviews, overall merit of the proposal, and review times required by the Department and other agencies.

If a cost reduction proposal submitted by the Contractor, and subsequently approved by the Engineer, provides for a reduction in contract time, 50 percent of that contract time reduction shall be credited to the State by reducing the contract working days, not including plant establishment. Attention is directed to "Beginning of Work, Time of Completion and Liquidated Damages" of these special provisions regarding the working days.

If a cost reduction proposal submitted by the Contractor, and subsequently approved by the Engineer, provides for a reduction in traffic congestion or avoids traffic congestion during construction, 60 percent of the estimated net savings in construction costs attributable to the cost reduction proposal will be paid to the Contractor. In addition to the requirements in Section 5-1.14, "Cost Reduction Incentive," of the Standard Specifications, the Contractor shall provide detailed comparisons of the traffic handling between the existing contract and the proposed change, and estimates of the traffic volumes and congestion.

5-1.02 LABOR NONDISCRIMINATION

Attention is directed to the following Notice that is required by Chapter 5 of Division 4 of Title 2, California Code of Regulations.

NOTICE OF REQUIREMENT FOR NONDISCRIMINATION PROGRAM

(GOV. CODE, SECTION 12990)

Your attention is called to the "Nondiscrimination Clause", set forth in Section 7-1.01A(4), "Labor Nondiscrimination," of the Standard Specifications, which is applicable to all nonexempt State contracts and subcontracts, and to the "Standard California Nondiscrimination Construction Contract Specifications" set forth therein. The specifications are applicable to all nonexempt State construction contracts and subcontracts of \$5000 or more.

5-1.022 EXCLUSION OF RETENTION

In conformance with 49 CFR, Part 26, Subpart B, Section 26.29 (b)(1), the retention of proceeds required by Public Contract Code Section 10261 shall not apply. In conformance with Public Contract Code 7200 (b), in subcontracts between the Contractor and a subcontractor and in subcontracts between a subcontractor and any subcontractor thereunder, retention proceeds shall not be withheld, and the exceptions provided in Public Contract Code 7200 (c) shall not apply. At the option of the Contractor, subcontractors may be required to furnish payment and performance bonds issued by an admitted surety insurer.

The third paragraph of Section 9-1.06, "Partial Payments," of the Standard Specifications, and Section 9-1.065, "Payment of Withheld Funds," of the Standard Specifications shall not apply.

5-1.023 UNSATISFACTORY PROGRESS

If the number of working days charged to the contract exceeds 75 percent of the working days in the current time of completion and the percent working days elapsed exceeds the percent work completed by more than 15 percentage points, the Department will withhold 10 percent of the amount due on the current monthly estimate.

The percent working days elapsed will be determined from the number of working days charged to the contract divided by the number of contract working days in the current time of completion, expressed as a percentage. The number of contract working days in the current time of completion shall consist of the original contract working days increased or decreased by time adjustments approved by the Engineer.

The percent work completed will be determined by the Engineer from the sum of payments made to date plus the amount due on the current monthly estimate, divided by the current total estimated value of the work, expressed as a percentage.

When the percent of working days elapsed minus the percent of work completed is less than or equal to 15 percentage points, the funds withheld shall be returned to the Contractor with the next monthly progress payment.

Funds kept or withheld from payment, due to the failure of the Contractor to comply with the provisions of the contract, will not be subject to the requirements of Public Contract Code 7107 or to the payment of interest pursuant to Public Contract Code Section 10261.5.

5-1.03 INTEREST ON PAYMENTS

Interest shall be payable on progress payments, payments after acceptance, final payments, extra work payments, and claim payments as follows:

- A. Unpaid progress payments, payment after acceptance, and final payments shall begin to accrue interest 30 days after the Engineer prepares the payment estimate.
- B. Unpaid extra work bills shall begin to accrue interest 30 days after preparation of the first pay estimate following receipt of a properly submitted and undisputed extra work bill. To be properly submitted, the bill must be submitted within 7 days of the performance of the extra work and in conformance with the provisions in Section 9-1.03C, "Records," and Section 9-1.06, "Partial Payments," of the Standard Specifications. An undisputed extra work bill not submitted within 7 days of performance of the extra work will begin to accrue interest 30 days after the preparation of the second pay estimate following submittal of the bill.
- C. The rate of interest payable for unpaid progress payments, payments after acceptance, final payments, and extra work payments shall be 10 percent per annum.
- D. The rate of interest payable on a claim, protest or dispute ultimately allowed under this contract shall be 6 percent per annum. Interest shall begin to accrue 61 days after the Contractor submits to the Engineer information in sufficient detail to enable the Engineer to ascertain the basis and amount of said claim, protest or dispute.

The rate of interest payable on any award in arbitration shall be 6 percent per annum if allowed under the provisions of Civil Code Section 3289.

5-1.04 PUBLIC SAFETY

The Contractor shall provide for the safety of traffic and the public in conformance with the provisions in Section 7-1.09, "Public Safety," of the Standard Specifications and these special provisions.

The Contractor shall install temporary railing (Type K) between a lane open to public traffic and an excavation, obstacle or storage area when the following conditions exist:

- A. Excavations.—The near edge of the excavation is 3.6 m or less from the edge of the lane, except:
 1. Excavations covered with sheet steel or concrete covers of adequate thickness to prevent accidental entry by traffic or the public.
 2. Excavations less than 0.3-m deep.

3. Trenches less than 0.3-m wide for irrigation pipe or electrical conduit, or excavations less than 0.3-m in diameter.
 4. Excavations parallel to the lane for the purpose of pavement widening or reconstruction.
 5. Excavations in side slopes, where the slope is steeper than 1:4 (vertical:horizontal).
 6. Excavations protected by existing barrier or railing.
- B. Temporarily Unprotected Permanent Obstacles.—The work includes the installation of a fixed obstacle together with a protective system, such as a sign structure together with protective railing, and the Contractor elects to install the obstacle prior to installing the protective system; or the Contractor, for the Contractor's convenience and with permission of the Engineer, removes a portion of an existing protective railing at an obstacle and does not replace such railing complete in place during the same day.
- C. Storage Areas.—Material or equipment is stored within 3.6 m of the lane and the storage is not otherwise prohibited by the provisions of the Standard Specifications and these special provisions.

The approach end of temporary railing (Type K), installed in conformance with the provisions in this section "Public Safety" and in Section 7-1.09, "Public Safety," of the Standard Specifications, shall be offset a minimum of 4.6 m from the edge of the traffic lane open to public traffic. The temporary railing shall be installed on a skew toward the edge of the traffic lane of not more than 0.3-m transversely to 3 m longitudinally with respect to the edge of the traffic lane. If the 4.6-m minimum offset cannot be achieved, the temporary railing shall be installed on the 10 to 1 skew to obtain the maximum available offset between the approach end of the railing and the edge of the traffic lane, and an array of temporary crash cushion modules shall be installed at the approach end of the temporary railing.

Temporary railing (Type K) shall conform to the provisions in Section 12-3.08, "Temporary Railing (Type K)," of the Standard Specifications. Temporary railing (Type K), conforming to the details shown on 1999 Standard Plan T3, may be used. Temporary railing (Type K) fabricated prior to January 1, 1993, and conforming to 1988 Standard Plan B11-30 may be used, provided the fabrication date is printed on the required Certificate of Compliance.

Temporary crash cushion modules shall conform to the provisions in "Temporary Crash Cushion Module" of these special provisions.

Except for installing, maintaining and removing traffic control devices, whenever work is performed or equipment is operated in the following work areas, the Contractor shall close the adjacent traffic lane unless otherwise provided in the Standard Specifications and these special provisions:

Approach Speed of Public Traffic (Posted Limit) (Kilometers Per Hour)	Work Areas
Over 72 (45 Miles Per Hour)	Within 1.8 m of a traffic lane but not on a traffic lane
56 to 72 (35 to 45 Miles Per Hour)	Within 0.9-m of a traffic lane but not on a traffic lane

The lane closure provisions of this section shall not apply if the work area is protected by permanent or temporary railing or barrier.

When traffic cones or delineators are used to delineate a temporary edge of a traffic lane, the line of cones or delineators shall be considered to be the edge of the traffic lane, however, the Contractor shall not reduce the width of an existing lane to less than 3 m without written approval from the Engineer.

When work is not in progress on a trench or other excavation that required closure of an adjacent lane, the traffic cones or portable delineators used for the lane closure shall be placed off of and adjacent to the edge of the traveled way. The spacing of the cones or delineators shall be not more than the spacing used for the lane closure.

Suspended loads or equipment shall not be moved nor positioned over public traffic or pedestrians.

Full compensation for conforming to the provisions in this section "Public Safety," including furnishing and installing temporary railing (Type K) and temporary crash cushion modules, shall be considered as included in the contract prices paid for the various items of work involved and no additional compensation will be allowed therefor.

5-1.05 TESTING

Testing of materials and work shall conform to the provisions in Section 6-3, "Testing," of the Standard Specifications and these special provisions.

Whenever the provisions of Section 6-3.01, "General," of the Standard Specifications refer to tests or testing, it shall mean tests to assure the quality and to determine the acceptability of the materials and work.

The Engineer will deduct the costs for testing of materials and work found to be unacceptable, as determined by the tests performed by the Department, and the costs for testing of material sources identified by the Contractor which are not used for the work, from moneys due or to become due to the Contractor. The amount deducted will be determined by the Engineer.

5-1.06 REMOVAL OF ASBESTOS AND HAZARDOUS SUBSTANCES

When the presence of asbestos or hazardous substances are not shown on the plans or indicated in the specifications and the Contractor encounters materials which the Contractor reasonably believes to be asbestos or a hazardous substance as defined in Section 25914.1 of the Health and Safety Code, and the asbestos or hazardous substance has not been rendered harmless, the Contractor may continue work in unaffected areas reasonably believed to be safe. The Contractor shall immediately cease work in the affected area and report the condition to the Engineer in writing.

In conformance with Section 25914.1 of the Health and Safety Code, removal of asbestos or hazardous substances including exploratory work to identify and determine the extent of the asbestos or hazardous substance will be performed by separate contract.

If delay of work in the area delays the current controlling operation, the delay will be considered a right of way delay and the Contractor will be compensated for the delay in conformance with the provisions in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

5-1.065 SOLID WASTE DISPOSAL AND RECYCLING REPORT

This work shall consist of reporting disposal and recycling of construction solid waste, as specified in these special provisions. For the purposes of this section, solid waste includes construction and demolition waste debris, but not hazardous waste.

Annually by the fifteenth day of January, the Contractor shall complete and certify Form CEM-2025, "Solid Waste Disposal and Recycling Report," which quantifies solid waste generated by the work performed and disposed of in landfills or recycled during the previous calendar year. The amount and type of solid waste disposed of or recycled shall be reported in either metric tonnes or cubic meters. The Contractor shall also complete and certify Form CEM-2025 within 5 days following contract acceptance.

Form CEM-2025, "Solid Waste Disposal and Recycling Report" can be downloaded from the following website:

<http://www.dot.ca.gov/hq/construc/manual2001>

If the Contractor has not submitted Form CEM-2025, by the dates specified above, the Department will withhold the amount of \$10,000 for each missing or incomplete report. The moneys withheld will be released for payment on the next monthly estimate for partial payment following the date that a complete and acceptable Form CEM-2025 is submitted to the Engineer. Upon completion of all contract work and submittal of the final Form CEM-2025, remaining withheld funds associated with this section, "Solid Waste Disposal and Recycling Report," will be released for payment. Withheld funds in conformance with this section shall be in addition to other moneys withheld provided for in the contract. No interest will be due the Contractor on withheld amounts.

Full compensation for preparing and submitting Form CEM-2025, "Solid Waste Disposal and Recycling Report," shall be considered as included in the contract price for the various items of work involved and no additional compensation will be allowed therefor.

5-1.07 (BLANK)

5-1.075 BUY AMERICA REQUIREMENTS

Attention is directed to the "Buy America" requirements of the Surface Transportation Assistance Act of 1982 (Section 165) and the Intermodal Surface Transportation Efficiency Act of 1991 (ISTEA) Sections 1041(a) and 1048(a), and the regulations adopted pursuant thereto. In conformance with the law and regulations, all manufacturing processes for steel and iron materials furnished for incorporation into the work on this project shall occur in the United States; with the exception that pig iron and processed, pelletized and reduced iron ore manufactured outside of the United States may be used in the domestic manufacturing process for such steel and iron materials. The application of coatings, such as epoxy coating, galvanizing, painting, and other coatings that protect or enhance the value of steel or iron materials shall be considered a manufacturing process subject to the "Buy America" requirements.

A Certificate of Compliance conforming to the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications shall be furnished for steel and iron materials. The certificates, in addition to certifying that the materials comply with the specifications, shall specifically certify that all manufacturing processes for the materials occurred in the United States, except for the above exceptions.

The requirements imposed by the law and regulations do not prevent a minimal use of foreign steel and iron materials if the total combined cost of the materials used does not exceed one-tenth of one percent (0.1 percent) of the total contract cost or \$2500, whichever is greater. The Contractor shall furnish the Engineer acceptable documentation of the quantity and value of the foreign steel and iron prior to incorporating the materials into the work.

5-1.08 SUBCONTRACTOR AND DBE RECORDS

The Contractor shall maintain records showing the name and business address of each first-tier subcontractor. The records shall also show the name and business address of every DBE subcontractor, DBE vendor of materials and DBE trucking company, regardless of tier. The records shall show the date of payment and the total dollar figure paid to all of these firms. DBE prime contractors shall also show the date of work performed by their own forces along with the corresponding dollar value of the work.

Upon completion of the contract, a summary of these records shall be prepared on Form CEM-2402 (F) and certified correct by the Contractor or the Contractor's authorized representative, and shall be furnished to the Engineer. The form shall be furnished to the Engineer within 90 days from the date of contract acceptance. \$10,000 will be withheld from payment until the Form CEM-2402 (F) is submitted. The amount will be returned to the Contractor when a satisfactory Form CEM-2402 (F) is submitted.

Prior to the fifteenth of each month, the Contractor shall submit documentation to the Engineer showing the amount paid to DBE trucking companies listed in the Contractor's DBE information. This monthly documentation shall indicate the portion of the revenue paid to DBE trucking companies which is claimed toward DBE participation. The Contractor shall also obtain and submit documentation to the Engineer showing the amount paid by DBE trucking companies to all firms, including owner-operators, for the leasing of trucks. The DBE who leases trucks from a non-DBE is entitled to credit only for the fee or commission it receives as a result of the lease arrangement. The records must confirm that the amount of credit claimed toward DBE participation conforms with Section 2-1.02, "Disadvantaged Business Enterprise," of these special provisions.

The Contractor shall also obtain and submit documentation to the Engineer showing the truck number, owner's name, California Highway Patrol CA number, and if applicable, the DBE certification number of the owner of the truck for all trucks used during that month for which DBE participation will be claimed. This documentation shall be submitted on Form CEM-2404 (F).

5-1.083 DBE CERTIFICATION STATUS

If a DBE subcontractor is decertified during the life of the project, the decertified subcontractor shall notify the Contractor in writing with the date of decertification. If a subcontractor becomes a certified DBE during the life of the project, the subcontractor shall notify the Contractor in writing with the date of certification. The Contractor shall furnish the written documentation to the Engineer.

Upon completion of the contract, Form CEM-2403 (F) indicating the DBE's existing certification status shall be signed and certified correct by the Contractor. The certified form shall be furnished to the Engineer within 90 days from the date of contract acceptance.

5-1.086 PERFORMANCE OF DBE SUBCONTRACTORS AND SUPPLIERS

The DBEs listed by the Contractor in response to the provisions in Section 2-1.02B, "Submission of DBE Information," and Section 3, "Award and Execution of Contract," of these special provisions, which are determined by the Department to be certified DBEs, shall perform the work and supply the materials for which they are listed, unless the Contractor has received prior written authorization to perform the work with other forces or to obtain the materials from other sources.

Authorization to use other forces or sources of materials may be requested for the following reasons:

- A. The listed DBE, after having had a reasonable opportunity to do so, fails or refuses to execute a written contract, when such written contract, based upon the general terms, conditions, plans and specifications for the project, or on the terms of such subcontractor's or supplier's written bid, is presented by the Contractor.
- B. The listed DBE becomes bankrupt or insolvent.
- C. The listed DBE fails or refuses to perform the subcontract or furnish the listed materials.
- D. The Contractor stipulated that a bond was a condition of executing a subcontract and the listed DBE subcontractor fails or refuses to meet the bond requirements of the Contractor.
- E. The work performed by the listed subcontractor is substantially unsatisfactory and is not in substantial conformance with the plans and specifications, or the subcontractor is substantially delaying or disrupting the progress of the work.
- F. It would be in the best interest of the State.

The Contractor shall not be entitled to any payment for such work or material unless it is performed or supplied by the listed DBE or by other forces (including those of the Contractor) pursuant to prior written authorization of the Engineer.

5-1.09 SUBCONTRACTING

Attention is directed to the provisions in Section 8-1.01, "Subcontracting," of the Standard Specifications, and Section 2, "Proposal Requirements and Conditions," and Section 3, "Award and Execution of Contract," of these special provisions.

Pursuant to the provisions of Section 1777.1 of the Labor Code, the Labor Commissioner publishes and distributes a list of contractors ineligible to perform work as a subcontractor on a public works project. This list of debarred contractors is available from the Department of Industrial Relations web site at:

<http://www.dir.ca.gov/DLSE/Debar.html>.

The provisions in the third paragraph of Section 8-1.01, "Subcontracting," of the Standard Specifications, that the Contractor shall perform with the Contractor's own organization contract work amounting to not less than 50 percent of the original contract price, is not changed by the Federal Aid requirement specified under "Required Contract Provisions Federal-Aid Construction Contracts" in Section 14 of these special provisions that the Contractor perform not less than 30 percent of the original contract work with the Contractor's own organization.

Each subcontract and any lower tier subcontract that may in turn be made shall include the "Required Contract Provisions Federal-Aid Construction Contracts" in Section 14 of these special provisions. This requirement shall be enforced as follows:

- A. Noncompliance shall be corrected. Payment for subcontracted work involved will be withheld from progress payments due, or to become due, until correction is made. Failure to comply may result in termination of the contract.

In conformance with the Federal DBE regulations Sections 26.53(f)(1) and 26.53(f)(2) Part 26, Title 49 CFR:

- A. The Contractor shall not terminate for convenience a DBE subcontractor listed in response to Section 2-1.02B, "Submission of DBE Information," and then perform that work with its own forces, or those of an affiliate without the written consent of the Department, and
- B. If a DBE subcontractor is terminated or fails to complete its work for any reason, the Contractor will be required to make good faith efforts to substitute another DBE subcontractor for the original DBE subcontractor, to the extent needed to meet the contract goal.

The requirement in Section 2-1.02, "Disadvantaged Business Enterprise (DBE)," of these special provisions that DBEs must be certified on the date bids are opened does not apply to DBE substitutions after award of the contract.

5-1.10 PROMPT PROGRESS PAYMENT TO SUBCONTRACTORS

Attention is directed to the provisions in Sections 10262 and 10262.5 of the Public Contract Code concerning prompt payment to subcontractors.

5-1.103 RECORDS

The Contractor shall maintain cost accounting records for the contract pertaining to, and in such a manner as to provide a clear distinction between, the following six categories of costs of work during the life of the contract:

- A. Direct costs of contract item work.
- B. Direct costs of changes in character in conformance with Section 4-1.03C, "Changes in Character of Work," of the Standard Specifications.
- C. Direct costs of extra work in conformance with Section 4-1.03D, "Extra Work," of the Standard Specifications.
- D. Direct costs of work not required by the contract and performed for others.
- E. Direct costs of work performed under a notice of potential claim in conformance with the provisions in Section 9-1.04, "Notice of Potential Claim," of the Standard Specifications.
- F. Indirect costs of overhead.

Cost accounting records shall include the information specified for daily extra work reports in Section 9-1.03C, "Records," of the Standard Specifications. The requirements for furnishing the Engineer completed daily extra work reports shall only apply to work paid for on a force account basis.

The cost accounting records for the contract shall be maintained separately from other contracts, during the life of the contract, and for a period of not less than 3 years after the date of acceptance of the contract. If the Contractor intends to file

claims against the Department, the Contractor shall keep the cost accounting records specified above until complete resolution of all claims has been reached.

5-1.104 INTERNET DAILY EXTRA WORK REPORT

When extra work is being paid for on a force account basis, the Contractor shall submit daily extra work reports in conformance with the provisions in Section 9-1.03C, "Records," of the Standard Specifications and these special provisions.

The Contractor shall send daily extra work reports to the Engineer using the Department's Internet extra work billing system. The reports shall conform to the requirements in the "iCAS User's Guide" (Guide). The Guide is available from the Department, and is also found on the Internet at:

http://www.dot.ca.gov/hq/construc/ewb/EWB_INSTRUCTION.pdf

The Department will provide system accounts to the Contractor's authorized representatives when at least one of the representatives has received training. The Department will provide system training to at least one of the Contractor's authorized representatives within 30 days of the Contractor's request for training. The Department will assign an account and user identification to the Contractor's authorized representatives, and each Contractor's authorized representative shall maintain a unique password. A daily extra work report that the Contractor's authorized representative sends to the Department using the Internet extra work billing system will be considered signed by the Contractor. A daily extra work report that the Engineer approves using the Internet extra work billing system will be considered signed by the Engineer.

Daily extra work reports that include billing for materials shall be substantiated by a valid copy of a vendor's invoice in conformance to the requirements in Section 9-1.03C, "Records," of the Standard Specifications. Each materials invoice shall clearly identify the relative daily extra work report and the associated cost of the materials. In addition to postal service and parcel service and if approved by the Engineer, invoices may be sent by facsimile or as an electronic-mail attachment.

The Contractor shall maintain the Contractor's interface with the Department's Internet extra work billing system. If the Contractor is using the file transfer process to submit extra work reports, it shall conform to the file transfer format and process defined in the Guide.

5-1.11 PARTNERING

The State will promote the formation of a "Partnering" relationship with the Contractor in order to effectively complete the contract to the benefit of both parties. The purpose of this relationship is to maintain a cooperative communication and to mutually resolve conflicts at the lowest responsible management level.

The Contractor may request the formation of a "Partnering" relationship by submitting a request in writing to the Engineer after approval of the contract. If the Contractor's request for "Partnering" is approved by the Engineer, scheduling of a "Partnering Workshop," selecting the "Partnering" facilitator and workshop site, and other administrative details shall be as agreed to by both parties. If agreed to by the parties, additional "Partnering Workshops" will be conducted as needed throughout the life of the contract.

A one-day "Training in Partnering Concepts" session will be conducted regardless of whether the Contractor requests the formation of a "Partnering" relationship. The "Training in Partnering Concepts" session will be conducted locally for the Contractor's and the Engineer's project representatives. The Contractor shall be represented by a minimum of 2 representatives, one being the Contractor's authorized representative pursuant to Section 5-1.06, "Superintendence," of the Standard Specifications. Scheduling of the "Training in Partnering Concepts" session and selection of the trainer and training site shall be determined cooperatively by the Contractor and the Engineer. If, upon the Contractor's request, "Partnering" is approved by the Engineer, the "Training in Partnering Concepts" session shall be conducted prior to the initial "Partnering Workshop."

The costs involved in providing the "Training in Partnering Concepts" trainer and training site will be borne entirely by the State. The costs will be determined in conformance with the provisions in Section 9-1.03B, "Work Performed by Special Forces or Other Special Services," of the Standard Specifications, and paying to the Contractor the sum of that cost, except no markups will be allowed.

The costs involved in providing the "Partnering Workshop" facilitator and workshop site will be borne equally by the State and the Contractor. The division of cost will be made by determining the cost in providing the "Partnering Workshop" facilitator and workshop site in conformance with the provisions in Section 9-1.03B, "Work Performed by Special Forces or Other Special Services," of the Standard Specifications, and paying to the Contractor one-half of that cost, except no markups will be allowed.

All other costs associated with "Training in Partnering Concepts" and "Partnering Workshops" will be borne separately by the party incurring the costs, such as wages and travel expenses, and no additional compensation will be allowed therefor.

The establishment of a "Partnering" relationship will not change or modify the terms and conditions of the contract and will not relieve either party of the legal requirements of the contract.

5-1.114 VALUE ANALYSIS

The Contractor may submit to the Engineer, in writing, a request for a "Value Analysis" workshop. The purpose for having a workshop is to identify value enhancing opportunities and to consider modifications to the plans and specifications that will reduce either the total cost, time of construction or traffic congestion, without impairing, in any manner, the essential functions or characteristics of the project including, but not limited to, service life, economy of operation, ease of maintenance, benefits to the travelling public, desired appearance, or design and safety standards.

To maximize the potential benefits of a workshop, the request should be submitted to the Engineer early in the project after approval of the contract. If the Contractor's request for a "Value Analysis" workshop is approved by the Engineer, scheduling of a workshop, selecting the facilitator and workshop site, and other administrative details shall be determined cooperatively by the Contractor and the Engineer.

The workshop shall be conducted in conformance with the methodology described in the Department's "Value Analysis Team Guide" available at the Department's web site at:

<http://www.dot.ca.gov/hq/oppd/value/>

The facilitator shall be a Certified Value Specialist (CVS) as recognized by the Society of American Value Engineers (SAVE) International, which may be contacted as follows:

SAVE International, 60 Revere Drive, Northbrook, IL 60062
Telephone 1-847-480-1730, FAX 1-847-480-9282

The Contractor may submit recommendations resulting from a "Value Analysis" workshop for approval by the Engineer as cost reduction incentive proposals in conformance with the provisions in Section 5-1.14, "Cost Reduction Incentive," of the Standard Specifications.

The costs involved in providing the "Value Analysis" facilitator and workshop site will be borne equally by the State and the Contractor. The division of cost will be made by determining the cost in providing the "Value Analysis" facilitator and workshop site in conformance with the provisions in Section 9-1.03B, "Work Performed by Special Forces or Other Special Services," of the Standard Specifications, and paying to the Contractor one-half of that cost, except no markups will be allowed.

All other costs associated with the "Value Analysis" workshop will be borne separately by the party incurring the costs, such as wages and travel expenses, and no additional compensation will be allowed therefor.

5-1.12 DISPUTE REVIEW BOARD

GENERAL

To assist in the resolution of disputes or potential claims arising out of the work of this project, a Dispute Review Board, hereinafter referred to as the "DRB," shall be established by the Engineer and Contractor cooperatively upon approval of the contract. The DRB is intended to assist the contract administrative claims resolution process as specified in the provisions in Section 9-1.04, "Notice of Potential Claim," and Section 9-1.07B, "Final Payment and Claims," of the Standard Specifications and these special provisions. The DRB shall not serve as a substitute for provisions in the specifications in regard to filing potential claims. The requirements and procedures established in this section shall be a prerequisite to filing a claim, filing for arbitration, or filing for litigation prior or subsequent to project completion.

The DRB shall be utilized when dispute or potential claim resolution at the project level is unsuccessful. The DRB shall function as specified herein until the day of acceptance of the contract, at which time the work of the DRB will cease except for completion of unfinished reports. No DRB dispute meetings shall take place later than 30 days prior to acceptance of contract. After acceptance of contract, disputes or potential claims which have followed the dispute resolution processes of the Standard Specifications and these special provisions, but have not been resolved, shall be stated or restated by the Contractor, in response to the Proposed Final Estimate within the time limits provided in Section 9-1.07B, "Final Payment and Claims," of the Standard Specifications. The State will review those claims in conformance with the provisions in Section 9-1.07B of the Standard Specifications. Following the adherence to and completion of the contractual administrative claims procedure, the Contractor may file for arbitration in conformance with the provisions in Section 9-1.10, "Arbitration," of the Standard Specifications and these special provisions.

Disputes, as used in this section, shall include differences of opinion, properly noticed as provided hereinafter, between the State and Contractor on matters related to the work and other subjects considered by the State or Contractor, or by both, to be of concern to the DRB on this project, except matters relating to Contractor, subcontractor or supplier potential claims not actionable against the Department as specified in these special provisions or quantification of disputes for overhead type expenses or costs. Disputes for overhead type expenses or costs shall conform to the requirements of Section 9-1.07B, "Final Payment and Claims," of the Standard Specifications. Whenever the term "dispute" or "disputes" is used herein, it shall be deemed to include potential claims as well as disputes.

The DRB shall serve as an advisory body to assist in the resolution of disputes between the State and the Contractor, hereinafter referred to as the "parties." The DRB shall consider disputes referred to it, and furnish written reports containing findings and recommendations pertaining to those disputes, to the parties to aid in resolution of the differences between them. DRB findings and recommendations are not binding on the parties.

SELECTION PROCESS, DISCLOSURE AND APPOINTMENTS

The DRB shall consist of one member selected by the State and approved by the Contractor, one member selected by the Contractor and approved by the State, and a third member selected by the first 2 members and approved by both the State and the Contractor. The third member shall act as the DRB Chairperson.

DRB members shall be especially knowledgeable in the type of construction and contract documents potentially anticipated by the contract. DRB members shall discharge their responsibilities impartially as an independent body, considering the facts and circumstances related to the matters under consideration, pertinent provisions of the contract and applicable laws and regulations.

The State and the Contractor shall nominate and approve DRB members in conformance with the terms and conditions of the Dispute Review Board Agreement and these special provisions, within 45 days of the approval of the contract. Each party shall provide written notification to the other of the name of their selected DRB nominee along with the prospective member's complete written disclosure statement.

Disclosure statements shall include a resume of the prospective member's experience and a declaration statement describing past, present, anticipated, and planned relationships, including indirect relationships through the prospective member's primary or full-time employer, to this project and with the parties involved in this construction contract, including but not limited to, relevant subcontractors or suppliers to the parties, parties' principals, or parties' counsel. DRB members shall also include a full disclosure of close professional or personal relationships with all key members of the contract. Objections to nominees must be based on a specific breach or violation of nominee responsibilities or on nominee qualifications under these provisions unless otherwise specified. The Contractor or the State may, on a one-time basis, object to the other's nominee without specifying a reason and this person will not be selected for the DRB. Another person shall then be nominated within 15 days.

The first duty of the State and Contractor selected members of the DRB shall be to select and recommend a prospective third DRB member to the parties for final selection and approval. The first 2 DRB members shall proceed with the selection of the third DRB member immediately upon receiving written notification from the State of their selection, and shall provide their recommendation simultaneously to the parties within 15 days of the notification.

The first 2 DRB members shall select a third DRB member subject to mutual approval of the parties or may mutually concur on a list of potentially acceptable third DRB members and submit the list to the parties for final selection and approval of the third member. The goal in the selection of the third member is to complement the professional experience of the first 2 members and to provide leadership for the DRB's activities.

The third prospective DRB member shall supply a full disclosure statement to the first 2 DRB members and to the parties prior to appointment.

An impasse shall be considered to have been reached if the parties are unable to approve a third member within 15 days of receipt of the recommendation of the first 2 DRB members, or if the first 2 DRB members are unable to agree upon a recommendation within their 15 day time limit. In the event of an impasse in selection of third DRB member the State and the Contractor shall each propose 3 candidates for the third DRB member position. The parties shall select the candidates proposed under this paragraph from the current list of arbitrators certified by the Public Works Contract Arbitration Committee created by Article 7.2 (commencing with Section 10245) of the State Contract Act. The first 2 DRB members shall then select one of the 6 proposed candidates in a blind draw.

No DRB member shall have prior direct involvement in this contract. No member shall have a financial interest in this contract or the parties thereto, within a period of 6 months prior to award of this contract or during the contract, except as follows:

- A. Compensation for services on this DRB.
- B. Ownership interest in a party or parties, documented by the prospective DRB member, that has been reviewed and determined in writing by the State to be sufficiently insignificant to render the prospective member acceptable to the State.
- C. Service as a member of other Dispute Review Boards on other contracts.
- D. Retirement payments or pensions received from a party that are not tied to, dependent on or affected by the net worth of the party.
- E. The above provisions apply to parties having a financial interest in this contract, including but not limited to contractors, subcontractors, suppliers, consultants, and legal and business services.

The Contractor or the State may reject any of the three DRB members who fail to fully comply at all times with all required employment and financial disclosure conditions of DRB membership as described in the Dispute Review Board Agreement and as specified herein. A copy of the Dispute Review Board Agreement is included in this section.

The Contractor, the State, and the 3 members of the DRB shall complete and adhere to the Dispute Review Board Agreement in administration of this DRB within 15 days of the parties' concurrence in the selection of the third member. No DRB meeting shall take place until the Dispute Review Board Agreement has been signed by all parties. The State authorizes the Engineer to execute and administer the terms of the Agreement. The person(s) designated by the Contractor as authorized to execute contract change orders shall be authorized to execute and administer the terms of this agreement, or to delegate the authority in writing. The operation of the DRB shall be in conformance with the terms of the Dispute Review Board Agreement.

COMPENSATION

The State and the Contractor shall bear the costs and expenses of the DRB equally. Each DRB member shall be compensated at an agreed rate of \$1,200 per day if time spent per meeting, including on-site time plus one hour of travel time, is greater than 4 hours. Each DRB member shall be compensated at an agreed rate of \$700 per day if time spent per meeting, including on-site time plus one hour of travel time, is less than or equal to 4 hours. The agreed rates shall be considered full compensation for on-site time, travel expenses, transportation, lodging, time for travel and incidentals for each day, or portion thereof, that the DRB member is at an authorized DRB meeting. No additional compensation will be made for time spent by DRB members in review and research activities outside the official DRB meetings unless that time, (such as time spent evaluating and preparing recommendations on specific issues presented to the DRB), has been specifically agreed to in advance by the State and Contractor. Time away from the project, which has been specifically agreed to in advance by the parties, will be compensated at an agreed rate of \$125 per hour. The agreed amount of \$125 per hour shall include all incidentals including expenses for telephone, fax, and computer services. Members serving on more than one DRB involving the Department, regardless of the number of meetings per day, shall not be paid more than the all inclusive rate per day or rate per hour for an individual project. The State will provide, at no cost to the Contractor, administrative services such as conference facilities and secretarial services to the DRB. These special provisions and the Dispute Review Board Agreement state the provisions for compensation and expenses of the DRB. DRB members shall be compensated at the same daily and hourly rate. The Contractor shall make direct payments to each DRB member for their participation in authorized meetings and approved hourly rate charges from invoices submitted by each DRB member. The State will reimburse the Contractor for the State's share of the costs. There will be no markups applied to expenses connected with the DRB, either by the DRB members or by the Contractor when requesting payment of the State's share of DRB expenses. Regardless of the DRB recommendation, neither party shall be entitled to reimbursement of DRB costs from the other party.

REPLACEMENT OF DRB MEMBERS

Service of a DRB member may be terminated at any time with not less than 15 days notice as follows:

- A. The State may terminate service of the State appointed member.
- B. The Contractor may terminate service of the Contractor appointed member.
- C. Upon the written recommendation of the State and Contractor appointed members for the removal of the third member.
- D. Upon resignation of a member.
- E. The State or Contractor may terminate the service of any member who fails to fully comply with all required employment and financial disclosure conditions of DRB membership

When a member of the DRB is replaced, the replacement member shall be appointed in the same manner as the replaced member was appointed. The appointment of a replacement DRB member will begin promptly upon determination of the need for replacement and shall be completed within 15 days. Changes in either of the DRB members chosen by the two parties will not require re-selection of the third member, unless both parties agree to such re-selection in writing. The Dispute Review Board Agreement shall be amended to reflect the change of a DRB member.

OPERATION

The following procedure shall be used for dispute resolution:

- A. If the Contractor objects to any decision, act or order of the Engineer, the Contractor shall give written notice of potential claim in conformance with the provisions in Section 9-1.04, "Notice of Potential Claim," of the Standard Specifications and these special provisions, including the provision of applicable cost documentation; or file written protests or notices in conformance with the provisions in the Standard Specifications and these special provisions.

- B. The Engineer will respond, in writing, to the Contractor's written supplemental notice of potential claim within 20 days of receipt of the notice.
- C. Within 15 days after receipt of the Engineer's written response, the Contractor shall, if the Contractor still objects, file a written reply with the Engineer, stating clearly and in detail the basis of the objection.
- D. Following an objection to the Engineer's written response, the Contractor shall refer the dispute to the DRB if the Contractor wishes to further pursue the objection to the Engineer's decision. The Contractor shall make the referral in writing to the DRB, simultaneously copied to the State, within 21 days after receipt of the written response from the Engineer. The written dispute referral shall describe the disputed matter in individual discrete segments so that it will be clear to both parties and the DRB what discrete elements of the dispute have been resolved, and which remain unresolved, and shall include an estimate of the cost of the affected work and impacts, if any, on project completion.
- E. By failing to submit the written notice of referral to the DRB, within 21 days after receipt of the Engineer's written response to the supplemental notice of potential claim, the Contractor waives future claims and arbitration on the matter in contention.
- F. The Contractor and the State shall each be afforded an opportunity to be present and to be heard by the DRB, and to offer evidence. Either party furnishing written evidence or documentation to the DRB must furnish copies of such information to the other party a minimum of 15 days prior to the date the DRB is scheduled to convene the meeting for the dispute. Either party shall produce such additional evidence as the DRB may deem necessary to reach an understanding and a determination of the dispute. The party furnishing additional evidence shall furnish copies of such additional evidence to the other party at the same time the evidence is provided to the DRB. The DRB shall not consider evidence not furnished in conformance with the terms specified herein.
- G. Upon receipt by the DRB of a written referral of a dispute, the DRB shall convene to review and consider the dispute. The dispute meeting shall be held no earlier than 30 days and no later than 60 days after receipt of the written referral unless otherwise agreed to by all parties. The DRB shall determine the time and location of the DRB dispute meeting, with due consideration for the needs and preferences of the parties while recognizing the paramount importance of a timely hearing of the dispute.
- H. There shall be no participation of either party's attorneys at DRB dispute meetings.
- I. There shall be no participation of persons who are not directly involved in the contract or who do not have direct knowledge of the dispute, including but not limited to consultants, except for expert testimony allowed at the discretion of the DRB and with approval prior to the dispute meeting by both parties.
- J. The DRB shall furnish a report, containing findings and recommendations as described in the Dispute Review Board Agreement, in writing to both the State and the Contractor. The DRB may request clarifying information of either party within 10 days after the DRB dispute meeting. Requested information shall be submitted to the DRB within 10 days of the DRB request. The DRB shall complete its report, including minority opinion, if any, and submit it to the parties within 30 days of the DRB dispute meeting, except that time extensions may be granted at the request of the DRB with the written concurrence of both parties. The report shall include the facts and circumstances related to the matters under consideration, pertinent provisions of the contract, applicable laws and regulations, and actual costs and time incurred as shown on the Contractor's cost accounting records. The DRB shall make recommendations on the merit of the dispute and, if appropriate, recommend guidelines for determining compensation.
- K. Within 30 days after receiving the DRB's report, both the State and the Contractor shall respond to the DRB in writing signifying that the dispute is either resolved or remains unresolved. Failure to provide the written response within the time specified, or a written rejection of the DRB's recommendation or response to a request for reconsideration presented in the report by either party, shall conclusively indicate that the party(s) failing to respond accepts the DRB recommendation. Immediately after responses have been received from both parties, the DRB shall provide copies of both responses to the parties simultaneously. Either party may request clarification of elements of the DRB's report from the DRB prior to responding to the report. The DRB shall consider any clarification request only if submitted within 10 days of receipt of the DRB's report, and if submitted simultaneously in writing to both the DRB and the other party. Each party may submit only one request for clarification for any individual DRB report. The DRB shall respond, in writing, to requests for clarification within 10 days of receipt of such requests.
- L. The DRB's recommendations, stated in the DRB's reports, are not binding on either party. Either party may seek a reconsideration of a recommendation of the DRB. The DRB shall only grant a reconsideration based upon submission of new evidence and if the request is submitted within the 30-day time limit specified for response to the DRB's written report. Each party may submit only one request for reconsideration regarding an individual DRB recommendation.
- M. If the State and the Contractor are able to resolve their dispute with the aid of the DRB's report, the State and Contractor shall promptly accept and implement the recommendations of the DRB. If the parties cannot agree on

compensation within 60 days of the acceptance by both parties of the DRB's recommendation, either party may request the DRB to make a recommendation regarding compensation.

- N. The State or the Contractor shall not call DRB members who served on the DRB for this contract as witnesses in arbitration proceedings which may arise from this contract, and all documents created by the DRB shall be inadmissible as evidence in subsequent arbitration proceedings, except the DRB's final written reports on each issue brought before it.
- O. The State and Contractor shall jointly indemnify and hold harmless the DRB members from and against all claims, damages, losses, and expenses, including but not limited to attorney's fees, arising out of and resulting from the findings and recommendations of the DRB.
- P. The DRB members shall have no claim against the State or the Contractor, or both, from claimed harm arising out of the parties' evaluations of the DRB's report.

DISPUTES INVOLVING SUBCONTRACTOR POTENTIAL CLAIMS

For purposes of this section, a "subcontractor potential claim" shall include any potential claim by a subcontractor (including also any pass through potential claims by a lower tier subcontractor or supplier) against the Contractor that is actionable by the Contractor against the Department which arises from the work, services, or materials provided or to be provided in connection with the contract. If the Contractor determines to pursue a dispute against the Department that includes a subcontractor potential claim, the dispute shall be processed and resolved in conformance with these special provisions and in conformance with the following:

- A. The Contractor shall identify clearly in submissions pursuant to this section, that portion of the dispute that involves a subcontractor potential claim or potential claims.
- B. The Contractor shall include, as part of its submission pursuant to Step D above, a certification (False Claims Act Certification) by the subcontractor's or supplier's officer, partner, or authorized representative with authority to bind the subcontractor and with direct knowledge of the facts underlying the subcontractor potential claim. The Contractor shall submit a certification that the subcontractor potential claim is acknowledged and forwarded by the Contractor. The form for these certifications is available from the Engineer.
- C. At DRB dispute meetings involving one or more subcontractor potential claims, the Contractor shall require that each subcontractor involved in the dispute have present an authorized representative with actual knowledge of the facts underlying the subcontractor potential claim to assist in presenting the subcontractor potential claim and to answer questions raised by the DRB members or the Department's representatives.
- D. Failure by the Contractor to declare a subcontractor potential claim on behalf of its subcontractor (including lower tier subcontractors' and suppliers' pass through potential claims) at the time of submission of the Contractor's potential claims, as provided hereunder, shall constitute a release of the State by the Contractor of such subcontractor potential claim.
- E. The Contractor shall include in all subcontracts under this contract that subcontractors and suppliers of any tier (a) agree to submit subcontractor potential claims to the Contractor in a proper form and in sufficient time to allow processing by the Contractor in conformance with the Dispute Review Board resolution specifications; (b) agree to be bound by the terms of the Dispute Review Board provisions to the extent applicable to subcontractor potential claims; (c) agree that, to the extent a subcontractor potential claim is involved, completion of all steps required under these Dispute Review Board special provisions shall be a condition precedent to pursuit by the subcontractor of other remedies permitted by law, including without limitation of a lawsuit against the Contractor; and (d) agree that the existence of a dispute resolution process for disputes involving subcontractor potential claims shall not be deemed to create any claim, right, or cause of action by any subcontractor or supplier against the Department.

Notwithstanding the foregoing, this Dispute Review Board special provision shall not apply to, and the DRB shall not have the authority to consider, subcontractor potential claims between the subcontractor(s) or supplier(s) and the Contractor that are not actionable by the Contractor against the Department.

RETENTION

Failure of the Contractor to nominate and approve DRB members in conformance with the terms and conditions of the Dispute Review Board Agreement and these special provisions shall result in the retention of 25 percent of the estimated value of all work performed during each estimate period in which the Contractor fails to comply with the requirements of this section as determined by the Engineer. DRB retentions will be released for payment on the next monthly estimate for partial payment following the date that the Contractor has nominated and approved DRB members and no interest will be due the Contractor.

DISPUTE REVIEW BOARD AGREEMENT

A copy of the "Dispute Review Board Agreement" to be executed by the Contractor, State and the 3 DRB members after approval of the contract follows:

Form 6202 Rev (09/01/02)

DISPUTE REVIEW BOARD AGREEMENT

(Contract Identification)

Contract No. _____

THIS DISPUTE REVIEW BOARD AGREEMENT, hereinafter called "AGREEMENT", made and entered into this _____ day of _____, _____, between the State of California, acting through the California Department of Transportation and the Director of Transportation, hereinafter called the "STATE," _____ hereinafter called the "CONTRACTOR," and the Dispute Review Board, hereinafter called the "DRB" consisting of the following members:

_____,
(Contractor Appointee)

_____,
(State Appointee)

and _____
(Third Person)

WITNESSETH, that

WHEREAS, the STATE and the CONTRACTOR, hereinafter called the "parties," are now engaged in the construction on the State Highway project referenced above; and

WHEREAS, the special provisions for the above referenced contract provides for the establishment and operation of the DRB to assist in resolving disputes; and

WHEREAS, the DRB is composed of three members, one selected by the STATE, one selected by the CONTRACTOR, and the third member selected by the other two members and approved by the parties;

NOW THEREFORE, in consideration of the terms, conditions, covenants, and performance contained herein, or attached and incorporated and made a part hereof, the STATE, the CONTRACTOR, and the DRB members hereto agree as follows:

SECTION I DESCRIPTION OF WORK

To assist in the resolution of disputes between the parties, the contract provides for the establishment and the operation of the DRB. The intent of the DRB is to fairly and impartially consider disputes placed before it and provide written recommendations for resolution of these disputes to both parties. The members of this DRB shall perform the services necessary to participate in the DRB's actions as designated in Section II, Scope of Work.

SECTION II SCOPE OF WORK

The scope of work of the DRB includes, but is not limited to, the following:

A. OBJECTIVE

The principal objective of the DRB is to assist in the timely resolution of disputes between the parties arising from performance of this contract. It is not intended for either party to default on their normal responsibility to amicably and fairly settle their differences by indiscriminately assigning them to the DRB. It is intended that the mere existence of the DRB will encourage the parties to resolve disputes without resorting to this review procedure. But when a dispute that is serious enough to warrant the DRB's review does develop, the process for prompt and efficient action will be in place.

B. PROCEDURES

The DRB shall render written reports on disputes between the parties arising from the construction contract. Prior to consideration of a dispute, the DRB shall establish rules and regulations that will govern the conduct of its business and reporting procedures in conformance with the requirements of the contract and the terms of this AGREEMENT. DRB recommendations, resulting from its consideration of a dispute, shall be furnished in writing to both parties. The recommendations shall be based on facts and circumstances involved in the dispute, pertinent contract provisions, applicable laws and regulations. The recommendations shall find one responsible party in a dispute; shared or "jury" determinations shall not be rendered. The DRB shall make recommendations on the merit of the dispute, and if appropriate, recommend guidelines for determining compensation. If the parties cannot agree on compensation within 60 days of the acceptance by both parties of the DRB's recommendation, either party may request the DRB to make a recommendation regarding compensation.

The DRB shall refrain from officially giving advice or consulting services to anyone involved in the contract. The individual members shall act in a completely independent manner and while serving as members of the DRB shall have no consulting business connections with either party or its principals or attorneys or other affiliates (subcontractors, suppliers, etc.) who have a beneficial interest in the contract.

During scheduled meetings of the DRB as well as during dispute meetings, DRB members shall refrain from expressing opinions on the merits of statements on matters under dispute or potential dispute. Opinions of DRB members expressed in private sessions shall be kept strictly confidential. Individual DRB members shall not meet with, or discuss contract issues with individual parties, except as directed by the DRB Chairperson. Such discussions or meetings shall be disclosed to both parties. Other discussions regarding the project between the DRB members and the parties shall be in the presence of all three members and both parties. Individual DRB members shall not undertake independent investigations of any kind pertaining to disputes or potential disputes, except with the knowledge of both parties and as expressly directed by the DRB Chairperson.

C. CONSTRUCTION SITE VISITS, PROGRESS MEETINGS AND FIELD INSPECTIONS

The DRB members shall visit the project site and meet with representatives of the parties to keep abreast of construction activities and to develop familiarity with the work in progress. Scheduled progress meetings shall be held at or near the project site. The DRB shall meet at least once at the start of the project, and at least once every 4 months thereafter. The frequency, exact time, and duration of additional site visits and progress meetings shall be as recommended by the DRB and approved by the parties consistent with the construction activities or matters under consideration and dispute. Each meeting shall consist of a round table discussion and a field inspection of the work being performed on the contract, if necessary. Each meeting shall be attended by representatives of both parties. The agenda shall generally be as follows:

1. Meeting opened by the DRB Chairperson.
2. Remarks by the STATE's representative.
3. A description by the CONTRACTOR's representative of work accomplished since the last meeting; the current schedule status of the work; and a forecast for the coming period.
4. An outline by the CONTRACTOR's representative of potential problems and a description of proposed solutions.
5. An outline by the STATE's representative of the status of the work as the STATE views it.
6. A brief description by the CONTRACTOR's or STATE's representative of potential claims or disputes which have surfaced since the last meeting.
7. A summary by the STATE's representative, the CONTRACTOR's representative, or the DRB of the status of past disputes and potential claims.

The STATE's representative will prepare minutes of all progress meetings and circulate them for revision and approval by all concerned within 10 days of the meeting.

The field inspection shall cover all active segments of the work, the DRB being accompanied by both parties' representatives. The field inspection may be waived upon mutual agreement of the parties.

D. DRB CONSIDERATION AND HANDLING OF DISPUTES

Upon receipt by the DRB of a written referral of a dispute, the DRB shall convene to review and consider the dispute. The dispute meeting shall be held no earlier than 30 days and no later than 60 days after receipt of the written referral, unless otherwise agreed to by all parties. The DRB shall determine the time and location of DRB dispute meetings, with due consideration for the needs and preferences of the parties while recognizing the paramount importance of speedy resolution of issues. No dispute meetings shall take place later than 30 days prior to acceptance of contract.

Normally, dispute meetings shall be conducted at or near the project site. However, any location that would be more convenient and still provide required facilities and access to necessary documentation shall be satisfactory.

Both parties shall be given the opportunity to present their evidence at these dispute meetings. It is expressly understood that the DRB members are to act impartially and independently in the consideration of the contract provisions, applicable

laws and regulations, and the facts and conditions surrounding any dispute presented by either party, and that the recommendations concerning any such dispute are advisory and nonbinding on the parties.

The DRB may request that written documentation and arguments from both parties be sent to each DRB member, through the DRB Chairperson, for review before the dispute meeting begins. A party furnishing written documentation to the DRB shall furnish copies of such information to the other party at the same time that such information is supplied to the DRB.

DRB dispute meetings shall be informal. There shall be no testimony under oath or cross-examination. There shall be no reporting of the procedures by a shorthand reporter or by electronic means. Documents and verbal statements shall be received by the DRB in conformance with acceptance standards established by the DRB. These standards need not comply with prescribed legal laws of evidence.

The third DRB member shall act as Chairperson for dispute meetings and all other DRB activities. The parties shall have a representative at all dispute meetings. Failure to attend a duly noticed dispute meeting by either of the parties shall be conclusively considered by the DRB as indication that the non-attending party considers written submittals as their entire and complete argument. The claimant shall discuss the dispute, followed by the other party. Each party shall then be allowed one or more rebuttals until all aspects of the dispute are thoroughly covered. DRB members shall ask questions, seek clarification, and request further data from either of the parties as may be necessary to assist in making a fully informed recommendation. The DRB may request from either party documents or information that would assist the DRB in making its findings and recommendations including, but not limited to, documents used by the CONTRACTOR in preparing the bid for the project. A refusal by a party to provide information requested by the DRB may be considered by the DRB as an indication that the requested material would tend to disprove that party's position. In large or complex cases, additional dispute meetings may be necessary in order to consider all the evidence presented by both parties. All involved parties shall maintain the confidentiality of all documents and information, as provided in this AGREEMENT.

During dispute meetings, no DRB member shall express an opinion concerning the merit of any facet of the case. DRB deliberations shall be conducted in private, with interim individual views kept strictly confidential.

After dispute meetings are concluded, the DRB shall meet in private and reach a conclusion supported by 2 or more members. Private sessions of the DRB may be held at a location other than the job site or by electronic conferencing as deemed appropriate, in order to expedite the process.

The DRB's findings and recommendations, along with discussion of reasons therefor, shall then be submitted as a written report to both parties. Recommendations shall be based on the pertinent contract provisions, applicable laws and regulations, and facts and circumstances related to the dispute. The report shall be thorough in discussing the facts considered, the contract language, law or regulation viewed by the DRB as pertinent to the issues, and the DRB's interpretation and philosophy in arriving at its conclusions and recommendations. The DRB's report shall stand on its own, without attachments or appendices. The DRB Chairperson shall furnish a copy of the written recommendation report to the DRB Coordinator, Division of Construction, MS 44, P.O. Box 942874, Sacramento, CA 94274.

With prior written approval of both parties, the DRB may obtain technical services necessary to adequately review the disputes presented, including audit, geotechnical, schedule analysis and other services. The parties' technical staff may supply those services as appropriate. The cost of technical services, as agreed to by the parties, shall be borne equally by the 2 parties as specified in an approved contract change order. The CONTRACTOR will not be entitled to markups for the payments made for these services.

The DRB shall resist submittal of incremental portions of information by either party, in the interest of making a fully informed decision and recommendation.

The DRB shall make every effort to reach a unanimous decision. If this proves impossible, the dissenting member shall prepare a minority opinion, which shall be included in the DRB's report.

Although both parties should place weight upon the DRB's recommendations, they are not binding. Either party may appeal a recommendation to the DRB for reconsideration. However, reconsideration shall only be allowed when there is new evidence to present, and the DRB shall accept only one appeal from each party pertaining to an individual DRB recommendation. The DRB shall hear appeals in conformance with the terms described in the Section entitled "Dispute Review Board" in the special provisions.

E. DRB MEMBER REPLACEMENT

Should the need arise to appoint a replacement DRB member, the replacement DRB member shall be appointed in the same manner as the original DRB members were appointed. The selection of a replacement DRB member shall begin promptly upon notification of the necessity for a replacement and shall be completed within 15 days. This AGREEMENT shall be amended to indicate change in DRB membership.

SECTION III CONTRACTOR RESPONSIBILITIES

The CONTRACTOR shall furnish to each DRB member one copy of pertinent documents that are or may become necessary for the DRB to perform their function. Pertinent documents are written notices of potential claim, responses to those notices, drawings or sketches, calculations, procedures, schedules, estimates, or other documents which are used in the

performance of the work or in justifying or substantiating the CONTRACTOR's position. The CONTRACTOR shall also furnish a copy of such pertinent documents to the STATE, in conformance with the terms outlined in the special provisions.

SECTION IV STATE RESPONSIBILITIES

The STATE will furnish the following services and items:

A. CONTRACT RELATED DOCUMENTS

The STATE will furnish to each DRB member one copy of Notice to Contractors and Special Provisions, Proposal and Contract, Plans, Standard Specifications, and Standard Plans, change orders, written instructions issued by the STATE to the CONTRACTOR, or other documents pertinent to any dispute that has been referred to the DRB and necessary for the DRB to perform its function.

B. COORDINATION AND SERVICES

The STATE, through the Engineer, will, in cooperation with the CONTRACTOR, coordinate the operations of the DRB. The Engineer will arrange or provide conference facilities at or near the project site and provide secretarial and copying services to the DRB without charge to the CONTRACTOR.

SECTION V TIME FOR BEGINNING AND COMPLETION

Once established, the DRB shall be in operation until the day of acceptance of the contract. The DRB members shall not begin work under the terms of this AGREEMENT until authorized in writing by the STATE.

SECTION VI PAYMENT

A. ALL INCLUSIVE RATE PAYMENT

The STATE and the CONTRACTOR shall bear the costs and expenses of the DRB equally. Each DRB member shall be compensated at an agreed rate of \$1,200 per day if time spent per meeting, including on-site time plus one hour of travel time, is greater than 4 hours. Each DRB member shall be compensated at an agreed rate of \$700 per day if time spent per meeting, including on-site time plus one hour of travel time, is less than or equal to 4 hours. The agreed rates shall be considered full compensation for on-site time, travel expenses, transportation, lodging, time for travel and incidentals for each day, or portion thereof, that the DRB member is at an authorized DRB meeting. No additional compensation will be made for time spent by DRB members in review and research activities outside the official DRB meetings unless that time has been specifically agreed to in advance by the STATE and CONTRACTOR. Time away from the project that has been specifically agreed to in advance by the parties will be compensated at an agreed rate of \$125 per hour. The agreed amount of \$125 per hour shall include all incidentals including expenses for telephone, fax, and computer services. Members serving on more than one DRB involving the State, regardless of the number of meetings per day, shall not be paid more than the all inclusive rate per day or rate per hour for an individual project. The STATE will provide, at no cost to the CONTRACTOR, administrative services such as conference facilities and secretarial services to the DRB.

B. PAYMENTS

DRB members shall be compensated at the same rate. The CONTRACTOR shall make direct payments to each DRB member for their participation in authorized meetings and approved hourly rate charges from invoices submitted by each DRB member. The STATE will reimburse the CONTRACTOR for its share of the costs of the DRB.

The DRB members may submit invoices to the CONTRACTOR for partial payment for work performed and services rendered for their participation in authorized meetings not more often than once per month during the progress of the work. The invoices shall be in a format approved by the parties and accompanied by a general description of activities performed during that billing period. Payment for hourly fees, at the agreed rate, shall not be paid to a DRB member until the amount and extent of those fees are approved by the STATE and CONTRACTOR.

Invoices shall be accompanied by original supporting documents, which the CONTRACTOR shall include with the extra work billing when submitting for reimbursement of the STATE's share of cost from the STATE. The CONTRACTOR will be reimbursed for one-half of approved costs of the DRB. No markups will be added to the CONTRACTOR's payment.

C. INSPECTION OF COSTS RECORDS

The DRB members and the CONTRACTOR shall keep available for inspection by representatives of the STATE and the United States, for a period of 3 years after final payment, the cost records and accounts pertaining to this AGREEMENT. If any litigation, claim, or audit arising out of, in connection with, or related to this contract is initiated before the expiration of the 3-year period, the cost records and accounts shall be retained until such litigation, claim, or audit involving the records is completed.

SECTION VII ASSIGNMENT OF TASKS OF WORK

The DRB members shall not assign the work of this AGREEMENT.

SECTION VIII TERMINATION OF DRB MEMBERS

DRB members may resign from the DRB by providing not less than 15 days written notice of the resignation to the STATE and CONTRACTOR. DRB members may be terminated by their original appointing power or by either party, for failing to fully comply at all times with all required employment and financial disclosure conditions of DRB membership in conformance with the terms of the contract.

SECTION IX LEGAL RELATIONS

The parties hereto mutually understand and agree that the DRB member in the performance of duties on the DRB, is acting in the capacity of an independent agent and not as an employee of either party.

No party to this AGREEMENT shall bear a greater responsibility for damages or personal injury than is normally provided by Federal or State of California Law.

Notwithstanding the provisions of this contract that require the CONTRACTOR to indemnify and hold harmless the STATE, the parties shall jointly indemnify and hold harmless the DRB members from and against all claims, damages, losses, and expenses, including but not limited to attorney's fees, arising out of and resulting from the findings and recommendations of the DRB.

SECTION X CONFIDENTIALITY

The parties hereto mutually understand and agree that all documents and records provided by the parties in reference to issues brought before the DRB, which documents and records are marked "Confidential - for use by the DRB only," shall be kept in confidence and used only for the purpose of resolution of subject disputes, and for assisting in development of DRB findings and recommendations; that such documents and records will not be utilized or revealed to others, except to officials of the parties who are authorized to act on the subject disputes, for any purposes, during the life of the DRB. Upon termination of this AGREEMENT, said confidential documents and records, and all copies thereof, shall be returned to the parties who furnished them to the DRB. However, the parties understand that such documents shall be subsequently discoverable and admissible in court or arbitration proceedings unless a protective order has been obtained by the party seeking further confidentiality.

SECTION XI DISPUTES

Disputes between the parties hereto, including disputes between the DRB members and either party or both parties, arising out of the work or other terms of this AGREEMENT, which cannot be resolved by negotiation and mutual concurrence between the parties, or through the administrative process provided in the contract, shall be resolved by arbitration as provided in Section 9-1.10, "Arbitration," of the Standard Specifications.

SECTION XII VENUE, APPLICABLE LAW, AND PERSONAL JURISDICTION

In the event that any party, including an individual member of the DRB, deems it necessary to institute arbitration proceedings to enforce any right or obligation under this AGREEMENT, the parties hereto agree that such action shall be initiated in the Office of Administrative Hearings of the State of California. The parties hereto agree that all questions shall be resolved by arbitration by application of California law and that the parties to such arbitration shall have the right of appeal from such decisions to the Superior Court in conformance with the laws of the State of California. Venue for the arbitration shall be Sacramento or any other location as agreed to by the parties.

SECTION XIII FEDERAL REVIEW AND REQUIREMENTS

On Federal-Aid contracts, the Federal Highway Administration shall have the right to review the work of the DRB in progress, except for private meetings or deliberations of the DRB.

Other Federal requirements in this agreement shall only apply to Federal-Aid contracts.

SECTION XIV CERTIFICATION OF THE CONTRACTOR, THE DRB MEMBERS, AND THE STATE

IN WITNESS WHEREOF, the parties hereto have executed this AGREEMENT as of the day and year first above written.

DRB MEMBER

DRB MEMBER

By: _____

By: _____

Title: _____

Title : _____

DRB MEMBER

By : _____

Title : _____

CONTRACTOR

CALIFORNIA STATE DEPARTMENT
OF TRANSPORTATION

By: _____

By: _____

Title: _____

Title: _____

5-1.13 FORCE ACCOUNT PAYMENT

Payment for extra work at force account will be determined by either non-subcontracted or subcontracted force account payment unless otherwise specified.

Non-Subcontracted Force Account Payment:

When extra work to be paid for on a force account basis is performed by the Contractor, compensation will be determined in accordance with Section 9-1.03, "Force Account Payment," of the Standard Specifications and these special provisions.

The second, third and fourth paragraphs of Section 9-1.03A, "Work Performed by Contractor," in the Standard Specifications, shall not apply.

Attention is directed to "Time-Related Overhead" of these special provisions.

To the total of the direct costs for work performed on a force account basis, computed as provided in Sections 9-1.03A(1), "Labor," 9-1.03A(2), "Materials," and 9-1.03A(3), "Equipment Rental," of the Standard Specifications, there will be added the following markups:

Cost	Percent Markup
Labor	28
Materials	10
Equipment Rental	10

The above markups shall be applied to work performed on a force account basis, regardless of whether the work revises the current contract completion date.

The above markups, together with payments made for time-related overhead pursuant to "Time-Related Overhead" of these special provisions, shall constitute full compensation for all overhead costs for work performed on a force account basis. These overhead costs shall be deemed to include all items of expense not specifically designated as cost or equipment rental in conformance with the provisions in Sections 9-1.03A(1), "Labor," 9-1.03A(2), "Materials," and 9-1.03A(3), "Equipment Rental," of the Standard Specifications. The total payment made as provided above and in the first paragraph of Section 9-1.03A, "Work Performed by Contractor," of the Standard Specifications shall be deemed to be the actual cost of the work performed on a force account basis, and shall constitute full compensation therefor.

Full compensation for overhead costs for work performed on a force account basis, and for which no adjustment is made to the quantity for time-related overhead conforming to the provisions in "Time-Related Overhead" of these special provisions, shall be considered as included in the markups specified above, and no additional compensation will be allowed therefor.

Subcontracted Force Account Payment:

When extra work to be paid for on a force account basis is performed by a subcontractor approved in conformance with the provisions in Section 8-1.01, "Subcontracting," of the Standard Specifications, compensation will be determined in accordance with the provisions in Section 9-1.03, "Force Account Payment," of the Standard Specifications.

5-1.14 COMPENSATION ADJUSTMENTS FOR PRICE INDEX FLUCTUATIONS

The provisions of this section shall apply only to the following contract items:

ITEM CODE	ITEM
390102	ASPHALT CONCRETE (TYPE A)
397001	ASPHALTIC EMULSION (PAINT BINDER)
390108	ASPHALT CONCRETE BASE (TYPE A)

The compensation payable for paving asphalt used in asphalt concrete, asphalt concrete base and asphaltic emulsion (paint binder) will be increased or decreased in conformance with the provisions of this section for paving asphalt price fluctuations exceeding 10 percent (Iu/Ib is greater than 1.10 or less than 0.90) which occur during performance of the work.

The quantity of paving asphalt used in asphaltic emulsion (paint binder) will be determined by multiplying the item quantity for asphaltic emulsion (paint binder) included in a monthly estimate by the minimum percent residue specified in Section 94, "Asphaltic Emulsions," of the Standard Specifications. The asphaltic emulsion minimum percent residue will be based on the type of emulsion used by the Contractor.

At the Contractor's option, the Contractor may provide actual daily test results for paving asphalt residue for the asphaltic emulsion (paint binder) used. Test results provided by the Contractor shall be from an independent testing laboratory that participates in the AASHTO Proficiency Sample Program. The Contractor shall take samples of asphaltic emulsion from the distributor truck at mid-load from a sampling tap or thief. Two separate 2-liter samples shall be taken in the presence of the Engineer. The Contractor shall provide one sample to the Contractor's independent testing laboratory, with 24 hours of sampling. The second sample shall be given to the Engineer. The test results from the Contractor's independent testing laboratory shall be delivered to the Engineer within 10 days from sample date.

The adjustment in compensation will be determined in conformance with the following formulae when the item of asphalt concrete, asphalt concrete base or asphaltic emulsion (paint binder), or combination thereof, are included in a monthly estimate:

- A. Total monthly adjustment = AQ
- B. For an increase in paving asphalt price index exceeding 10 percent:

$$A = 0.90 (1.1023) (Iu/Ib - 1.10) Ib$$

- C. For a decrease in paving asphalt price index exceeding 10 percent:

$$A = 0.90 (1.1023) (Iu/Ib - 0.90) Ib$$

- D. Where:

A = Adjustment in dollars per tonne of paving asphalt used to produce asphalt concrete, asphalt concrete base and asphaltic emulsion residue used as paint binder rounded to the nearest \$0.01.

Iu = The California Statewide Paving Asphalt Price Index which is in effect on the first business day of the month within the pay period in which the quantity subject to adjustment was included in the estimate.

Ib = The California Statewide Paving Asphalt Price Index for the month in which the bid opening for the project occurred.

Q = Quantity in tonnes of paving asphalt that was used in producing the quantity of asphalt concrete and asphalt concrete base shown under "This Estimate" on the monthly estimate using the amount of asphalt determined by the Engineer plus the quantity in tonnes of paving asphalt that would have been used as residue in the asphaltic emulsion (paint binder) shown under "This Estimate" on the monthly estimate.

The adjustment in compensation will also be subject to the following:

- A. The compensation adjustments provided herein will be shown separately on payment estimates. The Contractor shall be liable to the State for decreased compensation adjustments and the Department may deduct the amount thereof from moneys due or that may become due the Contractor.
- B. Compensation adjustments made under this section will be taken into account in making adjustments in conformance with the provisions in Section 4-1.03B, "Increased or Decreased Quantities," of the Standard Specifications.
- C. In the event of an overrun of contract time, adjustment in compensation for paving asphalt included in estimates during the overrun period will be determined using the California Statewide Paving Asphalt Price Index in effect on the first business day of the month within the pay period in which the overrun began.

The California Statewide Paving Asphalt Price Index is determined each month on the first business day of the month by the Department using the median of posted prices in effect as posted by Chevron, Mobil, and Unocal for the Buena Vista, Huntington Beach, Kern River, Long Beach, Midway Sunset, and Wilmington fields.

In the event that the companies discontinue posting their prices for a field, the Department will determine an index from the remaining posted prices. The Department reserves the right to include in the index determination the posted prices of additional fields.

The California Statewide Paving Asphalt Price Index is available on the Division of Engineering Services website at:

http://www.dot.ca.gov/hq/esc/oe/asphalt_index/astable.html

5-1.15 AREAS FOR CONTRACTOR'S USE

Attention is directed to the provisions in Section 7-1.19, "Rights in Land and Improvements," of the Standard Specifications and these special provisions.

The highway right of way shall be used only for purposes that are necessary to perform the required work. The Contractor shall not occupy the right of way, or allow others to occupy the right of way, for purposes which are not necessary to perform the required work.

No State-owned parcels adjacent to the right of way are available for the exclusive use of the Contractor within the contract limits. The Contractor shall secure, at the Contractor's own expense, areas required for plant sites, storage of equipment or materials, or for other purposes.

No area is available within the contract limits for the exclusive use of the Contractor. However, temporary storage of equipment and materials on State property may be arranged with the Engineer, subject to the prior demands of State maintenance forces and to other contract requirements. Use of the Contractor's work areas and other State-owned property shall be at the Contractor's own risk, and the State shall not be held liable for damage to or loss of materials or equipment located within such areas.

5-1.16 PAYMENTS

Attention is directed to Sections 9-1.06, "Partial Payments," and 9-1.07, "Payment After Acceptance," of the Standard Specifications and these special provisions.

For the purpose of making partial payments pursuant to Section 9-1.06, "Partial Payments," of the Standard Specifications, the amount set forth for the contract items of work hereinafter listed shall be deemed to be the maximum value of the contract item of work which will be recognized for progress payment purposes:

A. Clearing and Grubbing	\$48,500.00
B. Develop Water Supply	\$20,000.00
C. Prepare Storm Water Pollution Prevention Plan	\$ 7,500.00
D. Progress Schedule (Critical Path Method)	\$12,500.00

After acceptance of the contract pursuant to the provisions in Section 7-1.17, "Acceptance of Contract," of the Standard Specifications, the amount, if any, payable for a contract item of work in excess of the maximum value for progress payment purposes hereinabove listed for the item, will be included for payment in the first estimate made after acceptance of the contract.

In determining the partial payments to be made to the Contractor, only the following listed materials will be considered for inclusion in the payment as materials furnished but not incorporated in the work:

- A. Bar reinforcing steel
- B. Sign structure
- C. Culvert pipe
- D. Miscellaneous drainage facilities

- E. Rock slope protection fabric
- F. Miscellaneous iron and steel
- G. Fences
- H. Metal beam guard railing
- I. Crash cushions
- J. Pavement markers
- K. Earth retaining system
- L. Tieback anchors
- M. Type B joint seal (MR=30 mm)
- N. Chain link railing
- O. Cable railing
- P. Tubular pipe handrailing
- Q. Irrigation Controllers
- R. Irrigation Controller Enclosure Cabinets
- S. Plastic Pipe (Irrigation Systems)
- T. Gate Valves
- U. Sprinklers
- V. Hose Expansion Assemblies
- W. Lighting Fixtures
- X. Luminaires
- Y. Signal and Lighting Standards
- Z. Splice Vaults
- AA. Fiber Optic Cable
- BB. Innerducts
- CC. Fiber Optic Conduit

5-1.17 PROJECT INFORMATION

The information in this section has been compiled specifically for this project and is made available for bidders and Contractors. Other information referenced in the Standard Specifications and these special provisions do not appear in this section. The information is subject to the conditions and limitations set forth in Section 2-1.03, "Examination of Plans, Specifications, Contract, and Site of Work," and Section 6-2, "Local Materials," of the Standard Specifications. Bidders and Contractors shall be responsible for knowing the procedures for obtaining information.

Information attached to the project plans is as follows:

- A. Log of test borings.

Information included in the Information Handout provided to bidders and Contractors is as follows:

- A. Water letter from City of San Diego
- B. Water Letter from City of Escondido.
- C. Materials Information Brochure
- D. Foundation recommendations
- E. Biological Opinion (FWS-SDG-1328.5) from the U.S. Fish and Wildlife Services
- F. Cross sections for tieback wall sites
- G. Foundation Recommendations (Retaining Walls 446 L/R)
- H. Revised Foundation Recommendations (Retaining Walls 446 L/R)
- I. Foundation Recommendations (Bridge No. 57-1196)
- J. Revised Foundation Recommendations (Bridge No. 57-1196)
- K. Foundation Recommendations (Bridge No. 57-0941 Tieback walls at Abutment 1&3)
- L. Foundation Recommendations (Bridge No. 57-0623 Tieback walls at Abutment 1&3)
- M. Foundation Recommendations (Bridge No. 57-1199)
- N. Foundation Recommendations (Retaining Walls 450 L/R)

Information available for inspection at the District Office is as follows:

Cross Sections

Cross sections are available in electronic copy.

The District Office in which the work is situated is located at 2829 Juan Street, San Diego, California 92110

Plans of the existing bridges may be requested by fax from the Office of Structure Maintenance and Investigations, 1801 30th Street, Sacramento, CA, Fax (916) 227-8357, and are available at the Office of Structure Maintenance and Investigations, Los Angeles, CA, Telephone (213) 897-0877.

Plans of the existing bridges available to bidders and Contractors are reproductions of the original contract plans, with significant changes noted, and working drawings, and do not necessarily show normal construction tolerances and variances. Where dimensions of new construction required by this contract are dependent on the dimensions of the existing bridges, the Contractor shall verify the controlling field dimensions and shall be responsible for adjusting dimensions of the work to fit existing conditions.

5-1.18 MIGRATORY BIRDS

Attention is directed to the Federal Migratory Bird Treaty Act (15 USC 703-711) 50 CFR Part 21 and 50 CFR Part 10, and the California Department of Fish and Game Code Sections 3503, 3513, and 3800, that protect migratory birds, their occupied nests, and their eggs from disturbance or destruction.

A Biologist will be provided by the State for this project.

Attention is directed to "Order of Work" and "Clearing and Grubbing" of these special provisions.

It is the Contractor's responsibility to ensure that birds and other wildlife (such as bats) are not allowed to nest or roost in areas that may be impacted by construction.

Between February 15 and September 1, the Contractor shall notify the Engineer in writing 15 working days prior to beginning work disturbing structures, the ground or vegetation. The notification shall include the timing and order of work to be performed. The Engineer will approve the beginning of work.

If, in the opinion of the Engineer, the Contractor's operations are delayed or interfered with by reason of the Engineer's delay in approving the disturbance to structures, ground or vegetation, the Contractor will be compensated for resulting losses, and an extension of time will be granted, in the same manner as provided for in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

Prior to the migratory bird nesting season of February 15 through September 1, vegetation mowing and tree removal within the limits of clearing and grubbing work shall be completed in conformance with the provisions in "Clearing and Grubbing" of these special provisions.

Existing vegetation, excluding trees, outside the limits of clearing and grubbing work and outside ESA areas, may be cut or mowed to a height between 50 mm (minimum) and 100 mm (maximum). Soil shall not be scraped and roots shall not be removed. All cut or mowed vegetation, stems, branches and leaves may be left in place provided that the debris pile does not exceed a height of 50 mm from the original grade when cutting or mowing is complete. Vegetation may be chipped or spread to achieve debris depth less than 50 mm.

In the event that an active nest or roost is discovered in the construction areas, or in adjacent areas considered by the biologist to be disturbed by construction, the areas shall be designated as environmentally sensitive areas and no work shall occur within 20 meters until the nesting season is over.

The boundaries of the environmentally sensitive areas for migratory birds are delineated in conformance with "Maintain Temporary Fence (Type ESA)" of these special provisions. Once the nesting season is over, the areas will not longer be considered an environmentally sensitive area and temporary fence (Type ESA) shall be removed.

If nesting migratory birds are found within the project limits and, if in the opinion of the Engineer, the Contractor's operations are delayed or interfered with, the State will compensate the Contractor for such delays to the extent provided in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

Attention is directed to "Time Related Overhead" of these special provisions.

Nothing in this section shall relieve the Contractor from providing for public safety in conformance with the provisions in Section 7-1.09, "Public Safety," of the Standard Specifications.

If any deficiencies related to the requirements of these special provisions are discovered by the Engineer during the life of the contract, the Contractor will be notified and be expected to correct the problem within 24 hours.

Full compensation for complying with the requirements of this section shall be considered as included in the various items of work involved and no additional compensation will be allowed therefor.

5-1.19 PALEONTOLOGY

A Paleontologist will be provided by the State for this project. The Contractor shall notify the Engineer 5 days in advance of any excavation. If fossils are discovered, excavation shall be suspended until the Engineer authorizes it to be resumed. If such suspension delays the current controlling operation, the Contractor will be granted an extension of time as provided in Section 8-1.07, "Liquidated Damages," of the Standard Specifications.

If such suspension delays the current controlling operation more than 2 working days, the delay will be considered a right of way delay, and the Contractor will be compensated for such delay as provided in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

The Department reserves the right to use other forces for exploratory work to identify and determine the extent of the area requiring fossil recovery and for removing fossils from such area.

5-1.20 SOUND CONTROL REQUIREMENTS

Sound control shall conform to the provisions in Section 7-1.01I, "Sound Control Requirements," of the Standard Specifications and these special provisions.

The noise level from the Contractor's operations, between the hours of 7:00 p.m. and 7:00 a.m., shall not exceed 86 dbA at a distance of 15 m. This requirement shall not relieve the Contractor from responsibility for complying with local ordinances regulating noise level outside the limits of the State right of way.

The noise level requirement specified herein shall apply to the equipment on the job or related to the job, including but not limited to trucks, transit mixers or transient equipment that may or may not be owned by the Contractor. The use of loud sound signals shall be avoided in favor of light warnings except those required by safety laws for the protection of personnel.

Full compensation for conforming to the requirements of this section shall be considered as included in the prices paid for the various contract items of work involved and no additional compensation will be allowed therefor.

5-1.21 RELATIONS WITH U.S. FISH AND WILDLIFE SERVICE

The project is located within the jurisdiction of the U.S. Fish and Wildlife Service. A biological opinion (FWS-SDG-1328.5) regarding impacts to endangered species was issued by the U.S. Fish and Wildlife Service. The Contractor shall be fully informed of the requirements of this agreement as well as rules, regulations, and conditions that may govern the Contractor's operations in these areas and shall conduct the work accordingly.

Copies of the opinion may be obtained at the Department of Transportation, Plans and Bid Documents Section, MS 26, 1120 N Street, Room 200, Sacramento, CA 95814, Telephone 916-654-4490, and are available for inspection from the District 11 Construction Duty Senior, Telephone No. (619) 688-6635 at the office of the District Director of Transportation at 2829 Juan Street, San Diego, California 92110.

5-1.22 ENVIRONMENTALLY SENSITIVE AREA

An environmentally sensitive area (ESA) consist of an area within and near the limits of construction where access is prohibited or limited for the preservation of archeological site or existing vegetation, or protection of biological habitat as shown on the plans. No work shall be conducted within the ESA.

Attention is directed to "Maintain Temporary Fence (Type ESA)" of these special provisions.

Attention is directed to Section 7—1.01 "Laws to be Observed," and Section 7—1.04 "Permits and Licenses," of the Standard Specifications regarding State and Federal regulations, permits, or agreements which pertain to an ESA.

Prior to beginning work, the boundaries of the ESA shall be clearly delineated by the placement of temporary fence (Type ESA).

Vehicle access, storage or transport of materials or equipment, or other project related activities are prohibited within the boundaries of ESA.

The Contractor shall mitigate damage or impacts to the ESA caused by the Contractor's operations, at the Contractor's expense. If the Engineer determines mitigation work will be performed by others, or if mitigation fees are assessed the Department, deductions from moneys due or to become due the Contractor will be made for the mitigation costs.

SECTION 6. (BLANK)

SECTION 7. (BLANK)

SECTION 8. MATERIALS

SECTION 8-1. MISCELLANEOUS

8-1.01 SUBSTITUTION OF NON-METRIC MATERIALS AND PRODUCTS

Only materials and products conforming to the requirements of the specifications shall be incorporated in the work. When metric materials and products are not available, and when approved by the Engineer, and at no cost to the State, materials and products in the United States Standard Measures which are of equal quality and of the required properties and characteristics for the purpose intended, may be substituted for the equivalent metric materials and products, subject to the following provisions:

- A. Materials and products shown on the plans or in the special provisions as being equivalent may be substituted for the metric materials and products specified or detailed on the plans.
- B. Before other non-metric materials and products will be considered for use, the Contractor shall furnish, at the Contractor's expense, evidence satisfactory to the Engineer that the materials and products proposed for use are equal to or better than the materials and products specified or detailed on the plans. The burden of proof as to the quality and suitability of substitutions shall be upon the Contractor and the Contractor shall furnish necessary information as required by the Engineer. The Engineer will be the sole judge as to the quality and suitability of the substituted materials and products and the Engineer's decision will be final.
- C. When the Contractor elects to substitute non-metric materials and products, including materials and products shown on the plans or in the special provisions as being equivalent, the list of sources of material specified in Section 6-1.01, "Source of Supply and Quality of Materials," of the Standard Specification shall include a list of substitutions to be made and contract items involved. In addition, for a change in design or details, the Contractor shall submit plans and working drawings in conformance with the provisions in Section 5-1.02, "Plans and Working Drawings," of the Standard Specifications. The plans and working drawings shall be submitted at least 7 days before the Contractor intends to begin the work involved.

Unless otherwise specified, the following substitutions of materials and products will be allowed:

SUBSTITUTION TABLE FOR PLAIN WIRE REINFORCEMENT
ASTM Designation: A 82

METRIC SIZE SHOWN ON THE PLANS ² mm	SIZE TO BE SUBSTITUTED ² inch x 100
MW9	W1.4
MW10	W1.6
MW13	W2.0
MW15	W2.3
MW19	W2.9
MW20	W3.1
MW22	W3.5
MW25	W3.9, except W3.5 in piles only
MW26	W4.0
MW30	W4.7
MW32	W5.0
MW35	W5.4
MW40	W6.2
MW45	W6.5
MW50	W7.8
MW55	W8.5, except W8.0 in piles only
MW60	W9.3
MW70	W10.9, except W11.0 in piles only
MW80	W12.4
MW90	W14.0
MW100	W15.5

SUBSTITUTION TABLE FOR BAR REINFORCEMENT

METRIC BAR DESIGNATION NUMBER ¹ SHOWN ON THE PLANS	BAR DESIGNATION NUMBER ² TO BE SUBSTITUTED
10	3
13	4
16	5
19	6
22	7
25	8
29	9
32	10
36	11
43	14
57	18

¹Bar designation numbers approximate the number of millimeters of the nominal diameter of the bars.

²Bar numbers are based on the number of eighths of an inch included in the nominal diameter of the bars.

No adjustment will be required in spacing or total number of reinforcing bars due to a difference in minimum yield strength between metric and non-metric bars.

SUBSTITUTION TABLE FOR SIZES OF:

(1) STEEL FASTENERS FOR GENERAL APPLICATIONS (ASTM Designation: A 307 or AASHTO Designation: M 314, Grade 36 or 55), and

(2) HIGH STRENGTH STEEL FASTENERS (ASTM Designation: A 325 or A 449)

METRIC SIZE SHOWN ON THE PLANS mm	SIZE TO BE SUBSTITUTED inch
6 or 6.35	1/4
8 or 7.94	5/16
10 or 9.52	3/8
11 or 11.11	7/16
13, 12.70, or M12	1/2
14 or 14.29	9/16
16, 15.88, or M16	5/8
19, 19.05, or M20	3/4
22, 22.22, or M22	7/8
24, 25, 25.40, or M24	1
29, 28.58, or M27	1-1/8
32, 31.75, or M30	1-1/4
35 or 34.93	1-3/8
38, 38.10, or M36	1-1/2
44 or 44.45	1-3/4
51 or 50.80	2
57 or 57.15	2-1/4
64 or 63.50	2-1/2
70 or 69.85	2-3/4
76 or 76.20	3
83 or 82.55	3-1/4
89 or 88.90	3-1/2
95 or 95.25	3-3/4
102 or 101.60	4

SUBSTITUTION TABLE FOR NOMINAL THICKNESS OF SHEET METAL

UNCOATED HOT AND COLD ROLLED SHEETS		HOT-DIPPED ZINC COATED SHEETS (GALVANIZED)	
METRIC THICKNESS SHOWN ON THE PLANS mm	GAGE TO BE SUBSTITUTED inch	METRIC THICKNESS SHOWN ON THE PLANS mm	GAGE TO BE SUBSTITUTED inch
7.94	0.3125	4.270	0.1681
6.07	0.2391	3.891	0.1532
5.69	0.2242	3.510	0.1382
5.31	0.2092	3.132	0.1233
4.94	0.1943	2.753	0.1084
4.55	0.1793	2.372	0.0934
4.18	0.1644	1.994	0.0785
3.80	0.1495	1.803	0.0710
3.42	0.1345	1.613	0.0635
3.04	0.1196	1.461	0.0575
2.66	0.1046	1.311	0.0516
2.28	0.0897	1.158	0.0456
1.90	0.0747	1.006 or 1.016	0.0396
1.71	0.0673	0.930	0.0366
1.52	0.0598	0.853	0.0336
1.37	0.0538	0.777	0.0306
1.21	0.0478	0.701	0.0276
1.06	0.0418	0.627	0.0247
0.91	0.0359	0.551	0.0217
0.84	0.0329	0.513	0.0202
0.76	0.0299	0.475	0.0187
0.68	0.0269	-----	-----
0.61	0.0239	-----	-----
0.53	0.0209	-----	-----
0.45	0.0179	-----	-----
0.42	0.0164	-----	-----
0.38	0.0149	-----	-----

SUBSTITUTION TABLE FOR WIRE

METRIC THICKNESS SHOWN ON THE PLANS mm	WIRE THICKNESS TO BE SUBSTITUTED inch	GAGE NO.
6.20	0.244	3
5.72	0.225	4
5.26	0.207	5
4.88	0.192	6
4.50	0.177	7
4.11	0.162	8
3.76	0.148	9
3.43	0.135	10
3.05	0.120	11
2.69	0.106	12
2.34	0.092	13
2.03	0.080	14
1.83	0.072	15
1.57	0.062	16
1.37	0.054	17
1.22	0.048	18
1.04	0.041	19
0.89	0.035	20

SUBSTITUTION TABLE FOR PIPE PILES

METRIC SIZE SHOWN ON THE PLANS mm x mm	SIZE TO BE SUBSTITUTED inch x inch
PP 360 x 4.55	NPS 14 x 0.179
PP 360 x 6.35	NPS 14 x 0.250
PP 360 x 9.53	NPS 14 x 0.375
PP 360 x 11.12	NPS 14 x 0.438
PP 406 x 12.70	NPS 16 x 0.500
PP 460 x T	NPS 18 x T"
PP 508 x T	NPS 20 x T"
PP 559 x T	NPS 22 x T"
PP 610 x T	NPS 24 x T"
PP 660 x T	NPS 26 x T"
PP 711 x T	NPS 28 x T"
PP 762 x T	NPS 30 x T"
PP 813 x T	NPS 32 x T"
PP 864 x T	NPS 34 x T"
PP 914 x T	NPS 36 x T"
PP 965 x T	NPS 38 x T"
PP 1016 x T	NPS 40 x T"
PP 1067 x T	NPS 42 x T"
PP 1118 x T	NPS 44 x T"
PP 1219 x T	NPS 48 x T"
PP 1524 x T	NPS 60 x T"

The thickness in millimeters (T) represents an exact conversion of the thickness in inches (T").

SUBSTITUTION TABLE FOR CIDH CONCRETE PILING

METRIC SIZE SHOWN ON THE PLANS	ACTUAL AUGER SIZE TO BE SUBSTITUTED inches
350 mm	14
400 mm	16
450 mm	18
600 mm	24
750 mm	30
900 mm	36
1.0 m	42
1.2 m	48
1.5 m	60
1.8 m	72
2.1 m	84
2.4 m	96
2.7 m	108
3.0 m	120
3.3 m	132
3.6 m	144
4.0 m	156

SUBSTITUTION TABLE FOR STRUCTURAL TIMBER AND LUMBER

METRIC MINIMUM DRESSED DRY, SHOWN ON THE PLANS mm x mm	METRIC MINIMUM DRESSED GREEN, SHOWN ON THE PLANS mm x mm	NOMINAL SIZE TO BE SUBSTITUTED inch x inch
19x89	20x90	1x4
38x89	40x90	2x4
64x89	65x90	3x4
89x89	90x90	4x4
140x140	143x143	6x6
140x184	143x190	6x8
184x184	190x190	8x8
235x235	241x241	10x10
286x286	292x292	12x12

SUBSTITUTION TABLE FOR NAILS AND SPIKES

METRIC COMMON NAIL, SHOWN ON THE PLANS	METRIC BOX NAIL, SHOWN ON THE PLANS	METRIC SPIKE, SHOWN ON THE PLANS	SIZE TO BE SUBSTITUTED Penny-weight
Length, mm Diameter, mm	Length, mm Diameter, mm	Length, mm Diameter, mm	
50.80 2.87	50.80 2.51	————	6d
63.50 3.33	63.50 2.87	————	8d
76.20 3.76	76.20 3.25	76.20 4.88	10d
82.55 3.76	82.55 3.25	82.55 4.88	12d
88.90 4.11	88.90 3.43	88.90 5.26	16d
101.60 4.88	101.60 3.76	101.60 5.72	20d
114.30 5.26	114.30 3.76	114.30 6.20	30d
127.00 5.72	127.00 4.11	127.00 6.68	40d
————	————	139.70 7.19	50d
————	————	152.40 7.19	60d

SUBSTITUTION TABLE FOR IRRIGATION
COMPONENTS

METRIC WATER METERS, TRUCK LOADING STANDPIPES, VALVES, BACKFLOW PREVENTERS, FLOW SENSORS, WYE STRAINERS, FILTER ASSEMBLY UNITS, PIPE SUPPLY LINES, AND PIPE IRRIGATION SUPPLY LINES SHOWN ON THE PLANS DIAMETER NOMINAL (DN) mm	NOMINAL SIZE TO BE SUBSTITUTED inch
15	1/2
20	3/4
25	1
32	1-1/4
40	1-1/2
50	2
65	2-1/2
75	3
100	4
150	6
200	8
250	10
300	12
350	14
400	16

Unless otherwise specified, substitutions of United States Standard Measures standard structural shapes corresponding to the metric designations shown on the plans and in conformance with the requirements in ASTM Designation: A 6/A 6M, Annex 2, will be allowed.

8-1.02 PREQUALIFIED AND TESTED SIGNING AND DELINEATION MATERIALS

The Department maintains the following list of Prequalified and Tested Signing and Delineation Materials. The Engineer shall not be precluded from sampling and testing products on the list of Prequalified and Tested Signing and Delineation Materials.

The manufacturer of products on the list of Prequalified and Tested Signing and Delineation Materials shall furnish the Engineer a Certificate of Compliance in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications for each type of traffic product supplied.

For those categories of materials included on the list of Prequalified and Tested Signing and Delineation Materials, only those products shown within the listing may be used in the work. Other categories of products, not included on the list of Prequalified and Tested Signing and Delineation Materials, may be used in the work provided they conform to the requirements of the Standard Specifications.

Materials and products may be added to the list of Prequalified and Tested Signing and Delineation Materials if the manufacturer submits a New Product Information Form to the New Product Coordinator at the Transportation Laboratory. Upon a Departmental request for samples, sufficient samples shall be submitted to permit performance of required tests. Approval of materials or products will depend upon compliance with the specifications and tests the Department may elect to perform.

PAVEMENT MARKERS, PERMANENT TYPE

Retroreflective With Abrasion Resistant Surface (ARS)

- A. Apex, Model 921AR (100 mm x 100 mm)
- B. Avery Dennison, Models C88 (100 mm x 100 mm), 911 (100 mm x 100 mm) and 953 (70 mm x 114 mm)
- C. Ray-O-Lite, Model "AA" ARS (100 mm x 100 mm)
- D. 3M Series 290 (89 mm x 100 mm)
- E. 3M Series 290 PSA, with pressure sensitive adhesive pad (89 mm x 100 mm)

Retroreflective With Abrasion Resistant Surface (ARS)

(for recessed applications only)

- A. Avery Dennison, Model 948 (58 mm x 119 mm)
- B. Avery Dennison, Model 944SB (51 mm x 100 mm)*
- C. Ray-O-Lite, Model 2002 (58 mm x 117 mm)
- D. Ray-O-Lite, Model 2004 ARS (51 mm x 100 mm)*

*For use only in 114 mm wide (older) recessed slots

Non-Reflective, 100 mm Round

- A. Apex Universal (Ceramic)
- B. Apex Universal, Models 929 (ABS) and 929PP (Polypropylene)
- C. Glowlite, Inc., (Ceramic)
- D. Hi-Way Safety, Inc., Models P20-2000W and 2001Y (ABS)
- E. Interstate Sales, "Diamond Back" (ABS) and (Polypropylene)
- F. Novabrite Models Cdot (White) Cdot-y (Yellow), Ceramic
- G. Novabrite Models Pdot-w (White) Pdot-y (Yellow), Polypropylene
- H. Road Creations, Model RCB4NR (Acrylic)
- I. Three D Traffic Works TD10000 (ABS), TD10500 (Polypropylene)

PAVEMENT MARKERS, TEMPORARY TYPE

Temporary Markers For Long Term Day/Night Use (6 months or less)

- A. Vega Molded Products "Temporary Road Marker" (75 mm x 100 mm)

Temporary Markers For Short Term Day/Night Use (14 days or less)

(For seal coat or chip seal applications, clear protective covers are required)

- A. Apex Universal, Model 932
- B. Bunzl Extrusion, Models T.O.M., T.R.P.M., and "HH" (High Heat)
- C. Hi-Way Safety, Inc., Model 1280/1281
- D. Glowlite, Inc., Model 932

STRIPING AND PAVEMENT MARKING MATERIAL

Permanent Traffic Striping and Pavement Marking Tape

- A. Advanced Traffic Marking, Series 300 and 400
- B. Brite-Line, Series 1000
- C. Brite-Line, "DeltaLine XRP"
- D. Swarco Industries, "Director 35" (For transverse application only)
- E. Swarco Industries, "Director 60"
- F. 3M, "Stamark" Series 380 and 5730
- G. 3M, "Stamark" Series 420 (For transverse application only)

Temporary (Removable) Striping and Pavement Marking Tape (6 months or less)

- A. Advanced Traffic Marking, Series 200
- B. Brite-Line, Series 100
- C. Garlock Rubber Technologies, Series 2000
- D. P.B. Laminations, Aztec, Grade 102
- E. Swarco Industries, "Director-2"
- F. Trelleborg Industri, R140 Series
- G. 3M, Series 620 "CR", and Series A750

- H. 3M, Series A145, Removable Black Line Mask
(Black Tape: for use only on Asphalt Concrete Surfaces)
- I. Advanced Traffic Marking Black "Hide-A-Line"
(Black Tape: for use only on Asphalt Concrete Surfaces)
- J. Brite-Line "BTR" Black Removable Tape
(Black Tape: for use only on Asphalt Concrete Surfaces)
- K. Trelleborg Industri, RB-140
(Black Tape: for use only on Asphalt Concrete Surfaces)

Preformed Thermoplastic (Heated in place)

- A. Avery Dennison, "Hotape"
- B. Flint Trading, "Premark," "Premark 20/20 Flex," and "Premark 20/20 Flex Plus"

Ceramic Surfacing Laminate, 150 mm x 150 mm

- A. Highway Ceramics, Inc.

CLASS 1 DELINEATORS

One Piece Driveable Flexible Type, 1700 mm

- A. Bunzl Extrusion, "Flexi-Guide Models 400 and 566"
- B. Carsonite, Curve-Flex CFRM-400
- C. Carsonite, Roadmarker CRM-375
- D. FlexStake, Model 654 TM
- E. GreenLine Models HWD1-66 and CGD1-66

Special Use Type, 1700 mm

- A. Bunzl Extrusion, Model FG 560 (with 450 mm U-Channel base)
- B. Carsonite, "Survivor" (with 450 mm U-Channel base)
- C. Carsonite, Roadmarker CRM-375 (with 450 mm U-Channel base)
- D. FlexStake, Model 604
- E. GreenLine Models HWDU and CGD (with 450 mm U-Channel base)
- F. Impact Recovery Model D36, with #105 Driveable Base
- G. Safe-Hit with 200 mm pavement anchor (SH248-GP1)
- H. Safe-Hit with 380 mm soil anchor (SH248-GP2) and with 450 mm soil anchor (SH248-GP3)

Surface Mount Type, 1200 mm

- A. Bent Manufacturing Company, Masterflex Model MF-180EX-48
- B. Carsonite, "Super Duck II"
- C. FlexStake, Surface Mount, Models 704 and 754 TM
- D. Impact Recovery Model D48, with #101 Fixed (Surface-Mount) Base
- E. Three D Traffic Works "Channelflex" ID No. 522248W

CHANNELIZERS

Surface Mount Type, 900 mm

- A. Bent Manufacturing Company, Masterflex Models MF-360-36 (Round) and MF-180-36 (Flat)
- B. Bunzl Extrusion, Flexi-Guide Models FG300PE and FG300UR
- C. Carsonite, "Super Duck" (Flat SDF-436, Round SDR-336)
- D. Carsonite, "Super Duck II" Model SDCF203601MB "The Channelizer"
- E. FlexStake, Surface Mount, Models 703 and 753 TM
- F. GreenLine, Model SMD-36
- G. Hi-Way Safety, Inc. "Channel Guide Channelizer" Model CGC36
- H. Impact Recovery Model D36, with #101 Fixed (Surface-Mount) Base
- I. Repo, Models 300 and 400
- J. Safe-Hit, Guide Post, Model SH236SMA
- K. Three D Traffic Works "Channelflex" ID No. 522053W

Lane Separation System

- A. Bunzl "Flexi-Guide (FG) 300 Curb System"

- B. Qwick Kurb, "Klemmfix Guide System"
- C. Recycled Technology, Inc. "Safe-Lane System"

CONICAL DELINEATORS, 1070 mm

(For 700 mm Traffic Cones, see Standard Specifications)

- A. Bent Manufacturing Company "T-Top"
- B. Plastic Safety Systems "Navigator-42"
- C. Radiator Specialty Company "Enforcer"
- D. Roadmaker Company "Stacker"
- E. Traffix Devices "Grabber"
- F. Three D Traffic Works "Ringtop" TD7000, ID No. 742143

OBJECT MARKERS

Type "K", 450 mm

- A. Bunzl, Model FG318PE
- B. Carsonite, Model SMD 615
- C. FlexStake, Model 701 KM
- D. Repo, Models 300 and 400
- E. Safe-Hit, Model SH718SMA

Type "K-4" / "Q" Object Markers, 600 mm

- A. Bent Manufacturing "Masterflex" Model MF-360-24
- B. Bunzl Extrusion, Model FG324PE
- C. Carsonite, Super Duck II
- D. FlexStake, Model 701KM
- E. Repo, Models 300 and 400
- F. Safe-Hit, Models SH8 24SMA_WA and SH8 24GP3_WA
- G. The Line Connection, Model DP21-4Q
- H. Three D Traffic Works "Q" Marker, ID No. 531702W

CONCRETE BARRIER MARKERS AND TEMPORARY RAILING (TYPE K) REFLECTORS

Impactable Type

- A. ARTUK, "FB"
- B. Bunzl Extrusion, Models PCBM-12 and PCBM-T12
- C. Duraflex Corp., "Flexx 2020" and "Electriflexx"
- D. Hi-Way Safety, Inc., Model GMKRM100
- E. Plastic Safety Systems "BAM" Models OM-BARR and OM-BWAR
- F. Sun-Lab Technology, "Safety Guide Light Model TM-5"
- G. Three D Traffic Works "Roadguide" 9304 Series, ID No. 903176 (One-Way), ID No. 903215 (Two-Way)

Non-Impactable Type

- A. ARTUK, JD Series
- B. Plastic Safety Systems "BAM" Models OM-BITARW and OM-BITARA
- C. Vega Molded Products, Models GBM and JD

METAL BEAM GUARD RAIL POST MARKERS

(For use to the left of traffic)

- A. Bunzl Extrusion, "Mini" (75 mm x 254 mm)
- B. Creative Building Products, "Dura-Bull, Model 11201"
- C. Duraflex Corp., "Railrider"

CONCRETE BARRIER DELINEATORS, 400 mm

(For use to the right of traffic)

- A. Bunzl Extrusion, Model PCBM T-16
- B. Safe-Hit, Model SH216RBM
- C. Sun-Lab Technology, "Safety Guide Light, Model TM16," (75 mm x 300 mm)
- D. Three D Traffic Works "Roadguide" ID No. 904364 (White), ID No. 904390 (Yellow)

Contract No. 11-080944

CONCRETE BARRIER-MOUNTED MINI-DRUM (260 mm x 360 mm x 570 mm)

- A. Stinson Equipment Company "SaddleMarker"

SOUND WALL DELINEATOR

(Applied vertically. Place top of 75 mm x 300 mm reflective element at 1200 mm above roadway)

- A. Bunzl Extrusion, PCBM S-36
- B. Sun-Lab Technology, "Safety Guide Light, Model SM12," (75 mm x 300 mm)

GUARD RAILING DELINEATOR

(Place top of reflective element at 1200 mm above plane of roadway)

Wood Post Type, 686 mm

- A. Bunzl Extrusion, FG 427 and FG 527
- B. Carsonite, Model 427
- C. FlexStake, Model 102 GR
- D. GreenLine GRD 27
- E. Safe-Hit, Model SH227GRD
- F. Three D Traffic Works "Guardflex" TD9100 Series, ID No. 510476

Steel Post Type

- A. Carsonite, Model CFGR-327 with CFGRBK300 Mounting Bracket

RETROREFLECTIVE SHEETING

Channelizers, Barrier Markers, and Delineators

- A. Avery Dennison T-6500 Series (For rigid substrate devices only)
- B. Avery Dennison WR-6100 Series
- C. Nippon Carbide Industries, Flexible Ultralite Grade (ULG) II
- D. Reflexite, PC-1000 Metalized Polycarbonate
- E. Reflexite, AC-1000 Acrylic
- F. Reflexite, AP-1000 Metalized Polyester
- G. Reflexite, Conformalight, AR-1000 Abrasion Resistant Coating
- H. 3M, High Intensity

Traffic Cones, 330 mm Sleeves

- A. Reflexite SB (Polyester), Vinyl or "TR" (Semi-transparent)

Traffic Cones, 100 mm and 150 mm Sleeves

- A. Nippon Carbide Industries, Flexible Ultralite Grade (ULG) II
- B. Reflexite, Vinyl, "TR" (Semi-transparent) or "Conformalight"
- C. 3M Series 3840

Barrels and Drums

- A. Avery Dennison WR-6100
- B. Nippon Carbide Industries, Flexible Ultralite Grade (ULG) II
- C. Reflexite, "Conformalight", "Super High Intensity" or "High Impact Drum Sheeting"
- D. 3M Series 3810

Barricades: Type I, Medium-Intensity (Typically Enclosed Lens, Glass-Bead Element)

- A. American Decal, Adcolite
- B. Avery Dennison, T-1500 and T-1600 series
- C. 3M Engineer Grade, Series 3170

Barricades: Type II, Medium-High-Intensity (Typically Enclosed Lens, Glass-Bead Element)

- A. Avery Dennison, T-2500 Series
- B. Kiwalite Type II
- C. Nikkalite 1800 Series

Signs: Type II, Medium-High-Intensity (Typically Enclosed Lens, Glass-Bead Element)

- A. Avery Dennison, T-2500 Series
- B. Kiwalite, Type II
- C. Nikkalite 1800 Series

Signs: Type III, High-Intensity (Typically Encapsulated Glass-Bead Element)

- A. Avery Dennison, T-5500 and T-5500A Series
- B. Nippon Carbide Industries, Nikkalite Brand Ultralite Grade II
- C. 3M Series 3870

Signs: Type IV, High-Intensity (Typically Unmetallized Microprismatic Element)

- A. Avery Dennison, T-6500 Series
- B. Nippon Carbide Industries, Crystal Grade, 94000 Series
- C. Nippon Carbide Industries, Model No. 94847 Fluorescent Orange
- D. Nippon Carbide Industries, Model No. 94844 Fluorescent Yellow Green

Signs: Type VI, Elastomeric (Roll-Up) High-Intensity, without Adhesive

- A. Avery Dennison, WU-6014
- B. Novabrite LLC, "Econobrite"
- C. Reflexite "Vinyl"
- D. Reflexite "SuperBright"
- E. Reflexite "Marathon"
- F. 3M Series RS34 Orange and RS20 Fluorescent Orange

Signs: Type VII, Super-High-Intensity (Typically Unmetallized Microprismatic Element)

- A. 3M LDP Series 3924 Fluorescent Orange
- B. 3M LDP Series 3970

Signs: Type VIII, Super-High-Intensity (Typically Unmetallized Microprismatic Element)

- A. Avery Dennison, T-7500 Series
- B. Avery Dennison, T-7511 Fluorescent Yellow
- C. Avery Dennison, T-7513 Fluorescent Yellow Green
- D. Avery Dennison, W-7514 Fluorescent Orange
- E. Nippon Carbide Industries, Nikkalite Crystal Grade Model 92802 White
- F. Nippon Carbide Industries, Nikkalite Crystal Grade Model 92844 Fluorescent Yellow/Green
- G. Nippon Carbide Industries, Nikkalite Crystal Grade Model 92847 Fluorescent Orange

Signs: Type IX, Very-High-Intensity (Typically Unmetallized Microprismatic Element)

- A. 3M VIP Series 3981 Diamond Grade Fluorescent Yellow
- B. 3M VIP Series 3983 Diamond Grade Fluorescent Yellow/Green
- C. 3M VIP Series 3990 Diamond Grade

SPECIALTY SIGNS

- A. Hallmark Technologies, Inc., All Sign STOP Sign (All Plastic), 750 mm
- B. Reflexite "Endurance" Work Zone Sign (with Semi-Rigid Plastic Substrate)

SIGN SUBSTRATE

Fiberglass Reinforced Plastic (FRP)

- A. Fiber-Brite
- B. Sequentia, "Polyplate"
- C. Inteplast Group "InteCel" (13 mm for Post-Mounted CZ Signs, 1200 mm or less)

Aluminum Composite

- A. Alcan Composites "Dibond Material, 2 mm" (for temporary construction signs only)
- B. Mitsubishi Chemical America, Alpolic 350 (for temporary construction signs only)

8-1.03 STATE-FURNISHED MATERIALS

Attention is directed to Section 6-1.02, "State-Furnished Materials," of the Standard Specifications and these special provisions.

The following materials will be furnished to the Contractor:

- A. Barrier transfer machine.
- B. Concrete barrier (movable) will be available to the Contractor within San Diego County.
- C. Sign panels for roadside signs and overhead sign structures.
- D. Laminated wood box posts with metal caps for roadside signs.
- E. Hardware for mounting sign panels as follows:
 - 1. Aluminum closure inserts for multiple panel laminated signs.
 - 2. A-1 and A-2 mounting hardware for mounting laminated sign panels on overhead sign structures.
- F. Model 170 controller assemblies, including controller unit, completely wired controller cabinet, and inductive loop detector sensor units.
- G. Reflective numbers.

Completely wired controller cabinets, with auxiliary equipment but without controller unit, will be furnished to the Contractor at the District 11 Signal Laboratory, 7181 Opportunity Road, San Diego, California 92111, Telephone No. (858) 467-4010.

The Contractor shall notify the District Warehouse Manager, Telephone (858)-467-3293 and the Engineer not less than 48 hours before State-furnished material is to be picked up by the Contractor. A full description of the material and the time the material will be picked up shall be provided.

8-1.04 SLAG AGGREGATE

Air-cooled iron blast furnace slag shall not be used to produce aggregate for:

- A. Structure backfill material.
- B. Pervious backfill material.
- C. Permeable material.
- D. Reinforced or prestressed portland cement concrete component or structure.
- E. Nonreinforced portland cement concrete component or structure for which a Class 1 Surface Finish is required by the provisions in Section 51-1.18B, "Class 1 Surface Finish," of the Standard Specifications.

Aggregate produced from slag resulting from a steel-making process shall not be used for a highway construction project except for the following items:

- A. Imported Borrow.
- B. Aggregate Subbase.
- C. Class 2 Aggregate Base.
- D. Asphalt Concrete.

Steel slag to be used to produce aggregate for aggregate subbase and Class 2 aggregate base shall be crushed so that 100 percent of the material will pass a 19-mm sieve and then shall be control aged for a period of at least 3 months under conditions that will maintain all portions of the stockpiled material at a moisture content in excess of 6 percent of the dry mass of the aggregate.

A supplier of steel slag aggregate shall provide separate stockpiles for controlled aging of the slag. An individual stockpile shall contain not less than 9075 tonnes nor more than 45 350 tonnes of slag. The material in each individual stockpile shall be assigned a unique lot number and each stockpile shall be identified with a permanent system of signs. The supplier shall maintain a permanent record of the dates on which stockpiles are completed and controlled aging begun, of the dates when controlled aging was completed, and of the dates tests were made and the results of these tests. Moisture tests shall be made at least once each week. No credit for aging will be given for the time period covered by tests which show a moisture content of 6 percent or less. The stockpiles and records shall be available to the Engineer during normal working hours for inspection, check testing and review.

The supplier shall notify the Transportation Laboratory, 5900 Folsom Boulevard, Sacramento, California 95819, when each stockpile is completed and controlled aging begun. No more aggregate shall be added to the stockpile unless a new aging period is initiated. A further notification shall be sent when controlled aging is completed.

The supplier shall provide a Certificate of Compliance in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications. Each stockpile or portion of a stockpile that is used in the work will be considered a lot. The Certificates of Compliance shall state that the steel slag aggregate has been aged in a stockpile for at least 3 months at a moisture content in excess of 6 percent of the dry mass of the aggregate.

Steel slag used for imported borrow shall be weathered for at least 3 months. Prior to the use of steel slag as imported borrow, the supplier shall furnish a Certificate of Compliance in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications. The Certificate of Compliance shall state that the steel slag has been weathered for at least 3 months.

Each delivery of aggregate containing steel slag for use as aggregate subbase or Class 2 aggregate base shall be accompanied by a delivery tag for each load which will identify the lot of material by stockpile number, where the slag was aged, and the date that the stockpile was completed and controlled aging begun.

Air-cooled iron blast furnace slag or natural aggregate may be blended in proper combinations with steel slag aggregate to produce the specified gradings, for those items for which steel slag aggregate is permitted, unless otherwise provided.

Aggregate containing slag shall meet the applicable quality requirements for the items in which the aggregate is used.

The combined slag aggregate shall conform to the specified grading for the item in which it is used. The grading will be determined by California Test 202, modified by California Test 105 when there is a difference in specific gravity of 0.2 or more between the coarse and fine portion of the aggregate or between blends of different aggregates.

No aggregate produced from slag shall be placed within 0.3-m, measured in any direction, of a non-cathodically protected pipe or structure unless the aggregate is incorporated in portland cement concrete pavement, in asphalt concrete, or in treated base.

When slag is used as aggregate in asphalt concrete, the K_c factor requirements, as determined by California Test 303, will not apply.

Slag aggregate used for embankment construction shall not be placed within 0.46-m of finished slope lines, measured normal to the plane of the slope.

If steel slag aggregates are used to make asphalt concrete, there shall be no other aggregates used in the mixture, except that up to 50 percent of the material passing the 4.75-mm sieve may consist of iron blast furnace slag aggregates or natural aggregates, or a combination thereof. If iron blast furnace aggregates or natural aggregates or a combination thereof are used in the mix, each type of aggregate shall be fed to the drier at a uniform rate. The rate of feed of each type of aggregate shall be maintained within 10 percent of the amount set. Adequate means shall be provided for controlling and checking the accuracy of the feeder.

In addition to the requirements of Section 39-3.01, "Storage," of the Standard Specifications, steel slag aggregate shall be stored separately from iron blast furnace slag aggregate and each type of slag aggregate shall also be stored separately from natural aggregate.

Asphalt concrete produced from more than one of the following shall not be placed in the same layer: steel slag aggregates, iron blast furnace slag aggregates, natural aggregates or any combination thereof. Once a type of aggregate or aggregates is selected, it shall not be changed without prior approval by the Engineer.

If steel slag aggregates are used to produce asphalt concrete, and if the specific gravity of a compacted stabilometer test specimen is in excess of 2.40, the quantity of asphalt concrete to be paid for will be reduced. The stabilometer test specimen will be fabricated in conformance with the procedures in California Test 304 and the specific gravity of the specimen will be determined in conformance with Method C of California Test 308. The pay quantity of asphalt concrete will be determined by multiplying the quantity of asphalt concrete placed in the work by 2.40 and dividing the result by the specific gravity of the compacted stabilometer test specimen. Such reduction in quantity will be determined and applied as often as is necessary to ensure accurate results as determined by the Engineer.

8-1.05 ENGINEERING FABRICS

Engineering fabrics shall conform to the provisions in Section 88, "Engineering Fabrics," of the Standard Specifications and these special provisions.

Filter fabric for this project shall be ultraviolet (UV) ray protected.

SECTION 8-2. CONCRETE

8-2.01 PORTLAND CEMENT CONCRETE

Portland cement concrete shall conform to the provisions in Section 90, "Portland Cement Concrete," of the Standard Specifications and these special provisions.

References to Section 90-2.01, "Portland Cement," of the Standard Specifications shall mean Section 90-2.01, "Cement," of the Standard Specifications.

Mineral admixture shall be combined with cement in conformance with the provisions in Section 90-4.08, "Required Use of Mineral Admixtures," of the Standard Specifications for the concrete materials specified in Section 56-2, "Roadside Signs," of the Standard Specifications.

The requirements of Section 90-4.08, "Required Use of Mineral Admixture," of the Standard Specifications shall not apply to Section 19-3.025C, "Soil Cement Bedding," of the Standard Specifications.

The Department maintains a list of sources of fine and coarse aggregate that have been approved for use with a reduced amount of mineral admixture in the total amount of cementitious material to be used. A source of aggregate will be considered for addition to the approved list if the producer of the aggregate submits to the Transportation Laboratory certified test results from a qualified testing laboratory that verify the aggregate complies with the requirements. Prior to starting the testing, the aggregate test shall be registered with the Department. A registration number can be obtained by calling (916) 227-7228. The registration number shall be used as the identification for the aggregate sample in correspondence with the Department. Upon request, a split of the tested sample shall be provided to the Department. Approval of aggregate will depend upon compliance with the specifications, based on the certified test results submitted, together with any replicate testing the Department may elect to perform. Approval will expire 3 years from the date the most recent registered and evaluated sample was collected from the aggregate source.

Qualified testing laboratories shall conform to the following requirements:

- A. Laboratories performing ASTM Designation: C 1293 shall participate in the Cement and Concrete Reference Laboratory (CCRL) Concrete Proficiency Sample Program and shall have received a score of 3 or better on all tests of the previous 2 sets of concrete samples.
- B. Laboratories performing ASTM Designation: C 1260 shall participate in the Cement and Concrete Reference Laboratory (CCRL) Pozzolan Proficiency Sample Program and shall have received a score of 3 or better on the shrinkage and soundness tests of the previous 2 sets of pozzolan samples.

Aggregates on the list shall conform to one of the following requirements:

- A. When the aggregate is tested in conformance with the requirements in California Test 554 and ASTM Designation: C 1293, the average expansion at one year shall be less than or equal to 0.040 percent; or
- B. When the aggregate is tested in conformance with the requirements in California Test 554 and ASTM Designation: C 1260, the average of the expansion at 16 days shall be less than or equal to 0.15 percent.

The amounts of cement and mineral admixture used in cementitious material shall be sufficient to satisfy the minimum cementitious material content requirements specified in Section 90-1.01, "Description," or Section 90-4.05, "Optional Use of Chemical Admixtures," of the Standard Specifications and shall conform to the following:

- A. The minimum amount of cement shall not be less than 75 percent by mass of the specified minimum cementitious material content.
- B. The minimum amount of mineral admixture to be combined with cement shall be determined using one of the following criteria:
 1. When the calcium oxide content of a mineral admixture is equal to or less than 2 percent by mass, the amount of mineral admixture shall not be less than 15 percent by mass of the total amount of cementitious material to be used in the mix.
 2. When the calcium oxide content of a mineral admixture is greater than 2 percent by mass, and any of the aggregates used are not listed on the approved list as specified in these special provisions, then the amount of mineral admixture shall not be less than 25 percent by mass of the total amount of cementitious material to be used in the mix.
 3. When the calcium oxide content of a mineral admixture is greater than 2 percent by mass and the fine and coarse aggregates are listed on the approved list as specified in these special provisions, then the amount of mineral admixture shall not be less than 15 percent by mass of the total amount of cementitious material to be used in the mix.
 4. When a mineral admixture that conforms to the provisions for silica fume in Section 90-2.04, "Admixture Materials," of the Standard Specifications is used, the amount of mineral admixture shall not be less than 10 percent by mass of the total amount of cementitious material to be used in the mix.
 5. When a mineral admixture that conforms to the provisions for silica fume in Section 90-2.04, "Admixture Materials," of the Standard Specifications is used and the fine and coarse aggregates are listed on the approved

list as specified in these special provisions, then the amount of mineral admixture shall not be less than 7 percent by mass of the total amount of cementitious material to be used in the mix.

- C. The total amount of mineral admixture shall not exceed 35 percent by mass of the total amount of cementitious material to be used in the mix. Where Section 90-1.01, "Description," of the Standard Specifications specifies a maximum cementitious content in kilograms per cubic meter, the total mass of cement and mineral admixture per cubic meter shall not exceed the specified maximum cementitious material content.

The Contractor will be permitted to use Type III portland cement for concrete used in the manufacture of precast concrete members.

8-2.02 CEMENT AND AIR CONTENT

Except for concrete listed below, all concrete which is designated as Class 2 and all concrete for use in structures shall contain not less than 375 kg of cementitious material per cubic meter and shall be air-entrained as provided in Section 90-4, "Admixtures," of the Standard Specifications. The air content at time of mixing and prior to placing shall be 3 percent \pm one percent.

- A. Paving concrete.
- B. Concrete designated by 28-day compressive strength.
- C. Concrete designated as Class 1 or by a cementitious material content which exceeds 375 kg/m³.
- D. Seal course concrete.
- E. Concrete for deck slabs of bridges and structure approach slabs.
- F. Concrete for piling.

8-2.03 PRECAST CONCRETE QUALITY CONTROL

GENERAL

Precast concrete quality control shall conform to these special provisions.

Unless otherwise specified, precast concrete quality control shall apply when any precast concrete members are fabricated in conformance with the provisions in Section 49, "Piling," or Section 51, "Concrete Structures," of the Standard Specifications.

Quality Control (QC) shall be the responsibility of the Contractor. The Contractor's QC inspectors shall perform inspection and testing prior to precasting, during precasting, and after precasting, and as specified in this section and additionally as necessary to ensure that materials and workmanship conform to the details shown on the plans and specifications.

Quality Assurance (QA) is the prerogative of the Engineer. Regardless of the acceptance for a given precast element by the Contractor, the Engineer will evaluate the precast element. The Engineer will reject any precast element that does not conform to the approved Precast Concrete Quality Control Plan (PCQCP), the details shown on the plans, and these special provisions.

The Contractor shall designate in writing a precast Quality Control Manager (QCM) for each precasting facility. The QCM shall be responsible directly to the Contractor for the quality of precasting, including materials and workmanship, performed by the Contractor and all subcontractors. The QCM shall be the sole individual responsible to the Contractor for submitting, receiving, and approving all correspondence, required submittals, and reports to and from the Engineer. The QCM shall not be employed or compensated by any subcontractor, or other persons or entities hired by subcontractors, or suppliers, who will provide other services or materials for the project. The QCM may be an employee of the Contractor.

Prior to submitting the PCQCP required herein, a meeting between the Engineer, the Contractor's QCM, and a representative from each entity performing precast concrete operations for this project, shall be held to discuss the requirements for precast quality control.

QC Inspectors shall either be 1) licensed as Civil Engineers in the State of California, or 2) have a current Plant Quality Personnel Certification, Level II, from the Precast/Prestressed Concrete Institute. A QC Inspector shall witness all precast concrete operations.

PRECAST CONCRETE QUALIFICATION AUDIT

Unless otherwise specified, no Contractors or subcontractors performing precast concrete operations for the project shall commence work without having successfully completed the Department's Precast Fabrication Qualification Audit, hereinafter referred to as the audit. The Engineer will perform the audit, and copies of the audit form, along with procedures for requesting and completing the audit, are available at the Transportation Laboratory or the following website:

<http://www.dot.ca.gov/hq/esc/Translab/smbresources.htm>

An audit that was previously approved by the Engineer no more than three years prior to the beginning of work on this contract will be acceptable for the entire period of this contract, provided the Engineer determines the audit is for the same type of work that is to be performed on this contract.

Successful completion of an audit shall not relieve the Contractor of the responsibility for furnishing materials or producing finished work of the quality specified in these special provisions and as shown on the plans.

PRECAST CONCRETE QUALITY CONTROL PLAN

Prior to performing any precasting operations, the Contractor shall submit to the Engineer, in conformance with the provisions in Section 5-1.02, "Plans and Working Drawings," of the Standard Specifications, 3 copies of a separate PCQCP for each item of work which is to be precast. A separate PCQCP shall be submitted for each facility. As a minimum, each PCQCP shall include the following:

- A. The name of the precasting firm, the concrete plants to be used, and any concrete testing firm to be used;
- B. A manual prepared by the precasting firm that includes equipment, testing procedures, safety plan, and the names, qualifications, and documentation of certifications for all personnel to be used;
- C. The name of the QCM and the names, qualifications, and documentation of certifications for all QC inspection personnel to be used;
- D. An organizational chart showing all QC personnel and their assigned QC responsibilities;
- E. The methods and frequencies for performing all required quality control procedures, including all inspections, material testing, and any required survey procedures for all components of the precast elements including prestressing systems, concrete, grout, reinforcement, steel components embedded or attached to the precast member, miscellaneous metal, and formwork;
- F. A system for identification and tracking of required precast element repairs, and a procedure for the re-inspection of any repaired precast element. The system shall have provisions for a method of reporting nonconforming precast elements to the Engineer; and
- G. Forms to be used for Certificates of Compliance, daily production logs, and daily reports.

The Engineer shall have 4 weeks to review the PCQCP submittal after a complete plan has been received. No precasting shall be performed until the PCQCP is approved in writing by the Engineer.

A PCQCP that was previously approved by the Engineer no more than one year prior to the beginning of work on this contract will be acceptable for the entire period of this contract, provided the Engineer determines the PCQCP is for the same type of work that is to be performed on this contract.

An amended PCQCP or addendum shall be submitted to, and approved in writing by the Engineer, for any proposed revisions to the approved PCQCP. An amended PCQCP or addendum will be required for any revisions to the PCQCP, including but not limited to changes in concrete plants or source materials, changes in material testing procedures and testing labs, changes in procedures and equipment, changes in QC personnel, or updated systems for tracking and identifying precast elements. The Engineer shall have 2 weeks to complete the review of the amended PCQCP or addendum, once a complete submittal has been received. Work that is affected by any of the proposed revisions shall not be performed until the amended PCQCP or addendum has been approved.

After final approval of the PCQCP, amended PCQCP, or addendum, the Contractor shall submit 7 copies to the Engineer of each of these approved documents.

It is expressly understood that the Engineer's approval of the Contractor's PCQCP shall not relieve the Contractor of any responsibility under the contract for the successful completion of the work in conformance with the requirements of the plans and specifications. The Engineer's approval shall neither constitute a waiver of any of the requirements of the plans and specifications nor relieve the Contractor of any obligation thereunder, and defective work, materials, and equipment may be rejected notwithstanding approval of the PCQCP.

REPORTING

The QC Inspector shall provide reports to the QCM on a daily basis for each day that precasting operations are performed.

A daily production log for precasting shall be kept by the QCM for each day that precasting operations, including setting forms, placing reinforcement, setting prestressing steel, casting, curing, post tensioning, and form release, are performed. The log shall include the facility location, and shall include specific description of casting or related operations, any problems or deficiencies discovered, any testing or repair work performed, and the names of all QC personnel and the specific QC inspections they performed that day. The daily report from each QC Inspector shall also be included in the log. This daily log shall be available for viewing by the Engineer, at the precasting facility.

All reports regarding material tests and any required survey checks shall be signed by the person that performed the test or check, and then submitted directly to the QCM for review and signature prior to submittal to the Engineer. Corresponding names shall be clearly printed or typewritten next to all signatures.

The Engineer shall be notified immediately in writing when any precasting problems or deficiencies are discovered and also of the proposed repair or process changes required to correct them. The Engineer shall have 4 weeks to review these procedures. No remedial work shall begin until the Engineer approves these procedures in writing.

The following items shall be included in a Precast Report that is to be submitted to the Engineer following the completion of any precast element:

- A. Reports of all material tests and any required survey checks;
- B. Documentation that the Contractor has evaluated all tests and corrected all rejected deficiencies, and all repairs have been re-examined with the required tests and found acceptable; and
- C. Daily production log.

At the completion of any precast element, and if the QCM determines that element is in conformance with these special provisions, the QCM shall sign and furnish to the Engineer, a certificate of compliance in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications. This certificate of compliance shall be submitted with the Precast Report. The certificate shall state that all of the materials and workmanship incorporated in the work, and all required tests and inspections of this work, have been performed in conformance with the details shown on the plans and the provisions of the Standard Specifications and these special provisions.

PAYMENT

In the event the Engineer fails to complete the review of 1) a PCQCP, 2) an amended PCQCP or addendum, or 3) a proposed repair or process change, within the time allowed, and if, in the opinion of the Engineer, completion of the work is delayed or interfered with by reason of the Engineer's delay in completing the review, the Contractor will be compensated for any resulting loss, and an extension of time will be granted, in the same manner as provided for in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

All required repair work or process changes required to correct precasting operation deficiencies, whether discovered by the QCM, QC Inspector, or by the Engineer, and any associated delays or expenses to the Contractor caused by performing these repairs, shall be at the Contractor's expense.

Full compensation for conforming to the requirements of this section shall be considered as included in the contract prices paid for the various items of work involved, and no additional compensation will be allowed therefor.

SECTION 8-3. WELDING

8-3.01 WELDING

GENERAL

Flux core welding electrodes conforming to the requirements of AWS A5.20 E6XT-4 or E7XT-4 shall not be used to perform welding for this project.

Wherever reference is made to the following AWS welding codes in the Standard Specifications, on the plans, or in these special provisions, the year of adoption for these codes shall be as listed:

AWS Code	Year of Adoption
D1.1	2002
D1.4	1998
D1.5	2002
D1.6	1999

Requirements of the AWS welding codes shall apply unless specified otherwise in the Standard Specifications, on the plans, or in these special provisions. Wherever the abbreviation AWS is used, it shall be equivalent to the abbreviations ANSI/AWS or AASHTO/AWS.

Section 6.1.1.1 of AWS D1.5 is replaced with the following:

Quality Control (QC) shall be the responsibility of the Contractor. As a minimum, the Contractor shall perform inspection and testing of each weld joint prior to welding, during welding, and after welding as specified in this section and as necessary to ensure that materials and workmanship conform to the requirements of the contract documents.

Sections 6.1.3 through 6.1.4.3 of AWS D1.1, Section 7.1.2 of AWS D1.4, and Sections 6.1.1.2 through 6.1.3.3 of AWS D1.5 are replaced with the following:

The QC Inspector shall be the duly designated person who acts for and on behalf of the Contractor for inspection, testing, and quality related matters for all welding.

Quality Assurance (QA) is the prerogative of the Engineer. The QA Inspector is the duly designated person who acts for and on behalf of the Engineer.

The QC Inspector shall be responsible for quality control acceptance or rejection of materials and workmanship, and shall be currently certified as an AWS Certified Welding Inspector (CWI) in conformance with the requirements in AWS QC1, "Standard for AWS Certification of Welding Inspectors."

The QC Inspector may be assisted by an Assistant QC Inspector provided that this individual is currently certified as an AWS Certified Associate Welding Inspector (CAWI) in conformance with the requirements in AWS QC1, "Standard for AWS Certification of Welding Inspectors." The Assistant QC Inspector may perform inspection under the direct supervision of the QC Inspector provided the Assistant is always within visible and audible range of the QC Inspector. The QC Inspector shall be responsible for signing all reports and for determining if welded materials conform to workmanship and acceptance criteria. The ratio of QC Assistants to QC Inspectors shall not exceed 5 to 1.

When the term "Inspector" is used without further qualification, it shall refer to the QC Inspector.

Section 6.14.6, "Personnel Qualification," of AWS D1.1, Section 7.8, "Personnel Qualification," of AWS D1.4, and Section 6.1.3.4, "Personnel Qualification," of AWS D1.5 are replaced with the following:

Personnel performing nondestructive testing (NDT) shall be qualified and certified in conformance with the requirements of the American Society for Nondestructive Testing (ASNT) Recommended Practice No. SNT-TC-1A and the Written Practice of the NDT firm. The Written Practice of the NDT firm shall meet or exceed the guidelines of the ASNT Recommended Practice No. SNT-TC-1A. Individuals who perform NDT, review the results, and prepare the written reports shall be either:

- A. Certified NDT Level II technicians, or;
- B. Level III technicians who hold a current ASNT Level III certificate in that discipline and are authorized and certified to perform the work of Level II technicians.

Section 6.5.4 of AWS D1.5 is replaced with the following:

The QC Inspector shall inspect and approve each joint preparation, assembly practice, welding technique, joint fit-up, and the performance of each welder, welding operator, and tack welder to make certain that the applicable requirements of this code and the approved Welding Procedure Specification (WPS) are met. The QC Inspector shall examine the work to make certain that it meets the requirements of Sections 3 and 6.26. The size and contour of all welds shall be measured using suitable gages. Visual inspection for cracks in welds and base metal, and for other discontinuities should be aided by strong light magnifiers, or such other devices as may be helpful. Acceptance criteria different from those specified in this code may be used when approved by the Engineer.

Section 6.6.5, "Nonspecified NDT Other than Visual," of AWS D1.1, Section 6.6.5 of AWS D1.4 and Section 6.6.5 of AWS D1.5 shall not apply.

For any welding, the Engineer may direct the Contractor to perform NDT that is in addition to the visual inspection or NDT specified in the AWS or other specified welding codes, in the Standard Specifications, or in these special provisions. Additional NDT required by the Engineer will be paid for as extra work as provided in Section 4-1.03D, "Extra Work," of the Standard Specifications. Should any welding deficiencies be discovered by this additional NDT, all costs associated with the repair of the deficient area, including NDT of the weld and of the weld repair, and any delays caused by the repair, shall be at the Contractor's expense.

Repair work to correct welding deficiencies discovered by visual inspection or NDT, or by additional NDT directed or performed by the Engineer, and any associated delays or expenses caused to the Contractor by performing these repairs, shall be at the Contractor's expense.

The Engineer shall have the authority to verify the qualifications or certifications of any welder, QC Inspector, or NDT personnel to specified levels by retests or other means approved by the Engineer.

Continuous inspection shall be provided when any welding is being performed. Continuous inspection, as a minimum, shall include having a QC Inspector within such close proximity of all welders or welding operators so that inspections by the QC Inspector of each welding operation at each welding location shall not lapse for a period exceeding 30 minutes.

Inspection and approval of all joint preparations, assembly practices, joint fit-ups, welding techniques, and the performance of each welder, welding operator, and tack welder shall be documented by the QC Inspector on a daily basis for

each day welding is performed. For each inspection, including fit-up, Welding Procedure Specification (WPS) verification, and final weld inspection, the QC Inspector shall confirm and document compliance with the requirements of the AWS or other specified code criteria and the requirements of these special provisions on all welded joints before welding, during welding, and after the completion of each weld.

When joint weld details that are not prequalified to the details of Section 3 of AWS D1.1 or to the details of Figure 2.4 or 2.5 of AWS D1.5 are proposed for use in the work, the joint details, their intended locations, and the proposed welding parameters and essential variables, will be approved by the Engineer. The Engineer shall have 2 weeks to complete the review of the proposed joint detail locations. In the event the Engineer fails to complete the review within the time allowed, and if, in the opinion of the Engineer, completion of the work is delayed or interfered with by reason of the Engineer's delay in completing the review, the Contractor will be compensated for any resulting loss, and an extension of time will be granted, in the same manner as provided for in Section 8-1.09, "Right of Way Delays," of the Standard Specifications. Upon approval of the proposed joint detail locations and qualification of the proposed joint details, welders and welding operators using these details shall perform a qualification test plate using the WPS variables and the joint detail to be used in production. The test plate shall have the maximum thickness to be used in production and a minimum length of 180 mm and minimum finish welded width 460 mm. The test plate shall be mechanically and radiographically tested. Mechanical and radiographic testing and acceptance criteria shall be as specified in the applicable AWS codes.

In addition to the requirements specified in the applicable code, the period of effectiveness for a welder's or welding operator's qualification shall be a maximum of 3 years for the same weld process, welding position, and weld type. If production welding will be performed without gas shielding, then qualification shall also be without gas shielding. Excluding welding of fracture critical members, a valid qualification at the beginning of work on a contract will be acceptable for the entire period of the contract, as long as the welder's or welding operator's work remains satisfactory.

The Engineer will witness all qualification tests for WPSs that were not previously approved by the Department. An approved independent third party will witness the qualification tests for welders or welding operators. The independent third party shall be a current CWI and shall not be employed by the contractor performing the welding. The Engineer shall have 2 weeks to review the qualifications and copy of the current certification of the independent third party. In the event the Engineer fails to complete the review within the time allowed, and if, in the opinion of the Engineer, completion of the work is delayed or interfered with by reason of the Engineer's delay in completing the review, the Contractor will be compensated for any resulting loss, and an extension of time will be granted, in the same manner as provided for in Section 8-1.09, "Right of Way Delays," of the Standard Specifications. The Contractor shall notify the Engineer one week prior to performing any qualification tests. Witnessing of qualification tests by the Engineer shall not constitute approval of the intended joint locations, welding parameters, or essential variables.

In addition to the requirements of AWS D1.5 Section 5.12 or 5.13, welding procedures qualification, for work welded in conformance with that code, shall conform to the following requirements:

- A. Unless considered prequalified, fillet welds, including reinforcing fillet welds, shall be qualified in each position. The fillet weld soundness test shall be conducted using the essential variables of the WPS as established by the Procedure Qualification Record (PQR.)
- B. For qualification of joints that do not conform to Figures 2.4 and 2.5 of AWS D1.5, two WPS qualification tests are required. The tests conforming to AWS D1.5 Section 5.13 shall be conducted using both Figure 5.1 and Figure 5.3. The test conforming to Figure 5.3 shall be conducted using the same welding electrical parameters that were established for the test conducted conforming to Figure 5.1.
- C. The travel speed, current, and voltage values that are used for tests conducted per AWS D1.5 Section 5.12 or 5.13 shall be consistent for each weld joint, and shall in no case vary by more than 10 percent for travel speed, 10 percent for current, and 7 percent for voltage.
- D. For a WPS qualified in conformance with AWS D1.5 Section 5.13, the values to be used for calculating ranges for current and voltage shall be based on the average of all weld passes made in the test. Heat input shall be calculated using the average of current and voltage of all weld passes made in the test for a WPS qualified in conformance with Section 5.12 or 5.13.
- E. To qualify for unlimited material thickness, two qualification tests are required for WPSs utilized for welding material thicknesses greater than 38 mm. One test shall be conducted using 20-mm thick test plates, and one test shall be conducted using test plates with a thickness between 38 mm and 50 mm. Two maximum heat input tests may be conducted for unlimited thickness qualification.
- F. Macroetch tests are required for WPS qualification tests, and acceptance shall be per AWS D1.5 Section 5.19.3.
- G. When a weld joint is to be made using a combination of qualified WPSs, each process shall be qualified separately.
- H. When a weld joint is to be made using a combination of qualified and prequalified processes, the WPS shall reflect both processes and the limitations of essential variables, including weld bead placement, for both processes.
- I. Prior to preparing mechanical test specimens, the PQR welds shall be inspected by visual and radiographic tests. Backing bar shall be 75 mm in width and shall remain in place during NDT testing. Results of the visual and

radiographic tests shall comply with AWS D1.5 Section 6.26.2, excluding Section 6.26.2.2. Test plates that do not comply with both tests shall not be used.

WELDING QUALITY CONTROL

Welding quality control shall conform to the requirements in the AWS or other specified welding codes, the Standard Specifications, and these special provisions.

Unless otherwise specified, welding quality control shall apply when any work is welded in conformance with the provisions in Section 49, "Piling," Section 52, "Reinforcement," Section 55, "Steel Structures," or Section 75-1.035, "Bridge Joint Restrainer Units," of the Standard Specifications.

The welding of fracture critical members (FCMs) shall conform to the provisions specified in the Fracture Control Plan (FCP) and herein.

The Contractor shall designate in writing a welding Quality Control Manager (QCM). The QCM shall be responsible directly to the Contractor for the quality of welding, including materials and workmanship, performed by the Contractor and subcontractors.

The QCM shall be the sole individual responsible to the Contractor for submitting, receiving, reviewing, and approving all correspondence, required submittals, and reports to and from the Engineer. The QCM shall be a registered professional engineer or shall be currently certified as a CWI or a CAWI.

The QCM shall not be employed or compensated by any subcontractor, or by other persons or entities hired by subcontractors, who will provide other services or materials for the project. The QCM may be an employee of the Contractor.

Welding inspection personnel or NDT firms to be used in the work shall not be employed or compensated by any subcontractor, or by other persons or entities hired by subcontractors, who will provide other services or materials for the project, except for the following conditions:

- A. The work is welded in conformance with AWS D1.5 and is performed at a permanent fabrication or manufacturing facility which is certified under the AISC Quality Certification Program, Category Cbr, Major Steel Bridges and Fracture Critical endorsement F.
- B. The welding is performed on pipe pile material at a permanent pipe manufacturing facility authorized to apply the American Petroleum Institute (API) monogram for API 5L pipe.

For welding performed at such facilities, the inspection personnel or NDT firms may be employed or compensated by the facility performing the welding.

Prior to submitting the Welding Quality Control Plan (WQCP) required herein, a pre-welding meeting between the Engineer, the Contractor's QCM, and a representative from each entity performing welding or inspection for this project, shall be held to discuss the requirements for the WQCP.

The Contractor shall submit to the Engineer, in conformance with the provisions in Section 5-1.02, "Plans and Working Drawings," of the Standard Specifications, 2 copies of a separate WQCP for each subcontractor or supplier for each item of work for which welding is to be performed.

The Contractor shall allow the Engineer 2 weeks to review the WQCP submittal after a complete plan has been received. No welding shall be performed until the WQCP is approved in writing by the Engineer. In the event the Engineer fails to complete the review within the time allowed, and if, in the opinion of the Engineer, completion of the work is delayed or interfered with by reason of the Engineer's delay in completing the review, the Contractor will be compensated for any resulting loss, and an extension of time will be granted, in the same manner as provided for in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

An amended WQCP or any addendum to the approved WQCP shall be submitted to, and approved in writing by the Engineer, for proposed revisions to the approved WQCP. An amended WQCP or addendum will be required for revisions to the WQCP, including but not limited to a revised WPS; additional welders; changes in NDT firms, QC, or NDT personnel or procedures; or updated systems for tracking and identifying welds. The Engineer shall have 1 week to complete the review of the amended WQCP or addendum. Work affected by the proposed revisions shall not be performed until the amended WQCP or addendum has been approved. In the event the Engineer fails to complete the review within the time allowed, and if, in the opinion of the Engineer, completion of the work is delayed or interfered with by reason of the Engineer's delay in completing the review, the Contractor will be compensated for any resulting loss, and an extension of time will be granted, in the same manner as provided for in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

Information regarding the contents, format, and organization of a WQCP, is available at the Transportation Laboratory or the following website:

<http://www.dot.ca.gov/hq/esc/Translab/smbresources.htm>

After final approval of the WQCP, amended WQCP, or addendum, the Contractor shall submit 7 copies to the Engineer of the approved documents. A copy of the Engineer approved document shall be available at each location where welding is to be performed.

A daily production log for welding shall be kept for each day that welding is performed. The log shall clearly indicate the locations of all welding. The log shall include the welders' names, amount of welding performed, any problems or deficiencies discovered, and any testing or repair work performed, at each location. The daily report from each QC Inspector shall also be included in the log.

The following items shall be included in a Welding Report that is to be submitted to the Engineer within 10 days following the performance of any welding:

- A. Reports of all visual weld inspections and NDT.
- B. Radiographs and radiographic reports, and other required NDT reports.
- C. Documentation that the Contractor has evaluated all radiographs and other nondestructive tests and corrected all rejectable deficiencies, and all repaired welds have been reexamined by the required NDT and found acceptable.
- D. Daily production log.

The following information shall be clearly written on the outside of radiographic envelopes: name of the QCM, name of the nondestructive testing firm, name of the radiographer, date, contract number, complete part description, and all included weld numbers or a report number, as detailed in the WQCP. In addition, all innerleaves shall have clearly written on them the part description and all included weld numbers, as detailed in the WQCP.

Reports regarding NDT shall be signed by both the NDT technician and the person that performed the review, and then submitted directly to the QCM for review and signature prior to submittal to the Engineer. Corresponding names shall be clearly printed or typewritten next to all signatures.

The Engineer will review the Welding Report to determine if the Contractor is in conformance with the WQCP. Unless otherwise specified, the Engineer shall be allowed 10 days to review the report and respond in writing after a complete Welding Report has been received. Prior to receiving notification from the Engineer of the Contractor's conformance with the WQCP, the Contractor may encase in concrete or cover welds for which a Welding Report has been submitted. However, should the Contractor elect to encase or cover those welds prior to receiving notification from the Engineer, it is expressly understood that the Contractor shall not be relieved of the responsibility for incorporating material in the work that conforms to the requirements of the plans and specifications. Material not conforming to these requirements will be subject to rejection. Should the Contractor elect to wait to encase or cover welds pending notification by the Engineer, and in the event the Engineer fails to complete the review within the time allowed, and if, in the opinion of the Engineer, completion of the work is delayed or interfered with by reason of the Engineer's delay in completing the review, the Contractor will be compensated for any resulting loss, and an extension of time will be granted, in the same manner as provided for in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

The QC Inspector shall provide reports to the QCM on a daily basis for each day that welding is performed.

Except for noncritical weld repairs, the Engineer shall be notified immediately in writing when welding problems, deficiencies, base metal repairs, or any other type of repairs not submitted in the WQCP are discovered, and also of the proposed repair procedures to correct them. The Contractor shall allow the Engineer one week to review these procedures. No remedial work shall begin until the repair procedures are approved in writing by the Engineer. In the event the Engineer fails to complete the review within the time allowed, and if, in the opinion of the Engineer, completion of the work is delayed or interfered with by reason of the Engineer's delay in completing the review, the Contractor will be compensated for any resulting loss, and an extension of time will be granted, in the same manner as provided for in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

The QCM shall sign and furnish to the Engineer, a Certificate of Compliance in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications for each item of work for which welding was performed. The certificate shall state that all of the materials and workmanship incorporated in the work, and all required tests and inspections of this work, have been performed in conformance with the details shown on the plans, the Standard Specifications, and these special provisions.

WELDING FOR OVERHEAD SIGN AND POLE STRUCTURES

The Contractor shall meet the following requirements for any work welded in conformance with the provisions in Section 56-1, "Overhead Sign Structures," or Section 86-2.04, "Standards, Steel Pedestals and Posts," of the Standard Specifications.

Welding inspection personnel or NDT firms to be used in the work shall not be employed or compensated by any subcontractor, or by other persons or entities hired by subcontractors, who will provide other services or materials for the project, except for when the welding is performed at a permanent fabrication or manufacturing facility which is certified under the AISC Quality Certification Program, Category Sbd, Conventional Steel Building Structures.

Welding Qualification Audit

Contractors or subcontractors performing welding operations for overhead sign and pole structures shall not deliver materials to the project without having successfully completed the Department's "Manufacturing Qualification Audit for Overhead Sign and Pole Structures," hereinafter referred to as the audit, not more than one year prior to the delivery of the materials. The Engineer will perform the audit. Copies of the audit form, and procedures for requesting and completing the audit, are available at the Transportation Laboratory or the following website:

<http://www.dot.ca.gov/hq/esc/Translab/smbresources.htm>

An audit that was approved by the Engineer no more than one year prior to the beginning of work on this contract will be acceptable for the entire period of this contract, provided the Engineer determines the audit was for the same type of work that is to be performed on this contract.

Successful completion of an audit shall not relieve the Contractor of the responsibility for furnishing materials or producing finished work of the quality specified in these special provisions and as shown on the plans.

Welding Report

For work welded in conformance with the provisions in Section 56-1, "Overhead Sign Structures," or Section 86-2.04, "Standards, Steel Pedestals and Posts," of the Standard Specifications, a Welding Report shall be submitted in conformance with the provisions in "Welding Quality Control," of these special provisions.

PAYMENT

Full compensation for conforming to the requirements of "Welding" shall be considered as included in the contract prices paid for the various items of work involved and no additional compensation will be allowed therefor.

SECTION 9. DESCRIPTION OF BRIDGE WORK

The bridge work to be done consists, in general, of constructing the following structures:

NORTH COUNTY FAIR DAR (SOUTH)
(Bridge # 57-1196)

A reinforced concrete slab bridge.

NORTH COUNTY FAIR DAR (SOUTH)
RETAINING WALL # 446R (Bridge # 57-E0009)

A combination of Type 1 retaining wall and MSE wall structures

NORTH COUNTY FAIR DAR (SOUTH)
RETAINING WALL # 446L (Bridge # 57-E0010)

A combination of Type 1 retaining wall and MSE wall structures

NORTH COUNTY FAIR OC BR #57-0941
TIEBACK WALL (ABUT 1) (RW449L)

A tieback retaining wall

NORTH COUNTY FAIR OC BR #57-0941
TIEBACK WALL (ABUT 3) (RW449R)

A tieback retaining wall

VIA RANCHO PARKWAY OC BR #57-0623
TIEBACK WALL (ABUT 1) (RW444L)

A tieback retaining wall

VIA RANCHO PARKWAY OC BR #57-0623
TIEBACK WALL (ABUT 3) (RW444R)

A tieback retaining wall

NORTH COUNTY FAIR DAR (NORTH)
(Bridge # 57-1199)

A reinforced concrete slab bridge.

NORTH COUNTY FAIR DAR (NORTH)
RETAINING WALL # 450R (Bridge # 57-E0021)

A combination of Type 1 retaining wall and MSE wall structures

NORTH COUNTY FAIR DAR (NORTH)
RETAINING WALL # 450L (Bridge # 57-E0020)

A combination of Type 1 retaining wall and MSE wall structures

SECTION 10. CONSTRUCTION DETAILS

SECTION 10-1. GENERAL

10-1.00 CONSTRUCTION PROJECT INFORMATION SIGNS

Before any major physical construction work readily visible to highway users is started on this contract, the Contractor shall furnish and erect 2 Type 2 Construction Project Information signs at the locations designated by the Engineer.

The signs and overlays shall be of a type and material consistent with the estimated time of completion of the project and shall conform to the details shown on the plans.

The sign letters, border and the Department's construction logos shall conform to the colors (non-reflective) and details shown on the plans, and shall be on a white background (non-reflective). The colors blue and orange shall conform to PR Color Number 3 and Number 6, respectively, as specified in the Federal Highway Administration's Color Tolerance Chart.

The sign message to be used for fund types shall consist of the following, in the order shown:

FEDERAL HIGHWAY TRUST FUNDS
STATE HIGHWAY FUNDS

The sign message to be used for type of work shall consist of the following:

HIGHWAY CONSTRUCTION

The sign message to be used for the Year of Completion of Project Construction will be furnished by the Engineer. The Contractor shall furnish and install the "Year" sign overlay within 10 working days of notification of the year date to be used.

The letter sizes to be used shall be as shown on the plans. The information shown on the signs shall be limited to that shown on the plans.

The signs shall be kept clean and in good repair by the Contractor.

Upon completion of the work, the signs shall be removed and disposed of outside the highway right of way in conformance with the provisions in Section 7-1.13 of the Standard Specifications.

Full compensation for furnishing, erecting, maintaining, and removing and disposing of the construction project information signs shall be considered as included in the contract lump sum price paid for construction area signs and no additional compensation will be allowed therefor.

10-1.01 ORDER OF WORK

Order of work shall conform to the provisions in Section 5-1.05, "Order of Work," of the Standard Specifications and these special provisions.

Complete design of the various phases of the project will be provided to the Contractor in conformance with the provisions in Section 1, "Specifications and Plans," of these special provisions. Work in any phase of the project shall not begin until the complete design, including final plans, for that phase has been provided to the Contractor by the Engineer.

The work in any phase shall be performed in conformance with the stages of construction shown in the final plans for that phase. Nonconflicting work in subsequent stages within that phase may proceed concurrently with work in preceding stages, provided satisfactory progress is maintained in the preceding stages of construction.

Attention is directed to "Migratory Birds" and "Clearing and Grubbing" of these special provisions regarding notification requirements prior to the initiation of clearing and grubbing work.

Attention is directed to "Paleontology" of these special provisions regarding notification prior to any excavation.

At the completion of Stage 1C and when Stage 2 begins, the first order of work shall be to complete all median excavation, drainage and paving between stations 435+00 SD-15M and Station 445+00 SD-15R and SD-15L. Non-conflicting work may proceed concurrently provided progress is maintained adequately to assure completion of all median excavation, drainage and paving within 60 working days between stations 435+00 SD-15M and Station 445+00 SD-15R and SD-15. In the event satisfactory progress is not maintained, the Engineer may order suspension of the non-conflicting work.

The Contractor shall install the temporary fence (Type ESA) before beginning any grading work.

Prior to the initiation of earthwork operations, temporary construction entrances shall be installed. Attention is directed to "Temporary Construction Entrance" of these special provisions.

Temporary concrete washout facility shall be in place prior to the start of any concrete work. Attention is directed to "Temporary Concrete Washout Facility" of these special provisions.

Application of temporary erosion control (Type 1), temporary erosion control (Type 2), and erosion control (Type 1, Type 2 and Type 3) may require several move-in/move-outs (Temporary Erosion Control) (Erosion Control) of erosion control equipment. Attention is directed to "Move-In/Move-Out (Temporary Erosion Control)" and to "Move-In/Move-Out (Erosion Control)" of these special provisions.

Fiber rolls shall be in place after final grading of slope is complete. Attention is directed to "Water Pollution Control" of these special provisions.

Attention is directed to "Minor Concrete (Gore Paving)" of these special provisions regarding constructing a 1.25 m by 1.25 m test panel prior to beginning work on textured paving placing the permanent slope paving.

Construction of the preconstruction shotcrete test panels shall be first order of work when constructing the tieback walls.

Attention is directed to "Miscellaneous Concrete Construction" of these special provisions regarding constructing a 600 mm by 600 mm test panel prior to constructing curb ramps with detectable warning surfaces.

Attention is directed to "Architectural Surface (Textured Concrete)" of these special provisions regarding constructing a 1.25 m by 1.25 m test panel prior to beginning work on architectural texture.

Temporary railing (Type K), traffic plastic drums and temporary crash cushions shall be secured in place prior to commencing work for which the temporary railing, traffic plastic drums and crash cushions are required.

Attention is directed to "Jointed Plain Concrete Pavement" of these special provisions in regards to providing Preparing Conference, Just-In-Time Training, Test Strip and the Contractor furnishing tests and mix proportions for concrete pavement prior to commencing pavement replacement operations.

Attention is directed to "Environmentally Sensitive Area" and "Maintain Temporary Fence (Type ESA)" of these special provisions.

Attention is directed to "Water Pollution Control" of these special provisions regarding the submittal and approval of the "Storm Water Pollution Prevention Plan" prior to performing work having potential to cause water pollution.

The Contractor's attention is directed to the presence of Emergency Call Boxes within the limits of this project.

The Contractor shall notify the Engineer and the Operators of the facility 10 days prior to commencing work affecting access to the facilities in order to allow the removal or relocation of the emergency call boxes by the operator. The facility operators may be reached at the following:

Facility Operator	Telephone Number
TeleTran Tek Services	1-858-279-1299
Comarco Wireless Technologies	1-858-268-8260

Ten days prior to the completion of the work, affecting access to the facilities, the Contractor shall notify the Engineer and Operator of the emergency call boxes. The Contractor shall provide access to the operator for the installation of the emergency call boxes.

If, in the opinion of the Engineer, the Contractor's operations are delayed or interfered with, the State will compensate the Contractor for such delays to the extent provided in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

Full compensation for conforming to the provisions in this section shall be considered as included in the prices paid for the various contract items of work and no additional compensation will be allowed therefor.

Attention is directed to "Maintaining Traffic" and "Temporary Pavement Delineation" of these special provisions and to the stage construction sheets of the plans.

Attention is directed to "Progress Schedule (Critical Path Method)" of these special provisions regarding the submittal of a general time-scaled logic diagram within 10 days after approval of the contract. The diagram shall be submitted prior to performing any work that may be affected by any proposed deviations to the construction staging of the project.

The work shall be performed in conformance with the stages of construction shown on the plans. Nonconflicting work in subsequent stages may proceed concurrently with work in preceding stages, provided satisfactory progress is maintained in the preceding stages of construction.

In each stage, after completion of the preceding stage, the first order of work shall be the removal of existing pavement delineation as directed by the Engineer. Pavement delineation removal shall be coordinated with new delineation so that lane lines are provided at all times on traveled ways open to public traffic.

Before obliterating any pavement delineation (traffic stripes, pavement markings, and pavement markers) that is to be replaced on the same alignment and location, as determined by the Engineer, the pavement delineation shall be referenced by the Contractor, with a sufficient number of control points to reestablish the alignment and location of the new pavement delineation. The references shall include the limits or changes in striping pattern, including one- and 2-way barrier lines, limit lines, crosswalks and other pavement markings. Full compensation for referencing existing pavement delineation shall be considered as included in the contract prices paid for new pavement delineation and no additional compensation will be allowed therefor.

Prior to applying asphalt concrete, the Contractor shall cover all manholes, valve and monument covers, grates, or other exposed facilities located within the area of application, using a plastic or oil resistant construction paper secured to the facility being covered by tape or adhesive. The covered facilities shall be referenced by the Contractor, with a sufficient number of control points to relocate the facilities after the asphalt concrete, has been placed. After completion of the paving operation, all covers shall be removed and disposed of in a manner satisfactory to the Engineer. Full compensation for covering manholes, valve and monument covers, grates, or other exposed facilities, referencing, and removing temporary cover shall be considered as included in the contract price paid per tonne for asphalt concrete (Type A), and no additional compensation will be allowed therefor.

When traffic is moved from an established path to a new path and pavement delineation changes are required, all material and equipment needed for new delineation shall be at the site of the work before any shift of traffic is undertaken. The equipment shall be in good working condition.

At those locations exposed to public traffic where guard railings or barriers are to be constructed, or removed, the Contractor shall schedule operations so that at the end of each working day there shall be no post holes open nor shall there be any railing or barrier posts installed without the blocks and rail elements assembled and mounted thereon.

Some plants required for this project may not be readily available and may have to be grown specifically for this project. Within 30 days after the contract has been approved, the Contractor shall furnish the Engineer a statement from the vendor that the order for the plants to be grown for this contract, including inspection plants and replacement plants, has been received and accepted by the vendor. The statement from the vendor shall include the names, sizes, and quantities of plants ordered and the anticipated dates of delivery. The Contractor shall notify the Engineer, in writing, when the vendor has started to grow the plants.

Not less than 60 days prior to planting the plants, the Contractor shall furnish the Engineer a statement from the vendor that the order for the plants required for this contract, including inspection plants, has been received and accepted by the vendor. The statement from the vendor shall include the names, sizes, and quantities of plants ordered and the anticipated date of delivery.

The Contractor shall place orders for replacement plants with the vendor at the appropriate time so that the roots of the replacement plants are not in a root-bound condition.

Not less than 60 days prior to applying seeds, the Contractor shall furnish the Engineer a statement from the vendor that the order for the seed required for this contract has been received and accepted by the vendor. The statement from the vendor shall include the names and quantity of seed ordered and the anticipated date of delivery.

Attention is directed to "Irrigation Systems Functional Test" of these special provisions, regarding restrictions for planting operations.

Attention is directed to "Locate Existing Crossovers and Conduits" of these special provisions regarding locating existing irrigation water line crossovers and conduits shown on the plans to be incorporated in the new work. Existing irrigation water line crossovers and conduits shall be located prior to performing work on the irrigation system.

Unless otherwise shown on the plans or specified in these special provisions, conduits to be jacked or drilled or installed by the open trench method for water line crossovers and sprinkler control crossovers shall be installed prior to the installation of other pipe supply lines.

Attention is directed to "Existing Highway Irrigation Facilities" of these special provisions regarding the checking of existing irrigation facilities that are to remain in place, prior to the start of any irrigation work.

Clearing, grubbing, and earthwork operations shall not be performed in areas where existing irrigation facilities are to remain in place until existing irrigation facilities have been checked for proper operation in conformance with the provisions in "Existing Highway Irrigation Facilities" of these special provisions.

Attention is directed to Section 20-5.027B, "Wiring Plans and Diagrams," of the Standard Specifications regarding submittal of working drawings.

Attention is directed to "Irrigation Controller Enclosure Cabinet" of these special provisions regarding preinstalling irrigation components in the irrigation controller enclosure cabinet prior to field installation.

When embankment settlement periods or surcharge embankment settlement periods are specified, the settlement periods and the deferment of portions of the work shall comply with the provisions in Section 19-6.025, "Settlement Period," of the Standard Specifications and in "Earthwork" of these special provisions.

10-1.02 WATER POLLUTION CONTROL

Water pollution control work shall conform to the provisions in Section 7-1.01G, "Water Pollution," of the Standard Specifications and these special provisions.

This project lies within the boundaries of the San Diego Regional Water Quality Control Board (RWQCB).

The State Water Resources Control Board (SWRCB) has issued a permit to the Department which governs storm water and non-storm water discharges from its properties, facilities and activities. The Department's Permit is entitled: "Order No. 99-06-DWQ, NPDES No. CAS000003, National Pollutant Discharge Elimination System (NPDES) Permit, Storm Water Permit and Waste Discharge Requirements (WDRs) for the State of California, Department of Transportation Properties, Facilities, and Activities." Copies of the Department's Permit are available for review from the SWRCB, Storm Water Permit Unit, 1001 "I" Street, P.O. Box 1977, Sacramento, California 95812-1977, Telephone: (916) 341-5254, and may also be obtained from the SWRCB Internet website at: <http://www.swrcb.ca.gov/stormwtr/caltrans.html>.

The Department's Permit references and incorporates by reference the current Statewide General Permit issued by the SWRCB entitled "Order No. 99-08-DWQ, National Pollutant Discharge Elimination System (NPDES) General Permit No. CAS000002, Waste Discharge Requirements (WDRs) for Discharges of Storm Water Associated with Construction Activity," which regulates discharges of storm water and non-storm water from construction activities disturbing 0.4-hectare or more of soil in a common plan of development. Sampling and analysis requirements as specified in SWRCB Resolution No. 2001-46 are added to the Statewide General Permit. Copies of the Statewide General Permit and modifications thereto are available for review from the SWRCB, Storm Water Permit Unit, 1001 "I" Street, P.O. Box 1977, Sacramento, California 95812-1977, Telephone: (916) 341-5254 and may also be obtained from the SWRCB Internet website at: <http://www.swrcb.ca.gov/stormwtr/construction.html>.

The NPDES permits that regulate this project, as referenced above, are hereafter collectively referred to as the "Permits."

This project shall conform to the Permits and modifications thereto. The Contractor shall maintain copies of the Permits at the project site and shall make the Permits available during construction.

The Permits require the preparation of a Storm Water Pollution Prevention Plan (SWPPP). The SWPPP shall be prepared in conformance with the requirements of the Permits, the Department's "Storm Water Pollution Prevention Plan (SWPPP) and Water Pollution Control Program (WPCP) Preparation Manual," and the Department's "Construction Site Best Management Practices (BMPs) Manual," including addenda to those permits and manuals issued up to and including the date of advertisement of the project. These manuals are hereinafter referred to, respectively, as the "Preparation Manual" and the "Construction Site BMPs Manual," and collectively, as the "Manuals." Copies of the Manuals may be obtained from the Department of Transportation, Material Operations Branch, Publication Distribution Unit, 1900 Royal Oaks Drive, Sacramento, California 95815, Telephone: (916) 445-3520, and may also be obtained from the Department's Internet website at: <http://www.dot.ca.gov/hq/construc/stormwater/stormwater1.htm>.

The Contractor shall know and fully comply with applicable provisions of the Permits and all modifications thereto, the Manuals, and Federal, State, and local regulations and requirements that govern the Contractor's operations and storm water and non-storm water discharges from both the project site and areas of disturbance outside the project limits during construction. Attention is directed to Sections 7-1.01, "Laws to be Observed," and 7-1.12, "Indemnification and Insurance," of the Standard Specifications.

The Permits shall apply to storm water and certain permitted non-storm water discharges from areas outside the project site which are directly related to construction activities for this contract including, but not limited to, asphalt batch plants, material borrow areas, concrete plants, staging areas, storage yards and access roads. The Contractor shall comply with the Permits and the Manuals for those areas and shall implement, inspect and maintain the required water pollution control practices. The Engineer shall be allowed full access to these areas during construction to assure Contractor's proper implementation of water pollution control practices. Installing, inspecting and maintaining water pollution control practices on areas outside the highway right of way not specifically arranged and provided for by the Department for the execution of this contract, will not be paid for.

The Contractor shall be responsible for penalties assessed or levied on the Contractor or the Department as a result of the Contractor's failure to comply with the provisions in this section "Water Pollution Control" including, but not limited to, compliance with the applicable provisions of the Permits, the Manuals, and Federal, State and local regulations and requirements as set forth therein.

Penalties as used in this section, "Water Pollution Control," shall include fines, penalties and damages, whether proposed, assessed, or levied against the Department or the Contractor, including those levied under the Federal Clean Water Act and the State Porter-Cologne Water Quality Control Act, by governmental agencies or as a result of citizen suits. Penalties shall also include payments made or costs incurred in settlement for alleged violations of the Permits, the Manuals, or applicable laws, regulations, or requirements. Costs incurred could include sums spent instead of penalties, in mitigation or to remediate or correct violations.

RETENTION OF FUNDS

Notwithstanding any other remedies authorized by law, the Department may retain money due the Contractor under the contract, in an amount determined by the Department, up to and including the entire amount of Penalties proposed, assessed, or levied as a result of the Contractor's violation of the Permits, the Manuals, or Federal or State law, regulations or requirements. Funds may be retained by the Department until final disposition has been made as to the Penalties. The Contractor shall remain liable for the full amount of Penalties until such time as they are finally resolved with the entity seeking the Penalties.

Retention of funds for failure to conform to the provisions in this section, "Water Pollution Control," shall be in addition to the other retention amounts required by the contract. The amounts retained for the Contractor's failure to conform to provisions in this section will be released for payment on the next monthly estimate for partial payment following the date when an approved SWPPP has been implemented and maintained, and when water pollution has been adequately controlled, as determined by the Engineer.

When a regulatory agency identifies a failure to comply with the Permits and modifications thereto, the Manuals, or other Federal, State or local requirements, the Department may retain money due the Contractor, subject to the following:

- A. The Department will give the Contractor 30 days notice of the Department's intention to retain funds from partial payments which may become due to the Contractor prior to acceptance of the contract. Retention of funds from payments made after acceptance of the contract may be made without prior notice to the Contractor.
- B. No retention of additional amounts out of partial payments will be made if the amount to be retained does not exceed the amount being withheld from partial payments pursuant to Section 9-1.06, "Partial Payments," of the Standard Specifications.
- C. If the Department has retained funds, and it is subsequently determined that the State is not subject to the entire amount of the Costs and Liabilities assessed or proposed in connection with the matter for which the retention was made, the Department shall be liable for interest on the amount retained for the period of the retention. The interest rate payable shall be 6 percent per annum.

During the first estimate period that the Contractor fails to conform to the provisions in this section, "Water Pollution Control," the Department may retain an amount equal to 25 percent of the estimated value of the contract work performed.

The Contractor shall notify the Engineer immediately upon request from the regulatory agencies to enter, inspect, sample, monitor, or otherwise access the project site or the Contractor's records pertaining to water pollution control work. The Contractor and the Department shall provide copies of correspondence, notices of violation, enforcement actions or proposed fines by regulatory agencies to the requesting regulatory agency.

STORM WATER POLLUTION PREVENTION PLAN PREPARATION, APPROVAL AND AMENDMENTS

As part of the water pollution control work, a Storm Water Pollution Prevention Plan (SWPPP) is required for this contract. The SWPPP shall conform to the provisions in Section 7-1.01G, "Water Pollution," of the Standard Specifications, the requirements in the Manuals, the requirements of the Permits, and these special provisions. Upon the Engineer's approval of the SWPPP, the SWPPP shall be considered to fulfill the provisions in Section 7-1.01G, "Water Pollution," of the Standard Specifications for development and submittal of a Water Pollution Control Program.

No work having potential to cause water pollution, shall be performed until the SWPPP has been approved by the Engineer. Approval shall not constitute a finding that the SWPPP complies with applicable requirements of the Permits, the Manuals and applicable Federal, State and local laws, regulations, and requirements.

The Contractor shall designate a Water Pollution Control Manager. The Water Pollution Control Manager shall be responsible for the preparation of the SWPPP and required modifications or amendments, and shall be responsible for the implementation and adequate functioning of the various water pollution control practices employed. The Contractor may designate different Water Pollution Control Managers to prepare the SWPPP and to implement the water pollution control practices. The Water Pollution Control Managers shall serve as the primary contact for issues related to the SWPPP or its implementation. The Contractor shall submit to the Engineer a statement of qualifications, describing the training, previous work history and expertise of the individual selected by the Contractor to serve as Water Pollution Control Manager. The Water Pollution Control Manager shall have a minimum of 24 hours of formal storm water management training or certification as a Certified Professional in Erosion and Sediment Control (CPESC). The Engineer will reject the Contractor's submission of a Water Pollution Control Manager if the submitted qualifications are deemed to be inadequate.

The SWPPP shall apply to the areas within and those outside of the highway right of way that are directly related to construction operations including, but not limited to, asphalt batch plants, material borrow areas, concrete plants, staging areas, storage yards, and access roads.

The SWPPP shall incorporate water pollution control practices in the following categories:

- A. Soil stabilization.
- B. Sediment control.
- C. Wind erosion control.
- D. Tracking control.
- E. Non-storm water management.
- F. Waste management and materials pollution control.

The following contract items of work shall be incorporated into the SWPPP as "Temporary Water Pollution Control Practices": Temporary Erosion Control (Type 1), Temporary Erosion Control (Type 2), Temporary Erosion Control (Type 3), Temporary Erosion Control (Type 4), Temporary Concrete Washout Facility, Temporary Construction Entrance, Temporary Check Dam, Move-in/Move-Out (Temporary Erosion Control), Temporary Drainage Inlet Protection, and Street Sweeping.

The Contractor's attention is directed to the special provisions provided for Temporary Water Pollution Control Practices.

The following contract items of work, as shown on the project plans or as specified elsewhere in these special provisions, shall be identified in the SWPPP as permanent water pollution control practices: Fiber Rolls. These permanent water pollution control practices shall be constructed as specified in "Order of Work" of these special provisions, and utilized during the construction period. The Contractor shall maintain and protect the permanent water pollution control practices throughout the duration of the project and shall restore these controls to the lines, grades and condition shown on the plans prior to acceptance of the contract.

The SWPPP shall include, but not be limited to, the items described in the Manuals, Permits and related information contained in the contract documents. The SWPPP shall also include a copy of the following: Notification of Construction.

The Contractor shall develop and include in the SWPPP the Sampling and Analysis Plan(s) as required by the Permits, and modifications thereto, and as required in "Sampling and Analytical Requirements" of this section.

The Contractor shall develop a Water Pollution Control Schedule that describes the timing of grading or other work activities that could affect water pollution. The Water Pollution Control Schedule shall be updated by the Contractor to reflect changes in the Contractor's operations that would affect the necessary implementation of water pollution control practices.

The Contractor shall complete the "Construction Site BMPs Consideration Checklist" presented in the Preparation Manual and shall incorporate water pollution control practices into the SWPPP. Water pollution control practices include the "Minimum Requirements" and other Contractor-selected water pollution control practices from the "Construction Site BMPs Consideration Checklist" and the "Project-Specific Minimum Requirements" identified in the Water Pollution Control Cost Break-Down of this section.

Within 20 working days after the approval of the contract, the Contractor shall submit 3 copies of the draft SWPPP to the Engineer. The Engineer will have 10 working days to review the SWPPP. If revisions are required, as determined by the Engineer, the Contractor shall revise and resubmit the SWPPP within 10 working days of receipt of the Engineer's comments. The Engineer will have 5 working days to review the revisions. Upon the Engineer's approval of the SWPPP, 4 approved copies of the SWPPP, incorporating the required changes, shall be submitted to the Engineer. In order to allow construction activities to proceed, the Engineer may conditionally approve the SWPPP while minor revisions are being completed. In no case will the conditional approval of the SWPPP exceed 30 days. In the event the Engineer fails to complete the review within the time allowed, and if, in the opinion of the Engineer, completion of the work is delayed or interfered with by reason of the Engineer's delay in completing the review, the Contractor will be compensated for resulting losses, and an extension of time will be granted, in the same manner as provided for in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

The Contractor shall prepare an amendment to the SWPPP when there is a change in construction activities or operations which may affect the discharge of pollutants to surface waters, ground waters, municipal storm drain systems, or when the Contractor's activities or operations violate a condition of the Permits, or when directed by the Engineer. Amendments shall identify additional water pollution control practices or revised operations, including those areas or operations not identified in the initially approved SWPPP. Amendments to the SWPPP shall be prepared and submitted for review and approval within a time approved by the Engineer, but in no case longer than the time specified for the initial submittal and review of the SWPPP. At a minimum, the SWPPP shall be amended annually and submitted to the Engineer 25 days prior to the defined rainy season.

The Contractor shall keep one copy of the approved SWPPP and approved amendments at the project site. The SWPPP shall be made available upon request by a representative of the Regional Water Quality Control Board, State Water Resources Control Board, United States Environmental Protection Agency, or the local storm water management agency. Requests by the public shall be directed to the Engineer.

COST BREAK-DOWN

The Contractor shall include a Water Pollution Control Cost Break-Down in the SWPPP which itemizes the contract lump sum for water pollution control work. The Contractor shall use the Water Pollution Control Cost Break-Down provided in this section as the basis for the cost break-down submitted with the SWPPP. The Contractor shall use the Water Pollution Control Cost Break-Down to identify items, quantities and values for water pollution control work, excluding Temporary Water Pollution Control Practices for which there are separate bid items. The Contractor shall be responsible for the accuracy of the quantities and values used in the cost break-down submitted with the SWPPP. Partial payment for the item of water pollution control will not be made until the Water Pollution Control Cost Break-Down is approved by the Engineer.

Attention is directed to "Time-Related Overhead" of these special provisions regarding compensation for time-related overhead.

Line items indicated in the Water Pollution Control Cost Break-Down in this section with a specified Estimated Quantity shall be considered "Project-Specific Minimum Requirements." The Contractor shall incorporate Project-Specific Minimum Requirements with Contractor-designated quantities and values into the Water Pollution Control Cost Break-Down submitted with the SWPPP.

Line items indicated in the Water Pollution Control Cost Break-Down in this section without a specified Estimated Quantity shall be considered by the Contractor for selection to meet the applicable "Minimum Requirements" as defined in the Manuals, or for other water pollution control work as identified in the "Construction Site BMPs Consideration Checklist" presented in the Preparation Manual. In the Water Pollution Control Cost Break-Down submitted with the SWPPP, the Contractor shall list only those water pollution control practices selected for the project, including quantities and values required to complete the work for those items.

The sum of the amounts for the items of work listed in the Water Pollution Control Cost Break-Down shall be equal to the contract lump sum price bid for water pollution control. Overhead and profit, except for time-related overhead, shall be included in the individual items listed in the cost break-down.

WATER POLLUTION CONTROL COST BREAK-DOWN

Contract No. 11-080944

ITEM	ITEM DESCRIPTION	UNIT	ESTIMATED QUANTITY	VALUE	AMOUNT
SS-5	Soil Binders	M2			
SS-6	Straw Mulch	M2			
SS-7	Geotextiles, Plastic Covers & Erosion Control Blankets/Mats	M2			
SS-9	Earth Dikes/Drainage Swales & Lined Ditches	M			
SS-10	Outlet Protection/Velocity Dissipation Devices	EA			
SS-11	Slope Drains	EA			
SC-1	Silt Fence	M			
SC-6	Gravel Bag Berm	M			
SC-8	Sandbag Barrier	M			
SC-9	Straw Bale Barrier	M			
WE-1	Wind Erosion Control	LS			
TC-3	Entrance/Outlet Tire Wash	EA			
NS-1	Water Conservation Practices	LS			
NS-2	Dewatering Operations	EA			
NS-3	Paving and Grinding Operations	LS			
NS-6	Illicit Connection/Illegal Discharge Detection and Reporting	LS			
NS-7	Potable Water/Irrigation	LS			
NS-9	Vehicle and Equipment Fueling	LS			
NS-10	Vehicle and Equipment Maintenance	LS			
NS-11	Pile Drilling Operations	LS			
NS-12	Concrete Curing	LS			
NS-14	Concrete Finishing	LS			
WM-1	Material Delivery and Storage	LS			
WM-2	Material Use	LS			
WM-3	Stockpile Management	LS			
WM-4	Spill Prevention and Control	LS			
WM-5	Solid Waste Management	LS			
WM-6	Hazardous Waste Management	LS			

Contract No. 11-080944

ITEM	ITEM DESCRIPTION	UNIT	ESTIMATED QUANTITY	VALUE	AMOUNT
WM-7	Contaminated Soil Management	LS			
WM-9	Sanitary/Septic Waste Management	LS			
WM-10	Liquid Waste Management	LS			

TOTAL _____

Adjustments in the items of work and quantities listed in the approved cost break-down shall be made when required to address amendments to the SWPPP, except when the adjusted items are paid for as extra work.

No adjustment in compensation will be made to the contract lump sum price paid for water pollution control due to differences between the quantities shown in the approved cost break-down and the quantities required to complete the work as shown on the approved SWPPP. No adjustment in compensation will be made for ordered changes to correct SWPPP work resulting from the Contractor's own operations or from the Contractor's negligence.

The approved cost break-down will be used to determine partial payments during the progress of the work and as the basis for calculating the adjustment in compensation for the item of water pollution control due to increases or decreases of quantities ordered by the Engineer. When an ordered change increases or decreases the quantities of an approved cost break-down item, the adjustment in compensation will be determined in the same manner specified for increases and decreases in the quantity of a contract item of work in conformance with the provisions in Section 4-1.03B, "Increased or Decreased Quantities," of the Standard Specifications. If an ordered change requires a new item which is not on the approved cost break-down, the adjustment in compensation will be determined in the same manner specified for extra work in conformance with Section 4-1.03D, "Extra Work," of the Standard Specifications.

If requested by the Contractor and approved by the Engineer, changes to the water pollution control practices listed in the approved cost break-down, including addition of new water pollution control practices, will be allowed. Changes shall be included in the approved amendment of the SWPPP. If the requested changes result in a net cost increase to the lump sum price for water pollution control, an adjustment in compensation will be made without change to the water pollution control item. The net cost increase to the water pollution control item will be paid for as extra work as provided in Section 4-1.03D, "Extra Work," of the Standard Specifications.

SWPPP IMPLEMENTATION

Unless otherwise specified, upon approval of the SWPPP, the Contractor shall be responsible throughout the duration of the project for installing, constructing, inspecting, maintaining, removing, and disposing of the water pollution control practices specified in the SWPPP and in the amendments. Unless otherwise directed by the Engineer, the Contractor's responsibility for SWPPP implementation shall continue throughout temporary suspensions of work ordered in conformance with the provisions in Section 8-1.05, "Temporary Suspension of Work," of the Standard Specifications. Requirements for installation, construction, inspection, maintenance, removal, and disposal of water pollution control practices shall conform to the requirements in the Manuals and these special provisions.

If the Contractor or the Engineer identifies a deficiency in the implementation of the approved SWPPP or amendments, the deficiency shall be corrected immediately unless requested by the Contractor and approved by the Engineer in writing, but shall be corrected prior to the onset of precipitation. If the Contractor fails to correct the identified deficiency by the date agreed or prior to the onset of precipitation, the project shall be in nonconformance with this section, "Water Pollution Control." Attention is directed to Section 5-1.01, "Authority of Engineer," of the Standard Specifications, and to "Retention of Funds" of this section for possible nonconformance penalties.

If the Contractor fails to conform to the provisions of this section, "Water Pollution Control," the Engineer may order the suspension of construction operations until the project complies with the requirements of this section.

Implementation of water pollution control practices may vary by season. The Construction Site BMPs Manual and these special provisions shall be followed for control practice selection of year-round, rainy season and non-rainy season water pollution control practices.

Year-Round Implementation Requirements

The Contractor shall have a year-round program for implementing, inspecting and maintaining water pollution control practices for wind erosion control, tracking control, non-storm water management, and waste management and materials pollution control.

The National Weather Service weather forecast shall be monitored and used by the Contractor on a daily basis. An alternative weather forecast proposed by the Contractor may be used if approved by the Engineer. If precipitation is predicted, the necessary water pollution control practices shall be deployed prior to the onset of the precipitation.

Disturbed soil areas shall be considered active whenever the soil disturbing activities have occurred, continue to occur or will occur during the ensuing 21 days. Non-active areas shall be protected as prescribed in the Construction Site BMPs Manual within 14 days of cessation of soil disturbing activities or prior to the onset of precipitation, whichever occurs first.

In order to provide effective erosion control, the Contractor may be directed by the Engineer to apply temporary erosion control and permanent erosion control in small or multiple units. The Contractor's attention is directed to "Temporary Erosion Control (Type 1) and (Type 3)", "Temporary Erosion Control (Type 2) and (Type 4)", "Erosion Control (Type 1), (Type 2) and (Type 3)", "Move-In/Move-Out (Temporary Erosion Control)" and "Move-In/Move-Out (Erosion Control)" of these special provisions.

Rainy Season Implementation Requirements

Soil stabilization and sediment control practices shall be provided throughout the rainy season, defined as between October 1 and May 1.

An implementation schedule of required soil stabilization and sediment control practices for disturbed soil areas shall be completed no later than 20 days prior to the beginning of each rainy season. The implementation schedule shall identify the soil stabilization and sediment control practices and the dates when the implementation will be 25 percent, 50 percent and 100 percent complete, respectively. For construction activities beginning during the rainy season, the Contractor shall implement applicable soil stabilization and sediment control practices.

Throughout the defined rainy season, the active disturbed soil area of the project site shall be not more than 4.0 hectares. The Engineer may approve, on a case-by-case basis, expansions of the active disturbed soil area limit. Soil stabilization and sediment control materials shall be maintained on site sufficient to protect disturbed soil areas. A detailed plan for the mobilization of sufficient labor and equipment shall be maintained to deploy the water pollution control practices required to protect disturbed soil areas prior to the onset of precipitation.

Non-Rainy Season Implementation Requirements

The non-rainy season shall be defined as days outside the defined rainy season. The Contractor's attention is directed to the Construction Site BMPs Manual for soil stabilization and sediment control implementation requirements on disturbed soil areas during the non-rainy season. Disturbed soil areas within the project shall be protected in conformance with the requirements in the Construction Site BMPs Manual with an effective combination of soil stabilization and sediment control.

MAINTENANCE

To ensure the proper implementation and functioning of water pollution control practices, the Contractor shall regularly inspect and maintain the construction site for the water pollution control practices identified in the SWPPP. The construction site shall be inspected by the Contractor as follows:

- A. Prior to a forecast storm.
- B. After a precipitation event which causes site runoff.
- C. At 24 hour intervals during extended precipitation events.
- D. Routinely, a minimum of once every two weeks outside of the defined rainy season.
- E. Routinely, a minimum of once every week during the defined rainy season.

The Contractor shall use the Storm Water Quality Construction Site Inspection Checklist provided in the Preparation Manual or an alternative inspection checklist provided by the Engineer. One copy of each site inspection record shall be submitted to the Engineer within 24 hours of completing the inspection.

REPORTING REQUIREMENTS

Report of Discharges, Notices or Orders

If the Contractor identifies discharges into surface waters or drainage systems in a manner causing, or potentially causing, a condition of pollution, or if the project receives a written notice or order from a regulatory agency, the Contractor shall immediately inform the Engineer. The Contractor shall submit a written report to the Engineer within 3 days of the discharge event, notice or order. The report shall include the following information:

- A. The date, time, location, nature of the operation, type and quantity of discharge, including the cause or nature of the notice or order.
- B. The water pollution control practices deployed before the discharge event, or prior to receiving the notice or order.
- C. The date of deployment and type of water pollution control practices deployed after the discharge event, or after receiving the notice or order, including additional measures installed or planned to reduce or prevent reoccurrence.
- D. An implementation and maintenance schedule for affected water pollution control practices.

Report of First-Time Non-Storm Water Discharge

The Contractor shall notify the Engineer at least 3 days in advance of first-time non-storm water discharge events, excluding exempted discharges. The Contractor shall notify the Engineer of the operations causing non-storm water discharges and shall obtain field approval for first-time non-storm water discharges. Non-storm water discharges shall be monitored at first-time occurrences and routinely thereafter.

Annual Certifications

By June 15 of each year, the Contractor shall complete and submit an Annual Certification of Compliance, as contained in the Preparation Manual, to the Engineer.

WATER POLLUTION CONTROL TRAINING

The Contractor's management and supervisory personnel along with workers involved with the placement and maintenance of non-storm and storm water pollution prevention "Best Management Practices" shall be trained on general non-storm and storm water pollution control requirements consistent with the "Construction Site Best Management Practices (BMPs) Manual". The training is to be provided by the Contractor. The amount of training provided should be commensurate with the job performed by the employee.

SAMPLING AND ANALYTICAL REQUIREMENTS

The Contractor is required to implement specific sampling and analytical procedures to determine whether BMPs implemented on the construction site are:

- A. preventing pollutants that are known or should be known by permittees to occur on construction sites that are not visually detectable in storm water discharges, to cause or contribute to exceedances of water quality objectives, and
- B. preventing further impairment by sediment in storm waters discharged into water bodies listed as impaired due to sediment, siltation or turbidity.

Sediment and Turbidity

The project discharges directly into Lake Hodges and Kit Carson Creek, water bodies listed as impaired due to Color, Nitrogen, Phosphorus and Total Dissolved Solids for Lake Hodges, and Total Dissolved Solids for Kit Carson Creek pursuant to Clean Water Act, Section 303(d), and has the potential to discharge storm water containing sediment. The project SWPPP shall contain a Sampling and Analysis Plan (SAP) that describes the sampling and analysis strategy and schedule to be implemented on the project for monitoring Color, Nitrogen, Phosphorus and Total Dissolved Solids for Lake Hodges, and Total Dissolved Solids for Kit Carson Creek in the 303(d) listed water body in conformance with this section. The SAP shall comply with pertinent requirements of the Permits, including modifications thereto, and shall be prepared in conformance with the Department's Guidance Manual: Stormwater Monitoring Protocols (July 2000). The Guidance Manual is available on the Department's Internet site at: <http://www.dot.ca.gov/hq/env/stormwater/special/index.htm>.

The SAP shall identify the locations where point sources from the construction site discharge directly into the 303(d) listed water body, and the locations of run-on to the project with the potential to combine with runoff that discharges directly from the construction site to the 303(d) listed water body. The discharge and run-on locations shall be shown on the SWPPP Water Pollution Control Drawings.

The SAP shall identify a sampling schedule that specifies that water quality samples for the parameter shall be collected during the first two hours of discharge from rain events during daylight hours (sunrise to sunset), and shall be collected regardless of the time of year, status of the construction site, or day of the week. A maximum of four sampling events are required within a 30-day period. A minimum of 72 hours of dry weather shall occur between rain events to distinguish separate rain events.

The SAP shall identify sampling locations for collecting water quality samples and the rationale for their selection. A sampling location shall be designated (1) upstream of direct discharges from the construction site, (2) immediately downstream from the last point of direct discharge from the construction site, and (3) immediately down gradient of run-on point(s) to the right of way. Sampling locations shall be shown on the SWPPP Water Pollution Control Drawings. Only trained personnel shall collect water quality samples and shall be identified in the SAP. Qualifications of designated sampling personnel shall describe training and experience, and shall be included in the SWPPP. The SAP shall state the sampling preparation and collection procedures, quality assurance/quality control, sample labeling procedures, sample collection documentation, sample shipping and chain of custody procedures, sample numbering system, and reference the construction site health and safety plan.

The SAP shall specify that for discharges to 303(d) water bodies listed as impaired due to Sedimentation/Siltation, water quality samples will be analyzed for both Settleable Solids in conformance with the requirements of EPA Test Method 160.5 or equivalent method and Total Suspended Solids in conformance with EPA Test Method 160.2 or equivalent method, or for Suspended Sediment Concentration in conformance with the requirements in ASTM Designation D3977-97. For discharges to 303(d) water bodies listed as impaired due to Turbidity, the SAP shall specify that water quality samples will be analyzed for turbidity in conformance with the requirements in EPA Test Method 180.1 or equivalent method. For samples analyzed in the field by sampling personnel, collection, analysis, and equipment calibration shall be in conformance with the Manufacturer's specifications. For samples that will be analyzed by a laboratory, sampling, preservation, and analysis shall be performed by a State-certified laboratory in conformance with the requirements in 40 CFR 136. The SAP shall identify the specific State-certified laboratory, sample containers, preservation requirements, holding times, and analysis method to be

used. A list of State-certified laboratories that are approved by the Department is available at the following Internet site: http://www.dhs.ca.gov/ps/ls/elap/html/lablist_county.htm.

Non-Visible Pollutants

The project has the potential to discharge non-visible pollutants in storm water from the construction site. The project SWPPP shall contain a Sampling and Analysis Plan (SAP) that describes the sampling and analysis strategy and schedule to be implemented on the project for monitoring non-visible pollutants in conformance with this section.

The SAP shall identify potential non-visible pollutants that are known or should be known to occur on the construction site associated with the following: (1) construction materials, wastes or operations; (2) known existing contamination due to historical site usage; or (3) application of soil amendments, including soil stabilization products, with the potential to alter pH or contribute toxic pollutants to storm water. Planned material and waste storage areas, locations of known existing contamination, and areas planned for application of soil amendments shall be shown on the SWPPP Water Pollution Control Drawings.

The SAP shall identify a sampling schedule for collecting a sample down gradient from the applicable non-visible pollutant source and a sufficiently large uncontaminated control sample during the first two hours of discharge from rain events during daylight hours which result in a sufficient discharge for sample collection. If run-on occurs onto the non-visible pollutant source, a run-on sample that is immediately down gradient of the run-on to the Department's right of way shall be collected. A minimum of 72 hours of dry weather shall occur between rain events to distinguish separate rain events.

The SAP shall state that water quality sampling will be triggered when any of the following conditions are observed during the required storm water inspections conducted before or during a rain event:

- A. Materials or wastes containing potential non-visible pollutants are not stored under watertight conditions.
- B. Materials or wastes containing potential non-visible pollutants are stored under watertight conditions, but (1) a breach, leakage, malfunction, or spill is observed; and (2) the leak or spill has not been cleaned up prior to the rain event; and (3) there is the potential for discharge of non-visible pollutants to surface waters or drainage system.
- C. Construction activities, such as application of fertilizer, pesticide, herbicide, methyl methacrylate concrete sealant, or non-pigmented curing compound have occurred during a rain event or within 24 hours preceding a rain event, and there is the potential for discharge of pollutants to surface waters or drainage system.
- D. Soil amendments, including soil stabilization products, with the potential to alter pH levels or contribute toxic pollutants to storm water runoff have been applied, and there is the potential for discharge of pollutants to surface waters or drainage system (unless independent test data are available that demonstrate acceptable concentration levels of non-visible pollutants in the soil amendment).
- E. Storm water runoff from an area contaminated by historical usage of the site is observed to combine with storm water, and there is the potential for discharge of pollutants to surface waters or drainage system.

The SAP shall identify sampling locations for collecting down gradient and control samples, and the rationale for their selection. The control sampling location shall be selected where the sample does not come into contact with materials, wastes or areas associated with potential non-visible pollutants or disturbed soil areas. Sampling locations shall be shown on the SWPPP Water Pollution Control Drawings. Only trained personnel shall collect water quality samples and be identified in the SAP. Qualifications of designated sampling personnel shall describe training and experience, and shall be included in the SWPPP. The SAP shall state monitoring preparation, sample collection procedures, quality assurance/quality control, sample labeling procedures, sample collection documentation, sample shipping and chain of custody procedures, sample numbering system, and reference the construction site health and safety plan.

The SAP shall identify the analytical method to be used for analyzing down gradient and control samples for potential non-visible pollutants on the project. For samples analyzed in the field by sampling personnel, collection, analysis, and equipment calibration shall be in conformance with the Manufacturer's specifications. For samples that will be analyzed by a laboratory, sampling, preservation, and analysis shall be performed by a State-certified laboratory in conformance with 40 CFR 136. The SAP shall identify the specific State-certified laboratory, sample containers, preservation requirements, holding times, and analysis method to be used. A list of State-certified laboratories that are approved by the Department is available at the following internet site: http://www.dhs.ca.gov/ps/ls/elap/html/lablist_county.htm.

Analytical Results and Evaluation

The Contractor shall submit a hard copy and electronic copy of water quality analytical results and quality assurance/quality control data to the Engineer within 5 days of sampling for field analyses and within 30 days for laboratory analyses. Analytical results shall be accompanied by an evaluation from the Contractor to determine if down gradient samples show elevated levels of the tested parameter relative to levels in the control sample. If down gradient or downstream samples, as applicable, show increased levels, the Contractor will assess the BMPs, site conditions, and surrounding

influences to determine the probable cause for the increase. As determined by the assessment, the Contractor will repair or modify BMPs to address increases and amend the SWPPP as necessary. Electronic results (in one of the following file formats: .xls, .txt, .csv, .dbs, or .mdb) shall have at a minimum the following information: sample identification number, contract number, constituent, reported value, method reference, method detection limit, and reported detection limit. The Contractor shall document sample collection during rain events.

Water quality sampling documentation and analytical results shall be maintained with the SWPPP on the project site until a Notice of Completion has been submitted and approved.

If construction activities or knowledge of site conditions change, such that discharges or sampling locations change, the Contractor shall amend the SAP in conformance with this section, "Water Pollution Control."

PAYMENT

The contract lump sum price paid for prepare storm water pollution prevention plan shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals for doing all the work involved in developing, preparing, obtaining approval of, revising, and amending the SWPPP, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

Full compensation for water pollution control training shall be considered as included in the contract lump sum price paid for prepare storm water pollution prevention plan, and no additional compensation will be allowed therefor.

Attention is directed to Section 9-1.06, "Partial Payments," and Section 9-1.07, "Payment After Acceptance," of the Standard Specifications. Payments for prepare storm water pollution prevention plan will be made as follows:

- A. After the SWPPP has been approved by the Engineer, 75 percent of the contract item price for prepare storm water pollution prevention plan will be included in the monthly partial payment estimate.
- B. After acceptance of the contract in conformance with the provisions in Section 7-1.17, "Acceptance of Contract," of the Standard Specifications, payment for the remaining 25 percent of the contract item price for prepare storm water pollution prevention plan will be made in conformance with the provisions in Section 9-1.07.

The contract lump sum price paid for water pollution control shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in installing, constructing, removing, and disposing of water pollution control practices, including non-storm water management, and waste management and materials pollution water pollution control practices, except those for which there is a contract item of work as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

Storm water sampling and analysis will be paid for as extra work as provided in Section 4-1.03D, "Extra Work," of the Standard Specifications. No payment will be made for the preparation, collection, analysis, and reporting of storm water samples required where appropriate BMPs are not implemented prior to a rain event, or if a failure of a BMP is not corrected prior to a rain event.

For items identified on the approved Water Pollution Control Cost Break-Down, the cost of maintaining the temporary water pollution control practices shall be divided equally by the State and the Contractor as follows:

Soil Stabilization

Temporary water pollution control practices except:

SS-1 Scheduling

SS-2 Preservation of Existing Vegetation

Sediment Control

Temporary water pollution control practices

Wind Erosion Control

No sharing of maintenance costs will be allowed.

Non-Storm Water Management

No sharing of maintenance costs will be allowed.

Waste Management & Materials Pollution Control

No sharing of maintenance costs will be allowed.

The division of cost will be made by determining the cost of maintaining water pollution control practices in conformance with the provisions in Section 9-1.03, "Force Account Payment," of the Standard Specifications and paying to the Contractor one-half of that cost. Cleanup, repair, removal, disposal, improper installation, and replacement of water pollution control practices damaged by the Contractor's negligence, shall not be considered as included in the cost for performing maintenance.

The provisions for sharing maintenance costs shall not relieve the Contractor from the responsibility for providing appropriate maintenance on items with no shared maintenance costs.

Full compensation for non-shared maintenance costs of water pollution control practices, as specified in this section, "Water Pollution Control," shall be considered as included in the contract lump sum price paid for water pollution control and no additional compensation will be allowed therefor.

Water pollution control practices for which there is a contract item of work, will be measured and paid for as that contract item of work.

10-1.03 TEMPORARY EROSION CONTROL (TYPE 1) AND (TYPE 3)

Temporary erosion control (Type 1) and (Type 3) shall conform to the provisions for erosion control in Section 20-3, "Erosion Control," of the Standard Specifications and these special provisions.

Temporary erosion control (Type 1) and (Type 3) shall be furnished, applied, maintained, and later removed at locations shown on the approved Storm Water Pollution Prevention Plan in conformance with "Water Pollution Control" of these special provisions, and in conformance with details shown on the plans and these special provisions.

Attention is directed to "Water Pollution Control" of these special provisions.

Temporary erosion control work shall consist of applying erosion control materials to embankment slopes, excavation slopes and other areas designated on the plans. Temporary erosion control work shall be completed in the designated areas during the period starting October 1 and ending May 1, or within 14 days after an area becomes inactive during this period as defined in "Water Pollution Control" of these special provisions.

Temporary erosion control (Type 1) and (Type 3) shall be used as water pollution control practices for soil stabilization. The Storm Water Pollution Prevention Plan shall include the use of temporary erosion control (Type 1) and (Type 3).

Temporary erosion control (Type 1) or (Type 3) shall be applied when an area is ready to receive temporary erosion control (Type 1) or (Type 3) as determined by the Engineer and in conformance with the provisions in "Move-in/Move-out (Temporary Erosion Control)" of these special provisions.

MATERIALS

Materials shall conform to the provisions in Section 20-2, "Materials," of the Standard Specifications and the following:

Seed

Seed shall conform to the provisions in Section 20-2.10, "Seed," of the Standard Specifications. Individual seed species shall be measured and mixed in the presence of the Engineer.

Seed shall be delivered to the project site in unopened separate containers with the seed tag attached. Containers without a seed tag attached will not be accepted.

A sample of approximately 30 g of seed will be taken from each seed container by the Engineer.

Non-Legume Seed

Non-legume seed shall consist of the following:

Temporary Erosion Control (Type 1) - NON-LEGUME SEED

Botanical Name (Common Name)	Percent Germination (Minimum)	Kilograms Pure Live Seed Per Hectare (Slope Measurement)
Triticum x elymus/Regreen (Sterile Wheat Grass)	50	40
Eschscholzia californica (California Poppy)	60	8

Commercial Fertilizer

Commercial fertilizer shall conform to the provisions in Section 20-2.02, "Commercial Fertilizer," of the Standard Specifications and shall have a guaranteed chemical analysis of 6 percent nitrogen, 20 percent phosphoric acid and 20 percent water soluble potash.

Stabilizing Emulsion

Stabilizing emulsion shall conform to the provisions in Section 20-2.11, "Stabilizing Emulsion," of the Standard Specifications and these special provisions.

Stabilizing emulsion shall be in a dry powder form, may be reemulsifiable, and shall be a processed organic adhesive.

Compost

At the option of the Contractor, compost may be either A, B, or any combination of both:

- A. Green material consisting of chipped, shredded, or ground vegetation; or clean processed recycled wood products.
- B. Class A, exceptional quality biosolids composts, conforming to the requirements in United States Environmental Protection Agency (EPA) regulation 40 CFR, Part 503c.

Compost shall not contain paint, petroleum products, herbicides, fungicides or other chemical residues harmful to plant or animal life. Other deleterious material, plastic, glass, metal or rock shall not exceed 0.1-percent by weight or volume.

Compost shall be thermophilically processed for 15 days. During this process, the compost shall be maintained at minimum internal temperature of 55°C and be thoroughly turned at least 5 times. A 90-day curing period shall follow the thermophilic process.

Compost shall be screened through a screen no larger than 12 mm.

Compost shall measure at least 6 on the maturity and stability scale with a Solvita test kit.

A Certificate of Compliance for compost shall be furnished to the Engineer in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications. The Certificate of Compliance shall state the Solvita maturity and stability scale test result of the compost.

APPLICATION

Temporary erosion control (Type 1) and (Type 3) materials shall be applied in two separate applications in the following sequence:

- A. The following mixture in the proportions indicated shall be applied with hydro-seeding equipment. In the case of temporary erosion control (Type 1), the mixture shall be applied within 60 minutes after the seed has been added to the mixture:

Temporary Erosion Control (Type 1) - Application 1

Material	Kilograms Per Hectare (Slope Measurement)
Fiber	1000
Non-Legume Seed	48
Stabilizing Emulsion (solids)	200

Temporary Erosion Control (Type 1) - Application 1

Material	Cubic Meter Per Hectare (Slope Measurement)
Compost	1.25

Temporary Erosion Control (Type 3) - Application 1

Material	Kilograms Per Hectare (Slope Measurement)
Fiber	1000
Stabilizing Emulsion (solids)	200

B. The following mixture in the proportions indicated shall be applied with hydro-seeding equipment:

Material	Kilograms Per Hectare (Slope Measurement)
Fiber	1800
Commercial Fertilizer	25
Stabilizing Emulsion (solids)	200

Material	Cubic Meter Per Hectare (Slope Measurement)
Compost	1.25

Material	Kilograms Per Hectare (Slope Measurement)
Fiber	1800
Stabilizing Emulsion (solids)	200

C. The ratio of total water to total stabilizing emulsion in the mixture shall be as recommended by the manufacturer.

MAINTENANCE

Temporary erosion control (Type 1) or (Type 3) shall be reapplied on the same day the damage occurs. Temporary erosion control (Type 1) or (Type 3) shall be reapplied when the area treated with temporary erosion control (Type 1) or (Type 3) becomes exposed or exhibits visible erosion.

REMOVAL

Removal shall consist of mechanically incorporating the temporary erosion control (Type 1) or (Type 3) into the soil with tracklaying equipment, disking, or other methods approved by the Engineer.

MEASUREMENT AND PAYMENT

The quantity of temporary erosion control (Type 1) and (Type 3) work will be measured by the square meter or hectare, whichever is designated in the contract item. The quantity of temporary erosion control (Type 1) and (Type 3) to be paid for by the square meter or hectare will be calculated on the basis of actual or computed slope measurements.

The contract price paid per square meter or hectare for temporary erosion control (Type 1) and (Type 3) shall include full compensation for furnishing all labor, (except maintenance), materials, tools, equipment, and incidentals, and for doing all the work involved in applying temporary erosion control (Type 1) and (Type 3), complete in place, including removal of temporary erosion control (Type 1) and (Type 3), as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

Temporary erosion control (Type 1) or (Type 3) disturbed or displaced by the Contractor's vehicles, equipment, or operations shall be reapplied at the Contractor's expense.

No adjustment of compensation will be made for any increase or decrease in the quantities of temporary erosion control (Type 1) and (Type 3) required, regardless of the reason for the increase or decrease. The provisions in Section 4-1.03B, "Increased or Decreased Quantities," of the Standard Specifications shall not apply to temporary erosion control (Type 1) or (Type 3).

The cost of maintaining the temporary erosion control (Type 1) and (Type 3) will be borne equally by the State and the Contractor.

The division of cost will be made by determining the cost of maintaining temporary erosion control (Type 1) or (Type 3) in conformance with the provisions in Section 9-1.03, "Force Account Payment," of the Standard Specifications and paying to the Contractor one-half of that cost.

Cleanup, repair, removal, disposal, or replacement of temporary erosion control (Type 1) or (Type 3) due to improper installation or the Contractor's negligence will not be considered as included in the cost for performing maintenance.

10-1.04 STREET SWEEPING

Street sweeping shall be conducted where sediment is tracked from the project site onto paved roads, as described in the approved Storm Water Pollution Prevention Plan in accordance with "Water Pollution Control" of these special provisions, and as directed by the Engineer.

Street sweeping shall be one of the water pollution control practices for sediment control. The Storm Water Pollution Prevention Plan shall include the use of street sweeping. Street sweeping shall be performed in accordance with Section 4, SC—7 in the Construction Site Best Management Practices Manual of the Caltrans Storm Water Quality Handbooks.

The number of street sweepers shall be as designated in the approved Storm Water Pollution Prevention Plan. The Contractor shall maintain at least one sweeper on the project site at all times during the period that sweeping work is required. Sweepers shall be self-loading, motorized, and shall have spray nozzles. Sweepers may include a vacuum apparatus.

Street sweeping shall commence at the beginning of clearing and grubbing and shall continue until completion of the project, or as directed by the Engineer. Street sweeping shall be performed immediately after soil disturbing activities occur or offsite tracking of material is observed. Street sweeping shall be performed so that dust is minimized. If dust generation is excessive or sediment pickup is ineffective as determined by the Engineer, the use of water or a vacuum will be required.

At the option of the Contractor, collected material may be temporarily stockpiled in accordance with the approved Storm Water Pollution Prevention Plan. Collected material shall be disposed of at least once per week.

Material collected during street sweeping operations shall be disposed of in conformance with Section 7—1.13, "Disposal of Material Outside The Highway Right Of Way," of the Standard Specifications.

MEASUREMENT AND PAYMENT

The contract lump sum price paid for street sweeping shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals and for doing all the work involved in street sweeping, including disposal of collected material, as shown on the plans, as specified in the Standard Specifications, these special provisions, and as directed by the Engineer.

The costs involved in providing street sweeping in addition to that required in the approved Storm Water Pollution Protection Plan and this section will be borne equally by the State and the Contractor. The division of cost will be made by determining the cost of providing street sweeping in conformance with the provisions in Section 9-1.03, "Force Account Payment," of the Standard Specifications, and paying to the Contractor one-half of that cost.

10-1.05 TEMPORARY EROSION CONTROL (TYPE 2) AND (TYPE 4)

Temporary erosion control (Type 2) and (Type 4) shall conform to the provisions for erosion control in Section 20-3, "Erosion Control," of the Standard Specifications and these special provisions.

Temporary erosion control (Type 2) and (Type 4) shall be furnished, applied, maintained, and later removed at locations shown on the approved Storm Water Pollution Prevention Plan in conformance with "Water Pollution Control" of these special provisions, and in conformance with details shown on the plans and these special provisions.

Attention is directed to "Water Pollution Control" of these special provisions.

Temporary erosion control (Type 2) and (Type 4) shall consist of applying a polymer stabilized fiber matrix to active and nonactive disturbed slopes steeper than 1:2. Temporary erosion control (Type 2) and (Type 4) work shall be completed in the designated areas during the period starting October 1 and ending May 1, or within 14 days after an area becomes inactive during this period as defined in "Water Pollution Control" of these special provisions.

Temporary erosion control (Type 2) and (Type 4) shall be used as a water pollution control practice for soil stabilization. The Storm Water Pollution Prevention Plan shall include the use of temporary erosion control (Type 2) and (Type 4).

Temporary erosion control (Type 2) and (Type 4) shall be applied when an area is ready to receive temporary erosion control (Type 2) and (Type 4) as determined by the Engineer and in conformance with the provisions in "Move-in/Move-out (Temporary Erosion Control)" of these special provisions.

MATERIALS

Materials shall conform to the provisions in Section 20-2, "Materials," of the Standard Specifications and the following:

Seed

Seed for temporary erosion control (Type 2) shall conform to the provisions specified for seed in "Temporary Erosion Control (Type 1) and (Type 3)" of these special provisions.

Non-Legume Seed

Non-legume seed shall consist of the following:

Botanical Name (Common Name)	Percent Germination (Minimum)	Kilograms Pure Live Seed Per Hectare (Slope Measurement)
Triticum x elymus/Regreen (Sterile Wheat Grass)	50	40
Eschscholzia californica (California Poppy)	60	8

Commercial Fertilizer

Commercial fertilizer for temporary erosion control (Type 2) shall conform to the provisions specified for commercial fertilizer in "Temporary Erosion Control (Type 1) and (Type 3)" of these special provisions.

Compost

Compost for temporary erosion control (Type 2) shall conform to the provisions specified for compost in "Temporary Erosion Control (Type 1) and (Type 3)" of these special provisions.

Tackifier

The tackifier shall conform to the provisions in Section 20-2.11, "Stabilizing Emulsion," of the Standard Specifications. The tackifier shall be nonflammable, nontoxic to aquatic organisms, and shall have no growth or germination inhibiting factors.

The tackifier shall be a liquid formulation having polyacrylamide (PAM) as the primary active ingredient, and shall be available as a prepackaged product. The PAM shall be a linear, anionic copolymer of acrylamide and sodium acrylate. The residual monomer content of the PAM shall not exceed 0.05 percent by weight.

Tackifier shall conform to and be labeled as one of the following:

- A. Tackifier shall be formulated as an water-in-oil emulsion and shall contain a minimum of 0.30 kg pure PAM per liter. The pure PAM shall be a minimum of 30 percent active.
- B. Tackifier shall be formulated as a liquid dispersed polyacrylamide (LDP) and shall contain a minimum of 0.53 kg pure PAM per liter. The pure PAM shall be a minimum of 35 percent active.

The prepackaged product label shall indicate that the PAM is registered and approved by the California Department of Food and Agriculture as an auxiliary soil and plant substance, and nonplant food ingredient.

If requested by the Engineer, the Contractor shall provide certification of the percent of pure PAM present by weight, the percent activity, the average molecular weight, and the charge density of the PAM; and shall provide a material safety data sheet for the prepackaged product.

Wood Fiber

Wood fiber shall conform to the provisions in Section 20-2.07, "Fiber," of the Standard Specifications and these special provisions. Fiber shall be long strand, whole wood fibers, thermo-mechanically processed from clean, whole wood chips, containing a minimum of 25 percent at 10 mm long, with a minimum of 40 percent retained on a 710 µm sieve. The wood chips shall not contain lead paint, printing ink, varnish, petroleum products, seed germination inhibitors, or chlorine bleach. Fiber shall not be produced from sawdust, cardboard, paper, or paper by-products.

APPLICATION

Temporary erosion control (Type 2) and (Type 4) materials shall be applied as follows:

- A. The following mixture in the proportions indicated shall be applied with hydroseeding equipment. In the case of temporary erosion control (Type 2), the mixture shall be applied within 60 minutes after the seed has been added to the mixture:

Temporary Erosion Control (Type 1)	
Material	Application Rate
Wood Fiber	3900 kg/ha
Tackifier	93 L/ha
Non-Legume Seed	48 kg/ha
Commercial Fertilizer	25 kg/ha

Temporary erosion Control (Type 2)	
Material	Cubic Meter Per Hectare (Slope Measurement)
Compost	1.25

Temporary Erosion Control (Type 3)	
Material	Application Rate
Wood Fiber	3900 kg/ha
Tackifier	93 L/ha

- B. The dilution of fiber to water per hectare shall be as required to facilitate even application of material.
- C. Material shall be applied to form a continuous mat covering all of the disturbed soil surface, shall have a minimum thickness of 2 mm, and shall have no gaps between the mat and the soil surface.
- D. Material shall be applied from 2 or more directions to achieve a continuous mat.
- E. Material shall be applied in layers to avoid slumping and to aid drying.
- F. Material shall be applied during dry weather, with a minimum of 24 hours of dry weather between completion of material application and predicted precipitation.

MAINTENANCE

Temporary erosion control (Type 2) or (Type 4) shall be reapplied on the same day the damage occurs. Temporary erosion control (Type 2) or (Type 4) shall be reapplied when the area treated with Temporary erosion control (Type 2) or (Type 4) exhibits visible erosion. Temporary erosion control (Type 2) or (Type 4) shall be reapplied within 24 hours of identifying visible erosion, or longer if approved by the Engineer.

REMOVAL

Removal shall consist of mechanically incorporating the erosion control (Type 2) and (Type 4) into the soil with tracklaying equipment, disking, or other method approved by the Engineer.

MEASUREMENT AND PAYMENT

The quantity of temporary erosion control (Type 2) and (Type 4) work will be measured by the square meter or hectare, whichever is designated in the contract item. The quantity of temporary erosion control (Type 2) and (Type 4) to be paid for by the square meter or hectare will be calculated on the basis of actual or computed slope measurements.

The contract price paid per square meter or hectare for temporary erosion control (Type 2) and (Type 4) shall include full compensation for furnishing all labor, (except maintenance), materials, tools, equipment, and incidentals, and for doing all the work involved in applying temporary erosion control (Type 2) and (Type 4), complete in place, including removal of temporary erosion control (Type 2) and (Type 4), as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

Temporary erosion control (Type 2) or (Type 4) disturbed or displaced by the Contractor's vehicles, equipment, or operations shall be reapplied at the Contractor's expense.

No adjustment of compensation will be made for any increase or decrease in the quantities of temporary erosion control (Type 2) and (Type 4) required, regardless of the reason for the increase or decrease. The provisions in Section 4-1.03B, "Increased or Decreased Quantities," of the Standard Specifications shall not apply to temporary erosion control (Type 2) or (Type 4).

The cost of maintaining the temporary erosion control (Type 2) and (Type 4) will be borne equally by the State and the Contractor.

The division of cost will be made by determining the cost of maintaining temporary erosion control (Type 2) and (Type 4) in conformance with the provisions in Section 9-1.03, "Force Account Payment," of the Standard Specifications and paying to the Contractor one-half of that cost.

Cleanup, repair, removal, disposal, or replacement of temporary erosion control (Type 2) or (Type 4) due to improper installation or the Contractor's negligence will not be considered as included in the cost for performing maintenance.

10-1.06 TEMPORARY CULVERTS

Temporary culverts shall be furnished, installed, maintained, and later removed as shown on the plans, as specified in these special provisions and as directed by the Engineer.

The size and type of temporary culvert to be installed at each location shall be at the option of the Contractor; however, the culvert shall be capable of sustaining the intended load and of discharging a quantity of water equivalent to the type and size of culvert shown on the plans. Adequacy as to equivalent strength and capacity shall be subject to approval, in writing, by the Engineer.

Used materials may be installed provided the used materials are good, sound and are suitable for the purpose intended, as determined by the Engineer.

Excavation and backfill for temporary culverts shall be performed in a manner that will provide adequate support for the culvert with a firm, nonsettling foundation for the roadbeds to be constructed over the culverts.

Temporary culverts that are damaged from any cause during the progress of the work shall be repaired or replaced by the Contractor at the Contractor's expense.

When no longer required for the work as determined by the Engineer, temporary culverts shall be removed. Removed facilities shall become the property of the Contractor and shall be removed from the site of the work, except as otherwise provided in this section.

Removed temporary culverts that are not damaged may be installed in the permanent work provided the culverts conform to the requirements specified for the permanent work and the culverts are new when installed as temporary culverts.

Trenches and pits caused by the removal of temporary culverts shall be backfilled in conformance with the provisions in the second paragraph of Section 15-1.02, "Preservation of Property," of the Standard Specifications.

Regardless of the sizes or kinds of temporary culverts installed, temporary culverts will be measured and paid for by the meter for the sizes of temporary culverts shown on the plans and listed in the Engineer's Estimate in the same manner specified for corrugated metal pipe in Section 66-4.01, "Measurement," and Section 66-4.02, "Payment," of the Standard Specifications.

Full compensation for maintaining, removing and disposing of temporary culverts shall be considered as included in the contract prices paid per meter for the various sizes or kinds of temporary culverts and no additional compensation will be allowed therefor.

10-1.07 TEMPORARY CONCRETE WASHOUT FACILITY

Temporary concrete washout facilities shall be constructed, maintained, and later removed at the locations shown on the approved Storm Water Pollution Prevention Plan in conformance with "Water Pollution Control" of these special provisions, and in conformance with details shown on the plans and these special provisions.

Attention is directed to "Water Pollution Control" of these special provisions.

Temporary concrete washout facilities shall be one of the water pollution control practices for waste management and materials pollution control. The Storm Water Pollution Prevention Plan shall include the use of temporary concrete washout facilities.

MATERIALS

Plastic Liner

Plastic liner shall be single ply, new polyethylene sheeting, a minimum of 0.25-mm thick and shall be free of holes, punctures, tears or other defects that compromise the impermeability of the material. Plastic liner shall not have seams or overlapping joints.

Gravel-filled Bags

Gravel bag fabric shall be non-woven polypropylene geotextile (or comparable polymer) and shall conform to the following requirements:

Specification	Requirements
Mass per unit area, grams per square meter, min. ASTM Designation: D 5261	270
Grab tensile strength (25-mm grip), kilonewtons, min. ASTM Designation: D4632*	0.89
Ultraviolet stability, percent tensile strength retained after 500 hours, ASTM Designation: D4355, xenon arc lamp method	70

* or appropriate test method for specific polymer

Gravel bags shall be between 600 mm and 800 mm in length, and between 400 mm and 500 mm in width.

Yarn used for binding gravel bags shall be as recommended by the manufacturer or bag supplier and shall be of a contrasting color.

Gravel shall be between 10 mm and 20 mm in diameter, and shall be clean and free from clay balls, organic matter, and other deleterious materials.

The opening of gravel-filled bags shall be secured to prevent gravel from escaping. Gravel-filled bags shall be between 13 kg and 22 kg in mass.

Straw Bales

Straw for straw bales shall conform to the provisions in Section 20-2.06, "Straw," of the Standard Specifications.

Straw bales shall be a minimum of 360 mm in width, 450 mm in height, 900 mm in length and shall have a minimum mass of 23 kg. The straw bale shall be composed entirely of vegetative matter, except for binding material.

Straw bales shall be bound by either wire, nylon or polypropylene string. Jute or cotton binding shall not be used. Baling wire shall be a minimum 1.57 mm in diameter. Nylon or polypropylene string shall be approximately 2 mm in diameter with 360 N of breaking strength.

Stakes

Stakes shall be wood or metal. Wood stakes shall be untreated fir, redwood, cedar, or pine, shall be cut from sound timber, and shall be straight and free from loose or unsound knots and other defects which would render them unfit for the purpose intended. Wood stakes shall be minimum 50 mm x 50 mm in size. Metal stakes may be used as an alternative, and shall be a minimum 13 mm in diameter. Stakes shall be a minimum 1.2 m in length. The tops of the metal stakes shall be bent at a 90-degree angle or capped with an orange or red plastic safety cap that fits snugly to the metal stake. The Contractor shall submit a sample of the metal stake and plastic cap, if used, for Engineer's approval prior to installation.

Staples

Staples shall be as shown on the plans. An alternative attachment device such as geotextile pins or plastic pegs may be used instead of staples. The Contractor shall submit a sample of the alternative attachment device for Engineer's approval prior to installation.

Signs

Wood posts for signs shall conform to the provisions in Section 56-2.02B, "Wood Posts," of the Standard Specifications. Lag screws shall conform to the provisions in Section 56-2.02D, "Sign Panel Fastening Hardware," of the Standard Specifications.

Plywood shall be freshly painted for each installation with not less than 2 applications of flat white paint. Sign letters shown on the plans shall be stenciled with commercial quality exterior black paint. Testing of paint will not be required.

INSTALLATION

Temporary concrete washout facilities shall be as follows:

- A. Temporary concrete washout facilities shall be installed prior to beginning placement of concrete and located a minimum of 15 m from storm drain inlets, open drainage facilities, and water courses unless determined infeasible by the Engineer. Temporary concrete washout facilities shall be located away from construction traffic or access areas at a location determined by the Contractor and approved by the Engineer.
- B. A sign shall be installed adjacent to each washout facility at a location determined by the Contractor and approved by the Engineer. Signs shall be installed in conformance with the provisions in Section 56-2.03, "Construction," and Section 56-2.04, "Sign Panel Installation," of the Standard Specifications.
- C. The length and width of a temporary concrete washout facility may be increased from the minimum dimensions shown on the plans, at the Contractor's expense and upon approval of the Engineer.

- D. Temporary concrete washout facilities shall be constructed in sufficient quantity and size to contain liquid and concrete waste generated by washout operations for concrete wastes. These facilities shall be constructed to contain liquid and concrete waste without seepage, spillage or overflow.
- E. Berms for below grade temporary concrete washout facilities shall be constructed from compacted native material. Gravel may be used in conjunction with compacted native material.
- F. Plastic liner shall be installed in below grade temporary concrete washout facilities.

Details for an alternative temporary concrete washout facility shall be submitted to the Engineer for approval at least 7 days prior to installation.

When temporary concrete washout facilities are no longer required for the work, as determined by the Engineer, the hardened concrete and liquid residue shall be removed and disposed of in conformance with the provisions in Section 15-3.02, "Removal Methods," of the Standard Specifications. Temporary concrete washout facilities shall become the property of the Contractor and be disposed of in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.

Ground disturbance, including holes and depressions, caused by the installation and removal of the temporary concrete washout facilities shall be backfilled and repaired in conformance with the provisions in Section 15-1.02, "Preservation of Property," of the Standard Specifications.

MAINTENANCE

Temporary concrete washout facilities shall be maintained to provide adequate holding capacity with a minimum freeboard of 300 mm. Maintaining temporary concrete washout facilities shall include removing and disposing of hardened concrete and returning the facilities to a functional condition. Hardened concrete materials shall be removed and disposed of in conformance with the provisions in Section 15-3.02, "Removal Methods," of the Standard Specifications. Holes, rips, and voids in the plastic liner shall be patched and repaired by taping or the plastic liner shall be replaced. Plastic liner shall be replaced when patches or repairs compromise the impermeability of the material as determined by the Engineer.

Gravel bags shall be replaced when the bag material is ruptured or when the yarn has failed, allowing the bag contents to spill out.

Temporary concrete washout facility shall be repaired or replaced on the same day when the damage occurs. Damage to the temporary concrete washout facility resulting from the Contractor's vehicles, equipment, or operations shall be repaired at the Contractor's expense.

MEASUREMENT AND PAYMENT

The quantity of temporary concrete washout facility to be paid for will be measured as unit determined from actual count in place.

The contract unit price paid for temporary concrete washout facility shall include full compensation for furnishing all labor, materials, tools, equipment and incidentals, and for doing all the work involved in constructing temporary concrete washout facility, complete in place, including excavation and backfill, maintenance, and removal of temporary concrete washout facility, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

No adjustment of compensation will be made for any increase or decrease in the quantities of temporary concrete washout facility required, regardless of the reason for the increase or decrease. The provisions in Section 4-1.03B, "Increased or Decreased Quantities," of the Standard Specifications shall not apply to temporary concrete washout facility.

10-1.08 TEMPORARY CHECK DAM

Temporary check dam shall be constructed, maintained, and later removed at the locations shown on the approved Storm Water Pollution Prevention Plan in conformance with "Water Pollution Control" of these special provisions, and in conformance with details shown on the plans and these special provisions.

Attention is directed to "Water Pollution Control" of these special provisions.

Temporary check dam shall be one of the water pollution control practices for sediment control. The Storm Water Pollution Prevention Plan shall include the use of temporary check dam.

Temporary check dam shall be Type 2 (gravel-filled bag).

MATERIALS

Gravel-filled Bag

Gravel bag fabric shall be non-woven polypropylene geotextile (or comparable polymer) and shall conform to the following requirements:

Specification	Requirements
Mass per unit area, grams per square meter, min. ASTM Designation: D 5261	270
Grab tensile strength (25-mm grip), kilonewtons, min. ASTM Designation: D4632*	0.89
Ultraviolet stability, percent tensile strength retained after 500 hours, ASTM Designation: D4355, xenon arc lamp method	70

* or appropriate test method for specific polymer

Gravel bags shall be between 600 mm and 800 mm in length, and between 400 mm and 500 mm in width.

Yarn used in construction of the gravel-filled bags shall be as recommended by the manufacturer or bag supplier and shall be of a contrasting color.

Gravel shall be between 10 mm and 20 mm in diameter, and shall be clean and free from clay balls, organic matter, and other deleterious materials. The opening of gravel-filled bags shall be secured to prevent gravel from escaping. Gravel-filled bags shall be between 13 kg and 22 kg in mass.

INSTALLATION

Temporary check dam shall be installed as follows:

- A. Temporary check dam (Type 2): A single layer of gravel-filled bags shall be placed in lined or unlined ditches with ends abutted tightly and not overlapped.
- B. The bedding area for the temporary check dam shall be cleared of obstructions including, but not limited to, rocks, clods, and debris greater than 25 mm in diameter prior to installation.
- C. Temporary check dam shall be installed across and approximately perpendicular to the centerline of ditch or drainage line.
- D. Temporary check dam shall be installed with sufficient spillway depth to prevent flanking of concentrated flow around the ends of the check dams.
- E. Temporary check dam shall be installed in an unlined ditch or swale prior to the application of other temporary erosion control or soil stabilization materials in the same unlined ditch or swale.
- F. Temporary check dam shall be installed upon completion of temporary erosion control blanket in earthen ditches or swales.

Details for an alternative temporary check dam shall be submitted to the Engineer for approval at least 7 days prior to installation.

When the temporary check dam is no longer required, as determined by the Engineer, temporary check dam shall become the property of the Contractor and be removed and disposed of in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.

Ground disturbances, including holes and depressions caused by the installation and removal of the temporary check dam shall be backfilled and repaired in conformance with the provisions in Section 15-1.02, "Preservation of Property," of the Standard Specifications.

MAINTENANCE

Temporary check dam shall be maintained to provide sediment holding capacity and to reduce runoff velocities. Gravel-filled bags shall be replaced when the bag material is ruptured or when the yarn has failed, allowing the bag contents to spill out. Locations where rills and other evidence of concentrated runoff have occurred beneath the check dams shall be corrected.

When sediment exceeds one-third the height of the check dam above ground, or when directed by the Engineer, sediment shall be removed. The removed sediment shall be deposited within the project limits in such a way that the sediment is not subject to erosion by wind or by water.

Temporary check dam shall be repaired or replaced on the same day the damage occurs. Washouts or scour beneath the temporary check dam shall be repaired. Temporary check dam damaged during the progress of work or resulting from the Contractor's vehicles, equipment, or operations shall be repaired or replaced at the Contractor's expense.

MEASUREMENT AND PAYMENT

The quantity of temporary check dam to be paid for will be measured by the meter along the centerline of the installed check dam.

The contract price paid per meter for temporary check dam shall include full compensation for furnishing all labor, (except maintenance), materials, tools, equipment, and incidentals, and for doing all the work involved in installing temporary check dam, complete in place, including removal of temporary check dam, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

No adjustment of compensation will be made for any increases or decreases in the quantities of temporary check dam, regardless of the reason for the increase or decrease. The provisions in Section 4-1.03B, "Increased or Decreased Quantities," of the Standard Specifications shall not apply to the item of temporary check dam.

The cost of maintaining the temporary check dam will be borne equally by the State and the Contractor.

The division of cost will be made by determining the cost of maintaining temporary check dam in conformance with the provisions in Section 9-1.03, "Force Account Payment," of the Standard Specifications and paying to the Contractor one-half of that cost. Clean-up, repair, removal, disposal, replacement because of improper installation, and replacement of temporary check dam damaged as a result of the Contractor's negligence will not be considered as included in the cost for performing maintenance.

10-1.09 TEMPORARY FENCE (TYPE ESA)

Temporary fence (Type ESA) shall be furnished, installed, maintained, and later removed in conformance with the details shown on the plans, as specified in these special provisions and as directed by the Engineer.

MATERIALS

Used materials may be installed provided the used materials conform to these special provisions. Materials for temporary fence (Type ESA) shall conform to the following:

High Visibility Fabric

High visibility fabric shall be machine produced, orange colored mesh manufactured from polypropylene or polyethylene. High visibility fabric may be made of recycled materials. Materials shall not contain biodegradable filler materials that can degrade the physical or chemical characteristics of the finished fabric. High visibility fabric shall be fully stabilized ultraviolet resistant, shall be a minimum of 1.22 m in width with a maximum mesh opening of 50 mm x 50 mm. High visibility fabric shall be furnished in one continuous width and shall not be spliced to conform to the specified width dimension.

Posts

Posts for temporary fence (Type ESA) shall be of one of the following:

- A. Wood posts shall be fir or pine, shall have a minimum cross section of 50 mm x 50 mm, and a minimum length of 1.6 m. The end of the post to be embedded in the soil shall be pointed. Wood posts shall not be treated with wood preservative.
- B. Steel posts shall have a "U", "T", "L" or other cross sectional shape that resists failure by lateral loads. Steel posts shall have a minimum mass per length of 1.1 kg/m and a minimum length of 1.6 m. One end of the steel post shall be pointed and the other end shall have a high visibility colored top.

Fasteners

Fasteners for attaching high visibility fabric to the posts shall be as follows:

- A. The high visibility fabric shall be attached to wooden posts with commercial quality nails or staples, or as recommended by the manufacturer or supplier.
- B. Tie wire or locking plastic fasteners shall be used for attaching the high visibility fabric to steel posts. Maximum spacing of tie wire or fasteners shall be 600 mm along the length of the steel post.

INSTALLATION

Temporary fence (Type ESA) shall be installed as follows:

- A. All fence construction activities shall be conducted from outside the ESA as shown on the plans or as staked.
- B. Posts shall be embedded in the soil a minimum of 380 mm. Post spacing shall be 2.5 m maximum from center to center and shall at all times support the fence in a vertical position.
- C. Temporary fence (Type ESA) shall be constructed prior to clearing and grubbing work, shall enclose the foliage canopy (drip line) of protected plants, and shall not encroach upon visible roots of the plants.

When Type ESA temporary fence is no longer required, as determined by the Engineer, the temporary fence shall become the property of the Contractor and shall be removed and disposed of in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications, except when reused as provided in this section.

Holes caused by the removal of temporary fence (Type ESA) shall be backfilled in conformance with the provisions in Section 15-1.02, "Preservation of Property," of the Standard Specifications.

MAINTENANCE

Temporary fence (Type ESA) that is damaged during the progress of the work shall be repaired or replaced by the Contractor the same day the damage occurs.

MEASUREMENT AND PAYMENT

Temporary fence (Type ESA) shall be measured and paid for in the same manner specified for permanent fence as provided in Section 80, "Fences," of the Standard Specifications.

Full compensation for maintaining, removing, and disposing of temporary fence (Type ESA) shall be considered as included in the contract price paid per meter for temporary fence (Type ESA) and no additional compensation will be allowed therefor.

10-1.10 PRESERVATION OF PROPERTY

Attention is directed to Section 7-1.11, "Preservation of Property," of the Standard Specifications and these special provisions.

Existing trees, shrubs and other plants, that are not to be removed as shown on the plans or specified in these special provisions, and are injured or damaged by reason of the Contractor's operations, shall be replaced by the Contractor. The minimum size of tree replacement shall be 600 mm box and the minimum size of shrub replacement shall be No. 15 container. Replacement planting shall conform to the requirements in Section 20-4.07, "Replacement," of the Standard Specifications. The Contractor shall water replacement plants in conformance with the provisions in Section 20-4.06, "Watering," of the Standard Specifications.

Damaged or injured plants shall be removed and disposed of outside the highway right of way in conformance with the provisions in Section 7-1.13 of the Standard Specifications.

Replacement planting of injured or damaged trees, shrubs, and other plants shall be completed prior to the start of the plant establishment period. Replacement planting shall conform to the provisions in Section 20-4.05, "Planting," of the Standard Specifications.

10-1.11 TEMPORARY CONSTRUCTION ENTRANCE

Temporary construction entrance shall be constructed, maintained, and later removed at the locations shown on the approved Storm Water Pollution Prevention Plan in conformance with "Water Pollution Control" of these special provisions, and in conformance with details shown on the plans and these special provisions.

Attention is directed to "Water Pollution Control" of these special provisions.

Temporary construction entrance shall be one of the water pollution control practices for tracking control. The Storm Water Pollution Prevention Plan shall include the use of temporary construction entrance.

Temporary construction entrance shall be Type 2 .

MATERIALS

Temporary Entrance Fabric

Temporary entrance fabric shall be manufactured from polyester, nylon or polypropylene material or any combination thereof. Temporary entrance fabric shall be a nonwoven, needle-punched fabric, free of any needles which may have broken off during the manufacturing process. Temporary entrance fabric shall be permeable and shall not act as a wicking agent.

Temporary entrance fabric shall be manufactured from virgin or recycled, or a combination of virgin and recycled, polymer materials. No virgin or recycled materials shall contain biodegradable filler materials that can degrade the physical or chemical characteristics of the finished fabric. The Engineer may order tests to confirm the absence of biodegradable filler materials in conformance to the requirements in ASTM Designation: E 204 (Fourier Transformed Infrared Spectroscopy-FTIR).

Temporary entrance fabric shall conform to the following requirements:

Specification	Requirements
Mass per unit area, grams per square meter, min. ASTM Designation: D 5261	235
Grab tensile strength (25-mm grip), kilonewtons, min. ASTM Designation: D4632*	0.89
Elongation at break, percent min. ASTM Designation: D4632*	50
Toughness, kilonewtons, min. (percent elongation x grab tensile strength)	53

* or appropriate test method for specific polymer

Rocks

Rocks shall be angular to subangular in shape, and shall conform to the material quality requirements in Section 72-2.02, "Materials," of the Standard Specifications for apparent specific gravity, absorption, and durability index. Rocks used for the temporary entrance shall conform to the following sizes:

Square Screen Size (mm)	Percentage Passing
150	100
75	0-20

Corrugated Steel Panels

Corrugated steel panels shall be prefabricated and shall be pressed or shop welded, with a slot or hooked section to facilitate coupling at the ends of the panels.

INSTALLATION

Temporary construction entrance shall be installed as follows:

- A. Prior to placing the temporary entrance fabric, the areas shall be cleared of all trash and debris. Vegetation shall be removed to the ground level. Trash, debris, and removed vegetation shall be disposed of in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.
- B. A sump shall be constructed within 6 m of each temporary construction entrance as shown on the plans. The exact location of the sump will be determined by the Engineer.
- C. Before placing the temporary entrance fabric, the ground shall be graded to a uniform plane. The relative compaction of the top 0.5-m shall be not less than 90 percent. The ground surface shall be free of sharp objects that may damage the temporary entrance fabric, and shall be graded to drain to the sump as shown on the plans.
- D. Temporary entrance fabric shall be positioned longitudinally along the alignment of the entrance, as directed by the Engineer.
- E. The adjacent ends of the fabric shall be overlapped a minimum length of 300 mm.
- F. Rocks to be placed directly over the fabric shall be spread in the direction of traffic, longitudinally and along the alignment of the temporary construction entrance.
- G. During spreading of the rocks, vehicles or equipment shall not be driven directly on the fabric. A layer of rocks of minimum 150 mm thick shall be placed between the fabric and the spreading equipment to prevent damage to the fabric.
- H. For Type 2 temporary construction entrance, a minimum of 6 coupled panel sections shall be installed for each temporary construction entrance. Prior to installing the panels, the ground surface shall be cleared of all debris to ensure uniform contact with the ground surface.

Fabric damaged during rock placement shall be repaired by placing a new piece of fabric over the damaged area. The piece of fabric shall be large enough to cover the damaged area and provide a minimum 450-mm overlap on all edges.

Details for alternative temporary construction entrance or alternative sump shall be submitted to the Engineer for approval at least 7 days prior to installation. The Contractor may eliminate the sump if approved by the Engineer in writing.

If buildup of soil and sediment deter the function of the temporary construction entrance, the Contractor shall immediately remove and dispose of the soil and sediment, and install additional corrugated steel panels and spread additional rocks to increase the capacity of the temporary construction entrance at the Contractor's expenses.

When no longer required as determined by the Engineer, temporary construction entrances shall become the property of the Contractor and be removed and disposed of in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.

Ground disturbance, including holes and depressions, caused by the installation and removal of the temporary construction entrance, including the sumps, shall be backfilled and repaired in conformance with the provisions in Section 15-1.02, "Preservation of Property," of the Standard Specifications.

While the temporary construction entrance is in use, pavement shall be cleaned and sediment removed at least once a day, and as often as necessary when directed by the Engineer. Soil and sediment or other extraneous material tracked onto existing pavement shall not be allowed to enter drainage facilities.

MAINTENANCE

The Contractor shall maintain temporary construction entrance throughout the contract or until removed. The Contractor shall prevent displacement or migration of the rock surfacing or corrugated steel panels. Any significant depressions resulted from settlement or heavy equipment shall be repaired by the Contractor, as directed by the Engineer.

Temporary construction entrance shall be maintained to minimize tracking of soil and sediment onto existing public roads.

Temporary construction entrance shall be repaired or replaced on the same day when the damage occurs. Damage to the temporary construction entrance resulting from the Contractor's vehicles, equipment, or operations shall be repaired at the Contractor's expense.

MEASUREMENT AND PAYMENT

The quantity of temporary construction entrance to be paid for will be measured as unit determined from actual count in place.

The contract unit price paid for temporary construction entrance shall include full compensation for furnishing all labor, (except maintenance), materials, tools, equipment, and incidentals, and for doing all the work involved in constructing temporary construction entrance, complete in place, including excavation and backfill, and removal of temporary construction entrance, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

No adjustment of compensation will be made for any increase or decrease in the quantities of temporary construction entrance required, regardless of the reason for the increase or decrease. The provisions in Section 4-1.03B, "Increased or Decreased Quantities," of the Standard Specifications shall not apply to temporary construction entrance.

The cost of maintaining the temporary construction entrance will be borne equally by the State and the Contractor.

The division of cost will be made by determining the cost of maintaining temporary construction entrance in conformance with the provisions in Section 9-1.03, "Force Account Payment," of the Standard Specifications and paying to the Contractor one-half of that cost. Clean-up, repair, removal, disposal, replacement because of improper installation, and replacement of temporary construction entrance damaged as a result of the Contractor's negligence will not be considered as included in the cost for performing maintenance.

10-1.12 MOVE-IN/MOVE-OUT (TEMPORARY EROSION CONTROL)

Move-in/move-out (temporary erosion control) shall include moving onto the project when an area is ready to receive temporary erosion control as determined by the Engineer, setting up required personnel and equipment for the application of erosion control materials and moving out all personnel and equipment when temporary erosion control (Type 1), (Type 2), (Type 3) or (Type 4) in that area is completed.

When areas are ready to receive applications of temporary erosion control (Type 1), (Type 2), (Type 3) or (Type 4), as determined by the Engineer, the Contractor shall begin erosion control work in that area within 5 working days of the Engineer's notification to perform the temporary erosion control work.

Attention is directed to the requirements of temporary erosion control (Type 1), (Type 2), (Type 3) or (Type 4) specified elsewhere in these special provisions.

Quantities of move-in/move-out (temporary erosion control) will be determined as units from actual count as determined by the Engineer. For measurement purposes, a move-in followed by a move-out will be considered as one unit.

The contract unit price paid for move-in/move-out (temporary erosion control) shall include full compensation for furnishing all labor, materials (excluding temporary erosion control materials), tools, equipment, and incidentals and for doing all the work involved in moving in and removing from the project all personnel and equipment necessary for application of temporary erosion control (Type 1), (Type 2), (Type 3) or (Type 4), as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

No adjustment of compensation will be made for increases or decreases in the quantities of move-in/move-out (temporary erosion control) required, regardless of the reason for the increase or decrease. The provisions in

Section 4-1.03B, "Increased or Decreased Quantities," of the Standard Specifications shall not apply to move-in/move-out (temporary erosion control).

10-1.13 TEMPORARY DRAINAGE INLET PROTECTION

Temporary drainage inlet protection shall be constructed, maintained, and removed at the locations shown on the approved Storm Water Pollution Prevention Plan in accordance with "Water Pollution Control" of these special provisions, and in accordance with the details shown on the plans and these special provisions.

Temporary drainage inlet protection shall be one of the water pollution control practices for sediment control.

The Contractor shall select the appropriate drainage inlet protection in accordance with the details to meet the field condition around the drainage inlet.

Throughout the duration of the contract, the Contractor shall provide protection to meet the changing condition around the drainage inlet.

Temporary drainage inlet protection shall be Type 3A and 3B.

MATERIALS

Erosion Control Blanket

The erosion control blanket shall be a rolled erosion control product (RECP) and shall be classified either as temporary and degradable or long term and non-degradable and shall conform to one of the following:

A. Temporary and Degradable:

1. Machine produced mats consisting of curled wood excelsior with 80 percent of the fiber 150 mm or longer. The excelsior blanket shall be of consistent thickness with wood fiber evenly distributed over the entire area of the blanket. The top surface of the blanket shall be covered with an extruded photodegradable plastic netting or lightweight non-synthetic netting. The blanket shall be smolder resistant without the use of chemical additives and shall be non-toxic and non-injurious to plant and animal life. The excelsior blanket shall be furnished in rolled strips with a minimum mass per unit area of 0.40-kg/m².
2. Machine produced mats consisting of 70 percent straw and 30 percent coconut fiber with an extruded photodegradable plastic netting or lightweight non-synthetic netting on the top and bottom surfaces of the blanket. The straw and coconut shall adhere to the netting using thread or glue strip. The straw and coconut blanket shall be of consistent thickness, and straw and coconut fiber shall be evenly distributed over the entire area of the blanket. The straw and coconut fiber blanket shall be furnished in rolled strips with a minimum mass per unit area of 0.27-kg/m².
3. Machine produced mats consisting of 100 percent coir consisting of coconut fiber with an extruded photodegradable plastic netting or lightweight non-synthetic netting on the top and bottom surfaces of the blanket. The coconut fiber shall adhere to the netting using thread or glue strip. The coconut blanket shall be of consistent thickness, with coconut fiber evenly distributed over the entire area of the blanket. The coconut fiber blanket shall be furnished in rolled strips with a minimum mass per unit area of 0.27-kg/m².
4. Machine woven netting consisting of 100 percent spun coir consisting of coconut fiber with an average open area of 63 to 70 percent. Coconut coir netting shall be furnished in rolled strips with a minimum mass per unit area of 0.40-kg/m².

B. Long-Term and Non-degradable: Geotextile blanket shall conform to the provisions for rock slope protection fabric (Type A) in Section 88-1.04, "Rock Slope Protection Fabric," of the Standard Specifications.

Staples

Staples shall be as shown on the plans. An alternative attachment device such as geotextile pins or plastic pegs may be used instead of staples. The Contractor shall submit a sample of the alternative attachment device for the Engineer's approval prior to installation.

Gravel-filled Bags

Gravel-filled bag shall conform to the provisions specified for gravel bag in "Temporary Check Dam" of these special provisions.

Within shoulder areas, gravel-filled bags shall only be used when placed behind temporary railing (Type K).

INSTALLATION

Temporary drainage inlet protection shall be installed at drainage inlets in paved and unpaved areas as follows:

- A. Temporary drainage inlet protection shall be installed such that ponded runoff does not encroach on the traveled way or overtop the curb or dike. Gravel-filled bags shall be placed to control ponding and prevent runoff from overtopping the curb or dike.
- B. The bedding area for the temporary drainage inlet protection shall be cleared of obstructions including, but not limited to, rocks, clods, and debris greater than 25 mm in diameter prior to installation.
- C. A temporary linear sediment barrier shall be installed up-slope of the existing drainage inlet and parallel with the curb, dike, or flow line to prevent sediment from entering the drainage inlet.

Erosion Control Blanket and Geotextile Fabric

The erosion control blanket and geotextile fabric shall be secured to the surface of the excavated sediment trap with staples and embedded in a trench adjacent to the drainage inlet. The perimeter edge of the erosion control blanket and geotextile fabric shall be anchored in a trench.

Gravel-filled Bags

Gravel-filled bags shall be stacked to form a gravel bag barrier. The gravel-filled bags shall be placed so that the bags are tightly abutted and overlap the joints in adjacent rows. A spillway shall be created by removing one or more gravel-filled bags from the upper layer of the gravel bag barrier.

REMOVAL

When the temporary drainage inlet protection is no longer required, temporary drainage inlet protection materials shall be removed and disposed of in accordance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.

Holes, depressions or other ground disturbance caused by the removal of the temporary drainage inlet protection shall be backfilled and repaired in accordance with the provisions in Section 15-1.02, "Preservation of Property," of the Standard Specifications.

MAINTENANCE

Temporary drainage inlet protection shall be maintained to provide sediment holding capacity and to reduce runoff velocities. Temporary drainage inlet protection shall be repaired or replaced immediately when the damage occurs.

Sediment deposits, trash and debris shall be removed from temporary drainage inlet protection as needed or when directed by the Engineer. Removed sediment shall be deposited within the project limits in such a way that the sediment is not subject to erosion by wind or by water. Trash and debris shall be removed and disposed of in accordance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.

At locations where rills and other evidence of concentrated runoff have occurred beneath the drainage inlet protection, the protection shall be adjusted to prevent that occurrence.

Sediment in excess of 50 mm above the surface of the erosion control blanket or geotextile fabric shall be removed.

Sediment deposits shall be removed when the deposit is one-third the height of the gravel bag barrier or one-half the height of the spillway; whichever is less.

Gravel-filled bags shall be replaced when the bag material ruptures or when the binding fails.

MEASUREMENT

Temporary drainage inlet protection will be measured by the unit as determined from actual count in place.

PAYMENT

The contract unit price paid for temporary drainage inlet protection shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in constructing the temporary drainage inlet protection, complete in place, including maintenance, removal of materials, and backfilling and repairing holes, depressions and other ground disturbance, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

No additional compensation will be made if the temporary drainage inlet protection changes during the course of construction.

No adjustment of compensation will be made for any increase or decrease in the quantities of temporary drainage inlet protection required, regardless of the reason for the increase or decrease. The provisions in Section 4-1.03B, "Increased or Decreased Quantities," of the Standard Specifications shall not apply to temporary drainage inlet protection.

The cost of maintaining the temporary drainage inlet protection will be borne equally by the State and the Contractor.

The division of cost will be made by determining the cost of maintaining temporary drainage inlet protection in accordance with the provisions in Section 9-1.03, "Force Account Payment," of the Standard Specifications and paying to the Contractor one-half of that cost. Clean-up, repair, removal, disposal, or replacement because of improper installation, or as a result of the Contractor's negligence will not be considered as included in the cost for performing maintenance.

10-1.14 COOPERATION

Attention is directed to Section 7-1.14, "Cooperation," and Section 8-1.10, "Utility and Non-Highway Facilities," of the Standard Specifications and these special provisions.

It is anticipated that work by another contractor (Contract No. 11-077304) to construct pavement rehabilitation in San Diego County on Route 15 from 0.5 km south of the Miramar Way Overcrossing to the Mission Road Undercrossing (KP R21.0 to KP R82.0) may be in progress adjacent to or within the limits of this project during progress of the work on this contract.

It is anticipated that work by another contractor (Contract No. 11-064844) to construct sound walls in San Diego County in San Diego and Escondido on Route 15 from 0.9 km north of Poway Road Overcrossing to 0.6 km north of Clarence Lane Undercrossing (KP M30.2 to KP M45.3) may be in progress adjacent to or within the limits of this project during progress of the work on this contract.

It is anticipated that work by another contractor (Contract No. 11-080904) to construct managed lanes middle unit 1 in San Diego County in San Diego on Route 15 from 0.9 km south of Route 56/15 Separation to 0.1 km north of Camino Del Norte Undercrossing (KP M30.6 to KP M35.4) and on Route 56 from 0.5 km west to 0.2 km east of Route 56/15 Separation (KP 14.3 to KP 15.0) may be in progress adjacent to or within the limits of this project during progress of the work on this contract.

It is anticipated that work by another contractor (Contract No. 11-080914) to construct managed lanes middle unit 2 in San Diego County in San Diego from Camino Del Norte Undercrossing to 0.5 km north of Rancho Bernardo Road Undercrossing (M35.4/M38.7) may be in progress adjacent to or within the limits of this project during progress of the work on this contract.

It is anticipated that work by another contractor (Contract No. 11-080924) to construct managed lanes middle unit 3 in San Diego County in San Diego from 0.5 km north of Rancho Bernardo Road Undercrossing to 0.7 km south of Via Rancho Parkway Overcrossing (KP M38.7 to KP M42.7) may be in progress adjacent to or within the limits of this project during progress of the work on this contract.

It is anticipated that work by another contractor (Contract No. 11-080934) to construct managed lanes middle unit 4 in San Diego County in San Diego at various locations may be in progress adjacent to or within the limits of this project during progress of the work on this contract.

It is anticipated that work by another contractor (Contract No. 11-2326U4) to construct widening and retrofit in San Diego County in San Diego from Mercy Road Undercrossing to 0.6 km south of the Route 56/15 Separation (KP M27.8 to KP M30.7) may be in progress adjacent to or within the limits of this project during progress of the work on this contract.

The Contractor should anticipate 3 move-ins and move-outs in the areas of Contracts 11-080904, 11-080914 and 11-080934 for guide wire installation, pavement delineation, signing and install moveable barrier between Station 309+40 "SD-15M" Line and Station 396+00 "SD-15M" Line. The Contractor shall include in the critical path method (CPM) progress schedule the anticipated move-ins and move-outs.

Consecutive on-ramp or off-ramps in the same direction of travel shall not be closed simultaneously unless otherwise provided in these special provisions or permitted by the Engineer.

10-1.15 PROGRESS SCHEDULE (CRITICAL PATH METHOD)

The Contractor shall submit to the Engineer practicable critical path method (CPM) progress schedules in conformance with these special provisions. Whenever the term "schedule" is used in this section it shall mean CPM progress schedule.

Attention is directed to "Payments" of Section 5 of these special provisions.

The provisions in Section 8-1.04, "Progress Schedule," of the Standard Specifications shall not apply.

DEFINITIONS

The following definitions shall apply to this section:

- A. **ACTIVITY.**—A task, event or other project element on a schedule that contributes to completing the project. Activities have a description, start date, finish date, duration and one or more logic ties.
- B. **BASELINE SCHEDULE.**—The initial schedule representing the Contractor's work plan on the first working day of the project.

- C. **CONTRACT COMPLETION DATE.**—The current extended date for completion of the contract shown on the weekly statement of working days furnished by the Engineer in conformance with the provisions in Section 8-1.06, "Time of Completion," of the Standard Specifications.
- D. **CRITICAL PATH.**—The longest continuous chain of activities for the project that has the least amount of total float of all chains. In general, a delay on the critical path will extend the scheduled completion date.
- E. **CRITICAL PATH METHOD (CPM).**—A network based planning technique using activity durations and the relationships between activities to mathematically calculate a schedule for the entire project.
- F. **DATA DATE.**—The day after the date through which a schedule is current. Everything occurring earlier than the data date is "as-built" and everything on or after the data date is "planned."
- G. **EARLY COMPLETION TIME.**—The difference in time between an early scheduled completion date and the contract completion date.
- H. **FLOAT.**—The difference between the earliest and latest allowable start or finish times for an activity.
- I. **MILESTONE.**—An event activity that has zero duration and is typically used to represent the beginning or end of a certain stage of the project.
- J. **NARRATIVE REPORT.**—A document submitted with each schedule that discusses topics related to project progress and scheduling.
- K. **NEAR CRITICAL PATH.**—A chain of activities with total float exceeding that of the critical path but having no more than 10 working days of total float.
- L. **SCHEDULED COMPLETION DATE.**—The planned project finish date shown on the current accepted schedule.
- M. **STATE OWNED FLOAT ACTIVITY.**—The activity documenting time saved on the critical path by actions of the State. It is the last activity prior to the scheduled completion date.
- N. **TIME IMPACT ANALYSIS.**—A schedule and narrative report developed specifically to demonstrate what effect a proposed change or delay has on the current scheduled completion date.
- O. **TOTAL FLOAT.**—The amount of time that an activity or chain of activities can be delayed before extending the scheduled completion date.
- P. **UPDATE SCHEDULE.**—A current schedule developed from the baseline or subsequent schedule through regular monthly review to incorporate as-built progress and any planned changes.

GENERAL REQUIREMENTS

The Contractor shall submit to the Engineer baseline, monthly update and final update schedules, each consistent in all respects with the time and order of work requirements of the contract. The project work shall be executed in the sequence indicated on the current accepted schedule.

Schedules shall show the order in which the Contractor proposes to carry out the work with logical links between time-scaled work activities, and calculations made using the critical path method to determine the controlling operation or operations. The Contractor is responsible for assuring that all activity sequences are logical and that each schedule shows a coordinated plan for complete performance of the work.

The Contractor shall produce schedules using computer software and shall furnish compatible software for the Engineer's exclusive possession and use. The Contractor shall furnish network diagrams, narrative reports, tabular reports and schedule data as parts of each schedule submittal.

Schedules shall include, but not be limited to, activities that show the following that are applicable to the project:

- A. Project characteristics, salient features, or interfaces, including those with outside entities, that could affect time of completion.
- B. Project start date, scheduled completion date and other milestones.
- C. Work performed by the Contractor, subcontractors and suppliers.
- D. Submittal development, delivery, review and approval, including those from the Contractor, subcontractors and suppliers.
- E. Procurement, delivery, installation and testing of materials, plants and equipment.
- F. Testing and settlement periods.
- G. Utility notification and relocation.
- H. Erection and removal of falsework and shoring.
- I. Major traffic stage switches.
- J. Finishing roadway and final cleanup.
- K. State-owned float as the predecessor activity to the scheduled completion date.

Schedules shall have not less than 50 and not more than 1000 activities, unless otherwise authorized by the Engineer. The number of activities shall be sufficient to assure adequate planning of the project, to permit monitoring and evaluation of progress, and to do an analysis of time impacts.

Schedule activities shall include the following:

- A. A clear and legible description.
- B. Start and finish dates.
- C. A duration of not less than one working day, except for event activities, and not more than 20 working days, unless otherwise authorized by the Engineer.
- D. At least one predecessor and one successor activity, except for project start and finish milestones.
- E. Required constraints.
- F. Codes for responsibility, stage, work shifts, location and contract pay item numbers.

The Contractor may show early completion time on any schedule provided that the requirements of the contract are met. Early completion time shall be considered a resource for the exclusive use of the Contractor. The Contractor may increase early completion time by improving production, reallocating resources to be more efficient, performing sequential activities concurrently or by completing activities earlier than planned. The Contractor may also submit for approval a cost reduction incentive proposal in conformance with the provisions in Section 5-1.14, "Cost Reduction Incentive," of the Standard Specifications that will reduce time of construction.

The Contractor may show a scheduled completion date that is later than the contract completion date on an update schedule, after the baseline schedule is accepted. The Contractor shall provide an explanation for a late scheduled completion date in the narrative report that is included with the schedule.

State-owned float shall be considered a resource for the exclusive use of the State. The Engineer may accrue State-owned float by the early completion of review of any type of required submittal when it saves time on the critical path. The Contractor shall prepare a time impact analysis, when requested by the Engineer, to determine the effect of the action in conformance with the provisions in "Time Impact Analysis" specified herein. The Engineer will document State-owned float by directing the Contractor to update the State-owned float activity on the next update schedule. The Contractor shall include a log of the action on the State-owned float activity and include a discussion of the action in the narrative report. The Engineer may use State-owned float to mitigate past, present or future State delays by offsetting potential time extensions for contract change orders.

The Engineer may adjust contract working days for ordered changes that affect the scheduled completion date, in conformance with the provisions in Section 4-1.03, "Changes," of the Standard Specifications. The Contractor shall prepare a time impact analysis to determine the effect of the change in conformance with the provisions in "Time Impact Analysis" specified herein, and shall include the impacts acceptable to the Engineer in the next update schedule. Changes that do not affect the controlling operation on the critical path will not be considered as the basis for a time adjustment. Changes that do affect the controlling operation on the critical path will be considered by the Engineer in decreasing time or granting an extension of time for completion of the contract. Time extensions will only be granted if the total float is absorbed and the scheduled completion date is delayed one or more working days because of the ordered change.

The Engineer's review and acceptance of schedules shall not waive any contract requirements and shall not relieve the Contractor of any obligation thereunder or responsibility for submitting complete and accurate information. Schedules that are rejected shall be corrected by the Contractor and resubmitted to the Engineer within 5 working days of notification by the Engineer, at which time a new review period of one week will begin.

Errors or omissions on schedules shall not relieve the Contractor from finishing all work within the time limit specified for completion of the contract. If, after a schedule has been accepted by the Engineer, either the Contractor or the Engineer discover that any aspect of the schedule has an error or omission, it shall be corrected by the Contractor on the next update schedule.

EQUIPMENT AND SOFTWARE

The Contractor shall provide for the State's exclusive possession and use a complete computer system specifically capable of creating, storing, updating and producing CPM schedules utilizing the latest hardware and software technology. Before delivery and setup of the computer system, the Contractor shall submit to the Engineer for approval a detailed list of all computer hardware and software the Contractor proposes to furnish. The minimum software and computer system to be furnished shall include the following:

- A. A complete computer system, including keyboard, mouse, 530-mm color SVGA flat LCD monitor (1,024x768 pixels), current Intel Pentium IV micro processor chip, or equivalent;
- B. Computer operating system software, compatible with the selected processing unit, for Windows 2000, or equivalent;
- C. Minimum five hundred twelve (512) megabytes of random access memory (RAM);
- D. A 20 gigabyte minimum hard disk drive, a 1.44 megabyte 90-mm floppy disk drive, 32x speed minimum CD-RW drive, Ethernet card, two UBCUSB ports, and 56K modem;

- E. A color-ink-jet plotter with a minimum 64 Megabyte RAM, capable of 600 dots per inch color, 1200 x 600 dots per inch monochrome, or equivalent. Capable of printing fully legible, time scaled charts, and network diagrams, in four colors, with a minimum size of 914-mm by 1219-mm (E size) and is compatible with the selected system. Plotter paper and ink cartridges will be provided throughout the contract. Plotter shall be HP Designjet 1055cm Plus or equivalent;
- F. CPM software shall be the latest version of Primavera Project Planner (P3);
- G. Scheduler Analyzer Pro or equivalent – a suite of programs to assist in the schedule analysis, the latest version for Windows 2000, or later and;
- H. Microsoft Office software, the latest version for Windows 2000, or later, and McAfee Virus software or equivalent.

The computer hardware and software furnished shall be compatible with that used by the Contractor for the production of the CPM progress schedule required by the Contract, and shall include original instruction manuals and other documentation normally provided with the hardware and software.

The Contractor shall furnish, install, set up, provide licenses for the all software programs, maintain and repair the computer hardware and provide software support ready for use at a location determined by the Engineer. The hardware and software shall be installed and ready for use by the first submission of the baseline schedule. The Contractor shall provide 24 hours of formal training for the Engineer and three other agents of the Department designated by the Engineer, in the use of the hardware and software to include schedule analysis, reporting and resource allocations. The training shall be performed by an authorized vendor of Primavera Project Planner.

All computer hardware and software furnished shall remain the property of the Contractor and shall be removed by the Contractor upon acceptance of the contract when no claims involving contract progress are pending. When claims involving contract progress are pending, computer hardware or software shall not be removed until final estimate has been submitted to the Contractor.

NETWORK DIAGRAMS, REPORTS AND DATA

The Contractor shall include the following for each schedule submittal:

- A. Two sets of originally plotted, time-scaled network diagrams.
- B. Two copies of a narrative report.
- C. Two copies of each of 3 sorts of the CPM software-generated tabular reports.
- D. One 1.44-megabyte 90 mm (3.5 inch) floppy diskette containing the schedule data.

The time-scaled network diagrams shall conform to the following:

- A. Show a continuous flow of information from left to right.
- B. Be based on early start and early finish dates of activities.
- C. Clearly show the primary paths of criticality using graphical presentation.
- D. Be prepared on E-size sheets, 860 mm x 1120 mm (34 inch x 44 inch).
- E. Include a title block and a timeline on each page.

The narrative report shall be organized in the following sequence with all applicable documents included:

- A. Contractor's transmittal letter.
- B. Work completed during the period.
- C. Identification of unusual conditions or restrictions regarding labor, equipment or material; including multiple shifts, 6-day work weeks, specified overtime or work at times other than regular days or hours.
- D. Description of the current critical path.
- E. Changes to the critical path and scheduled completion date since the last schedule submittal.
- F. Description of problem areas.
- G. Current and anticipated delays:
 - 1. Cause of delay.
 - 2. Impact of delay on other activities, milestones and completion dates.
 - 3. Corrective action and schedule adjustments to correct the delay.

H. Pending items and status thereof:

1. Permits
2. Change orders
3. Time adjustments
4. Non-compliance notices

I. Reasons for an early or late scheduled completion date in comparison to the contract completion date.

Tabular reports shall be software-generated and provide information for each activity included in the project schedule. Three different reports shall be sorted by (1) activity number, (2) early start and (3) total float. Tabular reports shall be 215 mm x 280 mm (8 1/2 inch x 11 inch) in size and shall include, as a minimum, the following applicable information:

- A. Data date
- B. Activity number and description
- C. Predecessor and successor activity numbers and descriptions
- D. Activity codes
- E. Scheduled, or actual and remaining durations (work days) for each activity
- F. Earliest start (calendar) date
- G. Earliest finish (calendar) date
- H. Actual start (calendar) date
- I. Actual finish (calendar) date
- J. Latest start (calendar) date
- K. Latest finish (calendar) date
- L. Free float (work days)
- M. Total float (work days)
- N. Percentage of activity complete and remaining duration for incomplete activities.
- O. Lags
- P. Required constraints

Schedule submittals will only be considered complete when all documents and data have been provided as described above.

PRE-CONSTRUCTION SCHEDULING CONFERENCE

The Contractor shall schedule and the Engineer will conduct a pre-construction scheduling conference with the Contractor's project manager and construction scheduler within 10 working days of the approval of the contract. At this meeting the Engineer will review the requirements of this section of the special provisions with the Contractor.

The Contractor shall submit a general time-scaled logic diagram displaying the major activities and sequence of planned operations and shall be prepared to discuss the proposed work plan and schedule methodology that comply with the requirements of these special provisions. If the Contractor proposes deviations to the construction staging of the project, then the general time-scaled logic diagram shall also display the deviations and resulting time impacts. The Contractor shall be prepared to discuss the proposal.

At this meeting, the Contractor shall additionally submit the alphanumeric coding structure and the activity identification system for labeling the work activities. To easily identify relationships, each activity description shall indicate its associated scope or location of work by including such terms as quantity of material, type of work, bridge number, station to station location, side of highway (such as left, right, northbound, southbound), lane number, shoulder, ramp name, ramp line descriptor or mainline.

The Engineer will review the logic diagram, coding structure, and activity identification system, and provide any required baseline schedule changes to the Contractor for implementation.

BASELINE SCHEDULE

Beginning the week following the pre-construction scheduling conference, the Contractor shall meet with the Engineer weekly until the baseline schedule is accepted by the Engineer to discuss schedule development and resolve schedule issues.

The Contractor shall submit to the Engineer a baseline schedule within 20 working days of approval of the contract. The Contractor shall allow 3 weeks for the Engineer's review after the baseline schedule and all support data are submitted. In addition, the baseline schedule submittal will not be considered complete until the computer software is delivered and installed for use in review of the schedule.

The baseline schedule shall include the entire scope of work and how the Contractor plans to complete all work contemplated. The baseline schedule shall show the activities that define the critical path. Multiple critical paths and near-critical paths shall be kept to a minimum. A total of not more than 50 percent of the baseline schedule activities shall be critical or near critical, unless otherwise authorized by the Engineer.

The baseline schedule shall not extend beyond the number of working days specified in these special provisions. The baseline schedule shall have a data date of the first working day of the contract and not include any completed work to date. The baseline schedule shall not attribute negative float or negative lag to any activity.

If the Contractor submits an early completion baseline schedule that shows contract completion in less than 85 percent of the working days specified in these special provisions, the baseline schedule shall be supplemented with resource allocations for every task activity and include time-scaled resource histograms. The resource allocations shall be shown to a level of detail that facilitates report generation based on labor crafts and equipment classes for the Contractor and subcontractors. The Contractor shall use average composite crews to display the labor loading of on-site construction activities. The Contractor shall optimize and level labor to reflect a reasonable plan for accomplishing the work of the contract and to assure that resources are not duplicated in concurrent activities. The time-scaled resource histograms shall show labor crafts and equipment classes to be utilized on the contract. The Engineer may review the baseline schedule activity resource allocations using Means Productivity Standards or equivalent to determine if the schedule is practicable.

UPDATE SCHEDULE

The Contractor shall submit an update schedule and meet with the Engineer to review contract progress, on or before the first day of each month, beginning one month after the baseline schedule is accepted. The Contractor shall allow 2 weeks for the Engineer's review after the update schedule and all support data are submitted, except that the review period shall not start until the previous month's required schedule is accepted. Update schedules that are not accepted or rejected within the review period will be considered accepted by the Engineer.

The update schedule shall have a data date of the twenty-first day of the month or other date established by the Engineer. The update schedule shall show the status of work actually completed to date and the work yet to be performed as planned. Actual activity start dates, percent complete and finish dates shall be shown as applicable. Durations for work that has been completed shall be shown on the update schedule as the work actually occurred, including Engineer submittal review and Contractor resubmittal times.

The Contractor may include modifications such as adding or deleting activities or changing activity constraints, durations or logic that do not (1) alter the critical path(s) or near critical path(s) or (2) extend the scheduled completion date compared to that shown on the current accepted schedule. The Contractor shall state in writing the reasons for any changes to planned work. If any proposed changes in planned work will result in (1) or (2) above, then the Contractor shall submit a time impact analysis as described herein.

DESIGN SEQUENCING

The dates specified in Section 1, "Specifications and Plans," of these special provisions, on which the Contractor will be provided the complete design of each project phase, shall be shown as milestones in the baseline schedule, and in subsequent updated and revised schedules.

At the completion of the design for each project phase, the schedule shall be updated showing the actual date the final plans, specifications and estimate of quantities for that phase were provided to the Contractor.

TIME IMPACT ANALYSIS

The Contractor shall submit a written time impact analysis (TIA) to the Engineer with each request for adjustment of contract time, or when the Contractor or Engineer consider that an approved or anticipated change may impact the critical path or contract progress.

The TIA shall illustrate the impacts of each change or delay on the current scheduled completion date or internal milestone, as appropriate. The analysis shall use the accepted schedule that has a data date closest to and prior to the event. If the Engineer determines that the accepted schedule used does not appropriately represent the conditions prior to the event, the accepted schedule shall be updated to the day before the event being analyzed. The TIA shall include an impact schedule developed from incorporating the event into the accepted schedule by adding or deleting activities, or by changing durations or logic of existing activities. If the impact schedule shows that incorporating the event modifies the critical path and scheduled completion date of the accepted schedule, the difference between scheduled completion dates of the two schedules shall be equal to the adjustment of contract time. The Engineer may construct and utilize an appropriate project schedule or other recognized method to determine adjustments in contract time until the Contractor provides the TIA.

The Contractor shall submit a TIA in duplicate within 15 working days of receiving a written request for a TIA from the Engineer. The Contractor shall allow the Engineer 2 weeks after receipt to approve or reject the submitted TIA. All approved TIA schedule changes shall be shown on the next update schedule.

If a TIA submitted by the Contractor is rejected by the Engineer, the Contractor shall meet with the Engineer to discuss and resolve issues related to the TIA. If agreement is not reached, the Contractor will be allowed 15 days from the meeting with the Engineer to give notice in conformance with the provisions in Section 9-1.04, "Notice of Potential Claim," of the Standard Specifications. The Contractor shall only show actual as-built work, not unapproved changes related to the TIA, in subsequent update schedules. If agreement is reached at a later date, approved TIA schedule changes shall be shown on the next update schedule. The Engineer will withhold remaining payment on the schedule contract item if a TIA is requested by the Engineer and not submitted by the Contractor within 15 working days. The schedule item payment will resume on the next estimate after the requested TIA is submitted. No other contract payment will be retained regarding TIA submittals.

FINAL UPDATE SCHEDULE

The Contractor shall submit a final update, as-built schedule with actual start and finish dates for the activities, within 30 days after completion of contract work. The Contractor shall provide a written certificate with this submittal signed by the Contractor's project manager and an officer of the company stating, "To my knowledge and belief, the enclosed final update schedule reflects the actual start and finish dates of the actual activities for the project contained herein." An officer of the company may delegate in writing the authority to sign the certificate to a responsible manager.

RETENTION

The Department will retain an amount equal to 25 percent of the estimated value of the work performed during each estimate period in which the Contractor fails to submit an acceptable schedule conforming to the requirements of these special provisions as determined by the Engineer. Schedule retentions will be released for payment on the next monthly estimate for partial payment following the date that acceptable schedules are submitted to the Engineer or as otherwise specified herein. Upon completion of all contract work and submittal of the final update schedule and certification, any remaining retained funds associated with this section, "Progress Schedule (Critical Path Method)", will be released for payment. Retentions held in conformance with this section shall be in addition to other retentions provided for in the contract. No interest will be due the Contractor on retention amounts.

PAYMENT

Progress schedule (critical path method) will be paid for at a lump sum price. The contract lump sum price paid for progress schedule (critical path method) shall include full compensation for furnishing all labor, material, tools, equipment, and incidentals, including computer software, and for doing all the work involved in preparing, furnishing, and updating schedules, and instructing and assisting the Engineer in the use of computer software, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

Payments for the progress schedule (critical path method) contract item will be made progressively as follows:

- A. A total of 25 percent of the item amount or a total of 25 percent of the amount listed for progress schedule (critical path method) in "Payments" of Section 5 of these special provisions, whichever is less, will be paid upon achieving all of the following:
 1. Completion of 5 percent of all contract item work.
 2. Acceptance of all schedules and TIAs required to the time when 5 percent of all contract item work is complete.
 3. Delivery of schedule software to the Engineer.
 4. Completion of required schedule software training.
- B. A total of 50 percent of the item amount or a total of 50 percent of the amount listed for progress schedule (critical path method) in "Payments" of Section 5 of these special provisions, whichever is less, will be paid upon completion of 25 percent of all contract item work and acceptance of all schedules and TIAs required to the time when 25 percent of all contract item work is complete.
- C. A total of 75 percent of the item amount or a total of 75 percent of the amount listed for progress schedule (critical path method) in "Payments" of Section 5 of these special provisions, whichever is less, will be paid upon completion of 50 percent of all contract item work and acceptance of all schedules and TIAs required to the time when 50 percent of all contract item work is complete.
- D. A total of 100 percent of the item amount or a total of 100 percent of the amount listed for progress schedule (critical path method) in "Payments" of Section 5 of these special provisions, whichever is less, will be paid upon completion of all contract item work, acceptance of all schedules and TIAs required to the time when all contract item work is complete, and submittal of the certified final update schedule.

If the Contractor fails to complete any of the work or provide any of the schedules required by this section, the Engineer shall make an adjustment in compensation in conformance with the provisions in Section 4-1.03C, "Changes in Character of

Work," of the Standard Specifications for the work not performed. Adjustments in compensation for schedules will not be made for any increased or decreased work ordered by the Engineer in furnishing schedules.

10-1.16 TIME-RELATED OVERHEAD

The Contractor will be compensated for time-related overhead as described below and in conformance with "Force Account Payment" of these special provisions. The Contractor will not be compensated for time-related overhead for delays to the controlling operations caused by the Engineer that occur prior to the first working day, but will be compensated for actual overhead costs incurred, as determined by an independent Certified Public Accountant audit examination and report.

Attention is directed to "Beginning of Work, Time of Completion and Liquidated Damages," "Force Account Payment," and "Progress Schedule (Critical Path Method)" of these special provisions.

The provisions in Section 9-1.08, "Adjustment of Overhead Costs," of the Standard Specifications shall not apply.

Time-related overhead shall consist of those overhead costs, including field and home office overhead, that are in proportion to the time required to complete the work. Time-related overhead shall not include costs that are not related to time, including but not limited to, mobilization, licenses, permits, and other charges incurred only once during the contract. Time-related overhead shall not apply to subcontractors of any tier, suppliers, fabricators, manufacturers, or other parties associated with the Contractor.

Field office overhead expenses include time-related costs associated with the normal and recurring operations of the construction project, and shall not include costs directly attributable to the work of the contract. Time-related costs of field office overhead include, but are not limited to, salaries, benefits, and equipment costs of project managers, general superintendents, field office managers and other field office staff assigned to the project, and rent, utilities, maintenance, security, supplies, and equipment costs of the project field office.

Home office overhead or general and administrative expenses refer to the fixed costs of operating the Contractor's business. These costs include, but are not limited to, general administration, insurance, personnel and subcontract administration, purchasing, accounting, and project engineering and estimating. Home office overhead costs shall exclude expenses specifically related to other contracts or other businesses of the Contractor, equipment coordination, material deliveries, and consultant and legal fees.

The quantity of time-related overhead associated with a reduction in contract time for cost reduction incentive proposals accepted and executed in conformance with the provisions in Section 5-1.14, "Cost Reduction Incentive," of the Standard Specifications shall be considered a construction cost attributable to the resultant estimated net savings due to the cost reduction incentive.

If the final increased quantity of time-related overhead exceeds 149 percent of the number of working days specified in the Engineer's Estimate, the Contractor shall, within 60 days of the Engineer's written request, submit to the Engineer an audit examination and report performed by an independent Certified Public Accountant of the Contractor's actual overhead costs. The audit examination and report shall depict the Contractor's project and company-wide financial records and shall specify the actual overall average daily rates for both field and home office overhead for the entire duration of the project, and whether the costs have been properly allocated. The rates of field and home office overhead shall exclude unallowable costs as determined in the Federal Acquisition Regulations, 48 CFR, Chapter 1, Part 31.

Independent Certified Public Accountant's audit examinations shall be performed in conformance with the requirements of the American Institute of Certified Public Accountants Attestation Standards. Audit examinations and reports shall determine if the rates of field office overhead and home office overhead are:

- A. Allowable in conformance with the requirements of the Federal Acquisition Regulations, 48 CFR, Chapter 1, Part 31.
- B. Adequately supported by reliable documentation.
- C. Related solely to the project under examination.

Within 20 days of receipt of the Engineer's written request, the Contractor shall make its financial records available for audit by the State for the purpose of verifying the actual rate of time-related overhead specified in the audit submitted by the Contractor. The actual rate of time-related overhead specified in the audit, submitted by the Contractor, will be subject to approval by the Engineer.

If the Engineer requests the independent Certified Public Accountant audit, or if it is requested in writing by the Contractor, the contract item payment rate for time-related overhead, in excess of 149 percent of the number of working days specified in the Engineer's Estimate, will be adjusted to reflect the actual rate.

The cost of performing an independent Certified Public Accountant audit examination and submitting the report, requested by the Engineer, will be borne equally by the State and the Contractor. The division of the cost will be made by determining the cost of providing an audit examination and report in conformance with the provisions of Section 9-1.03B, "Work Performed by Special Forces or Other Special Services," of the Standard Specifications, and paying to the Contractor one-half of that cost. The cost of performing an audit examination and submitting the independent Certified Public

Accountant audit report for overhead claims other than for the purpose of verifying the actual rate of time-related overhead shall be entirely borne by the Contractor. The cost of performing an audit examination and submitting the independent Certified Public Accountant audit report to verify actual overhead costs incurred prior to the first working day shall be entirely borne by the Contractor.

The quantity of time-related overhead to be paid will be measured by the working day, designated in the Engineer's Estimate as WDAY. The estimated number of working days is the number of working days, excluding days for plant establishment, as specified in "Beginning of Work, Time of Completion and Liquidated Damages" of these special provisions. The quantity of time-related overhead will be increased or decreased only as a result of suspensions or adjustments of contract time which revise the current contract completion date, and which satisfy any of the following criteria:

- A. Suspensions of work ordered in conformance with the provisions in Section 8-1.05, "Temporary Suspension of Work," of the Standard Specifications, except:
 1. Suspensions ordered due to weather conditions being unfavorable for the suitable prosecution of the controlling operation or operations.
 2. Suspensions ordered due to the failure on the part of the Contractor to carry out orders given, or to perform the provisions of the contract.
 3. Suspensions ordered due to factors beyond the control of and not caused by the State or the Contractor, for which the Contractor is granted extensions of time in conformance with the provisions of the third paragraph of Section 8-1.07, "Liquidated Damages," of the Standard Specifications.
 4. Other suspensions that mutually benefit the State and the Contractor.
- B. Extensions of contract time granted by the State in conformance with the provisions in the fifth paragraph in Section 8-1.07, "Liquidated Damages," of the Standard Specifications and set forth in approved contract change orders, in conformance with the provisions in Section 4-1.03, "Changes," of the Standard Specifications.
- C. Reductions in contract time set forth in approved contract change orders, in conformance with the provisions in Section 4-1.03, "Changes," of the Standard Specifications.

In the event an early completion progress schedule, as defined in "Progress Schedule (Critical Path Method)" of these special provisions, is submitted by the Contractor and approved by the Engineer, the amount of time-related overhead eligible for payment will be based on the total number of working days for the project, in conformance with the provisions in "Beginning of Work, Time of Completion and Liquidated Damages" of these special provisions, rather than the Contractor's early completion progress schedule.

The contract price paid per working day for time-related overhead shall include full compensation for time-related overhead, including the Contractor's share of costs of the independent Certified Public Accountant audit of overhead costs requested by the Engineer, as specified in these special provisions, and as directed by the Engineer.

The provisions in Sections 4-1.03B, "Increased or Decreased Quantities," and 4-1.03C, "Changes in Character of the Work," of the Standard Specifications shall not apply to the contract item of time-related overhead.

Full compensation for additional overhead costs involved in incentive and disincentive provisions to satisfy internal milestone or multiple calendar requirements shall be considered as included in the contract items of work involved and no additional compensation will be allowed therefor.

Full compensation for additional overhead costs incurred during days of inclement weather when the contract work is extended into additional construction seasons due to delays caused by the State shall be considered as included in the time-related overhead paid during the contract working days, and no additional compensation will be allowed therefor.

Full compensation for additional overhead costs involved in performing additional contract item work that is not a controlling operation shall be considered as included in the contract items of work involved and no additional compensation will be allowed therefor.

Full compensation for overhead, other than time-related overhead measured and paid for as specified above, and other than overhead costs included in the markups specified in "Force Account Payment" of these special provisions, shall be considered as included in the various items of work and no additional compensation will be allowed therefor.

Overhead costs incurred by subcontractors of any tier, suppliers, fabricators, manufacturers, and other parties associated with the Contractor shall be considered as included in the various items of work and as specified in Section 9-1.03, "Force Account Payment," of the Standard Specifications.

For the purpose of making partial payments pursuant to the provisions in Section 9-1.06, "Partial Payments," of the Standard Specifications, the number of working days to be paid for time-related overhead in each monthly partial payment will be the number of working days, specified above to be measured for payment that occurred during that monthly estimate period, including compensable suspensions and right of way delays. Working days granted by contract change order due to

extra work or changes in character of the work, will be paid for upon completion of the contract. The amount earned per working day for time-related overhead shall be the lesser of the following amounts:

- A. The contract item price.
- B. Twenty percent of the original total contract amount divided by the number of working days specified in "Beginning of Work, Time of Completion and Liquidated Damages," of these special provisions.

After the work has been completed, except plant establishment work, as provided in Section 20-4.08, "Plant Establishment Work," of the Standard Specifications, the amount of the total contract item price for time-related overhead not yet paid will be included for payment in the first estimate made after completion of roadway construction work, in conformance with the provisions in Section 9-1.06, "Partial Payments," of the Standard Specifications.

10-1.17 OBSTRUCTIONS

Attention is directed to Section 8-1.10, "Utility and Non-Highway Facilities," and Section 15, "Existing Highway Facilities," of the Standard Specifications and these special provisions.

Attention is directed to the existence of certain underground facilities that may require special precautions be taken by the Contractor to protect the health, safety and welfare of workers and of the public. Facilities requiring special precautions include, but are not limited to: conductors of petroleum products, oxygen, chlorine, and toxic or flammable gases; natural gas in pipelines greater than 150 mm in diameter or pipelines operating at pressures greater than 415 kPa (gage); underground electric supply system conductors or cables, with potential to ground of more than 300 V, either directly buried or in a duct or conduit which do not have concentric grounded or other effectively grounded metal shields or sheaths.

The Contractor shall notify the Engineer and the appropriate regional notification center for operators of subsurface installations at least 2 working days, but not more than 14 calendar days, prior to performing any excavation or other work close to any underground pipeline, conduit, duct, wire or other structure. Regional notification centers include, but are not limited to, the following:

If these facilities are not located on the plans in both alignment and elevation, no work shall be performed in the vicinity of the facilities until the owner, or the owner's representative, has located the facility by potholing, probing or other means that will locate and identify the facility. If, in the opinion of the Engineer, the Contractor's operations are delayed or interfered with by reason of the utility facilities not being located by the owner or the owner's representative, the State will compensate the Contractor for the delays to the extent provided in Section 8-1.09, "Right of Way Delays," of the Standard Specifications, and not otherwise, except as provided in Section 8-1.10, "Utility and Non-Highway Facilities," of the Standard Specifications.

Notification Center	Telephone Number
Underground Service Alert-Northern California (USA)	1-800-642-2444
	1-800-227-2600
Underground Service Alert-Southern California (USA)	1-800-422-4133
	1-800-227-2600

No excavation shall be performed within 1.2 m of the following utilities until the owner, or the owner's representative has located the facility by pot holing, probing, or other means that will positively locate and identify the facility both horizontally and vertically. The utility company will be allowed 20 working days to perform this work

The utility owner or the owner's representative shall be present whenever any excavation is performed within 1.2 meters of the following utilities.

Owner	Type	Location
SDG&E	400 mm gas main	Sta 357+42 "SD-15M"
SDG&E	200 mm gas main	Camino Del Norte UC

It is anticipated that the following utility facilities will be relocated prior to the dates shown:

Utility	Location	Date
400 mm water main	Sta 447+28.24 "SD15R" LINE	02/28/2006

In the event that the utility facilities mentioned above are not removed or relocated by the date specified and, if in the opinion of the Engineer, the Contractor's operations are delayed or interfered with by reason of the utility facilities not being removed or relocated by the date specified, the State will compensate the Contractor for the delays to the extent provided in

Section 8-1.09, "Right of Way Delays," of the Standard Specifications, and not otherwise, except as provided in Section 8-1.10, "Utility and Non-Highway Facilities," of the Standard Specifications.

10-1.18 MOBILIZATION

Mobilization shall conform to the provisions in Section 11, "Mobilization," of the Standard Specifications.

10-1.19 CONSTRUCTION AREA TRAFFIC CONTROL DEVICES

Flagging, signs, and temporary traffic control devices furnished, installed, maintained, and removed when no longer required shall conform to the provisions in Section 12, "Construction Area Traffic Control Devices," of the Standard Specifications and these special provisions.

Category 1 temporary traffic control devices are defined as small and lightweight (less than 45 kg) devices. These devices shall be certified as crashworthy by crash testing, crash testing of similar devices, or years of demonstrable safe performance. Category 1 temporary traffic control devices include traffic cones, plastic drums, portable delineators, and channelizers.

If requested by the Engineer, the Contractor shall provide written self-certification for crashworthiness of Category 1 temporary traffic control devices at least 5 days before beginning any work using the devices or within 2 days after the request if the devices are already in use. Self-certification shall be provided by the manufacturer or Contractor and shall include the following:

- A. Date,
- B. Federal Aid number (if applicable),
- C. Contract number, district, county, route and kilometer post of project limits,
- D. Company name of certifying vendor, street address, city, state and zip code,
- E. Printed name, signature and title of certifying person; and
- F. Category 1 temporary traffic control devices that will be used on the project.

The Contractor may obtain a standard form for self-certification from the Engineer.

Category 2 temporary traffic control devices are defined as small and lightweight (less than 45 kg) devices that are not expected to produce significant vehicular velocity change, but may cause potential harm to impacting vehicles. Category 2 temporary traffic control devices include barricades and portable sign supports.

Category 2 temporary traffic control devices shall be on the Federal Highway Administration's (FHWA) list of Acceptable Crashworthy Category 2 Hardware for Work Zones. This list is maintained by FHWA and can be located at:

http://safety.fhwa.dot.gov/roadway_dept/road_hardware/listing.cfm?code=workzone

The Department also maintains this list at:

<http://www.dot.ca.gov/hq/traffops/signtech/signdel/pdf/Category2.pdf>

Category 2 temporary traffic control devices that have not received FHWA acceptance shall not be used. Category 2 temporary traffic control devices in use that have received FHWA acceptance shall be labeled with the FHWA acceptance letter number and the name of the manufacturer. The label shall be readable and permanently affixed by the manufacturer. Category 2 temporary traffic control devices without a label shall not be used.

If requested by the Engineer, the Contractor shall provide a written list of Category 2 temporary traffic control devices to be used on the project at least 5 days before beginning any work using the devices or within 2 days after the request if the devices are already in use.

Category 3 temporary traffic control devices consist of temporary traffic-handling equipment and devices that weigh 45 kg or more and are expected to produce significant vehicular velocity change to impacting vehicles. Temporary traffic-handling equipment and devices include crash cushions, truck-mounted attenuators, temporary railing, temporary barrier, and end treatments for temporary railing and barrier.

Type III barricades may be used as sign supports if the barricades have been successfully crash tested, meeting the NCHRP Report 350 criteria, as one unit with a construction area sign attached.

Category 3 temporary traffic control devices shall be shown on the plans or on the Department's Highway Safety Features list. This list is maintained by the Division of Engineering Services and can be found at:

http://www.dot.ca.gov/hq/esc/approved_products_list/HighwaySafe.htm

Category 3 temporary traffic control devices that are not shown on the plans or not listed on the Department's Highway Safety Features list shall not be used.

Full compensation for providing self-certification for crashworthiness of Category 1 temporary traffic control devices and for providing a list of Category 2 temporary traffic control devices used on the project shall be considered as included in the prices paid for the various items of work requiring the use of the Category 1 or Category 2 temporary traffic control devices and no additional compensation will be allowed therefor.

10-1.20 CONSTRUCTION AREA SIGNS

Construction area signs for temporary traffic control shall be furnished, installed, maintained, and removed when no longer required in conformance with the provisions in Section 12, "Construction Area Traffic Control Devices," of the Standard Specifications and these special provisions.

Attention is directed to "Furnish Sign" of these special provisions.

Attention is directed to the provisions in "Prequalified and Tested Signing and Delineation Materials" of these special provisions. Type II retroreflective sheeting shall not be used on construction area sign panels. Type III, IV, VII, VIII, or IX retroreflective sheeting shall be used for stationary mounted construction area sign panels.

Attention is directed to "Construction Project Information Signs" of these special provisions regarding the number and type of construction project information signs to be furnished, erected, maintained, and removed and disposed of.

Unless otherwise shown on the plans or specified in these special provisions, the color of construction area warning and guide signs shall have black legend and border on orange background, except W10-1 or W47(CA) (Highway-Rail Grade Crossing Advance Warning) sign shall have black legend and border on yellow background.

Orange background on construction area signs shall be fluorescent orange.

Repair to construction area sign panels will not be allowed, except when approved by the Engineer. Sign panels exhibiting a significant color difference between daytime and nighttime shall be immediately replaced at the Contractor's expenses.

The Contractor shall notify the appropriate regional notification center for operators of subsurface installations at least 2 working days, but not more than 14 calendar days, prior to commencing excavation for construction area sign posts. The regional notification centers include, but are not limited to, the following:

Notification Center	Telephone Number
Underground Service Alert-Northern California (USA)	(800) 642-2444 (800) 227-2600
Underground Service Alert-Southern California (USA)	(800) 422-4133

Excavations required to install construction area signs shall be performed by hand methods without the use of power equipment, except that power equipment may be used if it is determined there are no utility facilities in the area of the proposed post holes. The post hole diameter, if backfilled with portland cement concrete, shall be at least 100 mm greater than the major dimension of the post.

Construction area signs placed within 4.6 m from the edge of the travel way shall be mounted on stationary mounted sign supports as specified in "Construction Area Traffic Control Devices" of these special provisions.

The Contractor shall maintain accurate and timely information on construction area signs. Signs that are no longer required shall be immediately covered or removed. Signs that convey inaccurate information shall be immediately replaced or the information shall be corrected. Covers shall be replaced when they no longer cover the signs properly. The Contractor shall immediately restore to the original position and location any sign that is displaced or overturned, from any cause, during the progress of work.

10-1.21 MAINTAINING TRAFFIC

Attention is directed to Sections 7-1.08, "Public Convenience," 7-1.09, "Public Safety," and 12, "Construction Area Traffic Control Devices," of the Standard Specifications and to the provisions in "Public Safety" of these special provisions and these special provisions. Nothing in these special provisions shall be construed as relieving the Contractor from the responsibilities specified in Section 7-1.09.

Attention is directed to "Traffic Plastic Drums," of these special provisions regarding the use of plastic drums in place of portable delineators, cones or Type I or II barricades.

Lane closures shall conform to the provisions in section "Traffic Control System for Lane Closure" of these special provisions.

Personal vehicles of the Contractor's employees shall not be parked on the traveled way or shoulders including any section closed to public traffic.

Whenever work vehicles or equipment are parked on the shoulder within 1.8 m of a traffic lane, the shoulder area shall be closed as shown on the plans.

Lanes shall be closed only during the hours shown on the charts included in this section "Maintaining Traffic." Except work required under Sections 7-1.08 and 7-1.09, work that interferes with public traffic shall be performed only during the hours shown for lane closures.

The full width of the traveled way shall be open for use by public traffic when construction operations are not actively in progress.

Designated legal holidays are: January 1st, the third Monday in February, the last Monday in May, July 4th, the first Monday in September, November 11th, Thanksgiving Day, and December 25th. When a designated legal holiday falls on a Sunday, the following Monday shall be a designated legal holiday. When November 11th falls on a Saturday, the preceding Friday shall be a designated legal holiday.

Minor deviations from the requirements of this section concerning hours of work which do not significantly change the cost of the work may be permitted upon the written request of the Contractor, if in the opinion of the Engineer, public traffic will be better served and the work expedited. These deviations shall not be adopted by the Contractor until the Engineer has approved the deviations in writing. All other modifications will be made by contract change order.

Chart No. 1 Multilane Lane Requirements																										
Direction: Northbound SD-15												Location: 0.4 km N. of Pomerado Road To 0.3 km S. of South Center City Pkwy														
FROM HOUR TO HOUR	a.m.											p.m.														
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12	
Mondays through Thursdays	1	1	1	1	1																					
Fridays	1	1	1	1	1																			3	2	1
Saturdays			1	1	1																					
Sundays			1	1	1	1																		2	1	
Day before designated legal holiday	1	1	1	1	1																					
Designated legal holidays																										
Legend:																										
1 One lane open in direction of travel																										
2 Two adjacent lanes open in direction of travel																										
3 Three adjacent lanes open in direction of travel																										
No lane closure is allowed																										
REMARKS:																										
KP: M30.0/M44.6																										

F=080941071305KC

**Chart No. 2
Multilane Lane Requirements**

Direction: Southbound SD-15

Location: 0.4 km N. of Pomerado Road To 0.3 km S. of South Center City Pkwy

FROM HOUR TO HOUR	a.m.												p.m.													
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12	
Mondays through Thursdays	1	1	1	1	2																			3	2	1
Fridays	1	1	1	1	2																					
Saturdays			1	1	2																					
Sundays			1	1	1	1	2																2	2	1	
Day before designated legal holiday	1	1	1	1	2																					
Designated legal holidays																										

Legend:

- One lane open in direction of travel
- Two adjacent lanes open in direction of travel
- Three adjacent lanes open in direction of travel
- No lane closure is allowed

REMARKS:

KP: M30.0/M44.6

F=080941071305KC

**Chart No. 3
Ramp Lane Requirements**

Direction: Northbound SD-15

Location: NB On-ramp from Via Rancho Parkway
NB Off-ramp to Via Rancho Parkway

FROM HOUR TO HOUR	a.m.												p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	R	R	R	R	R																			R	R
Fridays	R	R	R	R	R																				
Saturdays				R	R	R	R																		
Sundays				R	R	R	R	R																R	R
Day before designated legal holiday	R	R	R	R	R																				
Designated legal holidays																									

Legend:

R Ramp may be closed

No work that interferes with public traffic will be allowed

REMARKS:

NOTE: When an Off-ramp is allowed to be closed, place a PCMS (Portable Changeable Message Sign) in the direction of travel allowing the traffic the option to use the preceding Off-Ramp and warning them of the ramp closure ahead.

KP: M30.0/M44.6

F= 080941060705kc

**Chart No. 4
Ramp Lane Requirements**

Direction: Southbound SD-15

Location: SB On-ramp from Via Rancho Parkway
SB Off-ramp to Via Rancho Parkway

FROM HOUR TO HOUR	a.m.												p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	R	R	R	R	R																			R	R
Fridays	R	R	R	R	R																				
Saturdays				R	R	R																			
Sundays				R	R	R	R	R																R	R
Day before designated legal holiday	R	R	R	R	R																				
Designated legal holidays																									

Legend:

R Ramp may be closed

No work that interferes with public traffic will be allowed

REMARKS:

NOTE: When an Off-ramp is allowed to be closed, place a PCMS (Portable Changeable Message Sign) in the direction of travel allowing the traffic the option to use the preceding Off-Ramp and warning them of the ramp closure ahead.

KP: M30.0/M44.6

F= 080941060705kc

**Chart No. 5
Ramp Lane Requirements**

Direction: Northbound SD-15							Location: NB Off-ramp to Center City Parkway																		
FROM HOUR TO HOUR	a.m.											p.m.													
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	R	R	R	R	R	R																		R	R
Fridays	R	R	R	R	R	R																			
Saturdays				R	R	R	R																		
Sundays				R	R	R	R	R																R	R
Day before designated legal holiday	R	R	R	R	R																				
Designated legal holidays																									

Legend:

R Ramp may be closed

No work that interferes with public traffic will be allowed

REMARKS:

NOTE: When an Off-ramp is allowed to be closed, place a PCMS (Portable Changeable Message Sign) in the direction of travel allowing the traffic the option to use the preceding Off-Ramp and warning them of the ramp closure ahead.

KP: M30.0/M44.6

F= 080941060705kc

Chart No. 6																																		
Ramp Lane Requirements																																		
Direction: Southbound SD-15												Location: SB On-ramp from Center City Parkway																						
												a.m.												p.m.										
FROM HOUR TO HOUR	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12									
Mondays through Thursdays	R	R	R	R	R																				R	R	R							
Fridays	R	R	R	R	R																													
Saturdays					R	R	R																											
Sundays					R	R	R	R																	R	R	R							
Day before designated legal holiday	R	R	R	R	R																													
Designated legal holidays																																		
Legend:																																		
<input type="checkbox"/> R Ramp may be closed <input type="checkbox"/> No work that interferes with public traffic will be allowed																																		
REMARKS:																																		
<p>NOTE: When an Off-ramp is allowed to be closed, place a PCMS (Portable Changeable Message Sign) in the direction of travel allowing the traffic the option to use the preceding Off-Ramp and warning them of the ramp closure ahead.</p> <p>KP: M30.0/M44.6</p>																																		

F= 080941060705kc

Chart No. 7																																		
Road Lane Requirements																																		
Direction: EB/WB Via Rancho Parkway												Location: At RTE 15																						
												a.m.												p.m.										
FROM HOUR TO HOUR	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12									
Mondays through Thursdays	2	2	2	2	2																					2	2	2						
Fridays	2	2	2	2	2																													
Saturdays									2	2	2	2	2	2	2	2	2	2																
Sundays									2	2	2	2	2	2	2	2	2	2								2	2	2						
Day before designated legal holiday	2	2	2	2	2																													
Designated legal holidays																																		
Legend:																																		
<input type="checkbox"/> 2 Two lanes open in direction of travel <input type="checkbox"/> No lane closure is allowed																																		
REMARKS:																																		
<p>KP: M30.0/M44.6</p>																																		

F= 080941060705KC

Chart No. 8
Two - Lane Conventional Highway Lane Requirements

Direction: Eastbound / Westbound De Lago Blvd						Location: At RTE 15																				
FROM HOUR TO HOUR	a.m.											p.m.														
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12	
Mondays through Thursdays	R	R	R	R	R																			R	R	R
Fridays	R	R	R	R	R																					
Saturdays								R	R	R	R	R	R	R	R	R	R	R								
Sundays								R	R	R	R	R	R	R	R	R	R						R	R	R	
Day before designated legal holiday	R	R	R	R	R																					
Designated legal holidays																										

Legend:

R	A minimum of one paved traffic lane, not less than 3.60 m wide, shall be open for use by public traffic. (Reversing Control).
	No work that interferes with public traffic will be allowed

REMARKS:

NOTE: When Reverse Traffic Control is used:

1. Close one traffic lane and stop public traffic for periods not to exceed ten minutes.
2. Maximum length of one-way control shall be 800 m.

KP: M30.0/M44.6

F= 080941060705KC

**Chart No. 9
HOV Lane Requirements**

Direction: Northbound SD-15						Location: NB HOV Off-ramp to RTE 56																			
	a.m.						p.m.																		
FROM HOUR TO HOUR	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays	R	R	R	R	R																				
Tuesday through Thursdays																									
Fridays																					R	R	R	R	
Saturdays and Sundays	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R
Day before designated legal holiday																									
Designated legal holidays																									

Legend:

- HOV Ramp may be closed
- No lane closure allowed

REMARKS:

- **This chart shall be used no more than (3) weekends only.**
 - **This chart shall only be used with coordination from the TMC (Everett Townsend or Lima Kopitch).**
- Detour NB HOV traffic to NB RTE HOV off ramp to RTE 15 (Slip Ramp)**
1. Each request for any closure on the HOV Lanes MUST be submitted to the District Traffic Manager for approval.
 2. Each request for use of the HOV Lanes MUST be submitted to the Transportation Management Center (TMC) **2-weeks** in advance for approval. **This will expedite scheduling of TMC personnel for weekend work.** If the work is cancelled for any reason, the TMC MUST be notified as soon as possible.
 3. The Contractor and any Caltrans person responsible for overseeing the work/contract is responsible for maintaining safety on the HOV Lanes during **the scheduled work**. Caltrans maintenance units and/or CHP units may be on the lanes when the lanes are not open to the motoring public.
 4. The HOV Lanes are used as an alternate route when a major incident occurs on the main lanes of I-15 within the 8-mile length of the HOV Lanes. All contractor and Caltrans personnel, vehicles, and equipment must be able to vacate the HOV Lanes within approximately 20 minutes of being notified by the TMC.
 5. It is imperative the responsible Caltrans person and/or contractor have cellular phones so the TMC has contact with them at all times while they are on the lanes.
 6. A list of contractor personnel, along with the responsible Caltrans personnel, MUST be on file in the TMC including pager and cellular phone number information **prior** to approval for use of the HOV lanes for the work.
 7. **It is the responsibility of the contractor to post closure information signs at all entrances to the HOV lanes 3 days in advance of a full closure of the Lanes.** When closing the HOV lanes completely (all lanes), all entrance gates on the HOV Lanes (Gate 1, Gate 2, Gate 5) will be closed prior to the beginning of work. It is the responsibility of the contractor and/or Caltrans personnel on the HOV lanes to assist the TMC in this procedure. Once this is done, the work may proceed.
 8. After completing work for the day/night and prior to leaving the I-15 HOV Express Lanes, all HOV Gates **MUST** be re-opened. **Contact TMC personnel by phone (858-467-3090 or 3089)** to complete this procedure.
 9. **New operational hours have been implemented for the HOV Lanes. The HOV lanes remain open from 0500 Friday to 2000 on Monday. This chart allows the closing of the lanes during specific time frames for construction work.**
 10. **Day time lane closures must be coordinated with the TMC during the midday turnaround (close to SB traffic open to NB traffic) so all signs face on-coming traffic and indicate the appropriate closure message.**
 11. The Contractor shall place portable CMS's to provide an advanced warning to the public of an upcoming HOV closure or closures and CMS's South HOV lanes, warning RTE 56 closure. The messages must be coordinated with the TMC and reported to the TMC at the times of activation and deactivation of the signs.

**Chart No. 10
HOV Lane Requirements**

Direction: Northbound SD-15						Location: NB HOV lanes Off-ramp to RTE 56																							
	a.m.											p.m.																	
FROM HOUR TO HOUR	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12				
Mondays								R	R	R	R	R													R	R	R	R	
Tuesday through Thursdays	R	R	R	R	R	R	R	R	R	R	R	R														R	R	R	R
Fridays	R	R	R	R	R	R	R	R	R	R	R	R																	
Saturdays and Sundays																													
Day before designated legal holiday	R	R	R	R	R	R	R	R	R	R	R	R																	
Designated legal holidays																													

Legend:

- R HOV Ramp may be closed
- No lane closure allowed

REMARKS:

- **This chart shall be used no more than (15) days only.**
 - **This chart shall be used with coordination from the TMC (Everett Townsend or Lima Kopitch).**
12. Each request for any closure on the HOV Lanes MUST be submitted to the District Traffic Manager for approval.
 13. Each request for use of the HOV Lanes MUST be submitted to the Transportation Management Center (TMC) **2-weeks** in advance for approval. **This will expedite scheduling of TMC personnel for weekend work.** If the work is cancelled for any reason, the TMC MUST be notified as soon as possible.
 14. The Contractor and any Caltrans person responsible for overseeing the work/contract is responsible for maintaining safety on the HOV Lanes during **the scheduled work**. Caltrans maintenance units and/or CHP units may be on the lanes when the lanes are not open to the motoring public.
 15. The HOV Lanes are used as an alternate route when a major incident occurs on the main lanes of I-15 within the 8-mile length of the HOV Lanes. All contractor and Caltrans personnel, vehicles, and equipment must be able to vacate the HOV Lanes within approximately 20 minutes of being notified by the TMC.
 16. It is imperative the responsible Caltrans person and/or contractor have cellular phones so the TMC has contact with them at all times while they are on the lanes.
 17. A list of contractor personnel, along with the responsible Caltrans personnel, MUST be on file in the TMC including pager and cellular phone number information **prior** to approval for use of the HOV lanes for the work.
 18. **It is the responsibility of the contractor to post closure information signs at all entrances to the HOV lanes 3 days in advance of a full closure of the Lanes.** When closing the HOV lanes completely (all lanes), all entrance gates on the HOV Lanes (Gate 1, Gate 2, Gate 5) will be closed prior to the beginning of work. It is the responsibility of the contractor and/or Caltrans personnel on the HOV lanes to assist the TMC in this procedure. Once this is done, the work may proceed.
 19. After completing work for the day/night and prior to leaving the I-15 HOV Express Lanes, all HOV Gates **MUST** be re-opened. **Contact TMC personnel by phone (858-467-3090 or 3089)** to complete this procedure.
 20. **New operational hours have been implemented for the HOV Lanes. The HOV lanes remain open from 0500 Friday to 2000 on Monday. This chart allows the closing of the lanes during specific time frames for construction work.**
 21. **Day time lane closures must be coordinated with the TMC during the midday turnaround (close to SB traffic open to NB traffic) so all signs face on-coming traffic and indicate the appropriate closure message.**
 22. The Contractor shall place portable CMS's to provide an advanced warning to the public of an upcoming HOV closure or closures. The messages must be coordinated with the TMC and reported to the TMC at the times of activation and deactivation of the signs.

F=08094109090500

**Chart No. 11
HOV Lane Requirements**

Direction: Southbound SD-15						Location: SB Off-ramp to HOV Lanes																			
	a.m.											p.m.													
FROM HOUR TO HOUR	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays	R	R	R	R	R																				
Tuesday through Thursdays																									
Fridays																					R	R	R	R	
Saturdays and Sundays	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	
Day before designated legal holiday																									
Designated legal holidays																									

Legend:

R HOV Ramp may be closed

No lane closure allowed

REMARKS:

- **This chart shall be used no more than (3) weekends only.**
 - **This chart shall be used with coordination from the TMC (Everett Townsend or Lima Kopitch).**
23. Each request for any closure on the HOV Lanes MUST be submitted to the District Traffic Manager for approval.
 24. Each request for use of the HOV Lanes MUST be submitted to the Transportation Management Center (TMC) **2-weeks** in advance for approval. **This will expedite scheduling of TMC personnel for weekend work.** If the work is cancelled for any reason, the TMC MUST be notified as soon as possible.
 25. The Contractor and any Caltrans person responsible for overseeing the work/contract is responsible for maintaining safety on the HOV Lanes during **the scheduled work**. Caltrans maintenance units and/or CHP units may be on the lanes when the lanes are not open to the motoring public.
 26. The HOV Lanes are used as an alternate route when a major incident occurs on the main lanes of I-15 within the 8-mile length of the HOV Lanes. All contractor and Caltrans personnel, vehicles, and equipment must be able to vacate the HOV Lanes within approximately 20 minutes of being notified by the TMC.
 27. It is imperative the responsible Caltrans person and/or contractor have cellular phones so the TMC has contact with them at all times while they are on the lanes.
 28. A list of contractor personnel, along with the responsible Caltrans personnel, MUST be on file in the TMC including pager and cellular phone number information **prior** to approval for use of the HOV lanes for the work.
 29. **It is the responsibility of the contractor to post closure information signs at all entrances to the HOV lanes 3 days in advance of a full closure of the Lanes.** When closing the HOV lanes completely (all lanes), all entrance gates on the HOV Lanes (Gate 1, Gate 2, Gate 5) will be closed prior to the beginning of work. It is the responsibility of the contractor and/or Caltrans personnel on the HOV lanes to assist the TMC in this procedure. Once this is done, the work may proceed.
 30. After completing work for the day/night and prior to leaving the I-15 HOV Express Lanes, all HOV Gates **MUST** be re-opened. **Contact TMC personnel by phone (858-467-3090 or 3089)** to complete this procedure.
 31. **New operational hours have been implemented for the HOV Lanes. The HOV lanes remain open from 0500 Friday to 2000 on Monday. This chart allows the closing of the lanes during specific time frames for construction work.**
 32. **Day time lane closures must be coordinated with the TMC during the midday turnaround (close to SB traffic open to NB traffic) so all signs face on-coming traffic and indicate the appropriate closure message.**
 33. The Contractor shall place portable CMS's to provide an advanced warning to the public of an upcoming HOV closure or closures. The messages must be coordinated with the TMC and reported to the TMC at the times of activation and deactivation of the signs.

**Chart No. 12
HOV Lane Requirements**

Direction: Southbound SD-15						Location: SB Off-ramp to HOV Lanes																			
	a.m.											p.m.													
FROM HOUR TO HOUR	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays	R	R	R	R	R								R	R	R	R	R	R	R	R	R	R	R	R	R
Fridays	R	R	R	R	R																				
Saturdays																									
Sundays																						R	R	R	R
Day before designated legal holiday	R	R	R	R	R																				
Designated legal holidays																									

Legend:

- HOV Ramp may be closed
- No lane closure allowed

REMARKS:

- **This chart shall be used no more than (15) days only.**
- **This chart shall be used with coordination from the TMC (Everett Townsend or Lima Kopitch).**
- 34. Each request for any closure on the HOV Lanes MUST be submitted to the District Traffic Manager for approval.
- 35. Each request for use of the HOV Lanes MUST be submitted to the Transportation Management Center (TMC) **2-weeks** in advance for approval. **This will expedite scheduling of TMC personnel for weekend work.** If the work is cancelled for any reason, the TMC MUST be notified as soon as possible.
- 36. The Contractor and any Caltrans person responsible for overseeing the work/contract is responsible for maintaining safety on the HOV Lanes during **the scheduled work**. Caltrans maintenance units and/or CHP units may be on the lanes when the lanes are not open to the motoring public.
- 37. The HOV Lanes are used as an alternate route when a major incident occurs on the main lanes of I-15 within the 8-mile length of the HOV Lanes. All contractor and Caltrans personnel, vehicles, and equipment must be able to vacate the HOV Lanes within approximately 20 minutes of being notified by the TMC.
- 38. It is imperative the responsible Caltrans person and/or contractor have cellular phones so the TMC has contact with them at all times while they are on the lanes.
- 39. A list of contractor personnel, along with the responsible Caltrans personnel, MUST be on file in the TMC including pager and cellular phone number information **prior** to approval for use of the HOV lanes for the work.
- 40. **It is the responsibility of the contractor to post closure information signs at all entrances to the HOV lanes 3 days in advance of a full closure of the Lanes.** When closing the HOV lanes completely (all lanes), all entrance gates on the HOV Lanes (Gate 1, Gate 2, Gate 5) will be closed prior to the beginning of work. It is the responsibility of the contractor and/or Caltrans personnel on the HOV lanes to assist the TMC in this procedure. Once this is done, the work may proceed.
- 41. After completing work for the day/night and prior to leaving the I-15 HOV Express Lanes, all HOV Gates **MUST** be re-opened. **Contact TMC personnel by phone (858-467-3090 or 3089)** to complete this procedure.
- 42. **New operational hours have been implemented for the HOV Lanes. The HOV lanes remain open from 0500 Friday to 2000 on Monday. This chart allows the closing of the lanes during specific time frames for construction work.**
- 43. **Day time lane closures must be coordinated with the TMC during the midday turnaround (close to SB traffic open to NB traffic) so all signs face on-coming traffic and indicate the appropriate closure message.**
- 44. The Contractor shall place portable CMS's to provide an advanced warning to the public of an upcoming HOV closure or closures. The messages must be coordinated with the TMC and reported to the TMC at the times of activation and deactivation of the signs.

F=08094109090500

**Chart No. 13
HOV Lane Requirements**

Direction: Northbound – Southbound SD-15						Location: RTE 15 HOV Lanes																			
	a.m.											p.m.													
FROM HOUR TO HOUR	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays through Thursdays												1	1	1	1										
Fridays												1	1	1	1										
Saturdays																									
Sundays																									
Day before designated legal holiday												1	1	1	1										
Designated legal holidays																									

Legend:

- 1 One HOV-lane open in direction of travel
- No lane closure allowed

REMARKS:

- **This chart shall be used with coordination from the TMC (Everett Townsend or Lima Kopitch).**
- 45. Each request for any closure on the HOV Lanes MUST be submitted to the District Traffic Manager for approval.
- 46. Each request for use of the HOV Lanes MUST be submitted to the Transportation Management Center (TMC) **2-weeks** in advance for approval. **This will expedite scheduling of TMC personnel for weekend work.** If the work is cancelled for any reason, the TMC MUST be notified as soon as possible.
- 47. The Contractor and any Caltrans person responsible for overseeing the work/contract is responsible for maintaining safety on the HOV Lanes during **the scheduled work.** Caltrans maintenance units and/or CHP units may be on the lanes when the lanes are not open to the motoring public.
- 48. The HOV Lanes are used as an alternate route when a major incident occurs on the main lanes of I-15 within the 8-mile length of the HOV Lanes. All contractor and Caltrans personnel, vehicles, and equipment must be able to vacate the HOV Lanes within approximately 20 minutes of being notified by the TMC.
- 49. It is imperative the responsible Caltrans person and/or contractor have cellular phones so the TMC has contact with them at all times while they are on the lanes.
- 50. A list of contractor personnel, along with the responsible Caltrans personnel, MUST be on file in the TMC including pager and cellular phone number information **prior** to approval for use of the HOV lanes for the work.
- 51. **It is the responsibility of the contractor to post closure information signs at all entrances to the HOV lanes 3 days in advance of a full closure of the Lanes.** When closing the HOV lanes completely (all lanes), all entrance gates on the HOV Lanes (Gate 1, Gate 2, Gate 5) will be closed prior to the beginning of work. It is the responsibility of the contractor and/or Caltrans personnel on the HOV lanes to assist the TMC in this procedure. Once this is done, the work may proceed.
- 52. After completing work for the day/night and prior to leaving the I-15 HOV Express Lanes, all HOV Gates **MUST** be re-opened. **Contact TMC personnel by phone (858-467-3090 or 3089)** to complete this procedure.
- 53. **New operational hours have been implemented for the HOV Lanes. The HOV lanes remain open from 0500 Friday to 2000 on Monday. This chart allows the closing of the lanes during specific time frames for construction work.**
- 54. **Day time lane closures must be coordinated with the TMC during the midday turnaround (close to SB traffic open to NB traffic) so all signs face on-coming traffic and indicate the appropriate closure message.**
- 55. The Contractor shall place portable CMS's to provide an advanced warning to the public of an upcoming HOV closure or closures. The messages must be coordinated with the TMC and reported to the TMC at the times of activation and deactivation of the signs.

**Chart No. 14
HOV Shoulder Closure Requirements**

Direction: Northbound – Southbound SD-15						Location: RTE 15 HOV Lanes																		
FROM HOUR TO HOUR	a.m.											p.m.												
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11
Mondays through Thursdays	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S
Fridays	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S
Saturdays	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S
Sundays	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S
Day before designated legal holiday	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S
Designated legal holidays	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S	S

Legend:

S HOV Shoulder may be closed

No Shoulder closure allowed

REMARKS: The shoulder closure is for the west side of the HOV

- This chart shall only be used with coordination from the TMC (Everett Townsend or Lima Kopitch).

KP: M30.0/M44.6

F=08094109080500

**Chart No. 15
Full Freeway Closure Requirements**

Direction: Northbound SD-15						Location: At Via Rancho Parkway OC																					
FROM HOUR TO HOUR	a.m.											p.m.															
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12		
Mondays through Thursdays	F	F	F	F	F																				3	2	1
Fridays	F	F	F	F	F																						
Saturdays																											
Sundays	F	F	F	F	F																				3	3	2
Day before designated legal holiday																											
Designated legal holidays																											

Legend:

- F Freeway may be closed
- 1 One lane open in direction of travel
- 2 Two adjacent lanes open in direction of travel
- 3 Three adjacent lanes open in direction of travel
- No lane closure is allowed

REMARKS:

This chart shall be used no more than four (4) nights only.

Detour NB RTE 15 for the full Freeway closure

Detour NB RTE 15 traffic via NB RTE 15 Off-ramp to Via Rancho Parkway thence westerly on Via Rancho Parkway to Felicita Road thence northerly on Felicita Road to Citracado Parkway thence easterly on Citracado Parkway to NB RTE 15.

NOTE: When the freeway is closed, place a PCMS (Portable Changeable Message Sign) on NB RTE 15 S. of Pomerado Rd. warning the traffic of the closure ahead.

KP: M43.893

F= 08094109090500

**Chart No. 16
Road Closure Requirements**

Direction: Southbound "Center City Parkway"

Location: At Citracado Parkway

FROM HOUR TO HOUR	a.m.											p.m.													
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12
Mondays	X	X	X	X	X																				
Tuesday through Thursdays																									
Fridays																				X	X	X	X	X	
Saturdays and Sundays	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
Day before designated legal holiday																									
Designated legal holidays																									

Legend:

Road may be closure

No lane closure allowed

REMARKS:

- **This chart shall be used no more than two (2) weekends only.**

Detour SB Center City Parkway to SB RTE 15 On ramp

Detour SB Center City Parkway SB RTE 15 On ramp traffic via southerly on Center City Parkway to SB Center City Parkway to WB Citracado Parkway thence westerly on Citracado Parkway to SB RTE 15 On ramp.

NOTE: This chart should be used in conjunction with chart No. 17, when SB RTE 15 On ramp closure is allowed.

KP:R43.1

F= 08094109220500

Chart No. 17																													
Ramp Lane Requirements																													
Direction: Southbound SD - 15												Location: SB On-ramp from Center City Parkway																	
												a.m.						p.m.											
FROM HOUR TO HOUR	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11	12				
Mondays	R	R	R	R	R																								
Tuesday through Thursdays																													
Fridays																				R	R	R	R	R					
Saturdays and Sundays	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R	R					
Day before designated legal holiday																													
Designated legal holidays																													
Legend:																													
<table style="width:100%; border-collapse: collapse;"> <tr> <td style="border: 1px solid black; width: 20px; text-align: center;">R</td> <td>Ramp may be closed</td> </tr> <tr> <td style="border: 1px solid black; width: 20px; height: 15px;"></td> <td>No work that interferes with public traffic will be allowed</td> </tr> </table>																								R	Ramp may be closed		No work that interferes with public traffic will be allowed		
R	Ramp may be closed																												
	No work that interferes with public traffic will be allowed																												
REMARKS:																													
<ul style="list-style-type: none"> • This chart shall be used no more than two (2) weekends only. <p>Detour SB Center City Parkway to SB RTE 15 Detour SB Center City Parkway to SB RTE 15 traffic via southerly on Center City Parkway to Citracado Parkway thence westerly on Citracado Parkway to SB RTE 15 On ramp.</p> <p>NOTE: This chart should be used in conjunction with chart No.16, when SB RTE 15 On ramp closure is allowed.</p> <p>KP: M44.184</p>																													

F= 08094109130500

Erection and removal of falsework at locations where falsework openings are required shall be undertaken one location at a time. During falsework erection and removal, public traffic in the lanes over which falsework is being erected or removed shall be detoured or stopped as specified in this section, "Maintaining Traffic." Falsework erection shall include adjustments or removal of components that contribute to the horizontal stability of the falsework system. Falsework removal shall include lowering falsework, blowing sand from sand jacks, turning screws on screw jacks, and removing wedges.

The Contractor shall have necessary materials and equipment on the site to erect or remove the falsework in any one span or over any one opening before detouring or stopping public traffic.

10-1.22 CLOSURE REQUIREMENTS AND CONDITIONS

Lane closures shall conform to the provisions in "Maintaining Traffic" of these special provisions and these special provisions.

The term closure, as used herein, is defined as the closure of a traffic lane or lanes, including ramp or connector lanes, within a single traffic control system.

The Contractor shall furnish special portable freeway detour signs as shown on the plans to be used on the detour routes as directed by the Engineer.

CLOSURE SCHEDULE

By noon Monday, the Contractor shall submit a written schedule of planned closures for the following week period, defined as Friday noon through the following Friday noon. Closures involving work (temporary barrier placement and paving operations) that will reduce horizontal clearances, traveled way inclusive of shoulders, to 2 lanes or less shall be submitted not less than 18 working days and no more than 90 working days before the anticipated start of operation. Closures involving work (pavement overlay, overhead sign installation, falsework and girder erection) that will reduce the vertical clearances available to the public, shall be submitted not less than 18 working days and no more than 90 working days before the anticipated start of operation.

The Closure Schedule shall show the locations and times when the proposed closures are to be in effect. The Contractor shall use the Closure Schedule request forms furnished by the Engineer. Closure Schedules submitted to the Engineer with incomplete, unintelligible or inaccurate information will be returned for correction and resubmittal. The Contractor will be notified of disapproved closures or closures that require coordination with other parties as a condition of approval.

Amendments to the Closure Schedule, including adding additional closures, shall be submitted to the Engineer, in writing, at least 3 working days in advance of a planned closure. Approval of amendments to the Closure Schedule will be at the discretion of the Engineer.

The Contractor shall confirm, in writing, scheduled closures by no later than 8:00 a.m. 3 working days prior to the date on which the closure is to be made. Approval or denial of scheduled closures will be made no later than 4:00 p.m. 2 working days prior to the date on which the closure is to be made. Closures not confirmed or approved will not be allowed.

Freeways and ramps may be closed only if signed for closing 3 days in advance. The Contractor shall notify the Engineer not less than 5 calendar days prior to signing the freeway or ramp. If the freeway or ramp is not closed on the posted day, the closure shall be changed to allow 3 days advance notice before closure.

Confirmed closures that are cancelled due to unsuitable weather may be rescheduled at the discretion of the Engineer for the following working day.

Closure of two consecutive on-ramps or off-ramps in the same direction of travel will not be permitted simultaneously unless otherwise provided in these special provisions or permitted by the Engineer.

CONTINGENCY PLAN

The Contractor shall prepare a contingency plan for reopening closures to public traffic. The Contractor shall submit the contingency plan for a given operation to the Engineer within one working day of the Engineer's request.

LATE REOPENING OF CLOSURES

If a closure is not reopened to public traffic by the specified time, work shall be suspended in conformance with the provisions in Section 8-1.05, "Temporary Suspension of Work," of the Standard Specifications. The Contractor shall not make further closures until the Engineer has accepted a work plan, submitted by the Contractor, that will insure that future closures will be reopened to public traffic at the specified time. The Engineer will have 2 working days to accept or reject the Contractor's proposed work plan. The Contractor will not be entitled to compensation for the suspension of work resulting from the late reopening of closures.

For each 10-minute interval, or fraction thereof past the time specified to reopen the closure, the Department will deduct \$11,240.00 per interval from moneys due or that may become due the Contractor under the contract.

COMPENSATION

The Contractor shall notify the Engineer of delay in the Contractor's operations due to the following conditions, and if, in the opinion of the Engineer, the Contractor's controlling operation is delayed or interfered with by reason of those conditions, and the Contractor's loss due to that delay could not have been avoided by rescheduling the affected closure or by judicious handling of forces, equipment and plant, the delay will be considered a right of way delay within the meaning of Section 8-1.09, "Right of Way Delays," and compensation for the delay will be determined in conformance with the provisions in Section 8-1.09:

- A. The Contractor's proposed Closure Schedule is denied and his planned closures are within the time frame allowed for closures in "Maintaining Traffic" of these special provisions, except that the Contractor will not be entitled to compensation for amendments to the Closure Schedule that are not approved.
- B. The Contractor is denied a confirmed closure.

Should the Engineer direct the Contractor to remove a closure prior to the time designated in the approved Closure Schedule, delay to the Contractor's schedule due to removal of the closure will be considered a right of way delay within the meaning of Section 8-1.09, "Right of Way Delays," and compensation for the delay will be determined in conformance with the provisions in Section 8-1.09.

10-1.23 TRAFFIC CONTROL SYSTEM FOR LANE CLOSURE

A traffic control system shall consist of closing traffic lanes and ramps in conformance with the details shown on the plans, the provisions in Section 12, "Construction Area Traffic Control Devices," of the Standard Specifications, the provisions under "Maintaining Traffic" and "Construction Area Signs" of these special provisions, and these special provisions.

The provisions in this section will not relieve the Contractor of responsibility for providing additional devices or taking measures as may be necessary to comply with the provisions in Section 7-1.09, "Public Safety," of the Standard Specifications.

During traffic stripe operations and pavement marker placement operations using bituminous adhesive, traffic shall be controlled, at the option of the Contractor, with either stationary or moving lane closures. During other operations, traffic shall be controlled with stationary lane closures. Attention is directed to the provisions in Section 84-1.04, "Protection From Damage," and Section 85-1.06, "Placement," of the Standard Specifications.

If components in the traffic control system are displaced or cease to operate or function as specified, from any cause, during the progress of the work, the Contractor shall immediately repair the components to the original condition or replace the components and shall restore the components to the original location.

STATIONARY LANE CLOSURE

When lane and ramp closures are made for work periods only, at the end of each work period, components of the traffic control system, except portable delineators placed along open trenches or excavation adjacent to the traveled way, shall be removed from the traveled way and shoulder. If the Contractor so elects, the components may be stored at selected central locations, designated by the Engineer within the limits of the highway right of way.

Each vehicle used to place, maintain and remove components of a traffic control system on multilane highways shall be equipped with a Type II flashing arrow sign which shall be in operation when the vehicle is being used for placing, maintaining or removing the components. Vehicles equipped with Type II flashing arrow sign not involved in placing, maintaining or removing the components when operated within a stationary type lane closure shall only display the caution display mode. The sign shall be controllable by the operator of the vehicle while the vehicle is in motion. The flashing arrow sign shown on the plans shall not be used on the vehicles which are doing the placing, maintaining and removing of components of a traffic control system and shall be in place before a lane closure requiring the sign's use is completed.

MOVING LANE CLOSURE

Flashing arrow signs used in moving lane closures shall be truck-mounted. Changeable message signs used in moving lane closure operations shall conform to the provisions in Section 12-3.12, "Portable Changeable Message Signs," of the Standard Specifications, except the signs shall be truck-mounted and the full operation height of the bottom of the sign may be less than 2.1 m above the ground, but should be as high as practicable.

Truck-mounted attenuators (TMA) for use in moving lane closures shall be any of the following approved models, or equal:

- A. Hexfoam TMA Series 3000, Alpha 1000 TMA Series 1000 and Alpha 2001 TMA Series 2001, manufactured by Energy Absorption Systems, Inc., One East Wacker Drive, Chicago, IL 60601-2076, Telephone (312) 467-6750.
 - 1. Distributor (northern): Traffic Control Service, Inc., 8585 Thys Court, Sacramento, CA 95828, Telephone (800) 884-8274, FAX (916) 387-9734.
 - 2. Distributor (southern): Traffic Control Service, Inc., 1881 Betmor Lane, Anaheim, CA 92805, Telephone (800) 222-8274.
- B. Cal T-001 Model 2 or Model 3, manufacturer and distributor: Hexcel Corporation, 11711 Dublin Boulevard, P.O. Box 2312, Dublin, CA 94568, Telephone (925) 551-4900.
- C. Renco Rengard Model Nos. CAM 8-815 and RAM 8-815, manufacturer and distributor: Renco Inc., 1582 Pflugerville Loop Road, P.O. Box 730, Pflugerville, TX 78660-0730, Telephone (800) 654-8182.

Each TMA shall be individually identified with the manufacturer's name, address, TMA model number, and a specific serial number. The names and numbers shall each be a minimum 13 mm high and located on the left (street) side at the lower front corner. The TMA shall have a message next to the name and model number in 13 mm high letters which states, "The bottom of this TMA shall be _____ mm \pm _____ mm above the ground at all points for proper impact performance." Any TMA which is damaged or appears to be in poor condition shall not be used unless recertified by the manufacturer. The Engineer shall be the sole judge as to whether used TMAs supplied under this contract need recertification. Each unit shall be certified by the manufacturer to meet the requirements for TMA in conformance with the standards established by the Transportation Laboratory.

Approvals for new TMA designs proposed as equal to the above approved models shall be in conformance with the procedures (including crash testing) established by the Transportation Laboratory. For information regarding submittal of new designs for evaluation contact: Transportation Laboratory, 5900 Folsom Boulevard, Sacramento, California 95819.

New TMAs proposed as equal to approved TMAs or approved TMAs determined by the Engineer to need recertification shall not be used until approved or recertified by the Transportation Laboratory.

PAYMENT

The contract lump sum price paid for traffic control system shall include full compensation for furnishing all labor, materials (including signs), tools, equipment, and incidentals, and for doing all the work involved in placing, removing, storing, maintaining, moving to new locations, replacing and disposing of the components of the traffic control system shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

The adjustment provisions in Section 4-1.03, "Changes," of the Standard Specifications shall not apply to the item of traffic control system. Adjustments in compensation for traffic control system will be made only for increased or decreased traffic control system required by changes ordered by the Engineer and will be made on the basis of the cost of the increased or decreased traffic control necessary. The adjustment will be made on a force account basis as provided in Section 9-1.03, "Force Account Payment," of the Standard Specifications for increased work and estimated on the same basis in the case of decreased work.

Traffic control system required by work which is classed as extra work, as provided in Section 4-1.03D of the Standard Specifications, will be paid for as a part of the extra work.

10-1.24 TEMPORARY PAVEMENT DELINEATION

Temporary pavement delineation shall be furnished, placed, maintained, and removed in conformance with the provisions in Section 12-3.01, "General," of the Standard Specifications and these special provisions. Nothing in these special provisions shall be construed as reducing the minimum standards specified in the MUTCD, the MUTCD California Supplement, or as relieving the Contractor from the responsibilities specified in Section 7-1.09, "Public Safety," of the Standard Specifications.

Attention is directed to "Traffic Plastic Drums," of these special provisions regarding the use of traffic plastic drums in place of portable delineators or cones.

GENERAL

Whenever the work causes obliteration of pavement delineation, temporary or permanent pavement delineation shall be in place prior to opening the traveled way to public traffic. Laneline or centerline pavement delineation shall be provided at all times for traveled ways open to public traffic. On multilane roadways (freeways and expressways), edgeline delineation shall be provided at all times for traveled ways open to public traffic.

Work necessary, including required lines or marks, to establish the alignment of temporary pavement delineation shall be performed by the Contractor. Surfaces to receive temporary pavement delineation shall be dry and free of dirt and loose material. Temporary pavement delineation shall not be applied over existing pavement delineation or other temporary pavement delineation. Temporary pavement delineation shall be maintained until superseded or replaced with a new pattern of temporary pavement delineation or permanent pavement delineation.

Temporary pavement markers and removable traffic tape which conflicts with a new traffic pattern or which is applied to the final layer of surfacing or existing pavement to remain in place shall be removed when no longer required for the direction of public traffic, as determined by the Engineer.

TEMPORARY LANELINE AND CENTERLINE DELINEATION

Whenever lanelines and centerlines are obliterated, the minimum laneline and centerline delineation to be provided shall be temporary raised pavement markers placed at longitudinal intervals of not more than 7.3 m. The temporary raised pavement markers shall be the same color as the laneline or centerline the markers replace. Temporary raised pavement markers shall be, at the option of the Contractor, one of the temporary pavement markers listed for short term day/night use (14 days or less) or long term day/night use (6 months or less) in "Prequalified and Tested Signing and Delineation Materials" of these special provisions.

Temporary raised pavement markers shall be placed in conformance with the manufacturer's instructions and shall be cemented to the surfacing with the adhesive recommended by the manufacturer, except epoxy adhesive shall not be used to place pavement markers in areas where removal of the markers will be required.

Temporary laneline or centerline delineation consisting entirely of temporary raised pavement markers placed on longitudinal intervals of not more than 7.3 m shall be used on lanes open to public traffic for a maximum of 14 days. Prior to the end of the 14 days, the permanent pavement delineation shall be placed. If the permanent pavement delineation is not placed within the 14 days, additional temporary pavement delineation shall be provided at the Contractor's expense. The additional temporary pavement delineation to be provided shall be equivalent to the pattern specified for the permanent pavement delineation for the area, as determined by the Engineer.

Full compensation for furnishing, placing, maintaining, and removing the temporary raised pavement markers used for temporary laneline and centerline delineation and for providing equivalent patterns of permanent traffic lines for these areas when required shall be considered as included in the contract prices paid for the items of work that obliterated the laneline and centerline pavement delineation and no separate payment will be made therefor.

TEMPORARY EDGELINE DELINEATION

Whenever edgelines are obliterated on multilane roadways (freeways and expressways), the edgeline delineation to be provided for that area adjacent to lanes open to public traffic shall consist of, at the option of the Contractor, either solid 100-mm wide traffic stripe of the same color as the stripe the temporary edgeline delineation replaces or shall consist of traffic cones, portable delineators or channelizers placed at longitudinal intervals not to exceed 30 m.

Traffic stripe (100-mm wide) placed for temporary edgeline delineation, which will require removal, shall consist of temporary removable construction grade striping and pavement marking tape listed in "Prequalified and Tested Signing and Delineation Materials" of these special provisions. Temporary removable construction grade striping and pavement marking tape when used shall be applied in conformance with the manufacturer's recommendations. Where removal of the 100-mm wide traffic stripe will not be required, painted traffic stripe used for temporary edgeline delineation shall conform to "Paint Traffic Stripes and Pavement Markings" of these special provisions, Section 84-3, "Painted Traffic Stripes And Pavement Markings," of the Standard Specifications, except for payment and the number of coats shall be, at the option of the Contractor, either one or 2 coats. The quantity of painted traffic stripe used for temporary edgeline delineation will not be included in the quantities of paint traffic stripe to be paid for.

The lateral offset for traffic cones, portable delineators or channelizers used for temporary edgeline delineation shall be determined by the Engineer. If traffic cones or portable delineators are used as temporary pavement delineation for edgelines, the Contractor shall provide personnel to remain at the project site to maintain the cones or delineators during hours of the day that the cones or delineators are in use.

Channelizers used for temporary edgeline delineation shall be the surface mounted type and shall be orange in color. Channelizer bases shall be cemented to the pavement in the same manner provided for cementing pavement markers to pavement in "Pavement Markers" of these special provisions, except epoxy adhesive shall not be used to place channelizers on the top layer of pavement. Channelizers shall be, at the Contractor's option, one of the surface mount types (900 mm) listed in "Prequalified and Tested Signing and Delineation Materials" of these special provisions.

Temporary edgeline delineation shall be removed when no longer required for the direction of public traffic, as determined by the Engineer.

Full compensation for furnishing, placing, maintaining, and removing temporary edgeline delineation shall be considered as included in the contract prices paid for the items of work that obliterated the edgeline pavement delineation and no separate payment will be made therefor.

10-1.25 PORTABLE CHANGEABLE MESSAGE SIGN

Portable changeable message signs shall be furnished, placed, operated, and maintained at those locations shown on the plans or where designated by the Engineer in conformance with the provisions in Section 12, "Construction Area Traffic Control Devices," of the Standard Specifications and these special provisions.

The Contractor shall have 12 portable changeable message signs on the project at all times.

Attention is directed to "Maintaining Traffic" of these special provisions regarding the use of the portable changeable message signs.

10-1.26 TEMPORARY RAILING

Temporary railing (Type K) shall be placed as shown on the plans, as specified in the Standard Specifications or these special provisions or where ordered by the Engineer and shall conform to the provisions in Section 12, "Construction Area Traffic Control Devices," of the Standard Specifications and these special provisions.

Reflectors on temporary railing (Type K) shall conform to the provisions in "Prequalified and Tested Signing and Delineation Materials" of these special provisions.

Temporary railing (Type K) shall conform to the details shown on Standard Plan T3. Temporary railing (Type K) fabricated prior to January 1, 1993, and conforming to 1988 Standard Plan B11-30 may be used, provided the fabrication date is printed on the required Certificate of Compliance.

Attention is directed to "Public Safety" and "Order of Work" of these special provisions.

Temporary railing (Type K) placed in conformance with the provisions in "Public Safety" of these special provisions will be neither measured nor paid for.

10-1.27 TRAFFIC PLASTIC DRUMS

Traffic plastic drums shall conform to the requirements for traffic control devices in Section 12, "Construction Area Traffic Control Devices," of the Standard Specifications and these special provisions.

Traffic plastic drums shall be constructed of low-density polyethylene material and shall be flexible or collapsible upon impact by a vehicle. The traffic plastic drum shall have a weighted base that will separate from the drum. The base shall be of such shape as to preclude rolling upon impact by a vehicle. The base shall be of sufficient weight to maintain the drum in position and upright. The base or external ballast rings shall not exceed 101.6 mm in height, and drum rings shall not exceed 965.2 mm maximum in diameter. The base or external rings placed over and around the drum, resting on the pavement or

ground shall contain the ballast for the drums. Ballast for drums shall be sand or water, except sand shall be used in areas susceptible to freezing. The base shall have drain holes to prevent the accumulation of water. Sand bags shall not be used as ballast for drums.

The body of the traffic plastic drum shall be of a fluorescent orange or predominately orange color. Drums shall be a minimum of 914.4 mm in height above the traveled way, and have at least an 457.2 mm minimum width, regardless of orientation.

The markings on drums shall be horizontal, circumferential, alternating orange and white reflective bands 101.6 to 152.4 mm wide. Each drum shall have a minimum of 2 orange and 2 white bands. The top of the uppermost reflective band shall be no lower than 152.4 mm from the top of the drum. Any non-reflective spaces between the bands shall not exceed 50.8 mm in width. The reflective sheeting shall conform to the provisions in "Prequalified and Tested Signing and Delineation Materials" of these special provisions.

Only one type of traffic plastic drum shall be used on the project. The type of traffic plastic drum proposed for use on the project shall be submitted to the Engineer for approval, prior to placement on the project.

In curvilinear alignment traffic plastic drums shall be used only on one side of the traveled way. Traffic plastic drums shall be placed on the alignment and location shown on the plans, or directed by the Engineer. Traffic plastic drums shall be placed uniformly, straight on tangent alignment and on a true arc on curved alignment. All layout work necessary to place the traffic plastic drums to the proper alignment shall be performed by the Contractor.

If traffic plastic drums are displaced or are not in an upright position, from any cause, the traffic plastic drums shall immediately be replaced or restored to their original location, in an upright position, by the Contractor.

At the option of the Contractor, where portable delineators, cones or Type I or II barricades are specified in the specifications or shown on the plans, traffic plastic drums may be used in place of those portable delineators, cones or Type I or II barricades.

At the completion of the project, traffic plastic drums shall become the property of the Contractor and removed from the site of the work.

Traffic plastic drums shall be installed as shown on the plans when temporary railing (Type K) is placed as required by "Public Safety" of these special provisions.

Traffic plastic drums will be measured as units from actual count of the number of traffic plastic drum designated on the plans or ordered by the Engineer. After initial placement of traffic plastic drums, and if ordered by the Engineer, the traffic plastic drums shall be moved from location to location and the cost thereof will be paid for as extra work as provided in Section 4-1.03D of the Standard Specifications. Traffic plastic drums which are used as part of traffic control system in place of cones, delineators or barricades or which are used in accordance with the requirements of "Public Safety" of these special provisions or which are placed in excess of the number specified or shown will not be included in the count of traffic plastic drums to be paid for.

The contract unit price paid for traffic plastic drum shall include full compensation for furnishing all labor, materials (including ballast), tools, equipment, and incidentals, and for doing all the work involved in furnishing, placing, maintaining, repairing, replacing and removing the traffic plastic drum, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.28 TEMPORARY CRASH CUSHION MODULE

This work shall consist of furnishing, installing, and maintaining sand filled temporary crash cushion modules in groupings or arrays at each location shown on the plans, as specified in these special provisions or where designated by the Engineer. The grouping or array of sand filled modules shall form a complete sand filled temporary crash cushion in conformance with the details shown on the plans and these special provisions.

Attention is directed to "Public Safety", and "Order of Work", of these special provisions.

Whenever the work or the Contractor's operations establishes a fixed obstacle, the exposed fixed obstacle shall be protected with a sand filled temporary crash cushion. The sand filled temporary crash cushion shall be in place prior to opening the lanes adjacent to the fixed obstacle to public traffic.

Sand filled temporary crash cushions shall be maintained in place at each location, including times when work is not actively in progress. Sand filled temporary crash cushions may be removed during a work period for access to the work provided that the exposed fixed obstacle is 4.6 m or more from a lane carrying public traffic and the temporary crash cushion is reset to protect the obstacle prior to the end of the work period in which the fixed obstacle was exposed. When no longer required, as determined by the Engineer, sand filled temporary crash cushions shall be removed from the site of the work.

At the Contractor's option, the modules for use in sand filled temporary crash cushions shall be either Energite III Inertial Modules, Fitch Inertial Modules or Traffix Sand Barrels manufactured after March 31, 1997, or equal:

- A. Energite III and Fitch Inertial Modules, manufactured by Energy Absorption Systems, Inc., One East Wacker Drive, Chicago, IL 60601-2076. Telephone (312) 467-6750, FAX (800) 770-6755

1. Distributor (North): Traffic Control Service, Inc., 8585 Thys Court, Sacramento, CA 95828. Telephone (800) 884-8274, FAX (916) 387-9734
 2. Distributor (South): Traffic Control Service, Inc., 1881 Betmor Lane, Anaheim, CA 92805. Telephone (800) 222-8274, FAX (714) 937-1070
- B. Traffix Sand Barrels, manufactured by Traffix Devices, Inc., 220 Calle Pinteroesco, San Clemente, CA 92672. Telephone (949) 361-5663, FAX (949) 361-9205
1. Distributor (North): United Rentals, Inc., 1533 Berger Drive, San Jose, CA 95112. Telephone (408) 287-4303, FAX (408) 287-1929
 2. Distributor (South): Statewide Safety & Sign, Inc., P.O. Box 1440, Pismo Beach, CA 93448. Telephone (800) 559-7080, FAX (805) 929-5786

Modules contained in each temporary crash cushion shall be of the same type at each location. The color of the modules shall be the standard yellow color, as furnished by the vendor, with black lids. The modules shall exhibit good workmanship free from structural flaws and objectionable surface defects. The modules need not be new. Good used undamaged modules conforming to color and quality of the types specified herein may be utilized. If used Fitch modules requiring a seal are furnished, the top edge of the seal shall be securely fastened to the wall of the module by a continuous strip of heavy duty tape.

Modules shall be filled with sand in conformance with the manufacturer's directions, and to the sand capacity in kilograms for each module shown on the plans. Sand for filling the modules shall be clean washed concrete sand of commercial quality. At the time of placing in the modules, the sand shall contain not more than 7 percent water as determined by California Test 226.

Modules damaged due to the Contractor's operations shall be repaired immediately by the Contractor at the Contractor's expense. Modules damaged beyond repair, as determined by the Engineer, due to the Contractor's operations shall be removed and replaced by the Contractor at the Contractor's expense.

Temporary crash cushion modules shall be placed on movable pallets or frames conforming to the dimensions shown on the plans. The pallets or frames shall provide a full bearing base beneath the modules. The modules and supporting pallets or frames shall not be moved by sliding or skidding along the pavement or bridge deck.

A Type R or P marker panel shall be attached to the front of the crash cushion as shown on the plans, when the closest point of the crash cushion array is within 3.6 m of the traveled way. The marker panel, when required, shall be firmly fastened to the crash cushion with commercial quality hardware or by other methods determined by the Engineer.

At the completion of the project, temporary crash cushion modules, sand filling, pallets or frames, and marker panels shall become the property of the Contractor and shall be removed from the site of the work. Temporary crash cushion modules shall not be installed in the permanent work.

Temporary crash cushion modules will be measured by the unit as determined from the actual count of modules used in the work or ordered by the Engineer at each location. Temporary crash cushion modules placed in conformance with the provisions in "Public Safety" of these special provisions and modules placed in excess of the number specified or shown will not be measured nor paid for.

Repairing modules damaged by public traffic will be paid for as extra work as provided in Section 4-1.03D of the Standard Specifications. Modules damaged beyond repair by public traffic, when ordered by the Engineer, shall be removed and replaced immediately by the Contractor. Modules replaced due to damage by public traffic will be measured and paid for as temporary crash cushion module.

If the Engineer orders a lateral move of the sand filled temporary crash cushions and the repositioning is not shown on the plans, moving the sand filled temporary crash cushion will be paid for as extra work as provided in Section 4-1.03D of the Standard Specifications and these temporary crash cushion modules will not be counted for payment in the new position.

The contract unit price paid for temporary crash cushion module shall include full compensation for furnishing all labor, materials (including sand, pallets or frames and marker panels), tools, equipment, and incidentals, and for doing all the work involved in furnishing, installing, maintaining, moving, and resetting during a work period for access to the work, and removing from the site of the work when no longer required (including those damaged by public traffic) sand filled temporary crash cushion modules, complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.29 EXISTING HIGHWAY FACILITIES

The work performed in connection with various existing highway facilities shall conform to the provisions in Section 15, "Existing Highway Facilities," of the Standard Specifications and these special provisions.

Crash cushions shown on the plans to be removed shall be removed when no longer required for the direction of public traffic.

Residue from saw cutting operations shall be removed from the pavement surface by vacuuming or other approved method and shall not be allowed to flow across the pavement nor be left on the surface of the pavement. Residue from saw cutting operations shall be disposed of outside the highway right of way in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside of the Highway Right of Way," of the Standard Specifications.

Full compensation for conforming to the requirements for the control, removal and disposal of residue resulting from saw cutting operations shall be considered as included in the contract price paid for the item of work involved and no additional compensation will be allowed therefor.

Attention is directed to Section 7-1.06, "Safety and Health Provisions," of the Standard Specifications. Work practices and worker health and safety shall conform to the California Division of Occupational Safety and Health Construction Safety Orders Title 8, of the California Code of Regulations including Section 5158, "Other Confined Space Operations."

ABANDON CULVERT

Existing culverts, where shown on the plans to be abandoned, shall be abandoned in place or, at the option of the Contractor, the culverts shall be removed and disposed of. Resulting openings into existing structures that are to remain in place shall be plugged with commercial quality concrete containing not less than 300 kg of cement per cubic meter.

Abandoning culverts in place shall conform to the following:

- A. Culverts that intersect the side slopes shall be removed to a depth of not less than one meter measured normal to the plane of the finished side slope, before being abandoned.
- B. Culverts 300 mm in diameter and larger, shall, at the Contractor's option, be backfilled with either sand, controlled low strength material or slurry cement backfill conforming to the provisions in Section 19-3.062, "Slurry Cement Backfill," of the Standard Specifications by any method acceptable to the Engineer that completely fills the pipe. Sand backfill material shall be clean, free draining, and free from roots and other deleterious substances.
- C. The ends of culverts shall be securely closed by a 150 mm thick tight fitting plug or wall of commercial quality concrete.

Culverts shall not be abandoned until their use is no longer required. The Contractor shall notify the Engineer in advance of any intended culvert abandonment.

If the Contractor elects to remove and dispose of a culvert which is specified to be abandoned, as provided herein, backfill specified for the culvert will be measured and paid for in the same manner as if the culvert has been abandoned in place.

Backfill will be measured by the cubic meter determined from the dimensions of the culverts to be abandoned.

The contract price paid per cubic meter for sand backfill shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in backfilling culverts with sand, complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

Controlled low strength material and slurry cement backfill, if used at the Contractor's option, will be measured and paid for by the cubic meter as sand backfill.

Full compensation for concrete plugs, pipe removal, structure excavation, and backfill shall be considered as included in the contract unit price paid for abandon culvert and no additional compensation will be allowed therefor.

ABANDON INLET

Existing pipe inlets and concrete drainage inlets, where shown on the plans to be abandoned, shall be abandoned.

The top portion of the inlets shall be removed to a depth of 0.30 m below finished grade.

Removed frames and grates shall be disposed of.

ABANDON IRRIGATION CROSSOVER

Existing irrigation crossovers, where shown on the plans to be abandoned, shall be abandoned in place.

Abandoning irrigation crossovers shall conform to the following:

- A. Existing No. 5 pull box, Type A pavement marker, waterline, electrical conduit and control and neutral conductor wires shall be removed 0.6 meters below finished grade and disposed of. The top of the waterline and electrical conduit that remain in place, shall be capped. Resulting holes shall be backfilled on the same day in which the pull box is removed.

Irrigation crossovers shall not be abandoned until their use is no longer required. The Contractor shall notify the Engineer in advance of any intended irrigation crossover abandonment.

Full compensation for removing and disposing of pull box, Type A pavement marker, electrical conduit, waterline (including capping conduit and waterline) and control and neutral conductor wires, excavation, and backfill shall be considered as included in the contract unit price paid for abandon irrigation crossover and no additional compensation will be allowed therefor.

REMOVE DOUBLE THRIE BEAM BARRIER

Existing double thrie beam barrier, where shown on the plans to be removed, shall be removed and disposed of.

Existing concrete anchors or steel foundation tubes shall be completely removed and disposed of. Full compensation for removing concrete anchors shall be considered as included in the contract price paid per meter for remove double thrie beam barrier and no separate payment will be made therefor.

Full compensation for removing cable anchor assemblies, terminal anchor assemblies or steel foundation tubes shall be considered as included in the contract price paid per meter for remove double thrie beam barrier and no separate payment will be made therefor.

REMOVE METAL BEAM GUARD RAILING

Existing metal beam guard railing, where shown on the plans to be removed, shall be removed and disposed of.

Existing concrete anchors or steel foundation tubes shall be completely removed and disposed of. Full compensation for removing concrete anchors shall be considered as included in the contract price paid per meter for remove metal beam guard railing and no separate payment will be made therefor.

Full compensation for removing cable anchor assemblies, terminal anchor assemblies or steel foundation tubes shall be considered as included in the contract price paid per meter for remove metal beam guard railing and no separate payment will be made therefor.

REMOVE CHAIN LINK FENCE

Existing chain link fence, including post footings and anchor blocks, where shown on the plans, shall be removed and disposed of.

Post footings which do not conflict with the installation of new fence may remain in place.

On structures, the posts shall be removed and the pipe post sleeves or other type post anchorages shall be cut off flush with the bridge deck. Sleeves shall be cleaned and filled with grout consisting of one part portland cement to 6 parts sand.

Full compensation for backfilling and compacting post holes in the median and for cutting off pipe post sleeves or other type post anchorages on structures shall be considered as included in the contract price paid per meter for remove chain link fence and no additional compensation will be allowed therefor.

10-1.30 MAINTAIN TEMPORARY FENCE (TYPE ESA)

Existing temporary fence (Type ESA), shown on the plans to be maintained shall be maintained, and later removed, as specified in these special provisions and as directed by the Engineer.

MATERIALS

In maintaining the existing temporary fence (Type ESA), materials may be either new or used materials providing they conform to the following:

High Visibility Fabric

High visibility fabric shall be machine produced mesh manufactured from polypropylene or polyethylene and shall be orange in color. High visibility fabric may be virgin or recycled polymer materials, or a combination of virgin and recycled polymer materials. No virgin or recycled polymer materials shall contain biodegradable filler materials that degrade the physical or chemical characteristics of the finished fabric. High visibility fabric shall be fully stabilized ultraviolet (UV) resistant. High visibility fabric shall be a minimum of 1.22 m in width with a maximum mesh opening of 50 mm x 50 mm. High visibility fabric shall be furnished in one continuous width and shall not be spliced to conform to the specified width dimension.

Posts

Posts for temporary fence (Type ESA) shall be of one of the following:

- A. Posts shall be fir or pine, a minimum of 38 mm x 50 mm in size, and a minimum 1.6 m in length. One end of the post shall be pointed. Posts shall not be treated with wood preservative.

- B. Posts shall be steel and have a "U", "T", "L" or other cross sectional shape that resists failure by lateral loads. Steel posts shall have a minimum mass per length of 1.1 kg/m and a minimum length of 1.6 m. One end of the steel post shall be pointed and the other end shall have a high visibility colored top.

Fasteners

Fasteners for attaching high visibility fabric to the posts shall be as follows:

- A. The high visibility fabric shall be attached to wooden posts with commercial quality nails or staples, or as recommended by the manufacturer or supplier, as determined by the Engineer.
- B. Tie wire or locking plastic fasteners shall be used for attaching the high visibility fabric to steel posts. Maximum spacing of tie wire or fasteners shall be 600 mm along the length of the steel post.

INSTALLATION

Temporary fence (Type ESA) shall be installed as follows:

- A. Posts shall be driven into the soil a minimum of 400 mm. Posts shall be spaced at 2-m centers maximum and shall at all times support the fence in a vertical, upright position.
- B. Temporary fence (Type ESA) shall be constructed prior to any clearing and grubbing work and a sufficient distance from protected plants to enclose all of the foliage canopy and not encroach upon visible roots of the plants.
- C. Temporary fence (Type ESA) shall be located to be unobstructed from view, as determined by the Engineer.

When no longer required for the work, as determined by the Engineer, temporary fence (Type ESA) shall be removed. Removed temporary fence (Type ESA) shall become the property of the Contractor and shall be removed from the site of the work, except when reused as provided in this section.

Holes caused by the removal of temporary fence (Type ESA) shall be backfilled in conformance with the provisions in the second paragraph of Section 15-1.02, "Preservation of Property," of the Standard Specifications.

MAINTENANCE

Temporary fence (Type ESA) that is damaged during the progress of the work shall be repaired or replaced by the Contractor the same day the damage occurred.

MEASUREMENT AND PAYMENT

The contract lump sum price paid for maintaining temporary fence (Type ESA) shall include full compensation for furnishing all labor, materials, tools, equipment and incidentals, and for doing all the work involved in maintain temporary fence (Type ESA) complete in place, including removal and disposal of materials, as specified in these special provisions, and as directed by the Engineer.

REMOVE METAL BEAM GUARD RAILING

Existing metal beam guard railing, where shown on the plans to be removed, shall be removed and disposed of.

Existing concrete anchors or steel foundation tubes shall be completely removed and disposed of. Full compensation for removing concrete anchors shall be considered as included in the contract price paid per meter for remove metal beam guard railing and no separate payment will be made therefor.

Full compensation for removing cable anchor assemblies, terminal anchor assemblies or steel foundation tubes shall be considered as included in the contract price paid per meter for remove metal beam guard railing and no separate payment will be made therefor.

REMOVE SIGN STRUCTURE

Existing sign structures, where shown on the plans to be removed, shall be removed and disposed of.

Overhead sign structure removal shall consist of removing posts, frames, portions of foundations, sign panels, walkways with safety railings, and sign lighting electrical equipment.

Bridge mounted sign structure removal shall consist of removing sign panels and frames, sign lighting electrical equipment, walkways with safety railings, structural braces and supports, and hardware.

A sign structure shall not be removed until the structure is no longer required for the direction of public traffic.

Concrete foundations may be abandoned in place, except that the top portion, including anchor bolts, reinforcing steel, and conduits shall be removed to a depth of not less than 0.30 m below the adjacent finished grade. The resulting holes shall be backfilled and compacted with material equivalent to the surrounding material.

Electrical wiring shall be removed to the nearest pull box. Fuses within spliced connections in the pull box shall be removed and disposed of.

Electrical equipment, where shown on the plans, shall be salvaged.

REMOVE PAVEMENT MARKER

Existing pavement markers, including underlying adhesive, and pavement markers, including underlying adhesive, shown on the stage construction and traffic handling plans when no longer required for traffic lane delineation as determined by the Engineer, shall be removed and disposed of.

Full compensation for removing and disposing of pavement markers and underlying adhesive, including pavement markers and underlying adhesive shown on the stage construction and traffic handling plans, shall be considered as included in the contract price paid per tonne for asphalt concrete (Type A) and no separate payment will be made therefor.

REMOVE TRAFFIC STRIPE AND PAVEMENT MARKING

Traffic stripe and pavement marking shall be removed at the locations shown on the plans and as directed by the Engineer.

Removal of pavement stripe shown on the stage construction and traffic handling sheets of the plans will be measured and paid for as remove traffic stripe.

Attention is directed to "Water Pollution Control" of these special provisions.

Waste from removal of yellow painted traffic stripe contains lead chromate in average concentrations greater than or equal to 350 mg/kg and less than 1000 mg/kg Total Lead. Yellow paint traffic exist from Station 435+00 "SD-15L" Line (southbound) to Station 455+60 "SD-15L" Line (southbound), Station 441+60 "VRPSON" Line (southbound) to Station 444+00 "VRPSON" Line (southbound), 452+50 "CCPNON" Line (northbound) to 454+55 "CCPNON" Line (northbound), Station 447+50 "SD-15R" Line (northbound) to Station 457+90 "SD-15R" Line (northbound), Station 434+00 "SD-15R" Line (northbound) to Station 447+50 "SD_15R" Line (northbound), Station 440+30 "VRPNOF" Line (northbound) to station 441+90 "VRPNOF" Line (northbound), Station 441+90 "VRPNOF" Line (northbound) to Station 442+70 "VRPNOF" Line (northbound) and from Station 19+00 "WFR" Line (east and westbound) to Station 21+00 "WFR: Line (east and westbound. Residue produced when yellow are removed may contain heavy metals in concentrations that exceed thresholds established by the California Health and Safety Code and may produce toxic fumes when heated.

The removed yellow paint shall be disposed of at a Class 1 disposal facility or a Class 2 disposal facility permitted by the Regional Water Quality Control Board in conformance with the requirements of the disposal facility operator within 60 days after accumulating 100 kg of residue and dust. The Contractor shall make necessary arrangements with the operator of the disposal facility to test the yellow paint residue as required by the facility and these special provisions. Testing shall include, at a minimum, (1) Total Lead and Chromium by EPA Method 7000 series and (2) Soluble Lead and Chromium by California Waste Extraction Test. From the first 3360 L of waste or portion thereof, if less than 3360 L of waste are produced, a minimum of four randomly selected samples shall be taken and analyzed. From each additional 840 L of waste or portion thereof, if less than 840 L are produced, a minimum of one additional random sample shall be taken and analyzed. The Contractor shall submit the name and location of the disposal facility and analytical laboratory along with the testing requirements to the Engineer not less than 15 days prior to the start of removal of yellow painted traffic stripe. The analytical laboratory shall be certified by the Department of Health Services Environmental Laboratory Accreditation Program. Test results shall be provided to the Engineer for review prior to signing a waste profile as requested by the disposal facility, prior to issuing an EPA identification number, and prior to allowing removal of the waste from the site.

The Contractor shall prepare a project specific Lead Compliance Plan to prevent or minimize worker exposure to lead while handling removed yellow paint residue. Attention is directed to Title 8, California Code of Regulations, Section 1532.1, "Lead," for specific Cal-OSHA requirements when working with lead.

The Lead Compliance Plan shall contain the elements listed in Title 8, California Code of Regulations, Section 1532.1(e)(2)(B). Before submission to the Engineer, the Lead Compliance Plan shall be approved by an Industrial Hygienist certified in Comprehensive Practice by the American Board of Industrial Hygiene. The Plan shall be submitted to the Engineer at least 7 days prior to beginning removal of yellow paint.

Prior to removing yellow painted traffic stripe personnel who have no prior training, including State personnel, shall complete a safety training program provided by the Contractor that meets the requirements of Title 8, California Code of Regulations, Section 1532.1, "Lead," and the Contractor's Lead Compliance Program.

Personal protective equipment, training, and washing facilities required by the Contractor's Lead Compliance Plan shall be supplied to State personnel by the Contractor. The number of State personnel will be 5.

Where grinding or other methods approved by the Engineer are used to remove yellow painted traffic stripe, the removed residue, including dust, shall be contained and collected immediately. Sweeping equipment shall not be used. Collection shall be by a high efficiency particulate air (HEPA) filter equipped vacuum attachment operated concurrently with the removal operations or other equally effective methods approved by the Engineer. The Contractor shall submit a written work plan for the removal, storage, and disposal of yellow painted traffic stripe to the Engineer for approval not less than 15 days

prior to the start of the removal operations. Removal operations shall not be started until the Engineer has approved the work plan.

The removed yellow painted traffic stripe residue shall be stored and labeled in covered containers. Labels shall conform to the provisions of Title 22, California Code of Regulations, Sections 66262.31 and 66262.32. Labels shall be marked with date when the waste is generated, the words "Hazardous Waste", composition and physical state of the waste (for example, asphalt grindings with thermoplastic or paint), the word "Toxic", the name and address of the Engineer, the Engineer's telephone number, contract number, and Contractor or subcontractor. The containers shall be a type approved by the United States Department of Transportation for the transportation and temporary storage of the removed residue. The containers shall be handled so that no spillage will occur. The containers shall be stored in a secured enclosure at a location within the project limits until disposal, as approved by the Engineer.

If the yellow painted traffic stripe residue is transported to a Class 1 disposal facility, a manifest shall be used, and the transporter shall be registered with the California Department of Toxic Substance Control. The Engineer will obtain the United States Environmental Protection Agency Identification Number and sign all manifests as the generator within 2 working days of receiving sample test results and approving the test methods.

The Contractor shall assume that the yellow paint removed is not regulated under the Federal Resource Conservation and Recovery Act (RCRA). Additional disposal costs for removal residue regulated under RCRA, as determined by test results required by the disposal facility, will be paid for as extra work as provided in Section 4-1.03D, "Extra Work," of the Standard Specifications.

Nothing in these special provisions shall relieve the Contractor of the Contractor's responsibilities as specified in Section 7-1.09, "Public Safety," of the Standard Specifications.

The contract lump sum price paid for Lead Compliance Plan shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals and for doing all the work involved in preparing the Lead Compliance Plan, including paying the Certified Industrial Hygienist, and for providing personnel protective equipment, training, air monitoring, and medical surveillance, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

Full compensation for providing a written work plan for the removal, storage, and disposal of yellow painted traffic stripe shall be considered as included in the contract items paid per meter for remove yellow painted traffic stripe and no separate payment will be made therefor.

REMOVE DRAINAGE FACILITY

Existing culverts, and inlets, where any portion of these structures is within one meter of the grading plane in excavation areas, or within 0.3-m of original ground in embankment areas, or where shown on the plans to be removed, shall be completely removed and disposed of.

REMOVE ROADSIDE SIGN

Existing roadside signs, at those locations shown on the plans to be removed, shall be removed and disposed of.

Existing roadside signs shall not be removed until replacement signs have been installed or until the existing signs are no longer required for the direction of public traffic, unless otherwise directed by the Engineer.

RESET ROADSIDE SIGN

Existing roadside signs, where shown on the plans to be reset, shall be removed and reset.

Each roadside sign shall be reset on the same day that the sign is removed.

Two holes shall be drilled in each existing post as required to provide the breakaway feature shown on the plans.

RELOCATE ROADSIDE SIGN

Existing roadside signs shall be removed and relocated to the new locations shown on the plans.

Each roadside sign shall be installed at the new location on the same day that the sign is removed from its original location.

Two holes shall be drilled in each existing post as required to provide the breakaway feature shown on the plans.

COLD PLANE ASPHALT CONCRETE PAVEMENT

Existing asphalt concrete pavement shall be cold planed at the locations and to the dimensions shown on the plans.

The Contractor shall schedule paving operations so that cold planed areas are paved with asphalt concrete within the same work shift.

Planing asphalt concrete pavement shall be performed by the cold planing method. Planing of the asphalt concrete pavement shall not be done by the heater planing method.

Cold planing machines shall be equipped with a cutter head not less than 750 mm in width and shall be operated so that no fumes or smoke will be produced. The cold planing machine shall plane the pavement without requiring the use of a heating device to soften the pavement during or prior to the planing operation.

The depth, width, and shape of the cut shall be as shown on the typical cross sections or as designated by the Engineer. The final cut shall result in a uniform surface conforming to the typical cross sections. The outside lines of the planed area shall be neat and uniform. Planing asphalt concrete pavement operations shall be performed without damage to the surfacing to remain in place.

Planed widths of pavement shall be continuous except for intersections at cross streets where the planing shall be carried around the corners and through the conform lines.

The material planed from the roadway surface, including material deposited in existing gutters or on the adjacent traveled way, shall be disposed of in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications. Removal operations of cold planed material shall be concurrent with planing operations and follow within 15 m of the planer, unless otherwise directed by the Engineer.

Cold plane asphalt concrete pavement will be measured by the square meter. The quantity to be paid for will be the actual area of surface cold planed irrespective of the number of passes required to obtain the depth shown on the plans.

The contract price paid per square meter for cold plane asphalt concrete pavement shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in cold planing asphalt concrete surfacing and disposing of planed material, as specified in the Standard Specifications and these special provisions and as directed by the Engineer.

CAP DRAINAGE FACILITY

Existing pipe risers and concrete drainage inlets, where shown on the plans to be capped, shall be capped and the bottoms of the inlets shall be rounded with portland cement concrete as shown on the plans.

Portland cement concrete shall be minor concrete or may be produced from commercial quality aggregates and cement containing not less than 350 kg of cement per cubic meter.

Inlets and risers shall be removed to a depth of at least 0.3-m below the grading plane.

Concrete removal shall be performed without damage to portions of the inlet and riser that are to remain in place. Damage to existing concrete, which is to remain in place, shall be repaired by the Contractor to a condition equal to that existing prior to the beginning of removal operations. The repair of existing concrete damaged by the Contractor's operations shall be at the Contractor's expense.

Existing reinforcement that is to be incorporated in the new work shall be protected from damage and shall be thoroughly cleaned of adhering material before being embedded in the new concrete.

The quantity of capping risers and inlets will be determined as units from actual count.

The contract unit price paid for cap inlet and cap riser shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in capping inlets and risers, including removing portions of inlets and risers, rounding bottoms of inlets, bar reinforcing steel, and structure excavation and structure backfill, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

BRIDGE REMOVAL

Removing portions of bridges shall conform to the provisions in Section 15-4, "Bridge Removal," of the Standard Specifications and these special provisions.

The portions of existing North County Fair Overcrossing (Bridge No. 57-0941) to be removed shall be as shown on the plans.

Removed materials that are not to be salvaged or used in the reconstruction shall become the property of the Contractor and shall be disposed of in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.

The Contractor shall submit a complete bridge removal plan to the Engineer for each bridge listed above, detailing procedures, sequences, and all features required to perform the removal in a safe and controlled manner.

The bridge removal plan shall include, but not be limited to the following:

- A. The removal sequence, including staging of removal operations.
- B. Equipment locations on the structure during removal operations.
- C. Temporary support shoring or temporary bracing.
- D. Locations where work is to be performed over traffic, utilities, or railroad property.
- E. Details, locations, and types of protective covers to be used.
- F. Measures to assure that people, property, utilities, and improvements will not be endangered.

- G. Details and measures for preventing material, equipment, and debris from falling onto public traffic, or railroad property.

When protective covers are required for removal of portions of a bridge, or when superstructure removal works on bridges are involved, the Contractor shall submit working drawings, with design calculations, to the Engineer for the proposed bridge removal plan, and the bridge removal plan shall be prepared and signed by an engineer who is registered as a Civil Engineer in the State of California. The design calculations shall be adequate to demonstrate the stability of the structure during all stages of the removal operations. Calculations shall be provided for each stage of bridge removal and shall include dead and live load values assumed in the design of protective covers.

Temporary support shoring, temporary bracing, and protective covers, as required, shall be designed and constructed in conformance with the provisions in Section 51-1.06, "Falsework," of the Standard Specifications and these special provisions.

The assumed horizontal load to be resisted by the temporary support shoring and temporary bracing, for removal operations only, shall be the sum of the actual horizontal loads due to equipment, construction sequence or other causes, and an allowance for wind, but in no case shall the assumed horizontal load to be resisted in any direction be less than 5 percent of the total dead load of the structure to be removed.

The bridge removal plan shall conform to the provisions in Section 5-1.02, "Plans and Working Drawings," of the Standard Specifications. The number of sets of drawings, design calculations, and the time for reviewing bridge removal plans shall be the same as specified for falsework working drawings in Section 51-1.06A, "Falsework Design and Drawings," of the Standard Specifications.

The following additional requirements apply to the removal of portions of bridges whenever the removal work is to be performed over public traffic

- A. A protective cover shall be constructed before beginning bridge removal work. The protective cover shall be supported by shoring, falsework, or members of the existing structure. The Contractor shall be responsible for designing and constructing safe and adequate protective covers, shoring, and falsework with sufficient strength and rigidity to support the entire load to be imposed.
- B. The construction and removal of the protective cover, and the installation and removal of temporary railings shall conform to the provisions in "Maintaining Traffic," and "Temporary Railings" of these special provisions.
- C. Bridge removal methods shall be described in the working drawings, supported by calculations with sufficient details to substantiate live loads used in the protective cover design. Dead and live load values assumed for designing the protective cover shall be shown on the working drawings.
- D. The protective cover shall prevent any materials, equipment, or debris from falling onto public traffic. The protective cover shall have a minimum strength equivalent to that provided by good, sound Douglas fir planking having a nominal thickness of 50 mm. Additional layers of material shall be furnished as necessary to prevent fine materials or debris from sifting down upon the traveled way and shoulders.
- E. During the removal of bridge segments, and when portions of the bridge, such as deck slabs or box girder slabs, comply with the requirements for the protective cover, a separate protective cover need not be constructed.
- F. The protective cover shall extend at least 3 m beyond the outside face of the bridge railing, except that, at locations where the bridge railing is to be removed and new girders are not constructed, the protective cover shall extend from the face of the exterior girder or at least 0.6-m inside of the bridge railing to be removed, whichever is less, to at least 1.2 m beyond the outside face of the bridge railing.
- G. The protective cover shall provide the openings specified under "Maintaining Traffic" of these special provisions, except that when no openings are specified for bridge removal, a vertical opening of 4.6 m and a horizontal opening of 9.8 m shall be provided for the passage of public traffic.
- H. Falsework or supports for protective covers shall not extend below the vertical clearance level nor to the ground line at any location within the roadbed.
- I. The construction of the protective cover as specified herein shall not relieve the Contractor of responsibilities specified in Section 7-1.12A, "Indemnification," and Section 7-1.12B, "Insurance," of the Standard Specifications.
- J. Before removal of the protective cover, the Contractor shall clean the protective cover of all debris and fine material.

For bridge removal that requires the Contractor's registered engineer to prepare and sign the bridge removal plan, the Contractor's registered engineer shall be present at all times when bridge removal operations are in progress. The Contractor's registered engineer shall inspect the bridge removal operation and report in writing on a daily basis the progress of the operation and the status of the remaining structure. A copy of the daily report shall be available at the site of the work at all times. Should an unplanned event occur or the bridge operation deviate from the approved bridge removal plan, the Contractor's registered engineer shall submit immediately to the Engineer for approval, the procedure of operation proposed to correct or remedy the occurrence.

REMOVE CONCRETE

Concrete, where shown on the plans to be removed, shall be removed.

The pay quantities of concrete, other than concrete barriers, to be removed will be measured by the cubic meter, measured before and during removal operations.

Removing concrete barrier (Type K) and (Type 60S) will be measured by the meter, measured along the barrier before removal operations.

Concrete barrier (Type K) removed shall be disposed of outside the highway right of way in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.

SALVAGE CRASH CUSHION (REACT 9SCBS)

Existing crash cushion (REACT 9SCBS), at those locations shown on the plans to be salvaged, shall be salvaged.

Existing crash cushions shall not be removed until the existing crash cushions are no longer required for the direction of public traffic, unless otherwise directed by the Engineer.

Salvaged crash cushions (REACT 9SCBS) that are not damaged may be installed in the permanent work provided the crash cushion (REACT 9SCBS) conform to the requirements specified for the permanent work.

The contract unit price paid for salvage crash cushion (REACT 9SCBC) shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in salvaging crash cushion (REACT 9SCBS), complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.31 CLEARING AND GRUBBING

Clearing and grubbing shall conform to the provisions in Section 16, "Clearing and Grubbing," of the Standard Specifications and these special provisions.

Vegetation shall be cleared and grubbed only within the excavation and embankment slope lines, as shown on the plans or as specified in these special provisions and as directed by the Engineer.

At locations where there is no grading adjacent to a bridge or other structure, clearing and grubbing of vegetation shall be limited to 1.5 m outside the physical limits of the bridge or structure.

Existing trees shown on the plans to be removed shall be removed. Trees to be removed shall be verified by the Engineer prior to removal.

Existing vegetation outside the areas to be cleared and grubbed, except as shown on the plans or as specified in these special provisions to be removed, shall be protected from injury or damage resulting from the Contractor's operations.

Activities controlled by the Contractor, except cleanup or other required work, shall be confined within the graded areas of the roadway.

Nothing herein shall be construed as relieving the Contractor of the Contractor's responsibility for final cleanup of the highway as provided in Section 4-1.02, "Final Cleaning Up," of the Standard Specifications.

Full compensation for tree removal shall be considered as included in the contract lump sum price paid for clearing and grubbing and no additional compensation will be made therefor.

10-1.32 WATERING

Developing a water supply and applying watering shall conform to the provisions in Section 17, "Watering," of the Standard Specifications and these special provisions.

Attention is directed to the source or sources of water for use on the project specified in the "Materials Information" handout available to the contractors.

10-1.33 EARTHWORK

Earthwork shall conform to the provisions in Section 19, "Earthwork," of the Standard Specifications and these special provisions.

Blasting

Project blasting shall conform to Sections 7-1.10, "Use of Explosives", and 19-2.03, "Blasting," of the Standard Specifications, and to the following:

- A. The Contractor shall make and document a pre-blast survey of properties and improvements located within 100 m of the blasting site. Pre-blast surveys shall be made no more than 45 days in advance of the planned commencement or resumption of blasting operations. The pre-blast surveys shall, as a minimum, contain the following:
 1. The names of the property owner and occupants, the address of the property, the date and time of the inspection.

2. The name of the person making the inspection.
 3. A complete description of the structure(s) or other improvement(s).
 4. A detailed interior inspection with each interior room (including attic and basement spaces) designated and described. All existing conditions of the walls, ceilings and floors such as cracks, holes and separations shall be noted.
 5. A detailed exterior inspection fully describing the existing conditions of all foundations, walls, roofs, doors and windows, and porches.
 6. A detailed listing, inspection and documentation of existing conditions of garages, outbuildings, sidewalks and driveways.
 7. A survey of any wells or other private water supplies including total depth and existing water surface levels.
- B. A resurvey of all locations will be required whenever blasting operations are either terminated or suspended for a period in excess of 45 calendar days.
 - C. The documentation may consist of either a written report, or a video tape with voice narration. The video tape, if used, must include the date and time displayed on the image.
 - D. Copies of the pre-blast inspection reports or video tape documentation shall be given to the Engineer at the time that the blasting plan is submitted.
 - E. The Contractor shall control project blasting so that vibration, fly rock and air noise do not cause damage to nearby structures, undue annoyance to nearby residents, or danger to employees on the project.
 - F. The Contractor shall submit a plan to the Engineer detailing how he proposes to control blasting. No blasting operation, including drilling, shall start until the Engineer has reviewed and approved this Blasting Control Plan in accordance with the provisions in Section 5-1.02, "Plans and Working Drawings," of the Standard Specifications. The Contractor shall allow not less than 2 weeks for the Engineer to complete the review of the Plan. In the event that additional Blasting Control Plans are required, the Contractor shall provide at least 2 weeks for the review of each additional plan. Should the Engineer fail to complete his review within the time allowance and if, in the opinion of the Engineer, the Contractor's controlling operation is delayed or interfered with by reason of this delay in blasting plan review, the delay will be considered a right of way delay as specified in Section 8-1.09, "Right of Way Delays", of the Standard Specifications. Approval of the Contractor's blasting control plan or blasting procedures shall not relieve the Contractor of any of his responsibility under the contract for assuring the complete safety of his operations or for the successful completion of the work in conformity with the requirements of the plans and specifications.
 - G. The blasting control plan shall provide for limiting the maximum peak particle velocity of any one of the 3 mutually perpendicular components of ground motion in the vertical and horizontal directions, or their resultants, to 50 mm/sec at the nearest structures. It shall provide for limiting air noise levels to 125 dBC, and for controlling fly rock.
 - H. The plan shall indicate the type and method of instrumentation proposed to determine the ground motion particle velocity and air noise. At the Contractor's option, shot designs may be based upon a scaled distance following the chart below. The scaled distance is the ratio of distance in meters from the blast site to the site to be protected, to the square root of the maximum explosive weight used for each delay of 9 milliseconds or more.

Distance to site to be protected	Scaled distance factor
0 to 91 meters	22.57 m/kg ^{1/2}
91 to 1524 meters	24.94 m/kg ^{1/2}
1525 or more meters	29.4 m/kg ^{1/2}

The Contractor shall keep accurate records of each blast.

Blasting records shall be available to the Engineer at all times and shall contain the following data as a minimum:

- A. Blast identification by numerical and chronological sequence.
- B. Location (referenced to stationing), date and time of blast.
- C. Type of material blasted.
- D. Number of holes, burden and spacing.
- E. Diameter and depth of holes.
- F. Height or length of stemming.
- G. Types of explosives used.
- H. Type of caps used and delay periods used.
- I. Total amount of explosives used.

- J. Maximum amount of explosives per delay period of 9 milliseconds or greater.
- K. Powder factor (kilograms of explosive per cubic meter of material blasted).
- L. Method of firing and type of circuit.
- M. Weather conditions (including wind direction).
- N. Direction and distance to nearest structure of concern.
- O. Type and method of instrumentation.
- P. Location and placement of instruments.
- Q. Instrumentation records and calculations for determination of ground motion particle velocity or for charge size based on scaled distance.
- U. Measures taken to limit air noise and fly rock.
- R. Any unusual circumstances or occurrences during blast.
- S. Name of Contractor.
- T. Name and signature of responsible blaster.

Blasting guards in sufficient numbers to assure that people, property and improvements will not be endangered shall be stationed around the blasting area during blasting operations.

Blasting operations may be suspended by the Engineer for any of the following:

- A. Safety precautions taken are inadequate.
- B. Ground motion particle velocity or air noise exceed the limits specified.
- C. Blasting Control Plans have not been approved.
- D. Required records are not being kept.

Suspension of blasting operations shall in no way relieve the Contractor of his responsibilities under the terms of this contract. Blasting operations shall not resume until modifications have been made to correct the conditions that resulted in the suspension.

Blasting complaints shall be accurately recorded by the Contractor as to complainant, address, date, time, nature of the complainant, name of person receiving the complaint, the complaint investigation conducted, and the disposition of the complaint. Complaint records shall be available to the Engineer at all times.

Full compensation for pre-blast survey shall be considered as included in the contract price paid per cubic meter for roadway excavation and no additional payment will be allowed therefor.

Surplus excavated material shall become the property of the Contractor and shall be disposed of in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.

Where a portion of the existing surfacing is to be removed, the outline of the area to be removed shall be cut on a neat line with a power-driven saw to a minimum depth of 50 mm before removing the surfacing. Full compensation for cutting the existing surfacing shall be considered as included in the contract price paid per cubic meter for roadway excavation and no additional compensation will be allowed therefor.

Attention is directed to "Existing Highway Facilities" of these special provisions concerning residue from saw cutting.

Reinforcement or metal attached to reinforced concrete rubble placed in embankments shall not protrude above the grading plane. Prior to placement within 0.6-m below the grading plane of embankments, reinforcement or metal shall be trimmed to no greater than 20 mm from the face of reinforced concrete rubble. Full compensation for trimming reinforcement or metal shall be considered as included in the contract prices paid per cubic meter for the types of excavation shown in the Engineer's estimate, or the contract prices paid for furnishing and placing imported borrow or embankment material, as the case may be, and no additional compensation will be allowed therefor.

Settlement periods are required for the bridge approach embankments at the bridges listed in the following table.

At the bridges listed in the following table, construction of the bridge deck or the approach slab at each location shall not be done until the expiration of the settlement period for the embankment at the adjacent abutment of the same structure or an adjacent structure.

Surcharge embankments shall be constructed at or above the grading plane where listed in the following table:

Bridge Name or Number			Surcharge Height (meters)	Settlement Period (days)
57-1196			0.0*	30
57-1199			0.0	30

* At this location, the surcharge embankment shall be constructed by extending the grading plane (GP) in the "Elevation" view of the "Bridge Embankment Surcharge" detail of Standard Plan A62B horizontally to the centerline of abutment.

Settlement periods are required for the roadway embankments at the earth retaining structures listed in the following table.

Surcharge embankments shall be constructed at or above the grading plane where listed in the following table.

Earth Retaining Structure Number	Surcharge Height (meters)	Settlement Period (days)
Retaining Walls 446L/R	0.0	45
Retaining Walls 450L/R	0.0	45

* At this location, the surcharge embankment shall be constructed by extending the grading plane (GP) in the "Elevation" view of the "Bridge Embankment Surcharge" detail of Standard Plan A62B horizontally to the centerline of abutment.

The duration of the required settlement period at each location will be determined by the Engineer. The estimated duration of the settlement periods are listed in the tables of settlement data. The Engineer may order an increase or decrease in any settlement period. An ordered increase or decrease in any settlement period will result in an increase or decrease in the number of contract working days if the settlement period involved is considered to be the current controlling operation in conformance with the provisions in Section 8-1.06, "Time of Completion," of the Standard Specifications. Adjustments of contract time due to increases or decreases in settlement periods will be made by contract change order.

The removal of surplus embankment material placed as a settlement or surcharge embankment, including material removed to conform to the finished slope lines shown on the plans, will be paid for at the contract price per cubic meter for roadway excavation.

At the locations and to the limits shown on the plans, material below the bottom of bridge footings shall be removed and replaced with Class 4 aggregate base material in conformance with the placing and compacting requirements for structure backfill. The relative compaction shall be not less than 95 percent. Removal of the material will be measured and paid for by the cubic meter as structure excavation (bridge) and furnishing, placing, and compacting the replacement material will be measured and paid for by the cubic meter as structure backfill (bridge).

At the locations and to the limits shown on the plans, material below the bottom of retaining wall footings shall be removed and replaced with Class 4 aggregate base material in conformance with the placing and compacting requirements for structure backfill. The relative compaction shall be not less than 95 percent. Removal of the material will be measured and paid for by the cubic meter as structure excavation (retaining wall) and furnishing, placing, and compacting the replacement material will be measured and paid for by the cubic meter as structure backfill (retaining wall).

TIEBACK WALL EARTHWORK

Tieback wall earthwork consisting of excavating for tieback wall construction and backfilling around completed tieback walls shall conform to the provisions in Section 19, "Earthwork," of the Standard Specifications and these special provisions.

Attention is directed to "Tieback Anchors" of these special provisions.

Working drawings for tieback wall earthwork shall contain all information required for the construction and quality control of the earthwork, including the following:

- A. The proposed schedule and detailed construction sequence. Construction sequence shall include measures to ensure wall and slope stability during various stages of wall construction including provisions for discontinuous rows of nails or anchors.
- B. Methods of excavation to the staged lifts indicated and excavation equipment types.
- C. Temporary shoring plans.
- D. Drilling methods and equipment including proposed drill hole size and any variation of these along the alignments.
- E. Information on space requirements for installation equipment.
- F. A detailed construction dewatering plan addressing all elements necessary to divert, control, and dispose of surface water, and ground water.

The Contractor shall allow four weeks after complete drawings and all support data are submitted for the review and approval of the proposed method of tieback wall construction.

Excavation and shotcrete placement for the tieback retaining wall shall not start until the Engineer has reviewed and approved the working drawings for the associated tieback retaining wall as specified in "Tieback Anchors" of these special provisions.

In the event the Engineer fail to complete the review and approval within the time allowed and if, in the opinion of the Engineer, the Contractor's controlling operation is delayed or interfered with by reason of the delay in completing the review, the Contractor will be compensated for any resulting loss, and an extension of time will be granted, in the manner as provided in Section 8-1.09, "Right of Way Delays."

The Contractor shall only excavate enough area that can be stabilized, prepared and covered with the shotcrete during the same work shift. Care shall be taken to minimize disturbing the natural foundation materials behind the excavation face and removing loosened areas of the face before shotcrete is applied.

Excavation for walls shall be limited to that area which can be anchored and covered with shotcrete during the same work shift in which the excavation is done. Subsequent excavation shall not be made within 3 meters of previously anchored and covered portions of the wall until those anchored and covered portions are structurally complete. A portion of the wall will be considered structurally complete when the tieback anchors have been installed, the shotcrete cover has set, anchor bearing assemblies installed, and specified anchorage testing has been completed for that portion of the wall, and the test results have been furnished to the Engineer.

Excavation to the final wall alignment for the full wall height shall incorporate a working berm which shall be constructed from the top down in a staged lift sequence as shown on the approved wall earthwork working drawings. The ground level in front of the wall face shall not be excavated more than 1 meter below the level of the row of tieback anchors to be installed in that same lift.

The Contractor shall immediately notify the Engineer if raveling or local instability of the final wall face excavation occurs. Unstable areas shall be temporarily stabilized. Structure excavation work shall be suspended in unstable areas until remedial measures, submitted by the Contractor and approved by the Engineer, have been taken.

The Contractor shall protect installed tieback anchors during excavation and subsequent operations. Any tieback anchors damaged during construction shall be replaced by the Contractor, at the Contractor's expense.

The Contractor shall remove all cobbles, boulders, rubble, or debris which are encountered at the final wall alignment during wall face excavation and which protrude from the excavated face more than 13 mm into the design shotcrete thickness as shown on the plans. Such over excavation shall be backfilled with shotcrete.

Geocomposite Drain

The geocomposite drain shall conform to the details shown on the plans and the following:

- A. Attention is directed to "Engineering Fabrics" under "Materials" of these special provisions.
- B. Geocomposite drain shall consist of a manufactured core not less than 6.35 mm thick nor more than 50 mm thick with one or both sides covered with a layer of filter fabric that will provide a drainage void. The drain shall produce a flow rate, through the drainage void, of at least 25 liters per minute per meter of width at a hydraulic gradient of 1.0 and a minimum externally applied pressure of 168 kPa.
- C. A Certificate of Compliance conforming to the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications shall be furnished for the geocomposite drain certifying that the drain produces the required flow rate and complies with these special provisions. The Certificate of Compliance shall be accompanied by a flow capability graph for the geocomposite drain showing flow rates for externally applied pressures and hydraulic gradients. The flow capability graph shall be stamped with the verification of an independent testing laboratory.
- D. Filter fabric for the geocomposite drain shall conform to the provisions for fabric for underdrains in Section 88, "Engineering Fabrics," of the Standard Specifications.
- E. The manufactured core shall be either a preformed grid of embossed plastic, a mat of random shapes of plastic fibers, a drainage net consisting of a uniform pattern of polymeric strands forming 2 sets of continuous flow channels, or a system of plastic pillars and interconnections forming a semirigid mat.
- F. The core material and filter fabric shall be capable of maintaining the drainage void for the entire height of geocomposite drain. Filter fabric shall be integrally bonded to the side of the core material with the drainage void. Core material manufactured from impermeable plastic sheeting having nonconnecting corrugations shall be placed with the corrugations approximately perpendicular to the drainage collection system.
- G. The geocomposite drain shall be installed with the drainage void and the filter fabric facing the embankment. The fabric facing the embankment side shall overlap a minimum of 75 mm at all joints and wrap around the exterior edges a minimum of 75 mm beyond the exterior edge. If additional fabric is needed to provide overlap at joints and wrap-around at edges, the added fabric shall overlap the fabric on the geocomposite drain at least 150 mm and be attached thereto.
- H. Should the fabric on the geocomposite drain be torn or punctured, the damaged section shall be replaced completely or repaired by placing a piece of fabric that is large enough to cover the damaged area and provide a minimum 150-mm overlap.
- I. Plastic pipe shall conform to the provisions for edge drain pipe and edge drain outlets in Section 68-3, "Edge Drains," of the Standard Specifications.
- J. Treated permeable base to be placed around the slotted plastic pipe at the bottom of the geocomposite drain shall be cement treated permeable base conforming to the provisions for cement treated permeable base in Section 29, "Treated Permeable Bases," of the Standard Specifications and these special provisions.

- K. The treated permeable base shall be enclosed with a high density polyethylene sheet or PVC geomembrane, not less than 250 µm thick, which is bonded with a suitable adhesive to the concrete and geocomposite drain. Surfaces to receive the polyethylene sheet shall be cleaned before applying the adhesive. The treated permeable base shall be compacted with a vibrating shoe type compactor.

MEASUREMENT AND PAYMENT

Measurement and payment for structure excavation (tieback wall) and structure backfill (tieback wall) shall conform to the provisions in Sections 19-3.07, "Measurement," and 19-3.08, "Payment," of the Standard Specifications and these special provisions.

Full compensation for working drawings and supplements, and shoring, if required, for tieback wall construction shall be considered as included in the contract price paid per cubic meter for structure excavation (tieback wall) and no additional compensation will be allowed therefor.

Full compensation for furnishing and installing geocomposite drain, filter fabric and drainage piping shall be considered as included in the contract unit price paid per cubic meter for structure excavation (tieback wall) and no additional compensation will be allowed therefor.

Full compensation for shotcrete used to fill voids created by the removal of cobbles and boulders or other obstructions shall be considered as included in the contract price paid per cubic meter for shotcrete and no additional compensation will be allowed therefor.

If structure excavation or structure backfill for bridges is not otherwise designated by type and payment for the structure excavation or structure backfill has not otherwise been provided for in the Standard Specifications or these special provisions, the structure excavation or structure backfill will be measured and paid for as structure excavation (bridge) or structure backfill (bridge), respectively.

Full compensation for working drawings and construction sequence, and temporary supports and shoring, if required, for tieback wall construction shall be considered as included in the contract price paid per cubic meter for structure excavation (tieback wall) and no additional compensation will be allowed therefor.

Full compensation for filter fabric shall be considered as included in the contract price paid per cubic meter for structure backfill (tieback wall) and no additional compensation will be allowed therefor.

10-1.34 EARTH RETAINING STRUCTURES

Earth retaining structures, consisting of mechanically stabilized embankments, shall conform to the details shown on the plans and these special provisions.

Attention is directed to "Precast Concrete Quality Control" of these special provisions.

At the Contractor's option, one of the following acceptable alternative earth retaining systems may be constructed:

Proprietary Earth Retaining System	Address and Phone Number
Reinforced Earth (1.52 m cruciform concrete face panels; 1.52 m square concrete face panels)	The Reinforced Earth Company 1 Orchard Road, Suite 220 Lake Forest, CA 92630 (949) 587-3060 www.reinforcedearth.com
Retained Earth (1.52 m square concrete face panels)	Foster Geotechnical 1660 Hotel Circle North, Suite 304 San Diego, CA 92108 (619) 688-2400 www.lbfoster.com
Welded Wire Wall	Hilfiker Retaining Walls P.O. Box 2012 Eureka, CA 95502-2012 (707) 443-5093 www.hilfiker.com
MSE Plus (1.52 m square concrete face panels; 1.52 m high by 1.83 m wide concrete face panels)	SSL 4740 Scotts Valley Drive, Suite 'E' Scotts Valley, CA 95066 (831) 430-9300
Criblock	Retaining Walls Company 1800 Thibodo Road, #110 Vista, CA 92083 (760) 599-9595 www.rwc.net
Port-O-Wall Precast Concrete Retaining Wall System	Port-O-Wall Systems, LLC 585 Fifth Street West, #182 Sonoma, CA 95476 (707) 938-4516 www.port-o-wall.com
ARES (2.75 m wide by 1.52 m high concrete face panels)	Tensar Earth Technologies, Inc. 34892 Calle Fortuna Capistrano Beach, CA 92624 (949) 488-7054 www.tensarcorp.com

Only one type of earth retaining system shall be used at any one location.

The above list of acceptable alternative earth retaining systems has been selected from the Department's current list of prequalified earth retaining systems and is limited only to those systems determined to have characteristics suitable for this project. Among the alternatives shown, some systems may be proprietary.

The list of prequalified earth retaining systems has been developed from data previously furnished by suppliers or manufacturers of each system. Approval of additional earth retaining systems is contingent on the system meeting the full range of parameters for which prequalification is required. The prequalification requirements can be obtained from the Office of Structure Design, Mail Station 9-2/9I, 1801 30th Street, Sacramento, CA 95816.

WORKING DRAWINGS

If the Contractor elects to use a proprietary earth retaining system from the list of acceptable alternative systems, the Contractor shall submit complete working drawings for each installation of the system to the Office of Structure Design (OSD) in conformance with the provisions in Section 5-1.02, "Plans and Working Drawings," of the Standard Specifications. For initial review, 4 sets of drawings shall be submitted. After review between 6 and 12 sets, as requested by the Engineer, shall be submitted to OSD for final approval and use during construction.

Working drawings shall be 279 mm x 432 mm in size, and each drawing and calculation sheet shall include the State assigned designations for the contract number, bridge number, full name of the structure as shown on the contract plans, and District-County-Route-Kilometer Post. The design firm's name, address, and phone number shall be shown on the working drawings. Each sheet shall be numbered in the lower right hand corner and shall contain a blank space in the upper right hand corner for future contract sheet numbers.

The Contractor shall verify the existing ground elevations at the site before preparing the working drawings. The working drawings shall contain all information required for the proper construction of the system at each location including existing ground line at face of wall as verified at the site and any required revisions or additions to drainage systems or other facilities. The working drawings shall include "General Notes" which contain design parameters, material notes, and wall construction procedures. The working drawings and calculations shall be stamped and signed by an engineer who is registered as a Civil Engineer in the State of California. The Contractor shall allow the Engineer 4 weeks to review the drawings after a complete set has been received.

Unless otherwise specified, at the completion of each structure for which working drawings were submitted, and if the work detailed in these working drawings is permanent, the Contractor shall submit to the Engineer one set of corrected as-built prints 279 mm x 432 mm in size and on 75-g/m² (minimum) bond paper, showing as built conditions. As-built drawings that are common to more than one structure shall be submitted for each structure.

MATERIALS

Earthwork

Excavation and backfill shall conform to the details shown on the plans, the provisions in Section 19, "Earthwork," of the Standard Specifications, and these special provisions.

Structure backfill for earth retaining structures with soil reinforcement shall be free of organic material and substantially free of shale or other soft materials of poor durability. Structure backfill shall not contain slag aggregate or recycled materials such as glass, shredded tires, portland cement concrete rubble, asphaltic concrete rubble, or other unsuitable material as determined by the Engineer.

Structure backfill for earth retaining structures with soil reinforcement shall conform to the following requirements:

Gradation Requirements		
Sieve Size	Percentage Passing	California Test
159-mm	100	202
75-mm	78 - 100	202
4.75-mm	----	202
600-µm	0 - 60	202
75-µm	0 - 15	202

Property Requirements		
Test	Requirement	California Test
Sand Equivalent	12 minimum	217
Plasticity Index	6 maximum	204
Minimum Resistivity	2000 ohm-cm	643
Chlorides	< 250 ppm	422
Sulfates	< 500 ppm	417
pH	5.5 to 10.0	643

If 12 percent or less passes the No. 75-µm sieve and 50 percent or less passes the No. 4.75-mm sieve, the Sand Equivalent and Plasticity Index requirements shall not apply.

Structure backfill for earth retaining structures with geosynthetic soil reinforcement shall conform to the following requirements:

Gradation Requirements		
Sieve Size	Percentage Passing	California Test
50-mm	100	202
4.75 mm	50 - 80	202
425- μ m	0 - 30	202
75- μ m	0 - 15	202

Property Requirements		
Test	Requirement	California Test
Sand Equivalent	30 minimum	217
Plasticity Index	6 maximum	204
Durability Index	35 minimum	229
pH	4.5 to 9.0	643

Permeable material shall be used for the portion of the structure backfill for earth retaining structures with soil reinforcement within the limits shown on the plans. Permeable material shall be Class 1, Type B, conforming to the provisions in Section 68-1.025, "Permeable Material," of the Standard Specifications.

Permeable material for earth retaining structures with metallic soil reinforcement shall conform to the following requirements:

Property Requirements		
Test	Requirement	California Test
Minimum Resistivity	2000 ohm-cm	643
Chlorides	< 250 ppm	422
Sulfates	< 500 ppm	417
pH	5.5 to 10.0	643

Permeable material for earth retaining structures with geosynthetic soil reinforcement shall conform to the following requirements:

Property Requirements		
Test	Requirement	California Test
pH	4.5 to 9.0	643

Water used for earthwork or dust control within 150 meters of earth retaining structures with metallic soil reinforcement shall conform to the provisions for water in Section 90-2.03, "Water," of the Standard Specifications.

Concrete

Concrete used in precast and cast-in-place reinforced concrete members of earth retaining structures shall conform to the details shown on the plans, the provisions in Section 51, "Concrete Structures," of the Standard Specifications, and these special provisions.

The concrete leveling pads for the Mechanically Stabilized Embankment (MSE) system shall conform to the provisions in Section 90-10, "Minor Concrete," of the Standard Specifications.

Reinforcement

Reinforcement shall conform to the provisions in Section 52, "Reinforcement," of the Standard Specifications and these special provisions.

Galvanizing

Soil reinforcement, connecting elements, and other steel components that are in contact with the earth shall be galvanized in conformance with the provisions in Section 75-1.05, "Galvanizing," of the Standard Specifications.

Inspection Elements

If a proprietary alternative system is selected, inspection elements representative of the particular soil reinforcement shall be furnished in the same number and approximate location as shown on the plans for the MSE system.

When metallic soil reinforcement is used, the threaded end of the inspection wire may be formed before or after galvanizing. The end 100 mm of the wire shall be coated with two applications of an approved unthinned commercial quality zinc-rich primer (organic vehicle type). The threaded end of the wire shall be encapsulated with corrosion inhibiting, mastic filled, round vinyl enclosure secured with a nylon tie as shown on the plans. If the threaded end is galvanized after threading, the threads shall be cleaned before painting. There shall be no damage to the unthreaded portion of the galvanized inspection wire.

Drainage System

The drainage system shall conform to the details shown on the plans and these special provisions.

Corrugated steel pipe shall conform to the provisions in Section 66, "Corrugated Metal Pipe," of the Standard Specifications.

Perforated steel pipe underdrains and underdrain outlets and risers shall conform to the provisions in Section 68-1, "Underdrains," of the Standard Specifications.

The class of rock used for rock slope protection at drain pipe outlets shall be No. 3 Backing and shall conform to the provisions in Section 72-2, "Rock Slope Protection," of the Standard Specifications.

Filter fabric shall be ultraviolet (UV) ray protected, and shall conform to the provisions for fabric for underdrains in Section 88-1.03, "Filter Fabric," of the Standard Specifications and these special provisions.

Adhesive for bonding filter fabric to concrete panels shall be commercial grade.

Soil Reinforcement

Soil reinforcement shall conform to the details shown on the contract plans, the approved working drawings, the pre-approved proprietary system details, and these special provisions.

MW70 and MW130 steel wire shall conform to the requirements in ASTM Designation: A 82/A 82M. The welded wire mat shall conform to the requirements in ASTM Designation: A 185/A 185M. MD70 and MD130 deformed steel wire may be substituted for MW70 and MW130 steel wire, respectively. The welded wire mat utilizing deformed steel wire shall conform to the requirements in ASTM Designation: A 496/A 496M and ASTM Designation: A 497/A 497M.

The button on button-head wires shall conform to the provisions in Section 50-1.05, "Prestressing Steel," of the Standard Specifications.

The coupler at the wire mat connection shall be a seamless steel sleeve. The coupler shall be applied over the button-head wires and swaged by means of a hydraulic press. The coupler shall develop the minimum tensile strength of the wire without exceeding a total slip of the wires of 5.0 mm.

Sample button-head wire and coupler connectors shall develop the minimum tensile requirements for MW70 and MW130 steel wire in ASTM Designation: A 82/A 82M without exceeding a total slip of the wires of 5.0 mm when tested in conformance with the provisions for tension testing of round wire samples in ASTM Designation: A 370. When MD70 and MD130 deformed steel wire are substituted, samples shall develop the minimum tensile requirements contained in ASTM Designation: A 496/A 496M. An independent testing laboratory shall perform button-head wire and coupler connection testing. Samples shall consist of 2 button-head wires each 600 mm long connected by a swaged coupler.

Prior to the start of wall construction, the Contractor shall furnish test results to the Engineer from tension and slip tests conducted on 6 proposed button-head wire and coupler connections. Failure of any of the proposed button-head wire and coupler connector samples to meet the slip and tensile strength requirements herein shall require the connection be redesigned by the Contractor.

No installation of face panels shall be allowed until the Contractor has successfully completed tension and slip testing for proposed button-head wire and coupler connectors.

During wall construction, the Contractor shall furnish test results to the Engineer from tension and slip testing of 4 samples of production button-head wire and coupler connections for each lot of 500 individual mat wire connections incorporated into the work. Production testing shall consist of testing each of the 4 sample connections for both slip and tensile requirements herein. If 2 or more of the production samples fail to meet slip or tensile test requirements, the entire lot represented by these samples shall be rejected. If one of the production samples fails to meet slip or tensile test requirements, an additional 4 samples shall be tested. Should any of the additional samples fail to meet the slip or tensile requirements, the entire lot represented by these samples shall be rejected.

Splicing of the welded wire mat along its length shall be by mechanical coupler, which shall develop the minimum tensile strength of the wire. The mechanical coupler shall be approved by the Engineer.

Geogrid soil reinforcement roll identification, storage, and handling shall be in accordance with ASTM Designation: D 4873, and as specified in the pre-approved proprietary details. The geogrid shall be shipped and stored such that the material is not placed directly on the ground. The geogrid shall be covered and protected at all times during shipment and storage such that it is fully protected from UV radiation including sunlight, site construction damage, precipitation, chemicals, flames including welding sparks, temperatures less than -29°C or greater than 60°C, or other conditions that may

damage the physical property values of the geogrid. The Contractor shall prevent foreign materials from coming into contact with or affixing to the geogrid.

Miscellaneous

Resin bonded cork for horizontal joints shall conform to the requirements in ASTM Designation: D 1752, Type II, with a compressive load of not less than 690 kPa.

Pipe for the pipe pin shall conform to the requirements in ASTM Designation: A 53/A 53M, Standard weight, except the amount of the zinc coating per square meter of actual surface shall average not less than 610 g and no individual specimen shall be less than 550 g.

CONSTRUCTION

Earth retaining structures shall be constructed to the lines, grades, and details shown on the plans, and shall conform to these special provisions.

Earthwork

The foundation for the structure shall be graded level for a width equal to the length of soil reinforcement elements plus 300 mm or as shown on the contract plans. The foundation material shall be compacted to a relative compaction of not less than 95 percent. The Engineer shall approve the compacted foundation area prior to commencement of wall construction.

The contractor shall remove unsuitable material as determined and directed by the Engineer. This work shall be paid for as extra work as provided in Section 4-1.03D, "Extra Work," of the Standard Specifications.

Structure backfill material shall be placed and compacted simultaneously with the erection of the facing panels. Placement and compaction shall be accomplished without distortion of the soil reinforcement or displacement of facing panels. Structure backfill at the front of the wall shall be completed prior to backfilling more than 4 m above the bottom of the lowermost face element.

Vertical and horizontal alignment tolerances of panels shall not exceed 20 mm when measured along a 3 m straight edge. The maximum allowable offset in any panel joint shall not exceed 20 mm.

Structure backfill for earth retaining structures with soil reinforcement shall be compacted to a relative compaction of not less than 95 percent.

A relative compaction of not less than 95 percent shall be obtained for embankment under earth retaining structures with soil reinforcement within the limits established by inclined planes sloping 1:1.5 (vertical:horizontal) out and down from lines 0.3-m outside the bottom limits of structure backfill, including permeable material when required.

Soil reinforcement shall be tensioned in the direction perpendicular to the wall face with enough force to remove any slack in the connection or in the soil reinforcement itself. Soil reinforcement shall be secured in place to prevent movement during placement of additional soil reinforcement and structure backfill until the initial lift of structure backfill is compacted.

Geogrid soil reinforcement shall be placed in full-length sections.

Soil reinforcement shall be covered with structure backfill during the same work shift that it is placed.

Placement and compaction of structure backfill shall begin 300 mm from the back face of wall panels and progress towards the free end of the soil reinforcement. Compaction equipment shall be operated parallel to the wall facing. The remaining width of backfill behind the wall panels shall be placed and compacted after soil reinforcement has been covered to a depth of 150 mm.

Sheepsfoot or grid-type rollers shall not be used for compacting material within the limits of the soil reinforcement. Hand-held or hand-guided compacting equipment shall be used to compact structure backfill material within one meter of the facing panels.

Construction equipment shall not be operated directly on the soil reinforcement. A layer of structure backfill material not less than 150 mm in thickness shall be maintained between the soil reinforcement and construction equipment of any type.

Structure backfill material for earth retaining structures with geogrid soil reinforcement shall be placed in lifts not to exceed 150 mm where hand-operated compacting equipment is used and 200 mm where heavy compaction equipment is used.

At each level of the soil reinforcement the structure backfill shall be constructed to a plane 50 mm above the elevation of the soil reinforcement connection and shall start one meter from the back of the face panel and extend for at least the remaining length of soil reinforcement. This grading shall be complete before placing the next layer of soil reinforcement.

Permeable material and filter fabric shall be placed along with structure backfill as shown on the plans. Permeable material shall be placed in layers not exceeding 0.6-m in thickness. Compaction of the permeable material for the drainage system outside the limits of the soil reinforcement is not required, and equipment shall not be operated directly on the permeable material or filter fabric. If a sloped layer of permeable material is placed to facilitate the work or to satisfy safety considerations, the vertical limits of permeable material shall remain unchanged and the thickness of the layer of permeable material shall be measured normal to the slope.

The Contractor shall grade the reinforced backfill to rapidly drain away from the wall face at the end of each work shift. Berms or ditches shall be provided to direct runoff away from the wall site. The Contractor shall not allow surface runoff from adjacent areas to enter the wall construction site.

Filter Fabric

Filter fabric shall be placed at the locations and in conformance with the details shown on the plans and these special provisions.

Immediately prior to placing filter fabric, the subgrade to receive the filter fabric shall conform to the compaction and elevation tolerance specified for the material involved and shall be free of loose or extraneous material and sharp objects that may damage the filter fabric during installation.

Concrete panel surfaces to receive filter fabric shall be dry and thoroughly cleaned of dust and deleterious materials.

Filter fabric shall be handled and placed in conformance with the manufacturer's recommendations.

Filter fabric shall be stretched, aligned, and placed in a wrinkle-free manner.

Adjacent borders of filter fabric shall be stitched or overlapped from 300 mm to 450 mm. The preceding roll shall overlap the following roll in the direction the material is being spread or shall be stitched. When filter fabric is joined by stitching it shall be stitched with yarn of a contrasting color. The size and composition of the yarn shall be as recommended by the filter fabric manufacturer. The stitches shall number 2 to 3 per centimeter of seam.

If the filter fabric is damaged during installation, it shall be repaired by placing a piece of filter fabric that is large enough to cover the damaged area and which meets the overlap requirement.

During spreading of the permeable material, a minimum of 150 mm of the material shall be maintained between the filter fabric and the Contractor's equipment. Where structure backfill material is to be placed on filter fabric, a minimum of 450 mm of structure backfill material shall be maintained between the filter fabric and the Contractor's equipment. Equipment or vehicles shall not be operated or driven directly on filter fabric.

Concrete

Concrete for the leveling pads shall be placed at least 24 hours prior to erecting face panels.

Architectural treatment for concrete surfaces of earth retaining structure shall conform to the details shown on the plans and the provisions in Section 51, "Concrete structures" of the Standard Specifications and "Architectural Surface (Textured Concrete)" of these special provisions.

After placement of an inspection element and placement of backfill to a level at least 0.6-m above the inspection element, the void in the face panel shall be dry packed with portland cement mortar as shown on the plans. Dry pack shall conform to the provisions in Section 51-1.135, "Mortar," of the Standard Specifications, except that the proportion of cement to sand shall be that required to achieve a 28-day mortar compressive strength of 7 MPa to 10 MPa.

Proprietary Earth Retaining Systems

If the Contractor elects to construct one of the acceptable proprietary alternative earth retaining systems, the structure shall be constructed to the lines and grades shown on the plans. Vertical and horizontal alignment shall be checked at every course throughout the erection process. The construction shall include a drainage system where shown on the plans, and shall conform to the details shown on the approved working drawings, approved proprietary system details, and these special provisions.

The Contractor shall supply a Certificate of Compliance conforming to the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications stating the supplied material meets the respective index criteria set forth when the proprietary alternative earth retaining system was prequalified by the Department, as measured in accordance with all test methods and standards specified in the Standard Specifications, these special provisions, and the approved working drawings.

A qualified representative of the proprietary earth retaining system manufacturer shall be present during erection and backfill of the first 3 meters of height of the entire length of the wall and shall be available during any remaining installations. The manufacturer's representative shall not be an employee of the Contractor.

Alternative earth retaining structures shall be constructed to accommodate the wall-mounted lighting, the wall mounted drainpipe, and the panels for future drainage inlets, as shown on the plans.

The top of wall profile of alternative earth retaining systems shall conform to the profile shown on the plans. The bottom of face panels shall be at or below the elevations shown on the plans. The height and length to be used for any system shall be the minimums for that system that will effectively retain the earth behind the structure for the loading conditions and the contours, profile, or slope lines shown on the plans. The length of soil reinforcement for any system shall be not less than that shown on the plans. In addition, if the plans or special provisions indicate limiting parameters for alternative systems, the system shall conform to those parameters.

The top of face panels, assuming no leveling pad settlement, shall be covered by the coping lip or concrete barrier slab lip at a minimum of 170 mm.

The top level of soil reinforcement shall be placed parallel to the top of the concrete panel at a distance below the top of the wall as shown on the plans. The top level of soil reinforcement shall also be 1) placed a minimum of 75 mm below the bottom of the barrier slab lip or the bottom of the concrete gutter behind coping and 2) placed a minimum of 125 mm below the top edge of the concrete panel.

MEASUREMENT AND PAYMENT

Earth retaining structures will be measured and paid for by the square meter. Regardless of the type of earth retaining structure actually constructed, the square meter area for payment will be based on the length and vertical height of each section of mechanically stabilized embankment system shown on the plans that was or would have been constructed. The vertical height of each section will be taken as the difference in elevation on the top of leveling pad to the top of wall profile.

The contract price paid per square meter for earth retaining structure at each location shown on the plans shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in constructing the earth retaining structure and inspection elements, including earthwork, leveling pad, coping, bearing pads, and drainage systems, complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

The contract price paid per cubic meter for structural concrete, barrier slab shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in constructing the barrier slab, complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

Full compensation for furnishing and testing sample mechanical connectors shall be considered as included in the contract price paid per square meter for earth retaining structure, and no separate payment will be made therefor.

Full compensation for revisions to the barrier support, drainage system, or other facilities made necessary by the use of an alternative earth retaining system shall be considered as included in the contract price paid per square meter for earth retaining structure, and no separate payment will be made therefor.

10-1.35 CONTROLLED LOW STRENGTH MATERIAL

Controlled low strength material shall consist of a workable mixture of aggregate, cementitious materials, and water and shall conform to the provisions for slurry cement backfill in Section 19-3.062, "Slurry Cement Backfill," of the Standard Specifications and these special provisions.

At the option of the Contractor, controlled low strength material may be used as structure backfill for drainage pipe

When controlled low strength material is used for structure backfill, the width of the excavation shown on the plans may be reduced so that the clear distance between the outside of the pipe and the side of the excavation, on each side of the pipe, is a minimum of 300 mm. This minimum may be reduced to 150 mm when the height of cover is less than or equal to 6.1 m or the pipe diameter or span is less than 1050 mm.

Controlled low strength material in new construction shall not be permanently placed higher than the basement soil. For trenches in existing pavements, permanent placement shall be no higher than the bottom of the existing pavement permeable drainage layer. If a drainage layer does not exist, permanent placement in existing pavements shall be no higher than 25 mm below the bottom of the existing asphalt concrete surfacing or no higher than the top of base below the existing portland cement concrete pavement. The minimum height that controlled low strength material shall be placed, relative to the culvert invert, is 0.5 diameter or 0.5 height for rigid culverts and 0.7 diameter or 0.7 height for flexible culverts.

When controlled low strength material is proposed for use, the Contractor shall submit a mix design and test data to the Engineer for approval prior to excavating the trench for which controlled low strength material is proposed for use. The test data and mix design shall provide for the following:

- A. A 28-day compressive strength between 345 kPa and 690 kPa for pipe culverts having a height of cover of 6.1 m or less and a minimum 28-day compressive strength of 690 kPa for pipe culverts having a height of cover greater than 6.1 m. Compressive strength shall be determined in conformance with the requirements in ASTM Designation: D 4832.
- B. Cement shall be any type of portland cement conforming to the requirements in ASTM Designation: C 150; or any type of blended hydraulic cement conforming to the requirements in ASTM Designation: C 595M or the physical requirements in ASTM Designation: C 1157M. Testing of cement will not be required.
- C. Admixtures may be used in conformance with the provisions in Section 90-4, "Admixtures," of the Standard Specifications. Chemical admixtures containing chlorides as Cl in excess of one percent by mass of admixture, as determined in conformance with the requirements of California Test 415, shall not be used. If an air-entraining admixture is used, the maximum air content shall be limited to 20 percent. Mineral admixtures shall be used at the Contractor's option.

Attention is directed to "Rock Staining" of these special provisions. Controlled low strength material used as structure backfill over downdrains shall have a color closely conforming to the color of the rock staining. Coloring shall be integral, chemically inert, fade resistant mineral oxide or synthetic type. Color shall be applied at the rate specified by the manufacturer. A sample of sufficient size of the controlled low strength material, to demonstrate the color, shall be submitted to the Engineer for approval.

Materials for controlled low strength material shall be thoroughly machine-mixed in a pugmill, rotary drum or other approved mixer. Mixing shall continue until the cementitious material and water are thoroughly dispersed throughout the material. Controlled low strength material shall be placed in the work within 3 hours after introduction of the cement to the aggregates.

When controlled low strength material is to be placed within the traveled way or otherwise to be covered by paving or embankment materials, the material shall achieve a maximum indentation diameter of 76 mm prior to covering and opening to public traffic. Penetration resistance shall be measured in conformance with the requirements in ASTM Designation: D 6024.

Controlled low strength material used as structure backfill for drainage pipe will be considered structure backfill for compensation purposes.

10-1.36 DUFF

This work shall consist of excavating, stockpiling, removing from stockpiles, spreading, and compacting duff in conformance with these special provisions.

Duff shall consist of a mixture of existing decomposed, chopped, broken or chipped plant material, leaves, grasses, weeds, and other plant material excavated from areas within the project limits. Existing shrubs and other small plants shall be incorporated into the duff by discing, or by other methods which will break or chop the material into particles not greater than 150 mm in greatest dimension.

When duff is to be excavated to a specified depth, duff may consist of plant material and soil. Rocks and plant material in excess of 150 mm in greatest dimension shall be removed from the excavated duff.

Trash and objectionable material shall be removed from duff excavation sites prior to duff excavation. The trash and objectionable material shall be removed and disposed of outside the highway right of way in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.

Duff shall be obtained by excavating the top 300 mm of existing material from proposed excavation and embankment areas and other areas within the project limits. Duff shall be stockpiled along the top of proposed excavation slopes and along the toe of proposed embankment slopes. When duff cannot be stockpiled outside the slope lines as specified herein, excavated duff material may be stockpiled at other locations when designated by the Engineer.

Duff shall be taken from and placed in the same location: Southbound I-15 (west of I-15), Sta. 449 + 50 to Sta. 451 + 60.

Upon completion of the grading operations for the excavation and embankment slopes and other areas to receive duff, the duff shall be spread on the areas designated to receive duff. Duff shall be placed to a uniform depth of not less than 100 mm and shall be compacted or stabilized in a manner that retains the material in place on the slopes. Duff shall not be compacted or stabilized to the degree that the duff is not maintained as a viable growing medium.

Duff shall be placed on designated excavation and embankment slopes prior to applying erosion control materials. Erosion control materials shall be furnished and applied as specified in these special provisions.

Duff placed on the finished slopes will be measured by the square meter. The areas of duff will be calculated on the basis of actual or computed slope measurements.

The contract price paid per square meter for duff shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in excavating, stockpiling, removing duff from stockpiles, spreading and compacting or stabilizing duff, complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.37 MOVE-IN/MOVE-OUT (EROSION CONTROL)

Move-in/move-out (erosion control) shall include moving onto the project when an area is ready to receive erosion control as determined by the Engineer, setting up all required personnel and equipment for the application of erosion control materials and moving out all personnel and equipment when erosion control in that area is completed.

When areas are ready to receive applications of erosion control (Type 1, Type 2 or Type 3), as determined by the Engineer, the Contractor shall begin erosion control work in that area within 5 working days of the Engineer's notification to perform the erosion control work.

Attention is directed to the requirements of erosion control (Type 1, Type 2 or Type 3) elsewhere in these special provisions.

Quantities of move-in/move-out (erosion control) will be determined as units from actual count as determined by the Engineer. For measurement purposes, a move-in followed by a move-out will be considered as one unit.

The contract unit price paid for move-in/move-out (erosion control) shall include full compensation for furnishing all labor, materials (excluding erosion control materials), tools, equipment, and incidentals and for doing all the work involved in moving in and removing from the project all personnel and equipment necessary for application of erosion control (Type 1, Type 2 or Type 3), as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

No adjustment of compensation will be made for any increase or decrease in the quantities of move-in/move-out (erosion control) required, regardless of the reason for the increase or decrease. The provisions in Section 4-1.03B, "Increased or Decreased Quantities," of the Standard Specifications shall not apply to the item of move-in/move-out (erosion control).

10-1.38 EROSION CONTROL (TYPE 1 , TYPE 2 AND TYPE 3)

Erosion control (Type 1, Type 2 and Type 3) shall conform to the provisions in Section 20-3, "Erosion Control," of the Standard Specifications and these special provisions and shall consist of applying erosion control materials to embankment and excavation slopes and other areas disturbed by construction activities.

Erosion control (Type 1, Type 2 and Type 3) shall be applied when an area is ready to receive erosion control as determined by the Engineer and in conformance with the provisions in "Move-in/Move-out (Erosion Control)" of these special provisions.

Prior to installing erosion control materials, soil surface preparation shall conform to the provisions in Section 19-2.05, "Slopes," of the Standard Specifications, except that rills and gullies exceeding 50 mm in depth or width shall be leveled. Vegetative growth, temporary erosion control materials, and other debris shall be removed from areas to receive erosion control.

MATERIALS

Materials shall conform to the provisions in Section 20-2, "Materials," of the Standard Specifications and these special provisions.

Seed

Seed shall conform to the provisions in Section 20-2.10, "Seed," of the Standard Specifications. Individual seed species shall be measured and mixed in the presence of the Engineer.

Seed shall be delivered to the project site in unopened separate containers with the seed tag attached. Containers without a seed tag attached will not be accepted.

A sample of approximately 30 g of seed will be taken from each seed container by the Engineer.

Legume Seed

Legume seed shall be pellet-inoculated or industrial-inoculated and shall conform to the following:

- A. Inoculated seed shall be inoculated in conformance with the provisions in Section 20-2.10, "Seed," of the Standard Specifications.
- B. Inoculated seed shall have a calcium carbonate coating.
- C. Industrial-inoculated seed shall be inoculated with Rhizobia and coated using an industrial process by a manufacturer whose principal business is seed coating and seed inoculation.
- D. Industrial-inoculated seed shall be sown within 180 calendar days after inoculation.
- E. Legume seed shall consist of the following:

Erosion Control (Type 1) - LEGUME SEED

Botanical Name (Common Name)	Percent Germination (Minimum)	Kilograms Pure Live Seed Per Hectare (Slope Measurement)
Lupinus succulentus (Arroyo Lupine)	50	10
Trifolium hirtum 'Hykon' (Hykon Rose Clover)	45	5

Erosion Control (Type 2 and Type 3) - LEGUME SEED

Botanical Name (Common Name)	Percent Germination (Minimum)	Kilograms Pure Live Seed Per Hectare (Slope Measurement)
Lotus scoparius (Deerweed)	35	4
Lupinus succulentus (Arroyo Lupine)	50	4

Non-Legume Seed

Non-legume seed shall consist of the following:

Erosion Control (Type 1) - NON-LEGUME SEED

Botanical Name (Common Name)	Percent Germination (Minimum)	Kilograms Pure Live Seed Per Hectare (Slope Measurement)
Eschschozia californica (California Poppy)	60	5
Lasthenia californica (Goldfields)	35	1.5

Erosion Control (Type 2 and Type 3) - NON-LEGUME SEED

Botanical Name (Common Name)	Percent Germination (Minimum)	Kilograms Pure Live Seed Per Hectare (Slope Measurement)
Eschschoziz californica (California Poppy)	60	8
Eriogonum fasciculatum (California Buckwheat)	35	3
Nassella lepida (Foothill Stipa)	35	5
Poa secunda (Malpais Bluegrass)	35	2
Salvia apiana (White Sage)	20	0.5
Salvia mellifera (Black Sage)	30	1
Viguiera laciniata (San Diego Sunflower)	30	0.5

Commercial Fertilizer

Commercial fertilizer shall conform to the provisions in Section 20-2.02, "Commercial Fertilizer," of the Standard Specifications and shall have a guaranteed chemical analysis of 6 percent nitrogen, 20 percent phosphoric acid and 20 percent water soluble potash.

Compost

Compost shall be Class A, exceptional quality biosolids composts, conforming to the requirements in United States Environmental Protection Agency (EPA) regulation 40 CFR, Part 503c.

Compost shall not contain paint, petroleum products, herbicides, fungicides or other chemical residues harmful to plant or animal life. Other deleterious material, plastic, glass, metal or rock shall not exceed 0.1-percent by weight or volume.

Compost shall be thermophilically processed for 15 days. During this process, the compost shall be maintained at minimum internal temperature of 55°C and be thoroughly turned at least 5 times. A 90-day curing period shall follow the thermophilic process.

Compost shall be screened through a screen no larger than 12 mm.

Compost shall measure at least 6 on the maturity and stability scale with a Solvita test kit.

A Certificate of Compliance for compost shall be furnished to the Engineer in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications. The Certificate of Compliance shall state the Solvita maturity and stability scale test result of the compost.

Stabilizing Emulsion

Stabilizing emulsion shall conform to the provisions in Section 20-2.11, "Stabilizing Emulsion," of the Standard Specifications and these special provisions.

Stabilizing emulsion shall be in a dry powder form, may be reemulsifiable, and shall be a processed organic adhesive used as a soil tackifier.

Bonded Fiber Matrix

Bonded fiber matrix shall be composed of tackifier and fiber as specified below:

- A. The tackifier shall conform to the provisions in Section 20-2.11, "Stabilizing Emulsion," of the Standard Specifications and these special provisions. The tackifier shall be nonflammable, non-toxic to aquatic organisms, and shall have no growth or germination inhibiting factors, and shall have an effective life of at least one year. The tackifier shall be an organic, high viscosity colloidal polysaccharide with activating agents, or a blended hydrocolloid-based binder. Emulsion material (solids) shall not dissolve or disperse upon rewetting. The tackifier shall be bonded to the fiber or prepackaged with the fiber by the manufacturer. The tackifier, including activating agents and additives, shall be a minimum of 10 percent by weight of the fiber.
- B. The fiber shall conform to the provisions in Section 20-2.07, "Fiber," of the Standard Specifications and these special provisions. The fiber shall be long strand, whole wood fibers, thermo-mechanically processed from clean, whole wood chips, containing a minimum of 25 percent at 10 mm long, with a minimum of 50 percent retained on a 710 more retained on a 710 µm sieve. The wood chips shall not contain lead paint, printing ink, varnish, petroleum products, seed germination inhibitors, or chlorine bleach. Fiber shall not be produced from sawdust, cardboard, paper, or paper by-products.
- C. A coloring agent shall be added to the bonded fiber matrix to contrast with the area on which it is applied. The coloring agent shall not include copper, mercury, or arsenic, and shall be biodegradable and nontoxic.
- D. A Certificate of Compliance for bonded fiber matrix shall be furnished to the Engineer in accordance with the provisions in Section 6-1.07, "Certificates of Compliance" of the Standard Specifications. The Certificate of Compliance shall include a list of pollutant indicators and potential pollutants not visually detectable as described under "Sampling and Analysis Plan for Non-Visible Pollutants" in the Storm Water Pollution Prevention Plan and Water Pollution Control Program Preparation Manual of the Storm Water Quality Handbooks issued by the Department.
- E. The Contractor shall provide written documentation certifying the bonded fiber matrix was applied in accordance with specified rates, including area of application, time of application, and quantities used.
- F. Monitoring for pollutants not visually detectable in storm water is required by the General Construction NPDES Permit for soil amendments, including soil stabilization products.

APPLICATION

Erosion control materials shall be applied in separate applications in the following sequence:

- A. The following mixture in the rates indicated shall be applied with hydro-seeding equipment within 60 minutes after the seed has been added to the mixture:

Application 1 - Erosion Control (Type 1)

Material	Kilograms Per Hectare (Slope Measurement)
Legume Seed	15
Non-Legume Seed	6.5
Fiber	800
Commercial Fertilizer	10

Application 1 - Erosion Control (Type 1)

Material	Cubic Meter Per Hectare (Slope Measurement)
Compost	2

Application 1 - Erosion Control (Type 2)

Material	Kilograms Per Hectare (Slope Measurement)
Legume Seed	8
Non-Legume Seed	20
Fiber	800
Commercial Fertilizer	10

Application 1 - Erosion Control (Type 2)

Material	Cubic Meter Per Hectare (Slope Measurement)
Compost	2

Application 1 - Erosion Control (Type 3)

Material	Kilograms Per Hectare (Slope Measurement)
Legume Seed	8
Non-Legume Seed	20
Bonded Fiber Matrix	2250

Application 1 - Erosion Control (Type 3)

Material	Cubic Meter Per Hectare (Slope Measurement)
Compost	0.84

- B. The Contractor may dry apply compost at the total of the rates specified in the preceding table and the following table instead of including it as part of the hydro-seeding operations. In areas where the compost is dry applied, all compost for that area shall be applied before the next operation.
- C. The following mixture in the rates indicated shall be applied with hydro-seeding equipment:

Application 2 - Erosion Control (Type 1)

Material	Kilograms Per Hectare (Slope Measurement)
Fiber	1000
Commercial Fertilizer	10
Stabilizing Emulsion (Solids)	250

Application 2 - Erosion Control (Type 1)

Material	Cubic Meter Per Hectare (Slope Measurement)
Compost	2

Application 2 - Erosion Control (Type 2)

Material	Kilograms Per Hectare (Slope Measurement)
Fiber	1000
Commercial Fertilizer	10
Stabilizing Emulsion (Solids)	250

Application 2 - Erosion Control (Type 2)

Material	Cubic Meter Per Hectare (Slope Measurement)
Compost	2

Application 2 - Erosion Control (Type 3)

Material	Kilograms Per Hectare (Slope Measurement)
Bonded Fiber Matrix	2250
Commercial Fertilizer	25

Application 2 - Erosion Control (Type 3)

Material	Cubic Meter Per Hectare (Slope Measurement)
Compost	0.84

The ratio of total water to total stabilizing emulsion in the mixture for erosion control (Type 1 and Type 2) shall be as recommended by the manufacturer.

The ratio of total water to total bonded fiber matrix in the mixture for erosion control (Type 3) shall be as recommended by the manufacturer.

The rates of erosion control materials may be changed by the Engineer to meet field conditions.

MEASUREMENT AND PAYMENT

Compost (erosion control) will be measured by the cubic meter in the vehicle at the point of delivery in conformance with the provisions in Section 9-1.01, "Measurement of Quantities," of the Standard Specifications.

Bonded fiber matrix (erosion control) will be measured by the kilogram. The weight will be as determined by the Engineer from marked mass and sack count or from scale weighings.

The contract price paid per cubic meter for compost (erosion control) shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in applying compost for erosion control, complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

The contract price paid per kilogram for bonded fiber matrix (erosion control) shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in applying bonded fiber matrix (erosion control), complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.39 FIBER ROLLS

Fiber rolls shall conform to the details shown on the plans for "Temporary Fiber Roll" and these special provisions. At the option of the Contractor, fiber rolls shall be Type 1 or Type 2.

MATERIALS

Fiber rolls shall consist of one of the following:

- A. Fiber rolls shall be constructed with a pre-manufactured blanket consisting of one material or a combination of materials consisting of wood excelsior, rice or wheat straw, or coconut fibers. The blanket shall be between 2.0 m and 2.4 m in width and between 20 m and 29 m in length. Wood excelsior shall be individual fibers, of which 80 percent shall be 150 mm or longer in length. The blanket shall have a photodegradable plastic netting or biodegradable jute, sisal or coir fiber netting on at least one side. The blanket shall be rolled along the width and

secured with jute twine spaced 2 m apart along the full length of the roll and placed 150 mm from the ends of each roll. The finished roll shall be between 200 mm and 250 mm in diameter, between 3 m and 6 m in length and shall weigh at least 0.81-kg/m. More than one blanket may be required to achieve the finished roll diameter. When more than one blanket is required, blankets shall be jointed longitudinally with an overlap of 150 mm along the length of the blanket.

- B. Fiber rolls shall be a pre-manufactured roll of rice or wheat straw, wood excelsior or coconut fiber encapsulated within a photodegradable plastic or biodegradable jute, sisal or coir fiber netting. Rolls shall be between 200 mm and 250 mm in diameter, between 3 m and 6 m in length and shall weigh at least 1.6 kg/m. The netting shall have a minimum durability of one year after installation. The netting shall be secured tightly at each end of the rolls.

Stakes

Wood stakes shall be a minimum of 19 mm x 19 mm in size for Type 1 installation, or shall be a minimum of 19 mm x 38 mm in size for Type 2 installation, and sufficient length as shown on detail. Stakes shall be driven to a maximum of 50 mm above, or flush with the top of the roll. Wood stakes shall be untreated fir, redwood, cedar, or pine, shall be cut from sound timber, and shall be straight and free of loose or unsound knots and other defects which would render them unfit for the purpose intended. Metal stakes may be used as an alternative. The Contractor shall submit a sample of the metal stake for Engineer's approval prior to installation. The tops of the metal stakes shall be bent at a 90-degree angle.

Rope

Rope shall be biodegradable, such as sisal or manila, with a minimum diameter of 6.35 mm.

INSTALLATION

Fiber rolls shall be installed as follows:

- A. Fiber rolls (Type 1): Furrows shall be constructed to a depth between 50 mm and 100 mm, and to a sufficient width to hold the fiber rolls. Stakes shall be installed 600 mm apart along the length of the fiber rolls and stopped at 300 mm from each end of the rolls. Stakes shall be driven to a maximum of 50 mm above, or flush with, the top of the roll.
- B. Fiber rolls (Type 2): Rope and notched stakes shall be used to restrain the fiber rolls against the slope. Stakes shall be driven into the slope until the notch is even with the top of the fiber rolls. Rope shall be knotted at each stake and laced between stakes. After installation of the rope, stakes shall be driven into the slope such that the rope will hold the fiber rolls tightly to the slope. Furrows will not be required. If metal stakes are used, the rope may be laced and knotted on the bend at the top of the metal stakes.
- C. Temporary fiber roll shall be placed 3.0 m apart along the slope for slope inclination (vertical:horizontal) of 1:2 and steeper, 4.5 m apart along the slope for slope inclination between 1:2 and 1:4, 6.0 m apart along the slope for slope inclination between 1:4 and 1:10, and a maximum of 15 m apart along the slope for slope inclination of 1:10 and flatter.
- D. Fiber rolls shall be installed approximately parallel to the slope contour.
- E. Fiber rolls shall be installed prior to the application of other temporary erosion control or soil stabilization materials in the same area.

Ground disturbances, including holes and depressions, caused by the installation of the fiber rolls shall be backfilled and repaired in conformance with the provisions in Section 15-1.02, "Preservation of Property," of the Standard Specifications.

MAINTENANCE

Fiber rolls shall be maintained to disperse concentrated water runoff and to reduce runoff velocities. Split, torn, or unraveling rolls shall be repaired or replaced. Broken or split stakes shall be replaced. Sagging or slumping fiber rolls shall be repaired with additional stakes or replaced. Locations where rills and other evidence of concentrated runoff have occurred beneath the rolls shall be corrected.

Fiber rolls shall be repaired or replaced on the same day when the damage occurs. Damage to the fiber rolls resulting from the Contractor's vehicles, equipment, or operations shall be repaired at the Contractor's expense.

MEASUREMENT AND PAYMENT

The quantity of fiber rolls to be paid for will be measured by the meter, along the centerline of the installed roll. Where fiber rolls are joined and overlapped, the joint will be measured as a single installed roll.

The contract price paid per meter for fiber rolls shall include full compensation for furnishing all labor, (except maintenance), materials, tools, equipment, and incidentals, and for doing all the work involved in installing fiber rolls,

complete in place, including furrow excavation and backfill, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

No adjustment of compensation will be made for any increase or decrease in the quantities of fiber rolls required, regardless of the reason for the increase or decrease. The provisions in Section 4-1.03B, "Increased or Decreased Quantities," of the Standard Specifications shall not apply to fiber rolls.

The cost of maintaining the fiber rolls will be borne equally by the State and the Contractor.

The division of cost will be made by determining the cost of maintaining fiber rolls in conformance with the provisions in Section 9-1.03, "Force Account Payment," of the Standard Specifications and paying to the Contractor one-half of that cost. Clean-up, repair, removal, disposal, replacement because of improper installation, and replacement of fiber rolls damaged as a result of the Contractor's negligence will not be considered as included in the cost for performing maintenance.

10-1.40 IRRIGATION CROSSOVERS

Irrigation crossovers shall conform to the provisions in Section 20-5, "Irrigation Systems," of the Standard Specifications and these special provisions.

Conduits shall be installed under existing paving by jacking or drilling methods in conformance with the provisions in Section 20-5.03B, "Conduit for Irrigation Crossovers," of the Standard Specifications.

At the Contractor's option, conduits to be installed under existing paving may be installed by the directional bore method.

Conduits installed by directional bore method shall be polyvinyl chloride (PVC) plastic pipe, Schedule 40, and shall conform to Section 20-2.15B(1), "Plastic Pipe Supply Line," of the Standard Specifications.

The diameter of the boring tool for directional boring shall be only as large as necessary to install conduit. Mineral slurry or wetting solution shall only be used to lubricate the boring tool and to stabilize the soil surrounding the boring path. Mineral slurry or wetting solution shall be water based and environmentally safe.

Residue from directional bore operations shall be handled in the same manner specified for residue from saw cutting operations in "Existing Highway Facilities," of these special provisions.

The directional bore equipment shall have directional control of the boring tool and have an electronic boring tool location detection system. During operation, the directional bore equipment shall be able to determine the location of the tool both horizontally and vertically.

A representative of the Contractor must be in direct charge and control of the directional bore operation at all times.

The Engineer shall be notified 2 working days in advance of starting directional bore operations. Directional bore shall only be performed in the presence of the Engineer unless otherwise notified in writing by the Engineer.

Polyvinyl chloride (PVC) plastic pipe, Schedule 40 will be measured and paid for as 200 mm welded steel pipe conduit (6.35 mm thick).

10-1.41 EXTEND IRRIGATION CROSSOVERS

Extend existing irrigation crossovers shall conform to the provisions in Section 20-5, "Irrigation Systems," of the Standard Specifications and these special provisions.

Extend irrigation crossovers shall include conduit, water line crossover, and sprinkler control crossover extensions and appurtenances, locating existing irrigation crossovers and pressure testing existing and new water line crossovers. The sizes of conduit, water line crossover, and sprinkler control crossover extensions shall be as shown on the plans.

Before work is started in an area where an existing irrigation crossover conduit is to be extended, the existing conduit shall be located by the Contractor. When exploratory holes are used to locate the existing conduit, the exploratory holes shall be excavated in conformance with the provisions in Section 20-5.03B, "Conduit for Irrigation Crossovers," of the Standard Specifications.

If debris is encountered in the ends of conduits to be extended, the debris shall be removed prior to extending conduits. Removal of debris within the first meter in the conduits shall be at the Contractor's expense. If debris is encountered in the conduit more than one meter from the ends of the conduits to be extended, the additional debris shall be removed as directed by the Engineer and will be paid for as extra work as provided in Section 4-1.03D, "Extra Work," of the Standard Specifications.

Prior to installation of water line crossover extensions, the existing water lines shall be pressure tested for leakage in conformance with the provisions in Section 20-5.03H, "Pressure Testing," of the Standard Specifications. Repairs to the existing water line crossover, when ordered by the Engineer, will be paid for as extra work as provided in Section 4-1.03D, "Extra Work," of the Standard Specifications.

Conduit extensions shall be corrugated high density polyethylene (CHDPE) pipe.

Water line crossover extensions shall be plastic pipe (PR 315) (supply line).

Sprinkler control crossover extensions shall be Type 3 electrical conduit.

Conductors shall be removed from existing sprinkler control crossovers to be extended.

After installation of the sprinkler control crossover extensions, new conductors shall be installed without splices in existing and extended sprinkler control crossovers. New conductors shall match the removed conductors in color and size and shall be spliced to the existing conductors in adjacent pull boxes. After the new conductors are installed, the conductors shall be tested in the same manner specified for traffic signal, sign illumination, and lighting circuits in conformance with the provisions in Section 86-2.14B, "Field Testing," of the Standard Specifications.

After water line crossover extensions have been installed, existing and extended water line crossovers shall be retested for leakage in conformance with the provisions in Section 20-5.03H, "Pressure Testing," of the Standard Specifications. Leaks that develop shall be repaired at the Contractor's expense and the water line crossovers shall be retested until a satisfactory pressure test is achieved.

10-1.42 IMPORTED TOPSOIL

Imported topsoil shall conform to the provisions in Section 20-2, "Materials," and Section 20-3, "Erosion Control," of the Standard Specifications.

10-1.43 FINISHING ROADWAY

Finishing roadway shall conform to the provisions in Section 22, "Finishing Roadway," of the Standard Specifications.

10-1.44 AGGREGATE BASE

Aggregate base shall be Class 2 and shall conform to the provisions in Section 26, "Aggregate Bases," of the Standard Specifications and these special provisions.

The restriction that the amount of reclaimed material included in Class 2 aggregate base not exceed 50 percent of the total volume of the aggregate used shall not apply. Aggregate for Class 2 aggregate base may include reclaimed glass. Aggregate base incorporating reclaimed glass shall not be placed at locations where surfacing will not be placed over the aggregate base.

10-1.45 ASPHALT CONCRETE

Asphalt concrete shall be Type A and shall conform to the provisions in Section 39, "Asphalt Concrete," of the Standard Specifications and these special provisions.

The grade of asphalt binder to be mixed with aggregate for Type A asphalt concrete shall be Grade 64-10 conforming to the provisions in Section 92, "Asphalts," of the Standard Specifications.

The amount of asphalt binder used in asphalt concrete placed in dikes, and gutters, at the ends of drainage structures shall be increased one percent by mass of the aggregate over the amount of asphalt binder determined for use in asphalt concrete placed on the traveled way.

The asphalt content of the asphalt mixture will be determined in conformance with the requirements in California Test 379, or in conformance with the requirements in California Test 382.

When portland cement concrete is placed on asphalt concrete base, the finished surface of the asphalt concrete base shall not extend above the grade established by the Engineer. Asphalt concrete base with a surface higher than the grade established by the Engineer shall be cold planed until the surface of asphalt concrete base conforms to the tolerances specified. Cold planing equipment shall be power driven and specifically designed to produce a smooth surface that conforms to the straight edge requirements specified in Section 39-6.03, "Compacting" of the Standard Specifications. Asphalt concrete base with a surface lower than 15 mm below the grade established by the Engineer shall be removed and replaced with asphalt concrete base which complies with requirements of these specifications.

Paint binder (tack coat) shall be applied to existing surfaces to be surfaced and between layers of asphalt concrete, except when eliminated by the Engineer.

Paint binder (tack coat) shall be, at the option of the Contractor, either slow-setting asphaltic emulsion, rapid-setting asphaltic emulsion or paving asphalt. Slow-setting asphaltic emulsion and rapid-setting asphaltic emulsion shall conform to the provisions in Section 39-4.02, "Prime Coat and Paint Binder (Tack Coat)," and the provisions in Section 94, "Asphaltic Emulsions," of the Standard Specifications. When paving asphalt is used for paint binder, the grade will be determined by the Engineer. Paving asphalt shall conform to the provisions in Section 39-4.02, "Prime Coat and Paint Binder (Tack Coat)," and the provisions in Section 92, "Asphalts," of the Standard Specifications.

Paint binder (tack coat) shall be applied in the liter per square meter range limits specified for the surfaces to receive asphalt concrete in the tables below. The exact application rate within the range will be determined by the Engineer.

Application Rates for Asphaltic Emulsion Paint Binder (Tack Coat) on Asphalt Concrete (except Open Graded) and on Portland Cement Concrete Pavement (PCCP)		
Type of surface to receive paint binder (tack coat)	Slow-Setting Asphaltic Emulsion L/m ² (Note A)	Rapid-Setting Asphaltic Emulsion L/m ² (Note B)
Dense, compact surfaces, between layers, and on PCCP	0.20 – 0.35	0.10 – 0.20
Open textured, or dry, aged surfaces	0.35 – 0.90	0.20 – 0.40

Note A: Slow-setting asphaltic emulsion is asphaltic emulsion diluted with additional water. Water shall be added and mixed with the asphaltic emulsion (containing up to 43 percent water) so the resulting mixture contains one part asphaltic emulsion and not more than one part added water. The water shall be added by the emulsion producer or at a facility that has the capability to mix or agitate the combined blend.

Note B: Undiluted rapid-setting asphaltic emulsion.

Application Rates for Paint Binder (Tack Coat) on Asphalt Concrete (except Open Graded) and on Portland Cement Concrete Pavement (PCCP)	
Type of surface to receive paint binder (tack coat)	Paving Asphalt L/m ²
Dense, compact surfaces, between layers, and on PCCP	0.05 – 0.10
Open textured, or dry, aged surfaces	0.10 – 0.25

When asphaltic emulsion is used as paint binder (tack coat), asphalt concrete shall not be placed until the applied asphaltic emulsion has completely changed color from brown to black.

Asphalt concrete and asphalt concrete base placed in layers of 45 mm or less in compacted thickness or widths of less than 1.5 m shall be spread and compacted with the equipment and by the methods conforming to the provisions in Section 39, "Asphalt Concrete," of the Standard Specifications. Other asphalt concrete and asphalt concrete base shall be compacted and finished in conformance with the provisions in Section 39 and the following:

- A. The provisions in Section 39-5.02, "Compacting Equipment," of the Standard Specifications shall not apply.
- B. The Contractor shall furnish a sufficient number of rollers to obtain the compaction specified in these special provisions and the surface finish required by the Standard Specifications and these special provisions.
- C. Rollers shall be equipped with pads and water systems that prevent sticking of asphalt mixtures to the pneumatic-tired or steel-tired wheels. A parting agent that will not damage the asphalt mixture may be used.
- D. The second paragraph in Section 39-6.01, "General Requirements," of the Standard Specifications shall not apply.
- E. Asphalt concrete and asphalt concrete base shall be compacted by any means to obtain the specified relative compaction before the temperature of the mixture drops below 65°C. Additional rolling to achieve the specified relative compaction will not be permitted after the temperature of the mixture drops below 65°C or once the pavement is opened to public traffic. When vibratory rollers are used as finish rollers the vibratory unit shall be turned off.
- F. The fifth and seventh through tenth paragraphs of Section 39-6.03, "Compacting," of the Standard Specifications shall not apply.
- G. Asphalt concrete and asphalt concrete base shall be compacted to a relative compaction of not less than 96.0 percent and shall be finished to the lines, grades, and cross section shown on the plans. In-place density of asphalt concrete and asphalt concrete base will be determined prior to opening the pavement to public traffic.
- H. Relative compaction will be determined by California Test 375.
- I. If the test results for a quantity of asphalt concrete or asphalt concrete base indicate that the relative compaction is below 96.0 percent, the Contractor will be notified. Asphalt concrete or asphalt concrete base spreading operations shall not continue until the Contractor has notified the Engineer of the adjustment that will be made in order to meet the specified relative compaction.
- J. If the test results for a quantity of asphalt concrete or asphalt concrete base indicate that the relative compaction is less than 96.0 percent, the asphalt concrete or asphalt concrete base represented by that quantity shall be removed, except as otherwise provided in these special provisions. If requested by the Contractor and approved by the Engineer, asphalt concrete or asphalt concrete base with a relative compaction of 93.0 percent or greater may remain in place and the Contractor shall pay to the State the amount of reduced compensation for the quantity with relative compaction less than 96.0 percent and greater than or equal to 93.0 percent. The Department will deduct the amount

of reduced compensation from moneys due, or that may become due, the Contractor under the contract. The amount of reduced compensation the Contractor shall pay to the State will be calculated using the total tonnes in the quantity with relative compaction less than 96.0 percent and greater than or equal to 93.0 percent multiplied by the contract price per tonne for asphalt concrete or asphalt concrete base involved multiplied by the following compensation factors:

Relative Compaction (Percent)	Reduced Compensation Factor	Relative Compaction (Percent)	Reduced Compensation Factor
96.0	0.000	94.4	0.062
95.9	0.002	94.3	0.068
95.8	0.004	94.2	0.075
95.7	0.006	94.1	0.082
95.6	0.009	94.0	0.090
95.5	0.012	93.9	0.098
95.4	0.015	93.8	0.108
95.3	0.018	93.7	0.118
95.2	0.022	93.6	0.129
95.1	0.026	93.5	0.142
95.0	0.030	93.4	0.157
94.9	0.034	93.3	0.175
94.8	0.039	93.2	0.196
94.7	0.044	93.1	0.225
94.6	0.050	93.0	0.300
94.5	0.056		

Planned roads and connections used as detours shall be paved, except that the top layer of asphalt concrete shall be deferred until permanent striping is to be placed.

Aggregate for asphalt concrete dikes shall be in conformance with the provisions for 9.5-mm Maximum grading in Section 39-2.02, "Aggregate," of the Standard Specifications.

If the Contractor selects the batch mixing method, asphalt concrete shall be produced by the automatic batch mixing method in conformance with the provisions in Section 39-3.03A(2), "Automatic Proportioning," of the Standard Specifications.

In addition to the provisions in Section 39-5.01, "Spreading Equipment," of the Standard Specifications, asphalt paving equipment shall be equipped with automatic screed controls and a sensing device or devices.

When placing asphalt concrete to the lines and grades established by the Engineer, the automatic controls shall control the longitudinal grade and transverse slope of the screed. Grade and slope references shall be furnished, installed, and maintained by the Contractor. Should the Contractor elect to use a ski device, the minimum length of the ski device shall be 9 m. The ski device shall be a rigid one piece unit and the entire length shall be utilized in activating the sensor.

When placing the initial mat of asphalt concrete on existing pavement, the end of the screed nearest the centerline shall be controlled by a sensor activated by a ski device not less than 9 m long. The end of the screed farthest from centerline shall be controlled by a sensor activated by a similar ski device or by an automatic transverse slope device set to reproduce the cross slope designated by the Engineer.

When paving contiguously with previously placed mats, the end of the screed adjacent to the previously placed mat shall be controlled by a sensor that responds to the grade of the previously placed mat and will reproduce the grade in the new mat within a 3-mm tolerance. The end of the screed farthest from the previously placed mat shall be controlled in the same way it was controlled when placing the initial mat.

Should the methods and equipment furnished by the Contractor fail to produce a layer of asphalt concrete conforming to the provisions, including straightedge tolerance, of Section 39-6.03, "Compacting," of the Standard Specifications, the paving operations shall be discontinued and the Contractor shall modify the equipment or methods, or furnish substitute equipment.

Should the automatic screed controls fail to operate properly during a day's work, the Contractor may manually control the spreading equipment for the remainder of that day. However, the equipment shall be corrected or replaced with alternative automatically controlled equipment conforming to the provisions in this section before starting another day's work.

The area to which paint binder has been applied shall be closed to public traffic. Care shall be taken to avoid tracking binder material onto existing pavement surfaces beyond the limits of construction.

A vertical longitudinal joint of more than 45 mm will not be allowed at any time between adjacent lanes open to public traffic.

Shoulders adjacent to a lane being paved shall be surfaced prior to opening the lane to public traffic.

The aggregate from each separate bin used for asphalt concrete and asphalt concrete base, Type A, except for the bin containing the fine material, shall have a Cleanness Value of 57 minimum for contract compliance and a value of 65 minimum for operating range as determined by California Test 227, modified as follows:

- A. Tests will be performed on the material retained on the 2.36-mm sieve from each bin and will not be a combined or averaged result.
- B. Each test specimen will be prepared by hand shaking for 30 seconds, a single loading of the entire sample on a 305-mm diameter, 4.75-mm sieve, nested on top of a 305-mm diameter, 2.36-mm sieve.
- C. Where a coarse aggregate bin contains material which will pass the maximum size specified and is retained on a 9.5-mm sieve, the test specimen mass and volume of wash water specified for 25-mm x 4.75-mm aggregate size will be used.
- D. Samples will be obtained from the weigh box area during or immediately after discharge from each bin of the batching plant or immediately prior to mixing with asphalt in the case of continuous mixers.
- E. The Cleanness Value of the test sample from each of the bins will be separately computed and reported.

At drier-drum and continuous plants with cold feed control, Cleanness Value test samples will be obtained from the discharge of each coarse aggregate storage. An aggregate sampling device shall be provided which will provide a 25-kg sample of each coarse aggregate.

If the results of the Cleanness Value tests do not meet the requirements specified for operating range but meet the contract compliance requirements, placement of the material may be continued for the remainder of that day. However, another day's work may not be started until tests, or other information, indicate to the satisfaction of the Engineer that the next material to be used in the work will comply with the requirements specified for operating range.

If the results of the Cleanness Value tests do not meet the requirements specified for contract compliance, the material which is represented by these tests shall be removed. However, if requested by the Contractor and approved by the Engineer, material having a Cleanness Value of 48 or greater may remain in place and accepted on the basis of a reduced payment for material left in place.

Asphalt concrete or asphalt concrete base that is accepted on the basis of reduced payment will be paid for at the contract prices for the items of asphalt concrete involved multiplied by the following factors:

Test Value	Pay Factor
56	0.90
55	0.85
54	0.80
53	0.75
52	0.70
51	0.65
50	0.60
49	0.55
48	0.50

If asphalt concrete or asphalt concrete base is accepted on the basis of reduced payment due to a Cleanness Value of 48 to 56 and also accepted on the basis of aggregate grading or Sand Equivalent tests not meeting the contract compliance requirements, the reduced payment for Cleanness Value shall apply and payment by the Contractor to the State for asphalt concrete or asphalt concrete base not meeting the contract compliance requirements for aggregate grading or Sand Equivalent shall not apply.

10-1.46 JOINTED PLAIN CONCRETE PAVEMENT

GENERAL

Jointed plain concrete pavement shall be constructed in conformance with the provisions in Section 40, "Portland Cement Concrete Pavement," of the Standard Specifications and these special provisions, and as shown on the plans.

Insert method for forming joints in pavement shall not be used.

PREPAVING CONFERENCE

Supervisory personnel of the Contractor and subcontractors who are to be involved in the concrete paving work shall meet with the Engineer at a prepaving conference, at a mutually agreed time, to discuss methods of accomplishing the paving work.

The Contractor shall provide a facility for the prepaving conference within 5 km of the construction site or at a nearby location agreed to by the Engineer. Attendance at the prepaving conference is mandatory for the Contractor's project superintendent, paving construction foreman, subcontractor's workers, including foremen and personnel performing saw cutting, joint sealing, concrete plant manager, and concrete plant operator. Conference attendees shall sign an attendance sheet provided by the Engineer. Production and placement shall not begin nor proceed unless the above-mentioned personnel have attended the mandatory prepaving conference.

JUST-IN-TIME TRAINING

Attending a 4-hour Just-In-Time Training (JITT) shall be mandatory, and consist of a formal joint training class on portland cement concrete and paving techniques. Construction operations for portland cement concrete paving shall not begin until the Contractor's and the Engineer's personnel have completed the mandatory JITT. The Contractor's personnel included in the list of participants for the prepaving conference as well as the Engineer's representatives shall attend JITT. JITT shall be in addition to the prepaving conference.

The JITT class will be conducted for not less than 4 hours on portland cement concrete pavement and paving techniques. The training class may be an extension of the prepaving conference and shall be conducted at a project field location convenient for both the Contractor and the Engineer. The JITT class shall be completed at least 15 days, not including Saturdays, Sundays or holidays, prior to the start of portland cement concrete paving operations. The class shall be held during normal working hours.

The JITT instructor shall be experienced in the construction methods, materials, and test methods associated with construction of portland cement concrete pavement and paving techniques. The instructor shall not be an employee of the Contractor or a member of the Engineer's field staff. A copy of the course syllabus, handouts, and presentation material shall be submitted to the Engineer at least 7 days before the day of the training. The Contractor and the Engineer shall mutually agree to course instructor, the course content, and training site. The instructor shall issue a certificate of completion to the participants upon completion of the class. The certificate of completion shall include the course title, date and location of the class, the name of the participant, instructor's name, location and telephone number.

The Contractor's or Engineer's personnel involved with portland cement concrete paving operations will not be required to attend JITT if they have completed equivalent training within the previous 12 months of the date of the JITT for this project. The Contractor shall provide a certificate of class completion as described above for each staff member to be excluded from the JITT class. The Engineer will provide the final determination for exclusion of staff member's participation. Attendees of the JITT shall complete, and submit to the Engineer, an evaluation of the training. The Engineer will provide the course evaluation form.

Just-In-Time Training shall not relieve the Contractor of responsibility under the contract for the successful completion of the work in conformance with the requirements of the plans and specifications.

TEST STRIP

At the beginning of paving operations, the Contractor shall construct a test strip of concrete pavement from 200 m to 300 m in length. The paving width for the test strip shall be the same as that intended by the Contractor for production work. The Contractor shall use the same equipment to construct the test strip for the remainder of the paving operations, except as specified in this section. The Contractor shall not begin paving operations until the test strip has been evaluated in conformance with the provisions in Section 40-1.10, "Final Finishing," of the Standard Specifications regarding surface straight edge requirements, and "Profile Index" in this section; for dowel and tie bar alignment verification; concrete quality (except modulus of rupture); and pavement thickness. Additional test strips will be required when:

- A. A portion of a test strip fails to conform to the provisions in Section 40-1.10, "Final Finishing," of the Standard Specifications for straight edge requirements;
- B. A portion of the test strip fails to conform to profile requirements;
- C. The Contractor proposes different paving equipment, including a batch plant, paver, dowel bar inserter, tie bar inserter, tining, or curing equipment;
- D. The dowel bar tolerances are not met;
- E. The pavement thickness deficiency is greater than 15 mm after grinding; or
- F. A change in concrete mix proportions has occurred.

The Contractor shall perform coring of the test strips as part of the dowel and tie bar placement tolerance verification, and pavement thickness verification. The Engineer will select a minimum of six dowel bars that will be cored for each test strip. The Engineer will have the option of selecting up to 6 tie bars that will be cored for each test strip. After removal of cores, voids in concrete pavement shall be cleaned and filled with hydraulic cement grout conforming to the provisions in "Core Drilling for Dowel Placement Alignment Assurance Testing" in this section.

Before mechanical dowel bar inserters are used, the Contractor shall demonstrate that the insertion equipment will not leave surface irregularities such as depressions, dips, or high areas adjacent to the dowel bar insertion point, or voids or segregation around dowel bars.

Before placement of the test strip, the Contractor shall submit a written procedure to locate transverse weakened plane joints that will coincide with the center of the dowel bars being placed and locating the tie bars along the longitudinal joints. This procedure shall be submitted prior to the prepaving conference, and shall describe the control of inadvertent covering of paint markings after applying curing compound, excessive paint spray producing too large a paint dot marking for the accuracy required, misalignment by transferring marking spots, and inadequate staking of joints.

Construction of concrete pavement shall not proceed until the Engineer has completed an evaluation of the test strip. The Engineer shall be allowed 3 days, not including Saturdays, Sundays and legal holidays, to evaluate the test strip. If, in the opinion of the Engineer, the Contractor's controlling operation is delayed or interfered with by reason of the Engineer not completing the evaluation of the test strip within the time specified, the delay will be considered a right of way delay in conformance with the provisions in Section 8-1.09, "Right of Way Delays," of the Standard Specifications. Test strips failing to conform to the specifications for concrete pavement shall be removed. Additional test strips shall be constructed until the Contractor constructs a test strip that conforms to the specifications for concrete pavement. Additional test strips shall conform to the requirements in this section, except the test strip shall be 200 m in length.

Prior to constructing additional test strips, the Contractor shall change methods or equipment to construct a test strip that conforms to the provisions in Section 40-1.10, "Final Finishing," of the Standard Specifications, "Profile Index" of this section, and dowel bar alignment verification, without grinding or other corrective work.

The Engineer may waive the initial test strip if the Contractor proposes to use a batch plant mixer and paving equipment with the same personnel that were satisfactorily used on a Department project within the preceding 12 months. The personnel shall be individuals listed in the prepaving conference used on a preceding Department project.

Materials resulting from the construction and removal of rejected test strips shall become the property of the Contractor and shall be removed and disposed of in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.

MATERIALS

Concrete

Attention is directed to Section 90, "Portland Cement Concrete," of the Standard Specifications, regarding mix proportions for concrete being determined by the Contractor.

Primary aggregate gradings shall conform to the gradation requirements of Section 90-3, "Aggregate Gradings," of the Standard Specifications. When combined in the proportions determined by the Contractor, the percent passing the 9.5 mm sieve and retained on the 2.36 mm sieve shall not be less than 16 percent of the total aggregate.

The cementitious material content shall not exceed 400 kg/m³.

Tie Bars

Tie bars shall be deformed reinforcing steel bars conforming to the requirements of ASTM Designation: A 615/A 615M, Grade 280 or 420; ASTM Designation: A 615/A 615M (Grade 280 or 420), A996/A996M or A706/A706M. Tie bars shall be epoxy-coated in conformance with the requirements in ASTM Designation: A 934/A 934M or A 775/A 775M and the provisions in Section 52-1.02B, "Epoxy-coated Reinforcement," of the Standard Specifications, except the epoxy-coating thickness after curing shall be between 175 to 400 micrometers (7 to 16 mils). Fabrication, sampling and jobsite handling shall conform to the requirements in ASTM Designation: D 3963 and the provisions in Section 52-1.02B, "Epoxy-coated Reinforcement," of the Standard Specifications, except the 2 samples shall be 750 mm long. Epoxy-coated tie bars shall not be bent.

Epoxy (Drill and Bond)

Epoxy for bonding tie bars and dowel bars to portland cement concrete shall be a two-component, epoxy-resin, conforming to the requirements of ASTM Designation: C 881, Type V, Grade 3 (Non-Sagging), Class A, B or C. The class used shall be dependent on the internal temperature of the hardened concrete at the time the epoxy is to be applied. Class A shall be used when the internal temperature is below 4°C, but not lower than recommended by the manufacturer. Class B shall be used when the internal temperature is from 4°C to 15°C. Class C shall be used when the internal temperature is above 15°C, but not higher than recommended by the manufacturer. A Certificate of Compliance in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications shall be furnished with the epoxy. A copy of the manufacturer's recommended installation procedure shall be provided to the Engineer at least 7 days prior to the start of work. Epoxy shall be applied in conformance with the manufacturer's recommendations.

Dowel Bars

Dowel bars shall be plain round smooth, epoxy-coated steel conforming to the requirements in ASTM Designation: A 615/A 615M, Grade 280 or 420, the details shown on the plans and the provisions in Section 52-1.02B, "Epoxy-coated Reinforcement," of the Standard Specifications, except that the two samples required in ASTM Designation D 3963/D 3963M shall be 460 mm long. Epoxy coating of dowel bars shall conform to the provisions in ASTM Designation: A 884/A 884M, Class A, Type 1 or Type 2, except that the bend test shall not apply.

Dowel bars shall be free from burrs or other deformations detrimental to free movement of the bars in the concrete.

Bond Breaker

Dowel bars shall be lubricated with a bond breaker over the entire bar. A bond breaker application of petroleum paraffin based lubricant or white-pigmented curing compound shall be used to coat the dowel bars completely prior to placement. Oil and asphalt based bond breakers shall not be used. Paraffin based lubricant shall be Dayton Superior DSC BB-Coat or Valvoline Tectyl 506 or an approved equal. Paraffin based lubricant shall be factory applied. White pigmented curing compound shall conform to the requirements of ASTM Designation: C 309, Type 2, Class A, and shall contain 22 percent minimum nonvolatile vehicles consisting of at least 50 percent paraffin wax. Curing compound shall be applied in 2 separate applications, the last application not more than 8 hours prior to placement of the dowel bars. Each application of curing compound shall be applied at the approximate rate of one liter per 3.7 m².

Dowel Bar Baskets

Dowel bar baskets shall be manufactured with a minimum welded wire gage number of MW 65. Baskets shall be either U-frame or A-frame shape. J-frame shapes shall not be used. Baskets shall be fabricated in conformance with the requirements in ASTM Designation: A 82. Welding of baskets shall conform to the requirements in AASHTO Designation: M 254. A broken weld will be a cause for rejection of the basket. Baskets shall be Class A, Type 1 epoxy-coated in conformance with the requirements in ASTM Designation: A 884/A 884M. Fabrication and job-site handling shall conform to the requirements in ASTM Designation: D 3963 and the provisions in Section 52-1.02B, "Epoxy-coated Reinforcement," of the Standard Specifications, except that sampling of epoxy-coated wire reinforcement will not be required. A Certificate of Compliance conforming to the provisions in Section 6-1.07, "Certificates of Compliance," shall be furnished for each shipment of epoxy-coated wire reinforcement certifying that the coated bars conform to the requirements in ASTM Designation: A 884/A 884M and the provisions in Section 52-1.02B, "Epoxy-coated Bar Reinforcement," of the Standard Specifications. The Certificate of Compliance shall include the certifications specified in ASTM Designation: A 884/A 884M and a statement that the coating material has been pre-qualified by acceptance testing performed by the Valley Forge Laboratories, Inc., Devon, Pennsylvania.

Concrete fasteners shall be used for anchoring dowel bar baskets to lean concrete base, asphalt concrete base, asphalt treated permeable base, or cement treated permeable base. Concrete fasteners shall be driven fasteners such as concrete nails, used specifically for fastening to hardened concrete, or asphalt concrete base. Concrete fasteners shall conform to the requirements of ASTM Designation: F 1667. Concrete nails used as fasteners on lean concrete base or asphalt concrete base shall have a minimum shank diameter of 4 mm with a minimum shank length of 64 mm. Concrete nails used as fasteners on asphalt treated or cement treated permeable base shall have a minimum shank diameter of 4 mm with a minimum shank length of 120 mm. Shank length shall be the distance from the point to the bottom of the nail head. Clips and washers shall be commercial quality manufactured for use with dowel bar baskets. The surface of concrete fasteners, clips, and washers shall be either zinc electroplated or galvanized with a minimum coating thickness of 0.005-mm.

Tie Bar Baskets

Tie bar baskets shall be manufactured with a minimum welded wire gage number of MW 65. Baskets shall be either U-frame or A-frame shape. J-frame shapes shall not be used. Tie bar baskets shall be fabricated in conformance with the requirements in ASTM Designation: A 82. Welding of baskets shall conform to the requirements in AASHTO Designation: M 254. A broken weld will be a cause for rejection of the basket. Baskets shall be Class A, Type 1 epoxy-coated in conformance with the requirements in ASTM Designation: A 884/A 884M. Fabrication and job-site handling shall conform to the requirements in ASTM Designation: D 3963 and the provisions in Section 52-1.02B, "Epoxy-coated Reinforcement," of the Standard Specifications, except that sampling of epoxy-coated wire reinforcement will not be required. A Certificate of Compliance conforming to the provisions in Section 6-1.07, "Certificates of Compliance," shall be furnished for each shipment of epoxy-coated wire reinforcement certifying that the coated bars conform to the requirements in ASTM Designation: A 884/A 884M and the provisions in Section 52-1.02B, "Epoxy-coated Bar Reinforcement," of the Standard Specifications. The Certificate of Compliance shall include the certifications specified in ASTM Designation: A 884/A 884M and a statement that the coating material has been pre-qualified by acceptance testing performed by the Valley Forge Laboratories, Inc., Devon, Pennsylvania.

Concrete fasteners shall be used for anchoring tie bar baskets to lean concrete base, asphalt concrete base, asphalt treated permeable base, or cement treated permeable base. Concrete fasteners shall be driven fasteners such as concrete nails, used specifically for fastening to hardened concrete, or asphalt concrete base. Concrete fasteners shall conform to the requirements of ASTM Designation: F 1667. Concrete nails used as fasteners on lean concrete base or asphalt concrete base shall have a minimum shank diameter of 4 mm with a minimum shank length of 64 mm. Concrete nails used as fasteners on asphalt treated or cement treated permeable base shall have a minimum shank diameter of 4 mm with a minimum shank length of 120 mm. Shank length shall be the distance from the point to the bottom of the nail head. Clips and washers shall be commercial quality manufactured for use with tie bar baskets. The surface of concrete fasteners, clips, and washers shall be either zinc electroplated or galvanized with a minimum coating thickness of 0.005-mm.

Reinforcement

Reinforcement shall be epoxy coated and shall conform to the provisions in Section 52, "Reinforcement," of the Standard Specifications.

Silicone Joint Sealant

Low modulus silicone joint sealant shall be furnished in a one-part silicone formulation. Acid cure sealant shall not be used. The compound shall be compatible with the surface to which it is applied and shall conform to the following requirements:

Property	Test Method	Requirement
Tensile stress, 150% elongation, 7-day cure at 25° ± 1°C and 45% to 55% R.H. ^e	ASTM D 412 (Die C)	310 kPa max.
Flow at 25° ± 1°C	ASTM C 639 ^a	Shall not flow from channel
Extrusion Rate at 25° ± 1°C	ASTM C 603 ^b	75-250 g/min.
Specific Gravity	ASTM D 792 Method A	1.01 to 1.51
Durometer Hardness, at -18°C, Shore A, cured 7 days at 25° ± 1°C	ASTM C 661	10 to 25
Ozone and Ultraviolet Resistance, after 5000 hours	ASTM C 793	No chalking, cracking or bond loss
Tack free at 25° ± 1°C and 45% to 55% R.H. ^e	ASTM C 679	Less than 75 minutes
Elongation, 7 day cure at 25° ± 1°C and 45% to 55% R.H. ^e	ASTM D 412 (Die C)	500 percent min.
Set to Touch, at 25° ± 1°C and 45% to 55% R.H. ^e	ASTM D 1640	Less than 75 minutes
Shelf Life, from date of shipment	—	6 months min.
Bond, to concrete mortar-concrete briquettes, air cured 7 days at 25° ± 1°C	AASHTO T 132 ^c	345 kPa min.
Movement Capability and Adhesion, 100% extension at -18°C after, air cured 7 days at 25° ± 1°C, and followed by 7 days in water at 25° ± 1°C	ASTM C 719 ^d	No adhesive or cohesive failure after 5 cycles

Notes:

- a. ASTM Designation: C 639 Modified (15 percent slope channel A).
- b. ASTM Designation: C 603, through 3-mm opening at 345 kPa.
- c. Mold briquettes in conformance with AASHTO Designation: T 132, sawed in half and bonded with a 1.5 mm maximum thickness of sealant and tested in conformance with AASHTO Designation: T 132. Briquettes shall be dried to constant mass at 100 ± 5° C.
- d. Movement Capability and Adhesion: Prepare 305 mm x 25 mm x 75 mm concrete blocks in conformance with ASTM Designation: C 719. A sawed face shall be used for bond surface. Seal 50 mm of block leaving 12.5 mm on each end of specimen unsealed. The depth of sealant shall be 9.5 mm and the width 12.5-mm.
- e. R.H. equals relative humidity.

The silicone joint sealant shall be formulated to cure rapidly enough to prevent flow after application on grades of up to 15 percent.

A Certificate of Compliance for the silicone sealant shall be furnished to the Engineer in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications. The Certificate shall also be accompanied with a certified test report of the results of the required tests performed on the sealant material within the

previous 12 months prior to proposed use. The Certificate and accompanying test report shall be provided for each lot of silicone joint sealant prior to use on the project.

Foam Backer Rods

Foam backer rods shall be Type 1, conforming to the requirements of ASTM Designation: D 5249. Foam backer rods shall have a diameter prior to placement at least 25 percent greater than the width of the sawcut and shall be expanded, crosslinked, closed-cell polyethylene foam that is compatible with the joint sealant so that no bond or adverse reaction occurs between the rod and sealant. Hot applied sealant that will melt the foam backer rod shall not be used. The Contractor shall submit a manufacturer's data sheet verifying that the foam backer rod is compatible with the sealant to be used.

Joint Filler Material

Joint filler material shall be preformed expansion joint filler for concrete (bituminous type), conforming to the requirements of ASTM Designation: D 994.

A Certificate of Compliance for the joint filler material shall be furnished to the Engineer in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications. The certificate shall be accompanied with a certified test report of the results of the required tests performed on the joint filler material within the previous 12 months prior to proposed use. The certificate and accompanying test report shall be provided for each lot of joint filler material prior to use on the project.

Hydraulic Cement Grout (non-shrink)

Hydraulic cement grout (non-shrink) shall conform to the requirements in ASTM Designation: C 1107. At the Contractor's option, clean, uniformly rounded aggregate filler may be used to extend the grout. The extension of grout shall not exceed 60 percent of the mass of the grout or the maximum amount of grout extension recommended by the manufacturer, whichever is less. The moisture content of the aggregate filler shall not exceed 0.5 percent. Grading of the aggregate filler shall conform to the following:

Sieve Size	Percentage Passing
12.5 mm	100
9.5 mm	85-100
4.75 mm	10-30
2.36 mm	0-10
1.10 mm	0-5

PAVEMENT CONCRETE MIX PROPORTIONS

The Contractor shall determine the mix proportions for pavement concrete. Section 40-1.015, "Cement Content," of the Standard Specifications shall not apply. The laboratory used to develop the mix proportions shall meet the requirements of ASTM Designation: C 1077, and shall have current AASHTO accreditation for test methods AASHTO Designation: T 97 or ASTM Designation: C 78, and AASHTO Designation: T 126 or ASTM Designation: C 192.

The minimum cementitious materials content or the maximum water to cementitious materials ratio shall be determined in conformance with the requirements in California Test 559. Trial mixtures shall be made no more than 24 months before field qualification. The minimum cementitious materials content or the maximum water to cementitious materials ratio shall be that determined from the trial mixtures curve to produce a minimum modulus of rupture of 3.9 MPa at 28 days age and 4.5 MPa at 42 days age. To account for variances in materials, production of concrete, and modulus of rupture testing, the Contractor shall include as part of the proposed mix proportions an increase to the cementitious material content or a decrease to the water to cementitious materials ratio, determined from trial mixtures, to ensure that portland cement concrete produced during paving operations conforms to the requirements in "Modulus of Rupture," in this section.

At least 14 days prior to field qualification, the Contractor shall submit the proposed pavement concrete mix proportions with laboratory test reports. Laboratory test reports shall include modulus of rupture determined for each trial mixture at ages of 10, 21, 28 and 42 days in conformance with the applicable portions of California Test 559.

Field Qualification

Field qualification of proposed mix proportions will be required prior to placement of pavement concrete. The Contractor shall perform field qualification and submit certified test data to the Engineer. Field qualification data shall be based upon the proposed use of materials, mix proportions, mixing equipment, procedures and size of batch.

Proposed concrete mix proportions will be field qualified when the test results of five beams from a single batch of concrete indicate the average modulus of rupture is at least 3.9 MPa with no single beam lower than 3.8 MPa at an age of the

Contractor's choice but not later than 28 days. Beams shall be tested for modulus of rupture at a minimum of 10, 21, and 28 days of age. Test specimens shall be made and tested in conformance with the requirements in California Test 523.

The certified field qualification test data reports shall include the following:

- A. Date of mixing,
- B. Mixing equipment and procedures used,
- C. Volume of batch in cubic meters and the mass or volume,
- D. Type and source of ingredients used,
- E. Penetration and slump of the concrete,
- F. The air content of the concrete, and
- G. The age at time of testing and strength of concrete specimens tested.

Field qualification test data reports shall be signed by a certified representative in charge of the laboratory that performed the tests.

If the Contractor changes a source of supply or proportions, the Contractor shall submit a new proposed mix design and furnish samples from the new source, or sources, at least 60 days prior to their intended use. The new mix proportions shall be trial batched and field qualified, unless, the Engineer determines the change is not substantive. No extension of contract time will be allowed for the time required to perform the sampling, testing, preparing and qualifying new mix proportions for new aggregate sources proposed by the Contractor.

MODULUS OF RUPTURE

The Engineer will test portland cement concrete pavement for modulus of rupture in conformance with the requirements in California Test 523. Acceptance will be on a lot basis. Each lot shall not to exceed 750 m³ of concrete pavement. The Engineer will determine sample locations. A minimum of six beam specimens shall be made from each sample. Beam specimens will be tested for modulus of rupture at 10, 21, and 28 days. The modulus of rupture for each lot will be calculated by averaging the results of two beams representing that lot tested at 28 days of age. The difference in modulus of rupture between each individual beam result shall not exceed 0.44-MPa.

The Contractor shall perform sampling and testing of beam specimens to determine if concrete pavement has achieved a modulus of rupture of 2.4 MPa when requesting early use of concrete pavement in conformance with the provisions in Section 90-8.03, "Protecting Concrete Pavement," of the Standard Specifications. Beam specimens shall be made and tested in conformance with the requirements in California Test 523.

INSTALLING TIE BARS

Tie bars shall be installed at longitudinal contact joints and longitudinal weakened plane joints as shown on the plans. Contiguous width of new portland cement concrete pavement tied together with tie bars shall not exceed 15 m. Tie bars shall not be installed at joints between portland cement concrete and asphalt concrete pavements.

Transverse tie bars along Longitudinal Contact (Construction) Joints and Longitudinal Weakened Plane Joints shall not be installed in the PCC pavement for the Managed Lanes SD-15M Line. All other tie bars and dowel bars shall be installed as shown on the plans.

Tie bars shall be installed at longitudinal joints by one of the following methods:

- A. Drilling and bonding tie bars with two-component, epoxy-resin that conforms to this section. Drilled holes shall be cleaned in conformance with the epoxy manufacturer's instructions and shall be dry at the time of placing the epoxy and tie bars. Tie bars will be rotated 180° while being inserted into the epoxy filled holes. Immediately after inserting the tie bars into the epoxy, the tie bars shall be supported as necessary to prevent movement during curing and shall remain undisturbed until the epoxy has cured as specified by the manufacturer instructions. Tie bars that are improperly placed or bonded, as determined by the Engineer, will be rejected. If rejected, new holes shall be drilled and new tie bars shall be placed and securely bonded to the concrete. Rejected tie bars shall be cut flush with the joint face. Exposed ends of tie bars shall be epoxy coated. The center of the new holes shall be offset 75 mm horizontally from the center of the rejected hole to maintain the minimum clearance to the dowel bar. Work necessary to correct improperly bonded tie bars shall be performed at the Contractor's expense.
- B. Inserting tie bars into the plastic slipformed concrete before finishing the concrete. Inserted tie bars shall have full contact between the bar and the concrete. When tie bars are inserted through the pavement surface, the concrete over the tie bars shall be reworked and refinished so that there is no evidence on the surface of the completed pavement that there has been an insertion performed. Loose tie bars shall be replaced by drilling and bonding as described in A above, at the Contractor's expense.
- C. Using threaded dowel splice couplers fabricated from deformed bar reinforcement material, free of external welding or machining. Threaded dowel splice couplers shall be accompanied by a Certificate of Compliance in conformance

with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications, and shall be accompanied with installation instructions. Installation of threaded dowel splice couplers shall conform to the requirements of the manufacturer's recommendations.

D. Using tie bar baskets that conform to these special provisions.

Tie bars shall be oriented perpendicular to the pavement joint and parallel with the surface of the pavement at mid-slab depth. Tie bar alignment tolerances shall conform to the requirements for dowel bars except embedment length tolerance shall be ± 50 mm.

If tie bar baskets are used, they shall be anchored to the base to hold the tie bars at the specified depth and alignment during concrete placement without displacement. A minimum of 8 alternating, equally spaced, concrete fasteners with clips shall be used to anchor each basket (4 per lower runner wire). Temporary spacer wires shall be cut or removed after the baskets are anchored into position before concrete placement. Concrete pavement shall not be placed if the baskets are not in place at least 60 m in advance of the concrete placement operation. The Engineer may waive this requirement upon written request by the Contractor in areas where access is restricted or other construction limitations are encountered. The Contractor shall demonstrate that the baskets are anchored and shall not shift during concrete placement. The Contractor shall provide longer concrete nails than the minimum lengths for the varying bases beneath the portland cement concrete when baskets demonstrate movement.

Full compensation for providing longer concrete nails shall be considered as included in the contract unit price paid per cubic meter for concrete pavement and no additional compensation will be allowed therefor.

DOWEL PLACEMENT

Dowel bars shall be centered on the joint within a tolerance of ± 50 mm in the longitudinal direction directly over the contact joint or sawcut for the transverse weakened plane joints, as shown on the plans. Prior to placement of dowel bars, the Contractor shall submit to the Engineer a written procedure to identify the transverse weakened plane joint locations relative to the middle of the dowel bars and the procedure for consolidating concrete around the dowel bars.

Dowel bars shall be placed at transverse weakened plane joints within shoulder areas except at drainage inlets.

Dowel bars shall be placed at longitudinal joints as shown on the plans.

Dowel bars shall be placed as shown on the plans by using dowel bar.

When dowel bar baskets are used, they shall be anchored to the base to hold the dowel bars at the specified depth and alignment during concrete placement without displacement. A minimum of 8 alternating, equally spaced, concrete fasteners with clips shall be used to anchor each 3.6 m dowel bar basket (4 per lower runner wire). At least 10 concrete fasteners shall be used for basket sections greater than 3.6 m and less than or equal to 4.9 m. Temporary spacer wires connecting dowel bar baskets shall be cut or removed after the dowel bar baskets are anchored into position prior to concrete placement. Paving shall be suspended when dowel bar baskets are not in place at least 60 m in advance of the concrete placement operation. The Engineer may waive this requirement upon written request by the Contractor, in areas, where access is restricted, or other construction limitations are encountered. The Contractor shall demonstrate to the Engineer's satisfaction that dowel bar baskets are adequately anchored and not shift during concrete placement. The Contractor shall provide longer concrete nails than the minimum lengths for the varying bases beneath the portland cement concrete when anchored dowel bar baskets demonstrate movement.

Full compensation for providing longer concrete nails shall be considered as included in the contract unit price paid per cubic meter for concrete pavement and no additional compensation will be allowed therefor.

Dowel bar placement at transverse and longitudinal weakened plane joints	
Horizontal offset	± 25 mm
Longitudinal translation	± 50 mm
Horizontal skew	9 mm
Vertical skew	9 mm
Vertical depth	($d/3 + 12$ mm) from pavement surface to top of dowel bar or -15 mm below planned placement

Note: d = pavement thickness in mm

CORE DRILLING FOR DOWEL BAR AND TIE BAR PLACEMENT ALIGNMENT ASSURANCE TESTING

Coring to confirm dowel bar and tie bar placement, alignment, and concrete consolidation shall be provided by the Contractor throughout the project, at locations determined by the Engineer. Each day's paving shall be cored within 2 days by performing a minimum of 2 and a maximum of 4 tests for dowel bar placement and position for every 1670 m² of doweled pavement or fraction thereof and one test for tie bar placement and position for every 3340 m² of pavement with tie bars. One test shall consist of drilling two cores, one on each end of a dowel bar to expose both ends and allow measurement for

proper alignment. The minimum core hole diameter shall be 127 mm. If the cores indicate that dowel bars or tie bars are not within the allowable tolerances or if air voids exist surrounding the dowel bars or tie bars, additional cores will be required to determine the limits and severity of unacceptable work.

The holes shall be cored by methods that will not damage the concrete adjacent to the holes. Immediately after coring, the concrete cores shall be submitted to the Engineer for inspection, and the cores shall be identified by the Contractor with a location description.

After removal of cores, core hole voids in concrete pavement shall be cleaned and filled with hydraulic cement grout (non-shrink). After placement of hydraulic cement grout, the material while still plastic shall be finished and textured to match the adjacent pavement surface. The backfill material shall be the same level as the pavement surface.

Water for core drilling operations shall be from a local domestic water supply, and shall contain not more than 1000 parts per million of chlorides as CL, nor more than 1300 parts per million of sulfates as SO_4 , nor shall it contain impurities in a sufficient amount to cause discoloration of the concrete or produce etching of the surface.

Water from core drilling operations shall not be permitted to fall on public traffic, to flow across shoulders or lanes occupied by public traffic, or to flow into gutters or other drainage facilities.

Dowel bar and tie bar alignment shall be within the specified tolerances. If dowel bars or tie bars are found to be installed improperly, the paving operations shall not continue until the Contractor has demonstrated to the Engineer that the problem which caused the improper dowel bar or tie bar positioning has been corrected.

Dowel bars in rejected joints shall be replaced by the Contractor by saw cutting on each side of the rejected joint a minimum of 0.9-m, lifting out concrete to be removed, installing new dowel bars at the new transverse joints, installing dowel bars and preformed sponge rubber expansion joint filler along the longitudinal joints, placing concrete, and installing new joints. Preformed sponge rubber expansion joint filler shall conform to the requirements in ASTM Designation: D 1752. New dowel bar holes shall be drilled, not more than 3 mm greater than the dowel bar diameter, by the use of an automatic dowel-drilling rig for the dowels to be installed at the contact joints. Dowel bars shall be placed, as shown on the plans, for the 2 new transverse contact joints. Original exposed tie bars, located within the slab replacement area, shall be cut flush with the lane or pavement edge and dowel bars shall be installed to replace the tie bars at an offset of 75 mm, horizontally from the tie bar location. Holes for dowel bars to be placed along the longitudinal joint shall be drilled, not more than 3 mm greater than the dowel bar diameter, by the use of an automatic dowel-drilling rig for the dowel bars to be installed at the contact joints.

When requested by the Contractor and approved by the Engineer, dowel bars which are more than ± 50 mm but less than ± 75 mm from being centered directly over the sawcut for the transverse weakened plane joint, may remain in place, and the Contractor shall pay to the State the amount of \$32.30 per square meter for the quantity of concrete pavement panels represented by the cores indicating incorrect dowel bar alignment or improper concrete consolidation around dowels. The quantity of concrete pavement area used to determine the amount of payment to the State will be calculated using the panel dimensions for panels adjacent to and inclusive of the joints with incorrect dowel bar alignment or improper concrete consolidation around dowel bars. The Department will reduce compensation from moneys due, or that may become due to the Contractor under the contract. This reduced compensation shall be in addition to other adjustments for incorrect tie bar alignment or improper concrete consolidation around tie bars as specified in these special provisions and for pavement thickness deficiency in conformance with the provisions in Section 40-1.135, "Pavement Thickness," of the Standard Specifications and in addition to other adjustments for deficient Cleanness Value and coarse aggregate grading; and for deficient Sand Equivalent and fine aggregate grading in conformance with the provisions in Section 90-2.02, "Aggregate," of the Standard Specifications.

Tie bars which are not within the specified tolerance for placement and position, as determined from inspection and measurements of cores, may remain in place when requested by the Contractor and approved by the Engineer. The Contractor shall pay to the State the amount of \$16.15 per square meter for the quantity of concrete pavement panels represented by the cores indicating incorrect tie bar alignment or improper concrete consolidation around tie bars. The quantity of concrete pavement area used to determine the amount of payment to the State will be calculated using the panel dimensions for panels adjacent to and inclusive of the joints with incorrect tie bar alignment or improper concrete consolidation around tie bars. The Department will reduce compensation from moneys due, or that may become due to the Contractor under the contract. This reduced compensation will be in addition to other adjustments for incorrect dowel bar alignment or improper concrete consolidation around dowel bars as specified in these special provisions and for pavement thickness deficiency in conformance with the provisions in Section 40-1.135, "Pavement Thickness," of the Standard Specifications and in addition to other adjustments for deficient Cleanness Value and coarse aggregate grading; and for deficient Sand Equivalent and fine aggregate grading in conformance with the provisions in Section 90-2.02, "Aggregate," of the Standard Specifications.

LIQUID JOINT SEALANT INSTALLATION

The joint sealant detail for transverse and longitudinal joints, as shown on the plans, shall apply only to weakened plane joints. Weakened plane joints shall be constructed by the sawing method. Should grinding or grooving be required over or

adjacent to joints after sealant has been placed, the joint materials shall be removed and disposed of in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications, and replaced at the Contractor's expense. Immediately after sawing, a water wash using less than 0.7 MPa pressure shall be used to remove the slurry from the sawing operation.

Transverse weakened plane joints shall be Type A1 or B as shown on the plans. Longitudinal weakened plane joints shall be Type A2 or B as shown on the plans.

Seven days after the concrete pavement placement and not more than 4 hours before placing backer rods and joint sealant materials, the joint walls shall be cleaned by the dry sand blast method and other means as necessary to remove from the joint objectionable material such as soil, asphalt, curing compound, paint and rust. Sand blasting shall be performed in at least 2 passes, one for each side of the joint, with the nozzle held at an angle to the joint within 25 to 51 mm of the pavement. After cleaning the joint, traces of sand, dust and loose material shall be removed from and near the joint for a distance along the pavement surfaces of at least 50 mm on each side of the joint by the use of a vacuum device. Surface moisture or dampness shall be removed at the joints by means of compressed air or moderate hot compressed air or other means approved by the Engineer. Drying procedures that leave a residue or film on the joint wall shall not be used. Sandblasting equipment shall have a maximum nozzle diameter size of 6 ± 1 -mm and a minimum pressure of 0.62-MPa.

Backer rods shall be installed when the temperature of the portland cement concrete pavement is above the dew point of the air and when the air temperature is 4°C or above. Backer rod shall be installed when the joints to be sealed have been properly patched, cleaned and dried, as determined by the Engineer. Methods of placing backer rod that leave a residue or film on joint walls shall not be used.

Immediately after placement of the backer rod, joint sealant shall be placed in the clean, dry, prepared joints as shown on the plans. The joint sealant shall be applied using a mechanical device with a nozzle shaped to fit inside the joint to introduce the sealant from inside the joint. Adequate pressure shall be applied to the sealant to ensure that the sealant material is extruded evenly and that full continuous contact is made with the joint walls. After application of the sealant, the surface of the sealant shall be recessed as shown on the plans.

Failure of the joint material in either adhesion or cohesion will be cause for rejection of the joint. The finished surface of joint sealant shall conform to the dimensions and allowable tolerances shown on the plans. Rejected joint materials or joint material whose finished surface does not conform to the dimensions shown on the plans, as determined by the Engineer, shall be repaired or replaced, at the Contractor's expense, with joint material that conforms to the requirements.

After each joint is sealed, surplus joint sealer on the pavement surface shall be removed. Traffic shall not be permitted over the sealed joints until the sealant is tack free and set sufficiently to prevent embedment of roadway debris into the sealant.

Longitudinal seals shall be installed before installing transverse seals. Longitudinal seals shall be continuous except at intersections with transverse seals. Transverse seals shall be installed in one continuous piece throughout each transverse joint. After the longitudinal seal is completed and the transverse seal is ready to be installed, a single cut with a sharp instrument or saw shall be made across the longitudinal seal at the middle of the intersection with the transverse seal. After the initial cut of the longitudinal seal, if the longitudinal joint material does not relax enough to allow proper installation of the transverse seal, the longitudinal joint material shall be trimmed precisely to accommodate the transverse seal and form a tight seal between the 2 joints.

An installation machine specifically designed for the installation of preformed compression joint seals shall be used to install the seal at the specified depth without cutting, nicking, or twisting the seal. The installation machine shall install the seal with no more than 4 percent stretch in the installed seal. Hand installation methods of installing seals will not be permitted.

The percentage of stretch shall be determined by laying a length of the preformed compression joint seal material cut to the exact length of the pavement joint to be sealed. The length shall then be measured. The cut length of preformed compression joint seal material shall then be installed in the joint. Excess amount of seal material remaining at the end of the joint shall be measured as the amount of stretch. The measured amount of stretch shall be divided by the original measured length to determine the percentage of stretch.

The completed seal shall not be twisted or have deformities that prevent the seal from making complete continuous contact with the joint walls. Seals installed that are twisted or deformed, or do not make continuous contact with joint walls or with greater than 4 percent stretch of the joint material will be rejected and removed.

CONSTRUCTING TRANSVERSE CONTACT JOINTS

A transverse contact (construction) joint shall be constructed, including dowel bars, at the end of each day's work or where concrete placement is interrupted for more than 30 minutes, to coincide with the next weakened plane joint location.

If sufficient concrete has not been mixed to form a slab to match the next weakened plane joint, when an interruption occurs, the excess concrete shall be removed and disposed of back to the last preceding joint. The cost of removing and disposing of excess concrete shall be at the Contractor's expense. Excess material shall become the property of the

Contractor and shall be disposed of in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.

A metal or wooden bulkhead (header) shall be used to form the joint. The bulkhead shall be designed to accommodate the installation of dowel bars.

CONSTRUCTING LONGITUDINAL ISOLATION JOINTS

Final alignment of perpendicular transverse weakened plane joints in pavement shall not be made to match the spacing or skew of the weakened plane joints in the existing parallel concrete pavement. Tie bars shall not be placed across longitudinal isolation joints. The edge of the existing pavement shall be saw cut a width 3 mm and to the full depth of the existing concrete pavement to produce a flat vertical face. Prior to placing concrete, joint filler material shall be placed as shown on the plans. The joint filler shall be secured to the face of the existing pavement joint face by a method that will hold the joint filler in place and prevent the new concrete from adhering to the existing concrete, during placement of concrete.

Sealant for longitudinal isolation joints shall be silicone sealant and placed in conformance with the requirements for liquid joint sealant installation as specified above, except references to backer rods shall not apply.

CONSTRUCTING TRANSVERSE JOINT CONNECTIONS AND ANCHORS

Concrete pavement joints at transitions to asphalt concrete pavement, pavement end anchors and bridge approach slabs shall conform to the details as shown on the plans. Paint binder shall be applied to the concrete surface that asphalt concrete pavement will contact. Paint binder shall be applied in conformance with the provisions in Section 39, "Asphalt Concrete," of the Standard Specifications.

PROFILE INDEX

The pavement surface shall be profiled, by the Contractor not more than 10 days following concrete placement, in the presence of the Engineer, using a California Profilograph or equivalent in conformance with the requirements in California Test 526, except a blanking band of zero (null) shall be used to determine the Profile Index. Two profiles shall be made within each traffic lane, one meter from and parallel with each lane line.

Profiled pavement shall conform to the following Profile Index requirements:

- A. Pavement on tangent alignment and pavement on horizontal curves having a centerline radius of curve 600 m or more shall have a Profile Index of 64 mm or less for each 0.1-km.
- B. Pavement on horizontal curves having a centerline radius of curve 300 m or more but less than 600 m and pavement within the superelevation transition of those curves shall have a Profile Index of 128 mm or less for each 0.1-km.

Individual high points in excess of 7.5 mm, as determined by measurements of the profilogram in conformance with the requirements in California Test 526, except using a blanking band of zero (null), shall be reduced by grinding in conformance with the requirements in Section 40-1.10, "Final Finishing," of the Standard Specifications until the high points as indicated by reruns of the profilogram do not exceed 7.5 mm.

Pavement grinding shall not be performed before 10 days have elapsed after concrete placement, nor before the concrete has developed a modulus of rupture of at least 3.8 MPa.

CONSTRUCTING WEAKENED PLANE JOINTS (EARLY ENTRY SAW METHOD)

The Contractor may construct weakened plane joints using lighter weight concrete saws (early entry saws) specifically designed for sawing fresh concrete without the use of water. The early entry saws shall be capable of sawing joints within 2 hours of cure time after placement of the concrete pavement without raveling or tearing, as defined in Section 40-1.08B(1), "Sawing Method," of the Standard Specifications. Joints sawed with early entry saws that develop random cracking shall be removed to the nearest controlled joint and replaced with concrete pavement containing dowel bars and tie bars in conformance with these special provisions and as shown on the plans. The removal and replacement work shall be at the Contractor's expense. Weakened plane joints not sawed within 2 hours of placing concrete pavement shall be sawed by conventional power driven wet-type concrete saws in conformance with the requirements of Section 40-1.08B(1), "Sawing Method," of the Standard Specifications.

Sawed grooves shall be cut to a maximum of 3 mm in width for longitudinal and transverse weakened plane joints made with early entry saws. The minimum depth of cut shall be calculated utilizing the formula in Section 40-1.08B(1), "Sawing Method," of the Standard Specifications except $d = t/4$.

TIE BARS ALONG LONGITUDINAL JOINT FOR SHORT RADIUS CURVES

When paving along short radius curves, the transverse joints shall be maintained in a single continuous straight line across lanes, through the radius point. Tie bars shall maintain minimum clearance from the transverse joint as shown on the plans. If the inside or outside curve of the panel does not allow equal uniform spacing of tie bars at 710 mm between tie bars,

then the tie bars shall be equally spaced so that a minimum spacing of 375 mm to a maximum spacing of 710 mm is maintained between tie bars. Additional tie bars shall be considered as included in the contract price paid per cubic meter for concrete pavement and no additional compensation will be allowed therefore.

If dowel bars are specified along longitudinal joint for short radius curves, then dowel bars shall conform to the requirements of this special provision for tie bars spacing and tolerance.

MEASUREMENT AND PAYMENT

Sealing longitudinal and transverse weakened plane joints, and longitudinal isolation joints in portland cement concrete pavement will be measured by the meter. When a test strip conforms to the specifications for concrete pavement and remains a part of the project paving surface, the sealed pavement joints will be measured and paid for as seal pavement joint.

The contract price paid per meter for seal pavement joint shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in sealing pavement joints complete in place, including sawing, cleaning and preparing the joints in the concrete pavement, furnishing and installing backer rod, repairing and patching spalled or raveled sawed joints, and replacing or repairing rejected joints, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

The contract price paid per meter for seal longitudinal isolation joint shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in sealing longitudinal isolation joints complete in place, including sawing, cleaning and preparing the joints in the concrete pavement, furnishing and installing joint filler material, repairing and patching spalled or raveled sawed joints, and replacing or repairing rejected joints, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

Concrete pavement will be measured by the cubic meter in conformance with the provisions in Section 40-1.13, "Measurement," of the Standard Specifications. No deduction will be made for the volume of epoxy-coated dowel bars, epoxy-coated tie bars and, when used, tie bar baskets with fasteners and dowel bar baskets with fasteners, in the concrete pavement. When a test strip conforms to the specifications for concrete pavement and remains a part of the project paving surface, the concrete will be measured and paid for as concrete pavement.

The contract price paid per cubic meter for concrete pavement shall include full compensation for furnishing all labor, materials (including cementitious material in the amount determined by the Contractor), tools, equipment, and incidentals, and for doing all the work involved in constructing the portland cement concrete pavement complete in place, including furnishing and placing epoxy-coated dowel bars, epoxy-coated tie bars and, when used, any tie bar baskets and dowel bar baskets with fasteners, submittal to the Engineer all test data for determination of mix proportions of concrete for concrete pavement and for providing the facility, Contractor personnel and all the work involved in arranging and holding the pre-paving conference, for constructing and repairing all joints; for performing all profile checks for Profile Index and furnishing final profilograms to the Engineer; for grooving and grinding required for final finishing; and for removing, and replacing pavement for deficient thickness, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

Full compensation for drilling holes and bonding tie bars with epoxy resin shall be considered as included in the contract price paid per cubic meter for concrete pavement and no additional compensation will be allowed therefor.

Full compensation for coring test strips for evaluation by the Engineer and for back-filling core holes with hydraulic cement grout when the test strip remains in place as part of the concrete pavement; and for constructing, coring and removing and disposing of test strips that are rejected shall be considered as included in the contract price paid per cubic meter for concrete pavement and no additional compensation will be allowed therefor.

Costs for providing JITT will be determined in conformance with the provisions in Section 9-1.03, "Force Account Payment," of the Standard Specifications, except no markups shall be added, and the Contractor will be paid for one half of the JITT cost. Costs for providing JITT shall include training materials, class site, and the JITT instructor including the JITT instructor's travel, lodging, meals and presentation materials. All costs incurred by the Contractor or Engineer for attending JITT shall be borne by the party incurring the costs.

Full compensation for core drilling for dowel bar or tie bar alignment and backfilling with hydraulic cement grout shall be considered as included in the contract price per cubic meter for concrete pavement and no additional compensation will be allowed therefor.

If the initial cores show that dowel bars or tie bars are out of alignment tolerances and the Engineer orders additional dowel bar or tie bar coring, full compensation for drilling the additional cores shall be considered as included in the contract price per cubic meter for concrete pavement and no additional compensation will be allowed therefor.

If the initial cores show that dowel bars or tie bars are within alignment tolerances and the Engineer orders more dowel bar coring the additional cores will be paid for as extra work in conformance with the provisions in Section 4-1.03D, "Extra Work," of the Standard Specifications.

Full compensation for drilling holes and bonding dowel bars with epoxy resin shall be considered as included in the contract price paid per cubic meter for concrete pavement and no additional compensation will be allowed therefore.

10-1.47 CONCRETE PAVEMENT (RAPID STRENGTH CONCRETE)

Concrete pavement (Rapid Strength Concrete) shall consist of constructing rapid strength concrete (RSC) pavement as shown on the plans and in conformance with Section 40, "Portland Cement Concrete Pavement," of the Standard Specifications and these special provisions.

DEFINITIONS

The following definitions shall apply to this section:

- A. EARLY AGE. – A time less than 10 times the final set time of the concrete.
- B. FINAL SET TIME. – The elapsed time after initial contact of cement and water, or accelerator, if used, at which a specific penetration resistance of 27.6 MPa is achieved in conformance with the requirements in ASTM Designation: C 403.
- C. OPENING AGE. – The age at which the concrete will achieve the specified strength for opening to public or Contractor traffic.

PRE-OPERATION CONFERENCE

The Contractor and subcontractors involved in construction operations of RSC shall meet with the Engineer at a pre-operation conference, at a mutually agreed time, to discuss methods of accomplishing all phases of the construction operation, contingency planning, and standards of workmanship for the completed item of work.

The Contractor shall provide the facility for the pre-operation conference. The Contractor's superintendent, foremen, subcontractors, field staff, plant personnel including plant supervisors, manager, and operator involved with RSC shall attend the pre-operation conference. The Contractor shall submit a list of participants to the Engineer for approval. The complete listing shall identify each participant's name, employer, title and role in construction of RSC. The pre-operation conference shall be held for no less than 2 hours. Construction operations of RSC shall not begin until the specified personnel have completed the mandatory pre-operation conference.

JUST-IN-TIME TRAINING

Just-In-Time Training (JITT) shall be mandatory, and consist of a formal joint training class on rapid strength concrete. Construction operations for rapid strength concrete shall not begin until the Contractor's and the Engineer's personnel have completed the mandatory JITT. The Contractor's personnel included in the list of participants for the Pre-Operation Conference along with the Engineer's representatives shall attend JITT.

The JITT session will be conducted for not less than 4 hours on rapid strength concrete. The training class may be an extension of the Pre-Operation Conference and shall be conducted at the project field location convenient for both the Contractor's and the Engineer's project staffs. Scheduling and completion of the JITT session shall be completed at least 5 working days prior to the start of construction of rapid strength concrete. The class shall be held during normal working hours.

The JITT instructor shall be experienced in the construction methods, materials, and test methods associated with rapid strength concrete. The instructor shall not be an employee of the Contractor or a member of the Engineer's field staff. A copy of the syllabus, handouts, and presentation material shall be submitted to the Engineer at least 7 days before the day of the training. Selection of the course instructor, the course content and training site shall be as mutually agreed to by the Contractor and the Engineer. The instructor shall issue a certificate of completion to the participants upon the completion of the class. The certificate shall include the course title, date and location of the class, the name of the participant, instructor's name, location and phone number.

The Contractor's or Engineer's personnel involved with rapid strength concrete operations will not be required to attend JITT if they have completed similar training within the previous 12 months of the date of the JITT for this project. The Contractor shall provide a certificate of class completion as described above for each staff member to be excluded from the JITT session. The final determination for exclusion of any staff member's participation will be as determined by the Engineer. All attendees of the JITT shall complete, and submit to the Engineer, an evaluation of the training. The course evaluation form will be provided by the Engineer.

It is expressly understood that Just-In-Time Training shall not relieve the Contractor of any responsibility under the contract for the successful completion of the work in conformity with the requirements of the plans and specifications.

TRIAL SLAB

Prior to beginning work on concrete pavement (RSC), the Contractor shall successfully complete one or more trial slabs for each RSC mix design to be used in constructing RSC pavement. Trial slabs shall be constructed, finished, cured and tested with the materials, tools, equipment, personnel and methods to be used in completing RSC pavement. Trial slabs shall demonstrate that the Contractor is capable of producing RSC pavement in conformance with the provisions in this section,

within anticipated time periods including delivery, placement, finishing and curing times, and under similar atmospheric and temperature conditions expected during operations. Multiple trial slabs for each RSC mix design may be required to envelop variable atmospheric and temperature conditions.

The minimum trial slab dimensions shall be 3 m by 6 m and shall be 225 mm thick where planned pavement nominal thickness is less than 255 mm. The trial slab thickness shall be 260 mm where planned pavement nominal thickness is 255 mm or greater. Where there are planned slabs with greater and less than 255 mm thickness then two trial slabs shall be required one at 225 mm thick and one at 260 mm thick. Trial slabs shall be placed near the project site at a location mutually acceptable to the Engineer and the Contractor except slabs shall not be placed on the roadway or within the project limits.

During trial slab construction and within 20 minutes of RSC delivery, beams shall be fabricated in conformance with the requirements in California Test 523. Beams shall be used to determine early age and 7-day modulus of rupture values. Beams fabricated for early age testing shall be cured so that the monitored temperature in the beams and the trial slab are within 3°C at all times. Internal temperatures of trial slab and early age beams shall be monitored and recorded at minimum time intervals of 5 minutes by installing thermocouples and or thermistors connected to strip-chart recorders or digital data loggers. Temperature recording devices shall be accurate to within $\pm 1^\circ\text{C}$. Internal temperature readings shall be measured at 25 mm from the top and 25 mm from the bottom, no closer than 75 mm from any edge of the concrete elements, until early age testing is completed. Beams fabricated for 7-day testing shall be cured in conformance with California Test 523 except they shall be placed into sand at between 5 and 10 times final set time or 24 hours, whichever is earlier. Trial slabs 225 mm thick shall have an early age modulus of rupture of not less than 2.8 MPa and a 7-day modulus of rupture of not less than 4.2 MPa. Trial slabs 260 mm thick shall have an early age modulus of rupture of not less than 2.3 MPa and a 7-day modulus of rupture of not less than 4.2 MPa. Beams failing early age or 7-day modulus of rupture requirements shall be cause for rejection of the trial slab.

Materials resulting from construction of trial slabs and test specimens shall become the property of the Contractor and shall be removed and disposed of in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.

TEMPORARY ROADWAY STRUCTURAL SECTION

Asphalt concrete and aggregate base, equal to the quantity of pavement removed during the work shift, shall be provided on site for construction of a temporary roadway structural section where existing pavement is to be placed. The quantity and location of standby material shall be included in the Contractor's contingency plan in conformance with the requirements of these special provisions. Temporary roadway structural section shall be maintained and later removed as the first order of work when concrete pavement (Rapid Strength Concrete) operations resume. The temporary roadway structural section shall consist of 90-mm thick asphalt concrete over aggregate base. RSC not conforming to these special provisions for RSC may be used for temporary roadway structural section with the Engineer's approval.

Aggregate base for temporary roadway structural section shall be produced from commercial quality aggregates consisting of broken stone, crushed gravel, natural rough-surfaced gravel, reclaimed concrete and sand, or any combination thereof. Grading of aggregate base shall conform to the 19-mm maximum grading specified in Section 26-1.02A, "Class 2 Aggregate Base," of the Standard Specifications.

Asphalt concrete for temporary roadway structural section shall be produced from commercial quality aggregates and asphalt binder. Grading of aggregate shall conform to the 19-mm maximum, medium grading in Section 39-2.02, "Aggregate," of the Standard Specifications and asphalt binder shall conform to requirements for liquid asphalt SC-800 in Section 93, "Liquid Asphalts," of the Standard Specifications. Amount of asphalt binder to be mixed with the aggregate shall be approximately 0.3 percent less than the optimum bitumen content determined in conformance with the requirements in California Test 367.

Aggregate base and asphalt concrete for the temporary roadway structural section shall be spread and compacted by methods that will produce a well-compacted, uniform base, with a surface of uniform smoothness, texture and density. Surfaces shall be free from pockets of coarse or fine material. Aggregate base may be spread and compacted in one layer. Asphalt concrete may be spread and compacted in one layer. Finished surface of asphalt concrete shall not vary more than 15 mm from the lower edge of a 3.6-m ± 0.06 m long straightedge placed parallel with the centerline and shall match the elevation of existing concrete pavement along the joints between the existing pavement and temporary surfacing.

Removed temporary roadway structural section materials shall be disposed of in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications, except that removed aggregate base may be stockpiled at the project site and reused for construction of temporary roadway structural sections. When no longer required, standby material or stockpiled material for construction of temporary roadway structural sections shall be disposed of in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.

RAPID STRENGTH CONCRETE

General

Rapid Strength Concrete (RSC) shall be a concrete made with hydraulic cement that develops opening age and 7-day specified modulus of rupture strengths.

Requirements of Sections 40-1.015, "Cement Content," 40-1.05, "Proportioning," and 90-1.01, "Description," of the Standard Specifications shall not apply.

Combined aggregate grading used in RSC shall be either the 37.5-mm, maximum grading, or 25-mm, maximum grading, at the option of the Contractor.

Cement for RSC shall be hydraulic cement as defined in ASTM Designation: C 219 and shall conform to the following requirements:

Test Description	Test Method	Requirement
Contraction in Air	California Test 527, W/C Ratio = 0.39 ± 0.010	0.053 %, max.
Mortar Expansion in Water	ASTM Designation: C 1038	0.04 %, max.
Soluble Chloride*	California Test 422	0.05 %, max.
Soluble Sulfates*	California Test 417	0.30 %, max.
Thermal Stability	California Test 553	60 %, min.
Compressive Strength @ 3 days	ASTM Designation: C 109	17 MPa

*Test is to be done on a cube specimen, fabricated in conformance with the requirements in ASTM Designation: C 109, cured at least 14 days and then pulverized to 100% passing the 300- μ m sieve

At least 45 days prior to intended use, the Contractor shall furnish a sample of cement from each lot proposed for use and all admixtures proposed for use in the quantities ordered by the Engineer.

The Contractor shall submit uniformity reports for cement used in RSC to the Engineer. Uniformity reports shall conform to the requirements in ASTM Designation: C 917, except that testing age and water content may be modified to suit the particular material. Uniformity reports shall be submitted at least every 30 days during RSC pavement operations.

Type C accelerating chemical admixtures conforming to the provisions in Section 90-4, "Admixtures," of the Standard Specifications may be used. In addition to the admixtures listed on the Department's current list of approved admixtures, citric acid or borax may be used if requested in writing by the cement manufacturer and a sample is submitted to the Engineer. Chemical admixtures, if used, shall be included in the testing for requirements listed in the table above.

At least 10 days prior to use in the trial slab, the Contractor shall submit a mix design for RSC that shall include the following:

- A. Opening age
- B. Proposed aggregate gradings
- C. Mix proportions of hydraulic cement and aggregate
- D. Types and amounts of chemical admixtures
- E. Maximum time allowed between batching RSC and placing roadway pavement
- F. Range of ambient temperatures over which the mix design is effective (10°C maximum range)
- G. Final set time of the concrete
- H. Any special instructions or conditions, including but not limited to, water temperature requirements when appropriate

The Contractor shall submit more than one mix design to plan for ambient temperature variations anticipated during placement of the roadway pavement. Each mix shall be designed for a maximum ambient temperature range of 10°C. The Contractor shall develop and furnish modulus of rupture development data for each proposed mix design. Modulus of rupture development data for up to 7 days shall be provided to the Engineer prior to beginning paving operations. Modulus of rupture development data may be developed from laboratory prepared samples. The testing ages for modulus of rupture development data shall include one hour before opening age, opening age, one hour after opening age, 24 hours, 7 days and 28 days.

Concrete pavement penetration requirements in Section 90-6.06, "Amount of Water and Penetration," of the Standard Specifications shall not apply to RSC.

RSC pavement shall develop a minimum modulus of rupture as specified in "Pay Factor Adjustment for Low Modulus of Rupture" of these special provisions before opening to public or Contractor traffic. In addition, RSC pavement shall develop a minimum modulus of rupture of 4.2 MPa in 7 days after placement. RSC pavement that attains a modulus of rupture of less than specified may be accepted in conformance with "Pay Factor Adjustment for Low Modulus of Rupture" specified herein. Modulus of rupture shall be determined by averaging results from 3 beam specimens tested in conformance with the requirements in California Test 523. Beam specimens may be fabricated using an internal vibrator in conformance with the

requirements in ASTM Designation: C 31. No single test shall represent more than the production of that day or 100 cubic meters, whichever is less.

Modulus of rupture at early age may be estimated using the correlation established during trial slab placement or by using results from beam specimens cured under atmospheric conditions and at a temperature within 3°C of the pavement. Modulus of rupture at other ages will be determined using beams cured and tested in conformance with California Test 523 except beams will be placed into sand between 5 and 10 times final set time or 24 hours, whichever is earlier. The Engineer will perform the testing to determine modulus of rupture values of the RSC pavement. The modulus of rupture, as determined above, will be the basis for accepting or rejecting the RSC pavement for modulus of rupture requirements.

Pay Factor Adjustment for Low Modulus of Rupture

Where pavement nominal thickness is less than 255 mm, payment for concrete pavement (Rapid Strength Concrete) will be adjusted for low modulus of rupture tests as follows:

- A. Concrete pavement (Rapid Strength Concrete) with modulus of rupture of 2.8 MPa or greater before the lane is opened to the traffic and 7-day modulus of rupture of 4.2 MPa or greater will be paid for at the contract price per cubic meter for concrete pavement (Rapid Strength Concrete).
- B. Concrete pavement (Rapid Strength Concrete) with a 7-day modulus of rupture of less than 3.4 MPa will not be paid for, and shall be removed and replaced, at the Contractor's expense with concrete pavement (Rapid Strength Concrete) conforming to the requirements of these special provisions.
- C. Concrete pavement (Rapid Strength Concrete) with modulus of rupture of 2.1 MPa or greater before the lane is opened to traffic and a 7-day modulus of rupture of equal to or greater than 3.4 MPa will be paid for at a percentage of the contract price per cubic meter for concrete pavement (Rapid Strength Concrete) in conformance with the percentages in the pay table below.
- D. Concrete pavement (Rapid Strength Concrete) with modulus of rupture of less than 2.1 MPa when the lane is opened to traffic will be rejected and shall be removed and replaced at the Contractor's expense with concrete pavement (Rapid Strength Concrete) conforming to the requirements of these special provisions.

Percentage Pay Table

Modulus of Rupture (MPa) at opening to traffic	7-Day Modulus of Rupture (MPa)		
	Greater than or equal to 4.2	Less than 4.2 and greater than or equal to 3.8	Less than 3.8 and greater than or equal to 3.4
Greater than or equal to 2.8	100%	95%	90%
Less than 2.8 and greater than or equal to 2.4	95%	95%	90%
Less than 2.4 and greater than or equal to 2.1	80%*	80%*	80%*

*Any panels that develops one or more transverse cracks within 21 days after placement shall be removed and replaced at the Contractor's expense with concrete pavement (Rapid Strength Concrete) conforming to the requirements of these special provisions. A transverse crack is defined as a crack running from one longitudinal edge of the panel to the other.

Where pavement nominal thickness is 255 mm or greater, payment for concrete pavement (Rapid Strength Concrete) will be adjusted for low modulus of rupture tests as follows:

- A. Concrete pavement (Rapid Strength Concrete) with modulus of rupture of 2.3 MPa or greater before the lane is opened to the traffic and 7-day modulus of rupture of 4.2 MPa or greater will be paid for at the contract price per cubic meter for concrete pavement (Rapid Strength Concrete).
- B. Concrete pavement (Rapid Strength Concrete) with a 7-day modulus of rupture of less than 3.4 MPa will not be paid for, and shall be removed and replaced, at the Contractor's expense with concrete pavement (Rapid Strength Concrete) conforming to the requirements of these special provisions.
- C. Concrete pavement (Rapid Strength Concrete) with modulus of rupture of 1.8 MPa or greater before the lane is opened to traffic and a 7-day modulus of rupture of equal to or greater than 3.4 MPa will be paid for at a percentage of the contract price per cubic meter for concrete pavement (Rapid Strength Concrete) in conformance with the percentages in the pay table below.
- D. Concrete pavement (Rapid Strength Concrete) with modulus of rupture of less than 1.8 MPa when the lane is opened to traffic will be rejected and shall be removed and replaced at the Contractor's expense with concrete pavement (Rapid Strength Concrete) conforming to the requirements of these special provisions.

Percentage Pay Table

Modulus of Rupture (MPa) at opening to traffic	7-Day Modulus of Rupture (MPa)		
	Greater than or equal to 4.2	Less than 4.2 and greater than or equal to 3.8	Less than 3.8 and greater than or equal to 3.4
Greater than or equal to 2.3	100%	95%	90%
Less than 2.3 and greater than or equal to 2.0	95%	95%	90%
Less than 2.0 and greater than or equal to 1.8	80%*	80%*	80%*

*Any panels that develops one or more transverse cracks within 21 days after placement shall be removed and replaced at the Contractor's expense with concrete pavement (Rapid Strength Concrete) conforming to the requirements of these special provisions. A transverse crack is defined as a crack running from one longitudinal edge of the panel to the other.

The Contractor shall pay to the State adjustments in payment for low modulus of rupture tests in conformance with the requirements specified in the tables in this section. The Department will deduct the amount of the adjustments from moneys due or that may become due, the Contractor under the contract.

Proportioning

Weighing, measuring and metering devices used for proportioning materials shall conform to the provisions in Section 9-1.01, "Measurement of Quantities," of the Standard Specifications and these special provisions.

Over and under dials, and other indicators for weighing and measuring systems used in proportioning materials shall be grouped so that the smallest increment for each indicator can be accurately read from the point at which the proportioning operation is controlled for ingredients batched at a central batch plant. In addition, indicators for weighing and measuring cement batched from a remote weighing system shall also be placed so that each indicator can be accurately read from the point at which the proportioning operation is controlled.

Aggregates shall be handled and stored in conformance with the provisions in Section 90-5.01, "Storage of Aggregates," of the Standard Specifications. Liquid admixtures shall be proportioned in conformance with the provisions in Section 90-4.10, "Proportioning and Dispensing Liquid Admixtures," of the Standard Specifications. Mineral admixtures shall be protected from exposure to moisture until used. Adequate facilities shall be provided to assure that mineral admixtures meeting the specified requirements are kept separate from other mineral admixtures to easily track the materials that are entering the work. Safe and suitable facilities for sampling mineral admixtures shall be provided at the weigh hopper or in the feed line immediately in advance of the hopper.

Weighing equipment shall be insulated against vibration or movement of other operating equipment. When the plant is in operation, the mass of each draft of material shall not vary from the designated mass by more than the tolerances specified herein. Each scale graduation shall be 0.001 of the usable scale capacity.

Aggregate shall be weighed cumulatively and equipment for the weighing of aggregate shall have a zero tolerance of ±0.5 percent of the designated total batch mass of the aggregate. Equipment for the separate weighing of the cement or mineral admixture shall have a zero tolerance of ±0.5 percent of their designated individual batch drafts. Equipment for measuring water shall have a zero tolerance of ±0.5 percent of its designated mass or volume.

The mass indicated for any individual batch of material shall not vary from the preselected scale setting by more than the following:

Material	Tolerance
Aggregate	± 1.0 percent of designated batch mass
Cement	± 0.5 percent of designated batch mass
Mineral Admixture	± 1.0 percent of designated batch mass
Water	± 1.5 percent of designated batch mass or volume

Proportioning shall consist of dividing the aggregates into the specified sizes, each stored in a separate bin, and combining them with cement, mineral admixture and water as provided in these special provisions. Dry ingredients shall be proportioned by mass. Liquid ingredients shall be proportioned by mass or volume.

At the time of batching, aggregates shall have been dried or drained sufficiently to result in stable moisture content, so that no visible separation of water from aggregate will take place during the proportioning process. In no event shall the free moisture content of the fine aggregate at the time of batching exceed 8 percent of its saturated, surface-dry mass.

If separate supplies of aggregate material of the same size group with different moisture content or specific gravity or surface characteristics affecting workability are available at the proportioning plant, withdrawals shall be made from one supply exclusively and the materials therein completely exhausted before starting upon another supply.

Cement shall be kept separate from the aggregates until released for discharge into the mixer. Cement shall be free of lumps and clods when discharged into the mixer. Fabric containers used for transportation or proportioning of cement shall be clean and free of residue before reuse.

Weigh systems for proportioning aggregate, cement, and mineral admixture shall be individual and distinct from all other weigh systems. Each weigh system shall be equipped with a hopper, a lever system, and an indicator to constitute an individual and distinct material-weighing device.

For batches with a volume of one cubic meter or more, proportioning equipment shall conform to one of the following methods:

- A. All ingredients shall be batched at a central batch plant and charged into a mixer truck for transportation to the pour site. Ingredient proportioning shall meet the requirements of Section 90-5, "Proportioning," of the Standard Specifications.
- B. All ingredients except the cement shall be batched at a central batch plant and charged into a mixer truck for transportation to a remote located silo and weigh system for the proportioning of the cement. The remote system shall proportion cement for charging the mixer truck.
- C. All ingredients except the cement shall be batched at a central batch plant and charged into a mixer truck for transportation to a remote location where pre-weighed, containerized cement shall be added to the mixer truck. The cement pre-weighing operation shall utilize a platform scale. The platform scale shall have a maximum capacity of 2.5 tonnes with a maximum graduation size of 0.5 kilograms. Cement shall be pre-weighed into a fabric container. The minimum amount of cement to be proportioned into any single container shall be one half of the total amount required for the load of RSC being produced.
- D. Cement, water, and aggregate shall be proportioned volumetrically in conformance with these special provisions.

In order to check the accuracy of batch masses, the gross mass and tare mass of truck mixers shall be determined when ordered by the Engineer. The equipment shall be weighed at the Contractor's expense on scales designated by the Engineer.

The Contractor shall install and maintain in operating condition an electrically actuated moisture meter. The meter shall indicate, on a readily visible scale, changes in the moisture content of the fine aggregate as it is batched. The meter shall have a sensitivity of 0.5 percent by mass of the fine aggregate.

No additional mixing water shall be incorporated into the concrete during hauling or after arrival at the delivery point, unless authorized by the Engineer. If the Engineer authorizes additional water to be incorporated into the concrete, the drum shall be revolved not less than 30 revolutions at mixing speed after the water is added and before discharge is commenced. Water added to the truck mixer at the job site shall be measured through a meter that conforms to the provisions in Section 9-1.01, "Measurement of Quantities," of the Standard Specifications.

Aggregate discharged from several bins shall be controlled by gates or by mechanical conveyors. The means of discharge from the bins and from the weigh hopper shall be interlocked so that no more than one bin can discharge at a time, and so that the weigh hopper can not be discharged until the required quantity from each of the bins has been deposited in the weigh hopper.

Weighmaster Certificates

Weighmaster certificates for RSC, regardless of the proportioning method used, shall include all information necessary to trace the manufacturer, and manufacturer's lot number for the cement being used. When proportioned into fabric containers the weighmaster certificates for the cement shall contain date of proportioning, location of proportioning and actual net draft mass of the cement. When proportioned at the pour site from a storage silo the weighmaster certificates shall contain date of proportioning, location of proportioning and the net draft mass of the cement used in the load.

Volumetric Proportioning

When RSC is proportioned by volume, the method shall conform to requirements specified herein.

Aggregates shall be handled and stored in conformance with the provisions in Section 90-5.01, "Storage of Aggregates," of the Standard Specifications. Liquid admixtures shall be proportioned in conformance with the provisions in Section 90-4.10, "Proportioning and Dispensing Liquid Admixtures," of the Standard Specifications. Mineral admixtures shall be protected from exposure to moisture until used. Adequate facilities shall be provided to assure that mineral admixtures meeting the specified requirements are kept separate from other mineral admixtures in order to prevent any but the specified mineral admixtures from entering the work. Safe and suitable facilities for sampling mineral admixtures shall be provided at the batch-mixer storage hopper or in the feed line.

Batch-mixer trucks shall be equipped to proportion cement, water, aggregate and additives by volume. Aggregate feeders shall be connected directly to the drive on the cement vane feeder. The cement feed rate shall be tied directly to the feed rate for the aggregate and other ingredients. Any change in the ratio of cement to aggregate shall be accomplished by

changing the gate opening for the aggregate feed. The drive shaft of the aggregate feeder shall be equipped with a revolution counter reading to the nearest full or partial revolution of the aggregate delivery belt.

Aggregate shall be proportioned using a belt feeder operated with an adjustable cutoff gate delineated to the nearest quarter increment. Height of the gate opening shall be readily determinable. Cement shall be proportioned by a method that conforms to the accuracy requirements of these special provisions. Water shall be proportioned by a meter conforming to the provisions in Section 9-1.01, "Measurement and Payment," of the Standard Specifications and these special provisions.

Delivery rate of aggregate and cement per revolution of the aggregate feeder shall be calibrated at appropriate gate settings for each batch-mixer truck used on the project and for each aggregate source. Batch-mixer trucks shall be calibrated at 3 different aggregate gate settings that are commensurate with production needs. Two or more calibration runs shall be required at each of the different aggregate gate openings. The actual mass of material delivered for aggregate proportioning device calibrations shall be determined by a platform scale as specified in these special provisions.

Aggregate belt feeder shall deliver aggregate to the mixer with volumetric consistency so that deviation for any individual aggregate delivery rate check-run shall not exceed 1.0 percent of the mathematical average of all runs for the same gate opening and aggregate type. Each test run shall be at least 500 kg. Fine aggregate used for calibration shall not be reused for device calibration.

At the time of batching, aggregates shall be dried or drained sufficiently to result in stable moisture content, so that no visible separation of water from aggregate takes place during the proportioning process. In no event shall the free moisture content of the fine aggregate at the time of batching exceed 8 percent of its saturated, surface-dry mass.

If separate supplies of aggregate material of the same size group with different moisture content or specific gravity or surface characteristics affecting workability are available at the proportioning plant, withdrawals shall be made from one supply exclusively and the materials therein completely exhausted before starting another supply.

Rotating and reciprocating equipment on batch-mixer trucks shall be covered with metal guards.

The cement proportioning system shall deliver cement to the mixer with a volumetric consistency so that the deviation for any individual delivery rate check-run shall not exceed 1.0 percent of the mathematical average of 3 runs of at least 500 kg each. Cement used for calibration shall not be reused for device calibration.

Water meter accuracy shall be such that, when operating between 50 percent and 100 percent of production capacity, the difference between the indicated mass of water delivered and the actual mass delivered shall not exceed 1.5 percent of the actual mass for each of two individual runs of 1200 liters. The water meter shall be calibrated in conformance with the requirements of California Test 109 and shall be equipped with a resettable totalizer and display the operating rate.

Calibration tests for aggregate, cement and water proportioning devices shall be conducted with a platform scale located at the calibration site. Weighing of test run calibration material shall be performed on a platform scale having a maximum capacity not exceeding 2.5 tonnes with maximum graduations of 0.5-kg. The platform scale shall be error tested within 8 hours of calibration of batch-mixer truck proportioning devices. Error testing shall be performed with test masses conforming to California Test 109 and shall produce a witness scale that is within 2 graduations of the test mass load. The scale shall be available for use at the production site throughout the production period. Equipment needed for the calibration of proportioning systems shall remain available at the production site throughout the production period. A Certificate of Compliance in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," shall be furnished with each delivery of aggregate, cement, and admixtures used for calibration tests and shall be submitted to the Engineer with certified copies of the mass of each delivery. The Certificate of Compliance shall state that the source of materials used for the calibration tests is from the same source as to be used for the planned work. The Certificate of Compliance shall state that the material supplied conforms to the Standard Specifications and these Special Provisions and shall be signed by an authorized representative who shall have the authority to represent and act for the Contractor.

The batch-mixer truck shall be equipped so that an accuracy check can be made prior to the first operation for the project and at any other time as directed by the Engineer. Further calibration of proportioning devices shall be required every 30 days after production begins or when the source or type of any ingredient is changed. A spot calibration shall consist of calibration of the cement proportioning system only. A two run spot re-calibration of the cement proportioning system shall be performed each time 50 tonnes of cement has passed through the batch-mixer truck. Should the spot re-calibration of the cement proportioning system fall outside the limitations specified herein, a full calibration of the cement proportioning system shall be completed before the resumption of production.

Liquid admixtures shall be proportioned by a meter.

Cement storage shall be located immediately before the cement feeder and shall be equipped with a device that will automatically shut down the power to the cement feeder and aggregate belt feeder when the cement storage level is lowered to a point where less than 20 percent of the total volume is left in storage.

The Contractor shall furnish aggregate moisture determinations, made in conformance with the requirements of California Test 223, at least every 2 hours during proportioning and mixing operations. Moisture determinations shall be recorded and presented to the Engineer at the end of the production shift.

Each aggregate bin shall be equipped with a device that will automatically shut down the power to the cement feeder and the aggregate belt feeder when the aggregate discharge rate is less than 95 percent of the scheduled discharge rate of any bin.

Indicators specified herein shall be in working order prior to commencing proportioning and mixing operations and shall be visible when standing near the batch-mixer truck.

Identifying numbers of batch-mixer trucks shall be at least 75 mm in height, and be located on the front and rear of the vehicles.

Volumetric proportioned RSC shall be mixed in a mechanically operated mixer of adequate size and power for the type of RSC to be placed. Mixers may be of the auger type and shall be operated uniformly at the mixing speed recommended by the manufacturer. Mixers that have an accumulation of hard concrete or mortar shall be removed from service until cleaned. Other types of mixers may be used provided mixing quality will meet the requirements of these special provisions.

Charge or rate of feed to the mixer shall not exceed that which will permit complete mixing of the materials. Dead areas in the mixer, where material does not move or is not sufficiently agitated, shall be corrected by a reduction in the volume of material or by other adjustments. The mixer shall be designed to provide sufficient mixing action and movement to produce properly mixed RSC. Mixing shall continue until a homogeneous mixture is produced at discharge from the mixer. There shall be no lumps or evidence of non-dispersed cement at discharge from the mixer. No water shall be added to the RSC after discharge from the mixer.

Equipment having components made of aluminum or magnesium alloys, which may have contact with plastic concrete during mixing or transporting of RSC, shall not be used.

Uniformity of concrete mixtures will be determined by differences in penetration measurement made in conformance with the requirements in California Test 533. Difference in penetration, determined by comparing penetration tests on 2 samples of mixed concrete from the same batch or truck mixer load, shall not exceed 15 mm. The Contractor shall furnish samples of freshly mixed concrete and provide facilities for obtaining the samples. Sampling facilities shall be safe, accessible, clean and produce a sample which is representative of production. Sample devices and sampling methods shall also conform to the requirements of California Test 125.

Ice shall not be used to cool RSC directly. When ice is used to cool water used in the mix, all of the ice shall be melted before entering the mixer.

Cement shall be proportioned and charged into the mixer by means that will result in no losses of cement due to wind, or due to accumulation on equipment, or other conditions which will vary the required quantity of cement.

Each mixer shall have a metal plate or plates, prominently attached, on which the following information is provided:

- A. Uses for which the equipment is designed.
- B. Manufacturer's guaranteed capacity of the mixer in terms of the volume of mixed concrete.
- C. Speed of rotation of the mixer.

Consistency and workability of mixed concrete when discharged at the delivery point shall be suitable for placement and consolidation.

Information generated by volumetric devices will not be used for payment calculations.

The device that controls the proportioning of cement, aggregate and water shall produce a log of production data. The log of production data shall consist of a series of snapshots captured at 15-minute intervals throughout the period of daily production. Each snapshot of production data shall be a register of production activity at that time and not a summation of the data over the preceding 15 minutes. The amount of material represented by each snapshot shall be the amount produced in the period of time from 7.5 minutes before to 7.5 minutes after the capture time. The daily log shall be submitted to the Engineer, in electronic or printed media, at the end of each production shift or as requested by the Engineer, and shall include the following:

- A. Mass of cement per revolution count.
- B. Mass of each aggregate size per revolution count.
- C. Gate openings for each aggregate size being used.
- D. Mass of water added to the concrete per revolution count.
- E. Moisture content of each aggregate size being used.
- F. Individual volume of all other admixtures per revolution count.
- G. Time of day.
- H. Day of week.
- I. Production start and stop times.
- J. Batch-mixer truck identification.
- K. Name of supplier.
- L. Specific type, size, or designation of concrete being produced.
- M. Source of the individual aggregate sizes being used.
- N. Source, brand and type of cement being used.
- O. Source, brand and type of individual admixtures being used.
- P. Name and signature of operator.

Required report items may be input by hand into a pre-printed form or captured and printed by the proportioning device. Electronic media containing recorded production data shall be presented in a tab delimited format on a 90-mm diskette with a capacity of at least 1.4 megabytes. Each snapshot of the continuous production shall be followed by a line-feed carriage-return with allowances for sufficient fields to satisfy the amount of data required by these specifications. The reported data shall be in the above order and shall include data titles at least once per report.

Bond Breaker

Bond breaker shall be placed between RSC pavement and asphalt concrete base layer. Bond breaker shall be one of the following:

- A. Curing paper conforming to the requirements in ASTM Designation: C 171, white.
- B. Polyethylene film conforming to the requirements in ASTM Designation: C 171, except that the minimum thickness shall be 0.15 mm, white opaque.
- C. Paving asphalt, PG Grade, conforming to the provisions in Section 92 of Section 11-2, "Asphalts," of these special provisions.
- D. Pigmented curing compound conforming to the requirements in ASTM Designation: C 309, Type 2, Class A, containing a minimum of 22 percent nonvolatile vehicles consisting of at least 50 percent paraffin wax.

When curing paper or polyethylene film is used, material shall be placed in a wrinkle free manner. Adjacent sheets shall be overlapped a minimum of 150 mm.

When paving asphalt is used, no water shall be added before applying asphalt to the surface of the base. The paving asphalt shall be applied in one even application at a rate of 0.10 to 0.45-L/m² over the entire base surface area. Concrete pavement shall not be placed until the paving asphalt has cured.

When curing compound is used, the curing compound shall be applied in two separate applications. Each application shall be applied evenly at a rate of 0.3 to 0.5-L/m² over the entire base surface area.

Spreading, Compacting and Shaping

Metal or wood side forms may be used. Wood side forms shall not be less than 38-mm thick. Side forms shall be of sufficient rigidity, both in the form and in the connection with adjoining forms, that movement will not occur under the force from subgrading and paving equipment or from the pressure of concrete.

Side forms shall remain in place until the pavement edge no longer requires the protection of forms. Side forms shall be thoroughly cleaned and oiled prior to each use.

Consolidation of RSC shall be by means of high-frequency internal vibrators after the RSC is deposited on the subgrade. Vibrating shall be done in a manner to assure uniform consolidation adjacent to forms and across the full paving width. RSC shall be placed as nearly as possible in its final position and use of vibrators for extensive shifting of the mass of RSC will not be permitted.

RSC shall be spread and shaped by suitable powered finishing machines and supplemented by hand finishing as necessary. Methods of spreading, shaping and consolidating that result in segregation, voids or rock pockets shall be discontinued. The Contractor shall use methods that will produce dense homogeneous pavement conforming to the required cross section.

After the RSC has been mixed and placed, no additional water shall be added to the surface to facilitate finishing. Surface finishing additives, when used, shall be as recommended by the manufacturer of the cement and shall be approved by the Engineer prior to use.

Joints

Prior to placing concrete against existing concrete, a 6-mm thick commercial quality polyethylene flexible foam expansion joint filler shall be placed across the original transverse and longitudinal joint faces and extend the full depth of the excavation. The top of the joint filler shall be placed flush with the top of pavement. Joint filler shall be secured to the joint face of the existing pavement by a method that will hold the joint filler in place during the placement of concrete.

Transverse weakened plane joints in pavement widenings shall be constructed to match the spacing and skew of the weakened plane joints in the adjacent existing pavement. Where the existing transverse weakened plane joint spacing in an adjacent lane exceeds 4.6 m, an additional transverse weakened plane joint shall be constructed midway between the existing joints. The provisions in the second and third paragraphs in Section 40-1.08B, "Weakened Plane Joints," and the third paragraph in Section 40-1.08B(1), "Sawing Method," of the Standard Specifications shall not apply. Sawing of weakened plane joints shall be completed within 2 hours of completion of final finishing. Minimum depth of cut for weakened plane joints shall be 70 mm.

Tie Bars

Tie bars shall be installed at longitudinal joints where existing tie bars were sawn through. Locations of new tie bars shall be placed as directed by the Engineer.

Tie bars shall be deformed reinforcing steel bars conforming to the requirements in ASTM Designation: A 615/A 615M, Grade 280 or 420 and shall be epoxy-coated in conformance with the provisions in Section 52-1.02B, "Epoxy-coated Reinforcement," of the Standard Specifications, except that references made to ASTM Designation: D 3963/D 3963M shall be deemed to mean ASTM Designation: A 934/A 934M or A 775/A 775M. Tie bars shall not be bent.

Tie bars shall not be used at joints where RSC and asphalt concrete pavements join.

Tie bars shall be installed at longitudinal joints by drilling and bonding with epoxy. Epoxy shall be a two-component, epoxy-resin, conforming to the requirements of ASTM Designation: C 881, Type V, Grade 3 (None-Sagging). The class used shall be dependent on the internal temperature of the existing hardened concrete at the time of tie bar installation as follows: Class A for below 4.5°C, Class B for 4.5°C to 15.5°C, and Class C for above 15.5°C. Epoxy shall be accompanied by a Certificate of Compliance in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications. A copy of the manufacturer's recommended installation procedure shall be provided to the Engineer at least 7 days prior to the start of work. Drilled holes shall be cleaned in conformance with the epoxy manufacturer's instructions and shall be dry at the time of placing the epoxy and tie bars. Immediately after inserting the tie bars into the epoxy, the tie bars shall be supported as necessary to prevent movement during curing and shall remain undisturbed until epoxy has cured a minimum time as specified by the manufacturer. Tie bars that are improperly bonded, as determined by the Engineer, will be rejected. If rejected, new holes shall be drilled adjacent to the rejected holes, as directed by the Engineer, and new tie bars shall be placed and securely bonded to the concrete. Work necessary to correct improperly bonded tie bars shall be performed at the Contractor's expense.

Dowels

Dowels shall conform to "Concrete Pavement (with doweled transverse Weaken Plane Joints)" of these special provisions.

Final Finishing

Tests to determine coefficient of friction of the final textured surface will be made only if the Engineer determines by visual inspection that the final texturing may not have produced a surface having the specified coefficient of friction. Any tests to determine the coefficient of friction will be made after the pavement is opened to public traffic, but not later than 5 days after concrete placement. Pavement areas having a coefficient of friction as determined in conformance with the requirements in California Test 342 of less than 0.30 shall be grooved in conformance with the provisions in Section 42-1.02, "Construction," of the Standard Specifications. Grooving shall be performed prior to the installation of any required edge drains adjacent to the areas to be grooved.

Transverse straightedge and longitudinal straightedge requirements will not apply to the pavement surface within 300 mm of the existing concrete pavement except as required in these special provisions. Longitudinal straightedge requirements in Section 40-1.10, "Final Finishing," of the Standard Specifications, shall be applied at transverse contact joints with existing concrete pavement where the straightedge is to be placed with the midpoint coincident with the joints. Pavement not meeting this straightedge requirement shall be corrected within 48 hours by grinding or other methods as approved by the Engineer.

Profiles of the completed pavement surface specified in Section 40-1.10, "Final Finishing," of the Standard Specifications will be required. The Profile Index requirements in Section 40-1.10, "Final Finishing," of the Standard Specifications shall apply.

Curing Method

The curing method for pavement shall be as recommended by the manufacturer of the cement and as approved by the Engineer.

MEASUREMENT AND PAYMENT

Concrete pavement (Rapid Strength Concrete) will be measured and paid for in the same manner specified for concrete pavement in Sections 40-1.13, "Measurement," and 40-1.14, "Payment," of the Standard Specifications, and these special provisions.

Concrete pavement (Rapid Strength Concrete) payments will be subject to the pay factor values listed in "Pay Factor Adjustment for Low Modulus of Rupture" of these special provisions.

Full compensation for the pre-operation conference, including furnishing the facility to hold the pre-operation conference in, shall be considered as included in the contract prices paid for the concrete pavement (Rapid Strength Concrete) and no additional compensation will be made therefor.

Costs for providing JITT will be made in conformance with the provisions in Section 9-1.03, "Force Account Payment," of the Standard Specifications, except no markups shall be added, and the Contractor will be paid for one half of the JITT cost. Costs for providing JITT shall include training materials, class site, and the JITT instructor including the JITT instructor's travel, lodging, meals and presentation materials. All costs incurred by the Contractor or Engineer for attending JITT shall be borne by the party incurring the costs.

The provisions in Section 40-1.135, "Pavement Thickness," of the Standard Specifications shall not apply.

Full compensation for removing and disposing of existing concrete pavement and underlying base, constructing trial slabs, furnishing and placing bond breaker, furnishing and disposing of standby materials for temporary roadway structural section, constructing, maintaining, removing, and disposing of temporary roadway structural section, shall be considered as included in the contract price paid per cubic meter for concrete pavement (Rapid Strength Concrete), and no additional compensation will be allowed therefor.

The contract unit price paid for tie bar (drill and bond) shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals and for doing all the work involved in placing epoxy-coated tie bars, drilling holes and bonding tie bars with epoxy resin, or furnishing and placing threaded dowel splice couplers, in concrete pavement complete in place, including properly aligning tie bars as shown on the plans, as specified in the Standard Specifications, and these special provisions, and as directed by the Engineer.

If calibration of volumetric batch-trucks is performed more than 160 km from the project limits, additional inspection expenses will be sustained by the State. Whereas it is and will be impracticable and extremely difficult to ascertain and determine the actual increase in these expenses, it is agreed that payment to the Contractor for Concrete Pavement (Rapid Setting Concrete) will be reduced \$1000.

10-1.48 REPAIR SPALLED JOINTS

This work shall consist of removing unsound or damaged concrete from spalled areas at transverse or longitudinal joints shown on the plans and filling the area with a fast-setting patching grout in conformance with these special provisions.

MATERIALS

Fast-Setting Grout

Fast-setting grout shall be, at the option of the Contractor, any of the following:

- A. either of the following magnesium phosphate grouts:
 - 1. single component water activated, or
 - 2. dual component with a prepackaged liquid activator
- B. modified high alumina based grout, or
- C. hydraulic cement based grout.

The Contractor may use accelerating admixtures conforming to the requirements in ASTM Designation: C 494, Type C and to the provisions in Section 90-4, "Admixtures," of the Standard Specifications, except that the chloride content of the accelerating admixture shall be less than one percent by mass. Fast-setting grout shall conform to the following requirements:

Property	Test Method	Requirements
Compressive Strength		
at 3 hours, MPa	California Test 551	21 min.
at 24 hours, MPa	California Test 551	35 min.
Flexural Strength		
at 24 hours, MPa	California Test 551	3.5 min.
Bond Strength: at 24 hours		
SSD Concrete, MPa	California Test 551	2.1 min.
Dry Concrete, MPa	California Test 551	2.8 min.
Water Absorption, %	California Test 551	10 max.
Abrasion Resistance		
at 24 hours, grams	California Test 550	25 max.
Drying Shrinkage at 4 days, %	ASTM Designation: C 596	0.13 max.
Soluble Chlorides by mass, %	California Test 442	0.05 max.
Water Soluble Sulfates* by mass, %	California Test 417	0.25 max.

* Test to be a cube specimen, fabricated in conformance with the requirements in ASTM Designation: C 109, cured at least 14 days and then pulverized to 100% passing the 300 µm sieve.

Clean, uniformly rounded aggregate filler may be used to extend the prepackaged grout. The moisture content of the aggregate filler shall not exceed 0.5-percent by mass. Grading of the aggregate filler shall conform to the following:

Sieve Size	Percentage Passing
6.5 mm	100
1.18 mm	0-5

The amount of aggregate filler shall conform to the fast-setting grout manufacturer's recommendation, but in no case shall the amount of aggregate filler exceed 50 percent of the volume of the grout mix.

Fast-setting grout shall be formulated for a minimum initial set time of 15 minutes and a minimum final set time of 25 minutes at 21°C. The materials, prior to use, shall be stored in a cool, dry environment.

Mix water used with water activated material shall be free from oil and shall not contain more than 2000 parts per million of chlorides as Cl, nor more than 1500 parts per million of sulfates as SO₄.

Water for curing shall not contain impurities in sufficient amounts to cause discoloration of the concrete surface or produce etching of the surface.

The quantity of water or liquid activator to be blended with the dry component for magnesium phosphate grout shall conform to the limits recommended by the manufacturer.

Addition of retarders, when needed, shall conform to the fast-setting grout manufacturer's recommendations.

Joint Bond Breaker

Joint bond breaker material shall be either corrugated cardboard with a 0.15-mm polyethylene covering or expanded polystyrene material.

Bonding Agent

Bonding agent shall be as recommended by the fast-setting grout manufacturer.

SPALL REPAIR PROCEDURE

Concrete Removal

Outlines of rectangular areas, as marked by the Engineer, shall be cut with a diamond bladed saw to a minimum depth of 50 mm. Unsound and damaged concrete between the saw cut and the joint, and to the depth of the saw cut, shall be removed by methods that will not damage the concrete pavement that is to remain in place. Damage to the concrete pavement beyond the limits to be removed shall be repaired at the Contractor's expense. A pneumatic hammer greater than 7 kg shall not be used for removal of concrete.

Concrete pavement removed to repair spalled joints shall become the property of the Contractor and shall be disposed of in conformance with the provisions in Section 7-1.13, "Disposal of Materials Outside the Highway Right of Way," of the Standard Specifications.

Cleaning

After the repair area has been cleared of unsound concrete, the exposed faces of the concrete shall be thoroughly cleaned. Cleaning shall be by abrasive blasting, either sand blasting or high pressure water blasting. Water blasting equipment for concrete cleaning shall be capable of producing a blast pressure of 20 MPa to 40 MPa.

After abrasive blasting, the exposed concrete area shall be cleaned with moisture-free, oil-free compressed air to remove debris. Air compressors shall deliver air at a minimum of 3.4 m³ per minute and develop 0.63-MPa of nozzle pressure.

Joint Bond Breaker Installation

A joint bond breaker shall be placed along the joint, and extend 25 mm beyond the edges of the patch. Joint bond breaker shall be the same width as the existing joint.

Bonding Agent Application

Bonding agent shall be mixed on site in small quantities and mixed in conformance with the manufacturer's instructions. Bonding agent shall be applied in a thin, even coat by using a stiff bristle brush scrubbing the entire area including the patch walls.

Mixing Fast-Setting Grout

Fast-setting grout shall be mixed in a small mobile drum or paddle mixer in conformance with the manufacturer's instructions and these special provisions.

The components of prepackaged, dual component magnesium phosphate grout with a prepackaged liquid activator shall be as supplied by the manufacturer. Portions of components shall not be used. Water shall not be added to dual component magnesium phosphate grout.

Magnesium phosphate grout shall not be mixed in containers or worked with tools containing zinc, cadmium, aluminum, or copper. Modified high alumina based grout shall not be mixed in containers or worked with tools containing aluminum.

Placement of Fast-Setting Grout

Magnesium phosphate grout shall be placed on a dry surface. The grout shall air cure with no curing medium applied. The repaired area shall be protected from public traffic for at least two hours after the grout sets.

High alumina based grout and hydraulic cement based grout may be placed on either a dry or damp surface, in conformance with the manufacturer's instructions. Curing shall be in conformance with the manufacturer's instructions. When curing compound is recommended by the manufacturer, either curing compound (1) or (2) that conforms to Section 90-7.01B, "Curing Compound Method," of the Standard Specifications may be used. The repaired area shall be protected from public traffic for at least two hours after the grout sets.

Resealing Joints

Existing joints where sealant was removed shall be cleaned, resealed and recessed below the final surface as shown on the plans in conformance with the joint sealant manufacturer's instructions and these special provisions.

MEASUREMENT AND PAYMENT

Repair spalled joints will be measured by the square meter of the pavement surface area repaired.

The contract price paid per square meter for repair spalled joints shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in repairing spalled joints, including removal and disposal of portions of concrete pavement involved in repairing spalled joints, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.49 GRIND EXISTING CONCRETE PAVEMENT

This work shall consist of grinding existing portland cement concrete as shown on the plans, as specified in Section 42-2, "Grinding," of the Standard Specifications and these special provisions, and as directed by the Engineer.

Grinding equipment for grinding concrete pavements shall use diamond blades mounted on a self-propelled machine designed for grinding and texturing concrete pavements. Grinding equipment that causes raveling, aggregate fracturing, or spalling, or that damages the transverse or longitudinal joints shall not be used.

Grinding shall be performed in the longitudinal direction of the traveled way and shall be done full lane width so that the grinding begins and ends at lines perpendicular to the pavement centerline.

Grinding concrete pavement shall result in a parallel corduroy texture consisting of grooves 2 mm to 3 mm wide with 183 to 193 grooves per meter width of grinding. Tops of ridges shall be between 1.5 mm and 2.0 mm from the bottom of the blade grooves.

The ground surface at transverse joints or cracks will be tested with a 3.6 m ± 0.06-m long straightedge laid on the pavement parallel with the centerline with its midpoint at the joint or crack. The surface shall not vary by more than 2 mm from the lower edge of the straightedge.

Cross-slope uniformity and positive drainage shall be maintained across the entire traveled way and shoulder. The cross-slope shall be uniform so that when tested with a 3.6 m ± 0.06-m long straightedge placed perpendicular to the centerline, the ground pavement surface shall not vary more than 6 mm from the lower edge of the straightedge.

After grinding has been completed, the pavement surface shall be profiled in conformance with the requirements of Section 40-1.10, "Final Finishing," of the Standard Specifications. Two profiles shall be obtained in each lane approximately one meter from the lane lines. The average profile index shall be determined by averaging the two profiles in each lane. Additional grinding shall be performed, where necessary, to bring the ground pavement surface within the Profile Index requirements specified in Section 40-1.10, "Final Finishing," of the Standard Specifications.

Full compensation for profiling the ground pavement surface with a California profilograph or equivalent and any necessary additional grinding to bring the finished surface within the specified tolerances and for furnishing final profilograms to the Engineer shall be considered as included in the contract price paid per square meter for grind existing concrete pavement and no additional compensation will be allowed therefor.

The Contractor shall provide, while performing profilograph and straightedge operations, a shadow vehicle. The shadow vehicle shall consist of a truck mounted crash cushion conforming to "Traffic Control System for Lane Closure" elsewhere in these special provisions. The shadow vehicle shall operate within a stationary lane closure. The shadow vehicle shall maintain a 23 to 25 meter distance from the profilograph or straightedge operation at all times.

Full compensation for shadow vehicle shall be considered as included in the contract price paid per square meter for grind existing concrete pavement and no additional compensation will be allowed therefor.

10-1.50 PILING

GENERAL

Piling shall conform to the provisions in Section 49, "Piling," of the Standard Specifications, and these special provisions.

Unless otherwise specified, welding of any work performed in conformance with the provisions in Section 49, "Piling," of the Standard Specifications, shall be in conformance with the requirements in AWS D1.1.

Attention is directed to "Welding" of these special provisions.

CAST-IN-DRILLED-HOLE CONCRETE PILES

Cast-in-drilled-hole concrete piling shall conform to the provisions in Section 49-4, "Cast-In-Place Concrete Piles," of the Standard Specifications and these special provisions.

The provisions of "Welding" of these special provisions shall not apply to temporary steel casings.

Cast-in-drilled-hole concrete piles 600 mm in diameter or larger may be constructed by excavation and depositing concrete under slurry.

Materials

Concrete deposited under slurry shall have a nominal penetration equal to or greater than 90 mm. Concrete shall be proportioned to prevent excessive bleed water and segregation.

Concrete deposited under slurry shall contain not less than 400 kg of cementitious material per cubic meter.

The combined aggregate grading used in concrete for cast-in-drilled-hole concrete piling shall be either the 25-mm maximum grading, the 12.5-mm maximum grading, or the 9.5-mm maximum grading and shall conform to the requirements in Section 90-3 "Aggregate Gradings," of the Standard Specifications.

Mineral Slurry

Mineral slurry shall be mixed and thoroughly hydrated in slurry tanks, and slurry shall be sampled from the slurry tanks and tested before placement in the drilled hole.

Slurry shall be recirculated or continuously agitated in the drilled hole to maintain the specified properties.

Recirculation shall include removal of drill cuttings from the slurry before discharging the slurry back into the drilled hole. When recirculation is used, the slurry shall be sampled and tested at least every 2 hours after beginning its use until

tests show that the samples taken from the slurry tank and from near the bottom of the hole have consistent specified properties. Subsequently, slurry shall be sampled at least twice per shift as long as the specified properties remain consistent.

Slurry that is not recirculated in the drilled hole shall be sampled and tested at least every 2 hours after beginning its use. The slurry shall be sampled midheight and near the bottom of the hole. Slurry shall be recirculated when tests show that the samples taken from midheight and near the bottom of the hole do not have consistent specified properties.

Slurry shall also be sampled and tested prior to final cleaning of the bottom of the hole and again just prior to placing concrete. Samples shall be taken from midheight and near the bottom of the hole. Cleaning of the bottom of the hole and placement of the concrete shall not start until tests show that the samples taken from midheight and near the bottom of the hole have consistent specified properties.

Mineral slurry shall be tested for conformance to the requirements shown in the following table:

MINERAL SLURRY		
PROPERTY	REQUIREMENT	TEST
Density (kg/m ³) - before placement in the drilled hole - during drilling - prior to final cleaning - immediately prior to placing concrete	1030* to 1110* 1030* to 1200*	Mud Weight (Density) API 13B-1 Section 1
Viscosity (seconds/liter) bentonite attapulgate	 29 to 53 29 to 42	Marsh Funnel and Cup API 13B-1 Section 2.2
pH	8 to 10.5	Glass Electrode pH Meter or pH Paper
Sand Content (percent) - prior to final cleaning - immediately prior to placing concrete	 less than or equal to 4.0	Sand API 13B-1 Section 5
*When approved by the Engineer, slurry may be used in salt water, and the allowable densities may be increased up to 32 kg/m ³ . Slurry temperature shall be at least 4 degrees Celsius when tested.		

Any caked slurry on the sides or bottom of hole shall be removed before placing reinforcement. If concrete is not placed immediately after placing reinforcement, the reinforcement shall be removed and cleaned of slurry, the sides of the drilled hole cleaned of caked slurry, and the reinforcement again placed in the hole for concrete placement.

Synthetic Slurry

Synthetic slurries shall be used in conformance with the manufacturer's recommendations and these special provisions. The following synthetic slurries may be used:

PRODUCT	MANUFACTURER
SlurryPro CDP	KB Technologies Ltd. 3648 FM 1960 West Suite 107 Houston, TX 77068 (800) 525-5237
Super Mud	PDS Company c/o Champion Equipment Company 8140 East Rosecrans Ave. Paramount, CA 90723 (562) 634-8180
Shore Pac GCV	CETCO Drilling Products Group 1350 West Shure Drive Arlington Heights, IL 60004 (847) 392-5800

Inclusion of a synthetic slurry on the above list may be obtained by meeting the Department's requirements for synthetic slurries. The requirements can be obtained from the Office of Structure Design, P.O. Box 942874, Sacramento, CA 94274-0001.

Synthetic slurries listed may not be appropriate for a given site.

Synthetic slurries shall not be used in holes drilled in primarily soft or very soft cohesive soils as determined by the Engineer.

A manufacturer's representative, as approved by the Engineer, shall provide technical assistance for the use of their product, shall be at the site prior to introduction of the synthetic slurry into a drilled hole, and shall remain at the site until released by the Engineer.

Synthetic slurries shall be sampled and tested at both mid-height and near the bottom of the drilled hole. Samples shall be taken and tested during drilling as necessary to verify the control of the properties of the slurry. Samples shall be taken and tested when drilling is complete, but prior to final cleaning of the bottom of the hole. When samples are in conformance with the requirements shown in the following tables for each slurry product, the bottom of the hole shall be cleaned and any loose or settled material removed. Samples shall be obtained and tested after final cleaning and immediately prior to placing concrete.

SlurryPro CDP synthetic slurries shall be tested for conformance to the requirements shown in the following table:

SLURRYPRO CDP KB Technologies Ltd.		
PROPERTY	REQUIREMENT	TEST
Density (kg/m ³) - during drilling - prior to final cleaning - just prior to placing concrete	less than or equal to 1075* less than or equal to 1025*	Mud Weight (Density) API 13B-1 Section 1
Viscosity (seconds/liter) - during drilling -prior to final cleaning - just prior to placing concrete	53 to 127 less than or equal to 74	Marsh Funnel and Cup API 13B-1 Section 2.2
pH	6 to 11.5	Glass Electrode pH Meter or pH Paper
Sand Content (percent) - prior to final cleaning - just prior to placing concrete	less than or equal to 0.5	Sand API 13B-1 Section 5
*When approved by the Engineer, slurry may be used in salt water, and the allowable densities may be increased up to 32 kg/m ³ . Slurry temperature shall be at least 4 degrees Celsius when tested.		

Super Mud synthetic slurries shall be tested for conformance to the requirements shown in the following table:

SUPER MUD PDS Company		
PROPERTY	REQUIREMENT	TEST
Density (kg/m ³) - prior to final cleaning - just prior to placing concrete	less than or equal to 1025*	Mud Weight (Density) API 13B-1 Section 1
Viscosity (seconds/liter) - during drilling - prior to final cleaning - just prior to placing concrete	34 to 64 less than or equal to 64	Marsh Funnel and Cup API 13B-1 Section 2.2
pH	8 to 10.0	Glass Electrode pH Meter or pH Paper
Sand Content (percent) - prior to final cleaning -just prior to placing concrete	less than or equal to 0.5	Sand API 13B-1 Section 5
<p>*When approved by the Engineer, slurry may be used in salt water, and the allowable densities may be increased up to 32 kg/m³. Slurry temperature shall be at least 4 degrees Celsius when tested.</p>		

Shore Pac GCV synthetic slurries shall be tested for conformance to the requirements shown in the following table:

Shore Pac GCV CETCO Drilling Products Group		
PROPERTY	REQUIREMENT	TEST
Density (kg/m ³) - prior to final cleaning - just prior to placing concrete	less than or equal to 1025*	Mud Weight (Density) API 13B-1 Section 1
Viscosity (seconds/liter) - during drilling - prior to final cleaning - just prior to placing concrete	35 to 78 less than or equal to 60	Marsh Funnel and Cup API 13B-1 Section 2.2
pH	8.0 to 11.0	Glass Electrode pH Meter or pH Paper
Sand Content (percent) - prior to final cleaning -just prior to placing concrete	less than or equal to 0.5	Sand API 13B-1 Section 5
<p>*When approved by the Engineer, slurry may be used in salt water, and the allowable densities may be increased up to 32 kg/m³. Slurry temperature shall be at least 4 degrees Celsius when tested.</p>		

Water Slurry

At the option of the Contractor water may be used as slurry when casing is used for the entire length of the drilled hole. Water slurry shall be tested for conformance to the requirements shown in the following table:

WATER SLURRY		
PROPERTY	REQUIREMENT	TEST
Density (kg/m ³) - prior to final cleaning - just prior to placing concrete	1017 *	Mud Weight (Density) API 13B-1 Section 1
Sand Content (percent) - prior to final cleaning -just prior to placing concrete	less than or equal to 0.5	Sand API 13B-1 Section 5
*When approved by the Engineer, salt water slurry may be used, and the allowable densities may be increased up to 32 kg/m ³ .		

Construction

The Contractor shall submit a placing plan to the Engineer for approval prior to producing the test batch for cast-in-drilled-hole concrete piling and at least 10 working days prior to constructing piling. The plan shall include complete descriptions, details, and supporting calculations as listed below:

A. Requirements for all cast-in-drilled hole concrete piling:

1. Concrete mix design, certified test data, and trial batch reports.
2. Drilling or coring methods and equipment.
3. Proposed method for casing installation and removal when necessary.
4. Plan view drawing of pile showing reinforcement and inspection pipes, if required.
5. Methods for placing, positioning, and supporting bar reinforcement.
6. Methods and equipment for accurately determining the depth of concrete and actual and theoretical volume placed, including effects on volume of concrete when any casings are withdrawn.
7. Methods and equipment for verifying that the bottom of the drilled hole is clean prior to placing concrete.
8. Methods and equipment for preventing upward movement of reinforcement, including the Contractor's means of detecting and measuring upward movement during concrete placement operations.

B. Additional requirements when concrete is placed under slurry:

1. Concrete batching, delivery, and placing systems, including time schedules and capacities therefor. Time schedules shall include the time required for each concrete placing operation at each pile.
2. Concrete placing rate calculations. When requested by the Engineer, calculations shall be based on the initial pump pressures or static head on the concrete and losses throughout the placing system, including anticipated head of slurry and concrete to be displaced.
3. Suppliers' test reports on the physical and chemical properties of the slurry and any proposed slurry chemical additives, including Material Safety Data Sheet.
4. Slurry testing equipment and procedures.
5. Methods of removal and disposal of excavation, slurry, and contaminated concrete, including removal rates.
6. Methods and equipment for slurry agitating, recirculating, and cleaning.

In addition to compressive strength requirements, the consistency of the concrete to be deposited under slurry shall be verified before use by producing a test batch. The test batch shall be produced and delivered to the project under conditions and in time periods similar to those expected during the placement of concrete in the piles. Concrete for the test batch shall

be placed in an excavated hole or suitable container of adequate size to allow for testing as specified herein. Depositing of test batch concrete under slurry will not be required. In addition to meeting the specified nominal penetration, the test batch shall meet the following requirements:

- A. For piles where the time required for each concrete placing operation, as submitted in the placing plan, will be 2 hours or less, the test batch shall demonstrate that the proposed concrete mix design achieves either a penetration of at least 50 mm or a slump of at least 125 mm after twice that time has elapsed.
- B. For piles where the time required for each concrete placing operation, as submitted in the placing plan, will be more than 2 hours, the test batch shall demonstrate that the proposed concrete mix design achieves either a penetration of at least 50 mm or a slump of at least 125 mm after that time plus 2 hours has elapsed.

The time period shall begin at the start of placement. The concrete shall not be vibrated or agitated during the test period. Penetration tests shall be performed in conformance with the requirements in California Test 533. Slump tests shall be performed in conformance with the requirements in ASTM Designation: C 143. Upon completion of testing, the concrete shall be disposed of in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.

The concrete deposited under slurry shall be carefully placed in a compact, monolithic mass and by a method that will prevent washing of the concrete. Concrete deposited under slurry need not be vibrated. Placing concrete shall be a continuous operation lasting not more than the time required for each concrete placing operation at each pile, as submitted in the placing plan, unless otherwise approved in writing by the Engineer. The concrete shall be placed with concrete pumps and delivery tube system of adequate number and size to complete the placing of concrete in the time specified. The delivery tube system shall consist of one of the following:

- A. A tremie tube or tubes, each of which are at least 250 mm in diameter, fed by one or more concrete pumps.
- B. One or more concrete pump tubes, each fed by a single concrete pump.

The delivery tube system shall consist of watertight tubes with sufficient rigidity to keep the ends always in the mass of concrete placed. If only one delivery tube is utilized to place the concrete, the tube shall be placed near the center of the drilled hole. Multiple tubes shall be uniformly spaced in the hole. Internal bracing for the steel reinforcing cage shall accommodate the delivery tube system. Tremies shall not be used for piles without space for a 250-mm tube.

Spillage of concrete into the slurry during concrete placing operations shall not be allowed. Delivery tubes shall be capped with a watertight cap, or plugged above the slurry level with a good quality, tight fitting, moving plug that will expel the slurry from the tube as the tube is charged with concrete. The cap or plug shall be designed to be released as the tube is charged. The pump discharge or tremie tube shall extend to the bottom of the hole before charging the tube with concrete. After charging the delivery tube system with concrete, the flow of concrete through a tube shall be induced by slightly raising the discharge end. During concrete placement, the tip of the delivery tube shall be maintained as follows to prevent reentry of the slurry into the tube. Until at least 3 m of concrete has been placed, the tip of the delivery tube shall be within 150 mm of the bottom of the drilled hole, and then the embedment of the tip shall be maintained at least 3 m below the top surface of the concrete. Rapid raising or lowering of the delivery tube shall not be permitted. If the seal is lost or the delivery tube becomes plugged and must be removed, the tube shall be withdrawn, the tube cleaned, the tip of the tube capped to prevent entrance of the slurry, and the operation restarted by pushing the capped tube 3 m into the concrete and then reinitiating the flow of concrete.

When slurry is used, a fully operational standby concrete pump, adequate to complete the work in the time specified, shall be provided at the site during concrete placement. The slurry level shall be maintained within 300 mm of the top of the drilled hole.

A log of concrete placement for each drilled hole shall be maintained by the Contractor when concrete is deposited under slurry. The log shall show the pile location, tip elevation, dates of excavation and concrete placement, total quantity of concrete deposited, length and tip elevation of any casing, and details of any hole stabilization method and materials used. The log shall include a 215 mm x 280 mm sized graph of the concrete placed versus depth of hole filled. The graph shall be plotted continuously throughout placing of concrete. The depth of drilled hole filled shall be plotted vertically with the pile tip oriented at the bottom and the quantity of concrete shall be plotted horizontally. Readings shall be made at least at each 1.5 m of pile depth, and the time of the reading shall be indicated. The graph shall be labeled with the pile location, tip elevation, cutoff elevation, and the dates of excavation and concrete placement. The log shall be delivered to the Engineer within one working day of completion of placing concrete in the pile.

After placing reinforcement and prior to placing concrete in the drilled hole, if drill cuttings settle out of the slurry, the bottom of the drilled hole shall be cleaned. The Contractor shall verify that the bottom of the drilled hole is clean.

If temporary casing is used, concrete placed under slurry shall be maintained at a level at least 1.5 m above the bottom of the casing. The withdrawal of casings shall not cause contamination of the concrete with slurry.

Material resulting from using slurry shall be disposed of in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.

Acceptance Testing and Mitigation

Vertical inspection pipes for acceptance testing shall be provided in all cast-in-drilled-hole concrete piles that are 600 mm in diameter or larger, except when the holes are dry or when the holes are dewatered without the use of temporary casing to control ground water.

Inspection pipes shall be Schedule 40 polyvinyl chloride pipes with a nominal inside diameter of 50 mm. Each inspection pipe shall be capped top and bottom and shall have watertight couplers to provide a clean, dry and unobstructed 50-mm diameter clear opening from 1.0 m above the pile cutoff down to the bottom of the reinforcing cage.

If the Contractor drills the hole below the specified tip elevation, the reinforcement and the inspection pipes shall be extended to 75 mm clear of the bottom of the drilled hole.

Inspection pipes shall be placed around the pile, inside the outermost spiral or hoop reinforcement, and 75 mm clear of the vertical reinforcement, at a uniform spacing not exceeding 840 mm measured along the circle passing through the centers of inspection pipes. A minimum of 2 inspection pipes per pile shall be used. When the vertical reinforcement is not bundled and each bar is not more than 26 mm in diameter, inspection pipes may be placed 50 mm clear of the vertical reinforcement. The inspection pipes shall be placed to provide the maximum diameter circle that passes through the centers of the inspection pipes while maintaining the clear spacing required herein. The pipes shall be installed in straight alignment, parallel to the main reinforcement, and securely fastened in place to prevent misalignment during installation of the reinforcement and placing of concrete in the hole.

The Contractor shall log the location of the inspection pipe couplers with respect to the plane of pile cut off, and these logs shall be delivered to the Engineer upon completion of the placement of concrete in the drilled hole.

After placing concrete and before requesting acceptance tests, each inspection pipe shall be tested by the Contractor in the presence of the Engineer by passing a 48.3-mm diameter rigid cylinder 610 mm long through the complete length of pipe. If the 48.3-mm diameter rigid cylinder fails to pass any of the inspection pipes, the Contractor shall attempt to pass a 32.0-mm diameter rigid cylinder 1.375 m long through the complete length of those pipes in the presence of the Engineer. If an inspection pipe fails to pass the 32.0-mm diameter cylinder, the Contractor shall immediately fill all inspection pipes in the pile with water.

The Contractor shall replace each inspection pipe that does not pass the 32.0-mm diameter cylinder with a 50.8-mm diameter hole cored through the concrete for the entire length of the pile. Cored holes shall be located as close as possible to the inspection pipes they are replacing and shall be no more than 150 mm inside the reinforcement. Coring shall not damage the pile reinforcement. Cored holes shall be made with a double wall core barrel system utilizing a split tube type inner barrel. Coring with a solid type inner barrel will not be allowed. Coring methods and equipment shall provide intact cores for the entire length of the pile concrete. The coring operation shall be logged by an Engineering Geologist or Civil Engineer licensed in the State of California and experienced in core logging. Coring logs shall include complete descriptions of inclusions and voids encountered during coring, and shall be delivered to the Engineer upon completion. Concrete cores shall be preserved, identified with the exact location the core was recovered from within the pile, and made available for inspection by the Engineer.

Acceptance tests of the concrete will be made by the Engineer, without cost to the Contractor. Acceptance tests will evaluate the homogeneity of the placed concrete. Tests will include gamma-gamma logging. Tests may also include crosshole sonic logging and other means of inspection selected by the Engineer. The Contractor shall not conduct operations within 8.0 m of the gamma-gamma logging operations. The Contractor shall separate reinforcing steel as necessary to allow the Engineer access to the inspection pipes to perform gamma-gamma logging or other acceptance testing. After requesting acceptance tests and providing access to the piling, the Contractor shall allow 3 weeks for the Engineer to conduct these tests and make determination of acceptance if the 48.3-mm diameter cylinder passed all inspection pipes, and 4 weeks if only the 32.0-mm diameter cylinder passed all inspection pipes. Should the Engineer fail to complete these tests within the time allowance, and if in the opinion of the Engineer, the Contractor's controlling operation is delayed or interfered with by reason of the delay in inspection, the delay will be considered a right of way delay as specified in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

All inspection pipes and cored holes in a pile shall be dewatered and filled with grout after notification by the Engineer that the pile is acceptable. Placement and removal of water in the inspection pipes shall be at the Contractor's expense. Grout shall conform to the provisions in Section 50-1.09, "Bonding and Grouting," of the Standard Specifications. The inspection pipes and holes shall be filled using grout tubes that extend to the bottom of the pipe or hole or into the grout already placed.

If acceptance testing performed by the Engineer determines that a pile does not meet the requirements of the specifications, then that pile will be rejected and all depositing of concrete under slurry or concrete placed using temporary casing for the purpose of controlling groundwater shall be suspended until written changes to the methods of pile construction are approved in writing by the Engineer.

The Contractor shall submit to the Engineer for approval a mitigation plan for repair, supplementation, or replacement for each rejected cast-in-drilled-hole concrete pile, and this plan shall conform to the provisions in Section 5-1.02, "Plans and Working Drawings," of the Standard Specifications. Prior to submitting this mitigation plan, the Engineer will hold a repair feasibility meeting with the Contractor to discuss the feasibility of repairing rejected piling. The Engineer will consider the size of the defect, the location of the defect, and the design information and corrosion protection considerations for the pile. This information will be made available to the Contractor, if appropriate, for the development of the mitigation plan. If the Engineer determines that it is not feasible to repair the rejected pile, the Contractor shall not include repair as a means of mitigation and shall proceed with the submittal of a mitigation plan for replacement or supplementation of the rejected pile.

If the Engineer determines that a rejected pile does not require mitigation due to structural, geotechnical, or corrosion concerns, the Contractor may elect to 1) repair the pile per the approved mitigation plan, or 2) not repair anomalies found during acceptance testing of that pile. For such unrepaired piles, the Contractor shall pay to the State, \$400 per cubic meter for the portion of the pile affected by the anomalies. The volume, in cubic meters, of the portion of the pile affected by the anomalies, shall be calculated as the area of the cross-section of the pile affected by each anomaly, in square meters, as determined by the Engineer, multiplied by the distance, in meters, from the top of each anomaly to the specified tip of the pile. If the volume calculated for one anomaly overlaps the volume calculated for additional anomalies within the pile, the calculated volume for the overlap shall only be counted once. In no case shall the amount of the payment to the State for any such pile be less than \$400. The Department may deduct the amount from any moneys due, or that may become due the Contractor under the contract.

Pile mitigation plans shall include the following:

- A. The designation and location of the pile addressed by the mitigation plan.
- B. A review of the structural, geotechnical, and corrosion design requirements of the rejected pile.
- C. A step by step description of the mitigation work to be performed, including drawings if necessary.
- D. An assessment of how the proposed mitigation work will address the structural, geotechnical, and corrosion design requirements of the rejected pile.
- E. Methods for preservation or restoration of existing earthen materials.
- F. A list of affected facilities, if any, with methods and equipment for protection of these facilities during mitigation.
- G. The State assigned contract number, bridge number, full name of the structure as shown on the contract plans, District-County-Route-Kilometer Post, and the Contractor's (and Subcontractor's if applicable) name on each sheet.
- H. A list of materials, with quantity estimates, and personnel, with qualifications, to be used to perform the mitigation work.
- I. The seal and signature of an engineer who is licensed as a Civil Engineer by the State of California.

For rejected piles to be repaired, the Contractor shall submit a pile mitigation plan that contains the following additional information:

- A. An assessment of the nature and size of the anomalies in the rejected pile.
- B. Provisions for access for additional pile testing if required by the Engineer.

For rejected piles to be replaced or supplemented, the Contractor shall submit a pile mitigation plan that contains the following additional information:

- A. The proposed location and size of additional piling.
- B. Structural details and calculations for any modification to the structure to accommodate the replacement or supplemental piling.

All provisions for cast-in-drilled-hole concrete piling shall apply to replacement piling.

The Contractor shall allow the Engineer 3 weeks to review the mitigation plan after a complete submittal has been received.

Should the Engineer fail to review the complete pile mitigation submittal within the time specified, and if, in the opinion of the Engineer, the Contractor's controlling operation is delayed or interfered with by reason of the delay in reviewing the pile mitigation plan, an extension of time commensurate with the delay in completion of the work thus caused will be granted in conformance with the provisions in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

When repairs are performed, the Contractor shall submit a mitigation report to the Engineer within 10 days of completion of the repair. This report shall state exactly what repair work was performed and quantify the success of the repairs relative to the submitted mitigation plan. The mitigation report shall be stamped and signed by an engineer that is licensed as a Civil Engineer by the State of California. The mitigation report shall show the State assigned contract number, bridge number, full name of the structure as shown on the contract plans, District-County-Route-Kilometer Post, and the

Contractor (and Subcontractor if applicable) name on each sheet. The Engineer will be the sole judge as to whether a mitigation proposal is acceptable, the mitigation efforts are successful, and to whether additional repairs, removal and replacement, or construction of a supplemental foundation is required.

Full compensation for any changes in the cost of constructing cast-in-drilled-hole concrete piling with increased diameters as provided in these special provisions, including the increased quantity of portland cement concrete and any changes in the drilling cost, shall be considered as included in the contract price paid per meter for the size of cast-in-drilled-hole concrete piling shown on the plans, and no separate payment will be made therefor.

Full compensation for slurry, depositing concrete under slurry, test batches, inspection pipes, filling inspection holes and pipes with grout, drilling oversized cast-in-drilled-hole concrete piling, filling cave-ins and oversized piles with concrete, and re-drilling through concrete, shall be considered as included in the contract prices paid per meter for cast-in-drilled-hole concrete piling of the types and sizes listed in the Engineer's Estimate, and no additional compensation will be allowed therefor.

10-1.51 TIEBACK ANCHORS

Anchors at the tieback retaining walls, consisting of holes drilled in foundation material, grouted steel bars or strands, and anchorage assemblies, and testing of installed anchors shall conform to the details shown on the plans, the provisions in Section 50, "Prestressing Concrete," of the Standard Specifications, and these special provisions.

Difficult tieback installation is anticipated due to the presence of caving soils, decomposed to slightly weathered granitic bedrock, dense to very dense compacted granular soils and low overhead clearance.

Temporary casing will be necessary for the top level of tieback tendons to prevent excessive soil erosion beneath the existing bridge footing.

The existing bridge footings shall be monitored for indications of movement during the construction of the top two tieback rows. The monitoring shall include measurement at least twice daily until the tendons are proof-tested and locked off.

The Contractor shall determine the bond length necessary to meet acceptance criteria specified herein.

The submittal of reduced prints of corrected original tracings will not be required for tieback anchor installations.

In fabricating, handling, shipping, and placing tieback anchors, adequate care shall be taken to avoid damage to the sheathing. Damage to the sheathing caused by handling and fabrication prior to tieback anchor installation shall be repaired or replaced as determined by the Engineer. Repair procedure for the sheathing shall be included in the working drawings.

The Contractor may submit, for approval by the Engineer and in conformance with the provisions in Section 5-1.02, "Plans and Working Drawings," of the Standard Specifications, calculations and details for furnishing an alternative number of tiebacks that provide the same horizontal component and distribution of the design force as provided by the planned tiebacks. Alternative wall details shall be furnished, for approval by the Engineer, if the number of tiebacks is reduced. Alternative design calculations and details shall be signed by an engineer who is licensed as a Civil Engineer in the State of California.

MATERIALS

Whenever "member" is referred to in Section 50, "Prestressing Concrete," of the Standard Specifications, it shall be considered to mean tieback anchor.

Structural steel for the tieback retaining wall shall conform to the provisions in Section 55, "Steel Structures," of the Standard Specifications and these special provisions. Structural steel shall consist of the anchorage assembly and the anchorage enclosure. The anchorage assembly and the anchorage enclosure shall be galvanized as indicated on the plans. The provisions of "Welding Quality Control" of these special provisions shall not apply to the anchorage enclosure or to the weld between the steel tube and the bearing plate of the anchorage assembly for tiebacks. Those provisions shall apply to all other welds of structural steel for tieback retaining walls.

The permanent bearing plate of the tieback anchor shall effectively distribute the design force (T) to the shotcrete, such that the concrete bearing stress does not exceed 11 MPa and the bending stress does not exceed $0.55 f_y$ for steel nor $0.36 f_y$ for cast steel or cast iron.

Grout shall conform to the provisions in Section 50-1.09, "Bonding and Grouting," of the Standard Specifications. Fine aggregate may be added to the grout mixture of portland cement and water used outside of the grouted sheathing in drilled holes which are 200 mm or greater in diameter, but only to the extent that the cement content of the grout is not less than 500 kg per cubic meter of grout. Fine aggregate, if used, shall conform to the provisions in Section 90-2, "Materials," and Section 90-3, "Aggregate Gradings," of the Standard Specifications.

The plastic sheathing for tieback anchors shall conform to one of the following: polyvinyl chloride (PVC) sheathing, high density polyethylene (HDPE) sheathing, or polypropylene sheathing.

Corrugated plastic sheathing shall be PVC or HDPE. The width of corrugations, the distance between corrugations, and the height of corrugations of corrugated plastic sheathing shall be approximately the same.

PVC sheathing may be used for corrugated sheathing and smooth sheathing for bar tendons. PVC sheathing shall conform to ASTM Designation: D 1784, Class 13464-B. Corrugated PVC sheathing shall have a nominal wall thickness of 1.0 mm. HDPE sheathing may be used for corrugated sheathing and smooth sheathing for bar tendons. HDPE sheathing shall have a density between 940 kg/m³ and 960 kg/m³ as measured in accordance with ASTM Designation: D 792, A-2. Corrugated HDPE sheathing shall have a nominal wall thickness of 1.5 mm for sheathing with an outside diameter of 75 mm or greater, and a nominal thickness of 1.0 mm for sheathing with an outside diameter less than 75 mm, with a tolerance of minus 0.25-mm.

HDPE sheathing may be used for the smooth sheathing encapsulating individual strands of strand type tendons. Smooth HDPE sheathing for encapsulating strands shall have a minimum wall thickness of 1.0 mm. Polypropylene sheathing may be used for the smooth plastic sheathing encapsulating individual strands of strand type tendons. Polypropylene sheathing shall have a density between 900 kg/m³ and 910 kg/m³. Smooth polypropylene sheathing shall have a minimum wall thickness of 1.0 mm.

The smooth sheathing for the unbonded length of the individual strands shall have sufficient strength to prevent damage during construction operations and shall be watertight, chemically stable without embrittlement or softening, and nonreactive with concrete, steel, or corrosion inhibiting grease. Smooth plastic sheathing, including joints, shall be watertight.

The corrugated sheathing, including joints, shall have sufficient strength to prevent damage during construction operations and shall be grout-tight and watertight, chemically stable without embrittlement or softening, and nonreactive with concrete, steel, or corrosion inhibiting grease.

The transition between the corrugated plastic sheathing and the anchorage assembly shall be an approved detail that allows stressing to the design force without evidence of distress in the corrugated plastic sheathing.

Additional requirements for tiebacks with strand type tendons are as follows:

- A.. The individual strands of a tendon, except for the bonded length, shall be fully coated with corrosion inhibiting grease and then encapsulated by a smooth HDPE or polypropylene sheath. The corrosion inhibiting grease shall fill all space between strand wires and shall encapsulate the strand giving an encasement diameter at least 0.12-mm greater than the diameter of the bare strand. The sheath shall be hot melt extruded onto the strand or shall be shop applied by an approved method that assures that all spaces between the sheath and the strand and between the strand wires are filled with corrosion inhibiting grease.
- B. The corrosion inhibiting grease shall provide a continuous nonbrittle film of corrosion protection to the prestressing steel and lubrication between the strand and the sheathing, shall resist flow from the sheathing, shall be chemically stable and nonreactive with the prestressing steel, sheathing material, and concrete, and shall be organic with appropriate polar, moisture displacing, and corrosion inhibiting additives.
- C. The corrosion inhibiting grease shall have the physical properties listed in Table 3.2.1 of the Post Tensioning Manual, Fourth Edition, by the Post Tensioning Institute and as modified below. At least 40 days before use, a sample from the lot to be used and test results shall be provided for the corrosion inhibiting grease.

Test	Requirements	ASTM Designation:
Water Soluble Ions: Nitrates	10 ppm max.	D 3867
Corrosion Test: 5% Salt Fog @ 38° C. 125 µm coating on 76 mm x 152 mm Q panel Type S, 1000 hrs min.	Grade 7 or better	B 117, D 610
Compatibility with sheathing: Hardness change & volume change of polymer after exposure to grease 40 days at 66° C.	15% max. 10% max.	D 4289, except use D 792 for density

CONSTRUCTION

Tieback anchors shall be installed in accordance with the manufacturer's recommendations. In case of a conflict between the manufacturer's recommendations and these special provisions, these special provisions shall prevail.

Water and grout from tieback anchor construction operations shall not be permitted to fall on public traffic, to flow across shoulders or lanes occupied by public traffic, or to flow into landscaping, gutters, or other drainage facilities. Excessive amounts of water shall not be used in any of the drilling and the tieback anchor installation procedures.

Tieback anchor steel shall be protected prior to completion of all grouting against rust, corrosion and physical damage in conformance with the provisions in Section 50, "Prestressing Concrete," of the Standard Specifications. In addition, there shall be no evidence of distress in the plastic sheathing or crushing of the cement grout within the pregrouted sheathing.

The tieback anchorage assembly shall be protected against rust, corrosion, and physical damage prior to completion of all grouting of enclosure or encasement in concrete.

The tieback anchor installation method selected by the Contractor shall be sufficient to achieve the loadings specified herein. Holes for tieback anchors shall be drilled in the foundation to a depth sufficient to provide the necessary bond length beyond the minimum unbonded length shown on the plans.

Tieback anchorage holes shall be drilled by either the rotary or rotary percussion drilling method.

The top level of tiebacks shall be installed in drilled holes advanced with drill casing. Drill casing shall be removed while filled with grout as the initial grout is being placed.

The diameter of the drilled hole shall be large enough to provide a minimum of 25 mm grout cover within the bonded length of the tendon. Centralizers shall be used within the bonded length of the tendon.

Pregrouting shall occur at least 48 hours before placing the tendon in the drilled hole.

Prior to installing each anchor assembly into the drilled hole, the anchor assembly shall be clean and free of oil, grease, or other extraneous substances, and any damage to the sheathing shall be repaired or replaced.

Grout for all stages of tieback construction shall be injected at the low end of the void being filled and shall be expelled at the high end until there is no evidence of entrapped air, water, or diluted grout. The grout shall be placed using grout tubes, unless another method is approved by the Engineer. The quantity of the grout and the grout pressures shall be recorded.

Voids in the foundation material may be encountered along the length of the drilled hole which may affect drilling and grouting. Measures such as the use of a "grout sock" may be necessary to avoid the excessive loss of grout into the voids encountered.

After placing initial grout, the anchor shall remain undisturbed until the grout has reached a strength sufficient to provide anchorage during testing operations.

Additional requirements for tiebacks with bar type tendons are as follows:

- A. The bar tendons in the unbonded area shall be sheathed with smooth sheathing that extends into the steel tube of the permanent tieback anchorage assembly, as shown on the plans. For this portion of smooth sheathing there is no minimum wall thickness and the sheathing shall be either PVC or HDPE.
- B. In addition, bar tendons shall be sheathed full-length with corrugated sheathing. The annular space between the bar and the corrugated sheathing shall be pregrouted prior to placing the tendons in the drilled hole. The bar shall be centered in the sheathing.
- C. There shall be a seal between the smooth sheathing and the corrugated sheathing at the top and bottom of the length of smooth sheathing.
- D. For bar tendons, the initial grout in the drilled hole may be placed before or after insertion of the bar tendon.
- E. For drilled holes 150 mm in diameter or less, the initial grout outside of the corrugated sheathing shall extend to within 150 mm of the end of the steel tube of the anchorage assembly. Grout in the unbonded length shall not be placed under pressure. For drilled holes greater than 150 mm in diameter, the initial grout outside of the corrugated sheathing shall be within the limits of the bonded length. After placing the initial grout, the anchor shall remain undisturbed until the grout has reached a strength sufficient to provide anchorage during testing operations.

Additional requirements for tiebacks with strand type tendons are as follows:

- A. The Contractor shall have the option of using Alternative A or Alternative B as shown on the plans for tieback tendons.
- B. For Alternative A and Alternative B, strand tendons shall be sheathed with corrugated sheathing. The individual strands within the bonded length shall be separated by spaces so that the entire surface of each strand is bonded in the grout. The maximum spacing of strand spacers shall be 1.50 m. The strand spacers shall be plastic and of a construction and strength that will provide support for the individual strands during construction operations.
- C. For Alternative A, the bonded length of the tendon shall be sheathed with corrugated sheathing and pregrouted full length of the corrugated sheathing before placing the tendon in the hole. The corrugated sheathing shall lap the smooth sheathing on the strands 600 mm. For this alternative, the initial grout in the drilled hole may be placed before or after insertion of the strand tendon.
- D. For Alternative B, the tendon shall be sheathed full length with corrugated sheathing and pregrouted a minimum length of 600 mm before placing the tendon in the hole. After placing the tendon into the drilled hole and before

placing initial grout in the drilled hole, the grout shall be injected at the low end of the corrugated sheathing and the grout shall be expelled at the high end until there is no evidence of entrapped air, water, or diluted grout.

- E. For Alternative A and Alternative B, anchors in holes of 150 mm diameter and smaller shall be initially grouted to within 150 mm of the end of the steel tube. Grout in the unbonded length shall not be placed under pressure. After placing the initial grout, the anchor shall remain undisturbed until the grout has reached a strength sufficient to provide anchorage during testing operations.
- F. For Alternative A and Alternative B, anchors in holes of greater than 150 mm diameter shall be initially grouted within the bond length. After placing the initial grout, the anchor shall remain undisturbed until the grout has reached a strength sufficient to provide anchorage during testing operations.

Testing

All tiebacks shall be load tested by either a performance test or a proof test. Load testing shall be performed against or against the permanent shotcrete wall. The shotcrete shall either attain a compressive strength of 22 MPa or cure for 7 days before loading. Bearing pads shall be kept a minimum of 300 mm away from the edges of the drilled hole. The magnitude of applied test loads shall be determined with a calibrated pressure gauge or a load cell. Movements of the end of the tieback, relative to an independent fixed reference point, shall be measured and recorded to the nearest 0.025 mm at each load increment during the load tests. The Contractor shall perform the measuring and recording and shall furnish the Engineer copies of the recorded movements.

A minimum of 3 tiebacks shall be performance tested per wall. The Engineer shall determine the location of the tiebacks to be performance tested.

The performance test or proof test shall be conducted by measuring the test load applied to the tieback and the tieback end movement during incremental loading and unloading of the anchor in accordance with the loading schedule. The test load shall be held constant for 10 minutes. During the test load hold, the movement of the end of the tendon shall be measured at 1, 2, 3, 4, 5, 6, and 10 minutes. If the total movement between one minute and 10 minutes exceeds one mm, the test load shall be held for an additional 50 minutes. Total movement shall be measured at 15, 20, 25, 30, 45, and 60 minutes. If the test load is held for 60 minutes, a creep curve showing the creep movement between one minute and 60 minutes shall be plotted as a function of the logarithm of time.

LOADING SCHEDULES		
PERFORMANCE TEST		PROOF TEST
	(CONT'D)	
AL	AL	AL
0.25T	0.25T	0.25T
AL	0.50T	0.50T
0.25T	0.75T	0.75T
0.50T	1.00T	1.00T
AL	1.25T	1.25T
0.25T	AL	1.50T (TEST LOAD)
0.50T	0.25T	AL
0.75T	0.50T	
AL	0.75T	
0.25T	1.00T	
0.50T	1.25T	
0.75T	1.50T (TEST LOAD)	
1.00T (CONT'D)	AL	
T = Design force for the anchor shown on the plans		
AL = Alignment load		

For performance and proof tests, each increment of load shall be applied in less than one minute and held for at least one minute but not more than 2 minutes or as specified above. The observation period for the load hold shall start when the pump begins to apply the last increment of load.

The jacking equipment, including the tendon movement measuring system, shall be stable during all phases of the tieback loading operations.

All tiebacks not performance tested shall be proof tested. If 1.5 times the design force cannot be obtained, the tieback shall be redesigned and replaced. Tieback anchors shall not be retested, unless the tieback bond length is post-grouted after the unacceptable test.

A performance tested tieback is acceptable if:

- A. The measured elastic movement exceeds 0.80 of the theoretical elongation of the unbonded length plus the jacking length at the maximum test load; and
- B. The creep movement between one and 10 minutes is less than 1.0 mm.

A proof tested tieback is acceptable if:

- A. The pattern of movements is similar to that of adjacent performance tested tiebacks; and
- B. The creep movement between one and 10 minutes is less than 1.0 mm.

Performance tested or proof tested tiebacks which fail to meet acceptance criterion B will be acceptable if the maximum load is held for 60 minutes and the creep curve plotted from the movement data indicates a creep rate of less than 2.0 mm for the last log cycle of time.

Lock-off

After successful testing of the tiebacks, the tiebacks shall be tensioned against the structure and locked off at a load equal to 1.00 T. The lock-off force is the load on the jacks which is maintained while the anchor head or anchor nuts on the tieback are permanently set. Immediately after lock-off, a lift-off test shall be performed to demonstrate that the specified lock-off force was obtained. Adjustments in the shim thickness shall be made if required to maintain the specified lock-off force.

For strand tendons, the permanent wedges shall be fully set in the anchor head while the tendon is stressed to the test load of 1.50 T, and then locked off at the lock-off force by removal of the shims or other appropriate means.

Grouting to the level of secondary grouting to the dimensions shown on the plans shall be completed only after successful testing and lock-off has been completed. At least 24 hours after the secondary grout has set, the remaining void in the steel tube and bearing plate shall be filled with grout. Grout shall be injected at the low end and expelled at the high end until there is no evidence of entrapped air or water. A minimum grout head of 600 mm shall be maintained until the grout has set.

MEASUREMENT AND PAYMENT

No payment will be made for tiebacks which do not pass the specified testing requirements.

Tieback anchors will be measured and paid for by the unit, and the number for payment will be determined by the requirements of the details shown on the plans. No change in the number of tieback anchors to be paid for will be made because of the use by the Contractor of an alternative number of tiebacks.

The contract unit price paid for tieback anchor shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in constructing the tieback anchors, including special measures taken to contain grout in the drilled hole, testing, and furnishing and installing anchorage assemblies, complete in place, including repair or replacement of sheathing as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.52 CONCRETE STRUCTURES

Portland cement concrete structures shall conform to the provisions in Section 51, "Concrete Structures," of the Standard Specifications and these special provisions.

Attention is directed to "Precast Concrete Quality Control" of these special provisions.

Shotcrete shall not be used as an alternative construction method for reinforced concrete members unless otherwise specified.

Neoprene strip shall be furnished and installed at abutment backwall joint protection in conformance with the details shown on the plans, the provisions in the Standard Specifications, and these special provisions.

Furnishing and installing neoprene strip shall conform to the requirements for strip waterstops as provided in Section 51-1.145, "Strip Waterstops," of the Standard Specifications, except that the protective board will not be required.

FALSEWORK

Falsework shall conform to the provisions in Section 51, "Concrete Structures," of the Standard Specifications and these special provisions.

Welding and Nondestructive Testing

Welding of steel members, except for previously welded splices and except for when fillet welds are used where load demands are less than or equal to 175 N/mm for each 3 mm of fillet weld, shall conform to AWS D1.1 or other recognized

welding standard. The welding standard to be utilized shall be specified by the Contractor on the working drawings. Previously welded splices for falsework members are defined as splices made prior to the member being shipped to the project site.

Splices made by field welding of steel beams at the project site shall undergo nondestructive testing (NDT). At the option of the Contractor, either ultrasonic testing (UT) or radiographic testing (RT) shall be used as the method of NDT for each field weld and any repair made to a previously welded splice in a steel beam. Testing shall be performed at locations selected by the Contractor. The length of a splice weld where NDT is to be performed, shall be a cumulative weld length equal to 25 percent of the original splice weld length. The cover pass shall be ground smooth at the locations to be tested. The acceptance criteria shall conform to the requirements of AWS D1.1, Section 6, for cyclically loaded nontubular connections subject to tensile stress. If repairs are required in a portion of the weld, additional NDT shall be performed on the repaired sections. The NDT method chosen shall be used for an entire splice evaluation including any required repairs.

For all field welded splices, the Contractor shall furnish to the Engineer a letter of certification which certifies that all welding and NDT, including visual inspection, are in conformance with the specifications and the welding standard shown on the approved working drawings. This letter of certification shall be signed by an engineer who is registered as a Civil Engineer in the State of California and shall be provided prior to placing any concrete for which the falsework is being erected to support.

For previously welded splices, the Contractor shall determine and perform all necessary testing and inspection required to certify the ability of the falsework members to sustain the stresses required by the falsework design. This welding certification shall be in writing, shall be signed by an engineer who is registered as a Civil Engineer in the State of California, and shall be provided prior to placing any concrete for which the falsework is being erected to support.

The Contractor's engineer who signs the falsework drawings shall also certify in writing that the falsework is constructed in conformance with the approved drawings and the contract specifications prior to placing concrete. This certification shall include performing any testing necessary to verify the ability of the falsework members to sustain the stresses required by the falsework design. The engineer who signs the drawings may designate a representative to perform this certification. Where falsework contains openings for railroads, vehicular traffic, or pedestrians, the designated representative shall be qualified to perform this work, shall have at least three years of combined experience in falsework design or supervising falsework construction, and shall be registered as a Civil Engineer in the State of California. For other falsework, the designated representative shall be qualified to perform this work and shall have at least three years of combined experience in falsework design or supervising falsework construction. The Contractor shall certify the experience of the designated representative in writing and provide supporting documentation demonstrating the required experience if requested by the Engineer.

ELASTOMERIC BEARING PADS

Elastomeric bearing pads shall conform to the provisions in Section 51-1.12H, "Elastomeric Bearing Pads," of the Standard Specifications and these special provisions.

DECK CRACK TREATMENT

The Contractor shall use all means necessary to minimize the development of shrinkage cracks.

The Contractor shall remove all equipment and materials from the deck and clean the surface as necessary for the Engineer to measure the surface crack intensity. Surface crack intensity will be determined by the Engineer after completion of concrete cure, before prestressing, and before the release of falsework. In any 50-m² portion of deck within the limits of the new concrete deck, should the intensity of cracking be such that there are more than 5 m of cracks whose width at any location exceeds 0.5-mm, the deck shall be treated with methacrylate resin. The area of deck to be treated shall have a width that extends for the entire width of new deck inside the concrete barriers and a length that extends at least 1.5 m beyond the furthest single continuous crack outside the 50-m² portion, measured from where that crack exceeds 0.5-mm in width, as determined by the Engineer.

Deck crack treatment shall consist of test sealing, and furnishing and applying methacrylate resin in conformance with the requirements of these special provisions. If grinding operation is required, deck treatment shall take place before grinding.

Before the start of deck treatment work, the Contractor shall submit for approval by the Engineer, a program for public safety associated with the use of methacrylate resin. The program shall identify materials, equipment, and methods to be used. The Contractor shall not perform deck treatment work, other than that specifically authorized in writing by the Engineer, until the program has been approved.

If the measures being taken by the Contractor are inadequate to provide for public safety associated with use of methacrylate resin, the Engineer will direct the Contractor to revise the operations and the public safety program. Directions for revisions will be in writing and will specify the items in which the Contractor's program is inadequate. No further deck treatment shall be performed until public safety measures are adequate, and a revised program for public safety has been approved.

The Engineer will notify the Contractor of the approval or rejection of any submitted or revised program for public safety associated with the use of methacrylate resin within 10 working days of receipt of the final submitted program.

The State will not be liable to the Contractor for failure to approve all or any portion of an originally submitted or revised program for public safety associated with the use of methacrylate resin, nor for any delays to the work due to the Contractor's failure to submit an acceptable program for public safety associated with the use of methacrylate resin. If the Engineer does not review or approve the program submitted by the Contractor within the time specified and if, in the opinion of the Engineer, the Contractor's controlling operation is delayed or interfered with by reason of the delay in reviewing the program for public safety, the delay will be considered a right of way delay in conformance with the provisions in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

Materials

The material used for treating the deck shall be a low odor, high molecular weight methacrylate resin. Before adding initiator, the resin shall have a maximum volatile content of 30 percent when tested in conformance with the requirements in ASTM Designation: D 2369, and shall conform to the following:

PROPERTY	TEST METHOD	REQUIREMENT
Viscosity Pa·s, maximum, (Brookfield RVT with UL adaptor, 50 RPM at 25°C)	ASTM D 2196	0.025
Specific Gravity minimum, at 25°C	ASTM D 1475	0.90
Flash Point °C, minimum	ASTM D 3278	82
Vapor Pressure mm Hg, maximum, at 25°C	ASTM D 323	1.0
Tack-free time minutes, maximum at 25°C	California Test 551	400
PCC Saturated Surface-Dry Bond Strength MPa, minimum at 24 hours and 21±1°C	California Test 551	3.5
* Test shall be performed before adding initiator.		

A Material Safety Data Sheet shall be furnished before use for each shipment of high molecular weight methacrylate resin.

The promoter and initiator, if supplied separately from the resin, shall not be mixed directly with each other. Containers of promoters and initiators shall not be stored together in a manner that will allow leakage or spillage from one to contact the containers or material of the other.

Testing

The Contractor shall allow 14 days for sampling and testing by the Engineer of the high molecular weight methacrylate resin before proposed use.

The Contractor shall treat a test area within the project limits of approximately 50 m² at a location approved by the Engineer. Conditions during the test treatment shall be similar to those expected on the deck. Equipment used in the test shall be similar to those used for the deck treating operations. If the test area is on the traveled way, traffic shall not be allowed on the treated test area until (1) the treated surface is tack free (non-oily), (2) the sand cover adheres sufficiently to resist brushing by hand, and (3) the coefficient of friction of the deck is at least 0.35 when tested in conformance with the requirements in California Test 342.

Should the above requirements for traffic use not be met, the Contractor shall suspend treating of bridge decks until another test area is treated and complies with the requirements.

Construction

Before deck treatment with methacrylate resin, the bridge deck surface shall be cleaned by abrasive blasting and all loose material shall be blown from visible cracks using high-pressure air. Concrete curing seals shall be cleaned from the deck surface to be treated, and the deck shall be dry when blast cleaning is performed. If the deck surface becomes contaminated at any time before placing the penetrating sealer, the deck surface shall be cleaned by abrasive blasting.

Equipment shall be fitted with suitable traps, filters, drip pans, or other devices as necessary to prevent oil or other deleterious material from being deposited on the deck.

Where abrasive blasting is being performed within 3 m of a lane occupied by public traffic, the residue including dust shall be removed immediately after contact between the abrasive and the surface being treated. The removal shall be by a vacuum attachment operating concurrently with the abrasive blasting operation.

The relative humidity shall be less than 90 percent at time of treatment.

A compatible promoter/initiator system shall be capable of providing a resin gel time of not less than 40 minutes nor more than 1.5 hours at the temperature of application. Gel time shall be adjusted to compensate for the changes in temperature throughout treatment application.

The quantity of resin mixed with promoter and initiator shall be limited to 20 L at a time for manual application.

Machine application of the resin shall be performed by using a two-part resin system using a promoted resin for one part and an initiated resin for the other part. This two-part resin system shall be combined at equal volumes to the spray bars through separate positive displacement pumps. Combining of the 2 components shall be by either static in-line mixers or by external intersecting spray fans. The pump pressure at the spray bars shall not be great enough to cause appreciable atomization of the resin. Compressed air shall not be used to produce the spray. A shroud shall be used to enclose the spray bar apparatus. Hand held spray apparatus shall not be used.

The Contractor shall allow methacrylate resin to be applied only to the specified area. Barrier rails, joints, and drainage facilities shall be adequately protected to prevent contamination by the treatment material. Contaminated items shall be repaired at the Contractor's expense.

The prepared area shall be dry and the surface temperature shall be less than or equal to 38°C when the resin is applied. The rate of application of promoted/initiated resin shall be approximately 2.2 square meters per liter, \pm 0.1 square meter per liter.

The deck surfaces to be treated shall be flooded with resin, allowing penetration into the concrete and filling of all cracks. The treatment shall be applied within 5 minutes after complete mixing. A significant increase in viscosity shall be cause for rejection. Excess material shall be redistributed by squeegees or brooms within 10 minutes after application.

After the resin has been applied, at least 20 minutes shall elapse before applying sand. The sand shall be commercial quality dry blast sand. Ninety-five percent of the sand shall pass the 2.36-mm sieve, and 95 percent shall be retained on the 850- μ m sieve. The sand shall be applied at a rate of one kilogram per square meter, \pm 0.1 kilogram per square meter.

Excess sand shall be removed from the deck surface by vacuuming or sweeping before opening to traffic.

Traffic shall not be allowed on the treated area until (1) the treated surface is tack free (non-oily), (2) the sand cover adheres sufficiently to resist brushing by hand, and (3) the coefficient of friction of the deck is at least 0.35 when tested in conformance with the requirements in California Test 342.

MEASUREMENT AND PAYMENT

Measurement and payment for concrete in structures shall conform to the provisions in Section 51-1.22, "Measurement," and Section 51-1.23, "Payment," of the Standard Specifications and these special provisions.

Full compensation for deck crack treatment, including a program for public safety shall be considered as included in the contract price paid per cubic meter for structural concrete, bridge and no additional compensation will be allowed therefor.

10-1.53 STRUCTURE APPROACH SLABS (Type N)

This work shall consist of constructing reinforced concrete approach slabs structure approach drainage system, and treated permeable base at structure approaches in conformance with the details shown on the plans, the provisions in Section 51, "Concrete Structures," of the Standard Specifications, and these special provisions.

GENERAL

Attention is directed to "Engineering Fabrics" of these special provisions.

STRUCTURE APPROACH DRAINAGE SYSTEM

Geocomposite Drain

Geocomposite drain shall consist of a manufactured core not less than 6.35 mm thick nor more than 50 mm thick with one or both sides covered with a layer of filter fabric that will provide a drainage void. The drain shall produce a flow rate, through the drainage void, of at least 25 liters per minute per meter of width at a hydraulic gradient of 1.0 and a minimum

externally applied pressure of 168 kPa. A Certificate of Compliance conforming to the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications shall be furnished for the geocomposite drain certifying that the drain produces the required flow rate and complies with these special provisions. The Certificate of Compliance shall be accompanied by a flow capability graph for the geocomposite drain showing flow rates and the externally applied pressures and hydraulic gradients. The flow capability graph shall be stamped with the verification of an independent testing laboratory.

Filter fabric for the geocomposite drain shall conform to the provisions for fabric for underdrains in Section 88, "Engineering Fabrics," of the Standard Specifications.

The manufactured core shall be either a preformed grid of embossed plastic, a mat of random shapes of plastic fibers, a drainage net consisting of a uniform pattern of polymeric strands forming 2 sets of continuous flow channels, or a system of plastic pillars and interconnections forming a semirigid mat.

The core material and filter fabric shall be capable of maintaining the drainage void for the entire height of geocomposite drain. Filter fabric shall be integrally bonded to the side of the core material with the drainage void. Core material manufactured from impermeable plastic sheeting having nonconnecting corrugations shall be placed with the corrugations approximately perpendicular to the drainage collection system.

The geocomposite drain shall be installed with the drainage void and the filter fabric facing the embankment. The fabric facing the embankment side shall overlap a minimum of 75 mm at all joints and wrap around the exterior edges a minimum of 75 mm beyond the exterior edge. If additional fabric is needed to provide overlap at joints and wrap-around at edges, the added fabric shall overlap the fabric on the geocomposite drain at least 150 mm and be attached thereto.

Should the fabric on the geocomposite drain be torn or punctured, the damaged section shall be replaced completely or repaired by placing a piece of fabric that is large enough to cover the damaged area and provide a 150-mm overlap.

Plastic Pipe

Plastic pipe shall conform to the provisions for pipe for edge drains and edge drain outlets in Section 68-3, "Edge Drains," of the Standard Specifications.

Treated Permeable Base At Bottom Of Geocomposite Drains

Treated permeable base to be placed around the slotted plastic pipe at the bottom of geocomposite drains shall conform to the provisions in "Treated Permeable Base Under Approach Slabs." If asphalt treated permeable base is used, it shall be placed at a temperature of not less than 82°C nor more than 110°C.

The filter fabric to be placed over the treated permeable base at the bottom of geocomposite drains shall conform to the provisions for filter fabric for edge drains in Section 88, "Engineering Fabrics," of the Standard Specifications.

ENGINEERING FABRICS

Filter fabric to be placed between the structure approach embankment material and the treated permeable base shall conform to the provisions for filter fabric for edge drains in Section 88, "Engineering Fabrics," of the Standard Specifications and these special provisions.

The subgrade to receive the filter fabric, immediately prior to placing, shall conform to the compaction and elevation tolerance specified for the material involved.

Filter fabric shall be aligned, handled, and placed in a wrinkle-free manner in conformance with the manufacturer's recommendations.

Adjacent borders of the filter fabric shall be overlapped from 300 to 450 mm or stitched. The preceding roll shall overlap the following roll in the direction the material is being spread or shall be stitched. When the fabric is joined by stitching, it shall be stitched with yarn of a contrasting color. The size and composition of the yarn shall be as recommended by the fabric manufacturer. The number of stitches per 25 mm of seam shall be 5 to 7.

Equipment or vehicles shall not be operated or driven directly on the filter fabric.

Woven tape fabric shall be treated to provide a minimum of 70 percent breaking strength retention after 500 hours exposure when tested in conformance with the requirements in ASTM Designation: D 4355. The Contractor shall notify the Engineer, in writing, of the source of woven tape fabric at least 45 days prior to use.

TREATED PERMEABLE BASE UNDER APPROACH SLAB

Treated permeable base under structure approach slabs shall consist of constructing either an asphalt treated permeable base or a cement treated permeable base in accordance with Section 29, "Treated Permeable Bases," of the Standard Specifications and these special provisions.

The type of treatment, asphalt or cement, to be used shall be at the option of the Contractor.

The Contractor shall notify the Engineer in writing, not less than 30 days prior to the start of placing the treated permeable base, which type of treated permeable base will be furnished. Once the Contractor has notified the Engineer of the

selection, the type to be furnished shall not be changed without a prior written request to do so and approval thereof in writing by the Engineer.

Asphalt treated permeable base shall be placed at a temperature of not less than 93°C nor more than 121°C. Material stored in excess of 2 hours shall not be used in the work.

Asphalt treated permeable base material may be spread in one layer. The base material shall be compacted with a vibrating shoe type compactor or rolled with a roller weighing at least 1.3 tonnes but no more than 4.5 tonnes. Rolling shall begin as soon as the mixture has cooled sufficiently to support the weight of the rolling equipment without undue displacement.

Cement treated permeable base material may be spread in one layer. The base material shall be compacted with either a vibrating shoe type compactor or with a steel-drum roller weighing at least 1.3 tonnes but no more than 4.5 tonnes. Compaction shall follow within one-half hour after the spreading operation and shall consist of 2 complete coverages of the treated material.

APPROACH SLABS

Concrete for use in approach slabs shall contain not less than 400 kilograms of cementitious material per cubic meter.

Steel components of abutment ties including plates, nuts, washers, and rods shall conform to the provisions in Section 75-1.03, "Miscellaneous Bridge Metal," of the Standard Specifications.

The steel angle at the concrete barrier joint shall conform to the provision in Section 75-1.03, "Miscellaneous Bridge Metal," of the Standard Specifications.

Structure approach slabs shall be cured for not less than 5 days prior to opening to public traffic, unless, at the option of the Contractor, the structure approach slabs are constructed using concrete with a non-chloride Type C chemical admixture conforming to these special provisions.

Portland cement for use in concrete using a non-chloride Type C chemical admixture shall be Type II Modified, Type II Prestress, or Type III. Type II Modified and Type III cement shall conform to the provisions in Section 90-2.01, "Cement," of the Standard Specifications. Type II Prestress cement shall conform to the requirements of Type II Modified cement, except the mortar containing the portland cement to be used and Ottawa sand, when tested in conformance with California Test 527, shall not contract in air more than 0.053-percent.

The non-chloride Type C chemical admixture, approved by the Engineer, shall conform to the requirements in ASTM Designation: C 494 and Section 90-4, "Admixtures," of the Standard Specifications.

The concrete with non-chloride Type C chemical admixture shall be prequalified prior to placement in conformance with the provisions for prequalification of concrete specified by compressive strength in Section 90-9.01, "General," of the Standard Specifications and the following:

- A. Immediately after fabrication of the 5 test cylinders, the cylinders shall be stored in a temperature medium of $21 \pm 1.5^\circ\text{C}$ until the cylinders are tested.
- B. The 6-hour average strength of the 5 test cylinders shall not be less than 5.85 MPa. No more than 2 test cylinders shall have a strength of less than 5.5 MPa.

Building paper shall be commercial quality No. 30 asphalt felt.

Polyvinyl chloride (PVC) conduit used to encase the abutment tie rod shall be of commercial quality.

The top surface of approach slabs shall be finished in conformance with the provisions in Section 51-1.17, "Finishing Bridge Decks," of the Standard Specifications. Edges of slabs shall be edger finished.

Approach slabs shall be cured with pigmented curing compound (1) in conformance with the provisions for curing structures in Section 90-7.01B, "Curing Compound Method," of the Standard Specifications.

Structure approach slabs constructed using concrete with a non-chloride Type C chemical admixture shall be cured for not less than 6 hours prior to opening to public traffic. The curing period shall be considered to begin at the start of discharge of the last truck load of concrete to be used in the slab.

If the ambient temperature is below 18°C during the curing period for approach slabs using concrete with a non-chloride Type C chemical admixture, an insulating layer or blanket shall be used to cover the surface. The insulating layer or blanket shall have an R-value rating given in the table below. At the Contractor's option, a heating tent may be used in lieu of or in combination with the insulating layer or blanket.

Temperature range during curing period	R-value, minimum
13°C to 18°C	1
7°C to 13°C	2
4°C to 7°C	3

JOINTS

Hardboard and expanded polystyrene shall conform to the provisions in Section 51-1.12D, "Sheet Packing, Preformed Pads and Board Fillers," of the Standard Specifications.

Type AL joint seals shall conform to the provisions in Section 51-1.12F, "Sealed Joints" of the Standard Specifications. The sealant may be mixed by hand-held power-driven agitators and placed by hand methods.

The pourable seal between the steel angle and concrete barrier shall conform to the requirements for Type A and AL seals in Section 51-1.12F(3), "Materials and Installation," of the Standard Specifications. The sealant may be mixed by hand-held power-driven agitators and placed by hand methods. Immediately prior to placing the seal, the joint shall be thoroughly cleaned, including abrasive blast cleaning of the concrete surfaces, so that all foreign material and concrete spillage are removed from all joint surfaces. Joint surfaces shall be dry at the time the seal is placed.

MEASUREMENT AND PAYMENT

Structural concrete, approach slab (Type N) will be measured and paid for in conformance with the provisions in Section 51-1.22, "Measurement," and Section 51-1.23, "Payment," of the Standard Specifications and these special provisions.

Full compensation for the structure approach drainage system including geocomposite drain, plastic pipe, and treated permeable base, filter fabric, woven tape fabric, miscellaneous metal and pourable seals shall be considered as included in the contract price paid per cubic meter for structural concrete, approach slab of the type shown in the Engineer's Estimate, and no additional compensation will be allowed therefor.

10-1.54 DRILL AND BOND DOWELS

Drilling and bonding dowels shall conform to the details shown on the plans, the provisions in Section 83-2.02D(1), "General," of the Standard Specifications, and these special provisions.

Dowels shall conform to the provisions for bar reinforcement in "Reinforcement" of these special provisions.

If reinforcement is encountered during drilling before the specified depth is attained, the Engineer shall be notified. Unless the Engineer approves coring through the reinforcement, the hole will be rejected and a new hole, in which reinforcement is not encountered, shall be drilled adjacent to the rejected hole to the depth shown on the plans.

Unless otherwise provided, dowels to be bonded into drilled holes will be paid for as bar reinforcing steel (bridge).

Unless otherwise provided, drilling and bonding dowels will be measured and paid for by the meter determined by the number and the required depth of holes as shown on the plans or as ordered by the Engineer.

The contract price paid per meter for drill and bond dowel shall include full compensation for furnishing all labor, materials (except reinforcing steel dowels), tools, equipment, and incidentals, and for doing all the work involved in drilling the holes, including coring through reinforcement when approved by the Engineer, and bonding the dowels, complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.55 SEALING JOINTS

Joints in concrete bridge decks and joints between concrete structures and concrete approach slabs shall be sealed in conformance with the details shown on the plans, the provisions in Section 51, "Concrete Structures," of the Standard Specifications, and these special provisions.

Where polyurethane seals are shown on the plans, a silicone sealant conforming to the provisions in Section 51-1.12F, "Sealed Joints," of the Standard Specifications may be used.

When ordered by the Engineer, a joint seal larger than called for by the Movement Rating shown on the plans shall be furnished and installed. Payment to the Contractor for furnishing the larger seal and for saw cutting the increment of additional depth of groove required will be determined as provided in Section 4-1.03, "Changes," of the Standard Specifications.

10-1.56 REFINISHING BRIDGE DECKS

Surfaces of bridge decks that are exposed when existing railings, curbs, or sidewalks are removed shall be prepared and refinished flush with the adjoining deck surface with portland cement concrete or rapid setting concrete, at the option of the Contractor, in conformance with these special provisions.

The exact area to be refinished will be designated by the Engineer.

Attention is directed to "Public Safety" of these special provisions.

When work is being performed within 3 m of a traffic lane or performed over traffic, dust and residue from deck preparation and cleaning shall be removed or controlled by vacuum, water spray, or shield methods approved by the Engineer.

Concrete shall be removed without damage to concrete that is to remain in place. Damage to concrete which is to remain in place shall be repaired to a condition satisfactory to the Engineer.

The concrete in deck areas to be refinished shall be removed to a depth of approximately 20 mm below the adjoining deck surface. A 20 mm deep saw cut shall be made along the perimeter of areas prior to removing the concrete.

Existing areas of the deck more than 20 mm below the adjoining deck surface shall be prepared by removing not less than 6 mm of surface material to expose sound aggregates.

Concrete removal may be done by abrasive blast cutting, abrasive sawing, impact tool cutting, machine rotary abrading, or by other methods, all to be approved by the Engineer. Cut areas shall be cleaned free of dust and all other loose and deleterious materials by brooming, abrasive blast cleaning, and high pressure air jets. Equipment shall be fitted with suitable traps, filters, drip pans or other devices to prevent oil or other deleterious matter from being deposited on the deck.

Existing reinforcement, exposed during the removal of concrete, that is to remain in place shall be protected from damage.

Steel dowels shall be cut off flush with the existing concrete or cut off at the bottom of concrete removal, whichever is lower. Patching around or over dowels in sound concrete will not be required. Existing voids around dowels, where refinishing is not required, shall be chipped back to sound concrete, the dowels removed 25 mm below the finished surface, and the hole filled with rapid setting concrete.

Refinishing isolated high areas in the existing deck may be accomplished by cutting the concrete down to be flush with the plane of the adjoining deck surface by abrasive sawing, grinding, impact tool cutting, or by other methods to be approved by the Engineer. When grinding is performed to bring the deck concrete flush with the adjoining deck surface, the resulting surface shall have a coefficient of friction of not less than 0.35 as determined by California Test 342.

PORTLAND CEMENT CONCRETE

An epoxy adhesive shall be applied to the surfaces to be refinished before placing the portland cement concrete. Immediately prior to applying the adhesive, the area to receive the adhesive shall be cleaned by abrasive blasting and blown clean by compressed air to remove dust and any other loose material. The area to be covered shall be surface dry and the ambient temperature shall be 10°C or above when the adhesive is applied.

The epoxy adhesive shall be furnished and applied in conformance with the provisions in Section 95-1, "General," and Section 95-2.03, "Epoxy Resin Adhesive for Bonding New Concrete to Old Concrete," of the Standard Specifications. Whenever the ambient temperature is below 18°C, Type II epoxy shall be used. The exact rate of applying epoxy adhesive will be as determined by the Engineer. The adhesive shall be worked onto the surface with stiff brushes or equal.

Portland cement concrete used to fill the prepared areas shall conform to the provisions in Section 90, "Portland Cement Concrete," of the Standard Specifications and the following:

- A. The concrete shall contain a minimum of 400 kilograms of portland cement per cubic meter.
- B. The amount of free water used in concrete shall not exceed 166 kg/m³.
- C. The aggregate shall contain between 50 and 55 percent fine aggregate and the remainder shall be pea gravel. The grading of pea gravel shall be such that 100 percent passes the 12.5 mm screen and not more than 5 percent passes the 1.18 mm sieve, unless a larger size is ordered by the Engineer.
- D. Admixtures shall be furnished and used if directed by the Engineer.
- E. Immediately after depositing on the newly placed adhesive, the portland cement concrete shall be thoroughly consolidated until all voids are filled and free mortar appears on the surface and then struck off to the required grade.
- F. Concrete shall be cured as provided in Section 90-7.03, "Curing Structures," of the Standard Specifications.
- G. No loads of any kind shall be applied to the portland cement concrete for at least 7 days after placing, unless otherwise permitted by the Engineer.

RAPID SETTING CONCRETE

The concrete used to fill the prepared areas shall be a high-strength material consisting of either magnesium phosphate concrete, modified high alumina based concrete, or portland cement based concrete. Magnesium phosphate concrete shall conform to the requirements for magnesium phosphate concrete in Section 83-2.02D(1), "General," of the Standard Specifications and these special provisions. Modified high alumina based concrete and portland cement based concrete shall be water activated and shall conform to the requirements for single component (water activated) magnesium phosphate concrete in Section 83-2.02D(1), "General," of the Standard Specifications and the following:

- A. A clean uniform rounded aggregate filler may be used to extend the concrete. The moisture content of the aggregate shall not exceed 0.5-percent. Grading of the aggregate shall conform to the following:

Sieve Size	Percentage Passing
12.5 mm	100
1.18 mm	0-5

- B. The amount of aggregate filler shall conform to the manufacturer's recommendation, but in no case shall the concrete strengths be less than that specified for magnesium phosphate concrete in Section 83-2.02D(1), "General," of the Standard Specifications.
- C. Mixing of components of dual component (with a prepackaged liquid activator) magnesium phosphate shall be by complete units, supplied by the manufacturer. Portions of units shall not be used. Water shall not be added to dual component magnesium phosphate.
- D. Immediately prior to applying the rapid setting concrete, the surface shall be dry and blown clean by compressed air to remove accumulated dust and any other loose material. If the surface becomes contaminated at any time prior to placing the concrete, the surface shall be cleaned by abrasive blasting. The surface temperature of the areas to be covered shall be 4°C or above when the concrete is applied. Methods proposed to heat said surfaces are subject to approval by the Engineer. The surface for the magnesium phosphate concrete shall be dry. The surfaces for modified high alumina based concrete or portland cement based concrete may be damp but not saturated.
- E. Magnesium phosphate concrete shall not be mixed in containers or worked with tools containing zinc, cadmium, aluminum or copper. Modified high alumina based concrete shall not be mixed in containers or worked with tools containing aluminum.
- F. Concrete shall not be retempered. Finishing tools that are cleaned with water shall be thoroughly dried before working the concrete.
- G. When placing concrete on slopes exceeding 5 percent, the Engineer may require the Contractor to provide a flow controlled modified material.
- H. Modified high alumina based concrete and portland cement based concrete shall be cured in conformance with the provisions in Section 90-7.01B, "Curing Compound Method," of the Standard Specifications. Magnesium phosphate concrete shall not be cured.
- I. Unless otherwise permitted in writing by the Engineer, public traffic shall not be permitted on the new concrete until at least 24 hours after final set.

FINISHING REQUIREMENTS

In advance of the curing operations, the surface of the concrete shall be textured by brooming with a stiff bristled broom or by other suitable devices which will result in uniform scoring. Brooming shall be performed transversely. The operation shall be performed at a time and in a manner that produces a hardened surface having a uniform texture and a coefficient of friction of not less than 0.35 as determined by California Test 342.

Refinished surfaces that are found to have a coefficient of friction less than 0.35 shall be ground or grooved by the Contractor at his expense in conformance with the applicable provisions in Section 42, "Groove and Grind Pavement," of the Standard Specifications.

In the longitudinal direction, refinished surfaces shall not vary more than 6 mm from the lower edge of a 3.6 m straightedge. The refinished surface shall be flush with the existing adjoining surface.

MEASUREMENT AND PAYMENT

No adjustment of compensation will be made for any increase or decrease in the quantity of refinish bridge deck, regardless of the reason for the increase or decrease. The provisions in Section 4-1.03B, "Increased or Decreased Quantities," of the Standard Specifications shall not apply to the contract item of refinish bridge deck.

The quantity in square meters of refinish bridge deck to be paid for will be determined from the lengths and widths of the refinished areas, measured horizontally, plus 0.02-m² for patching around each dowel.

The contract price paid per square meter for refinish bridge deck shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in refinishing areas of the existing bridge deck (including cutting steel dowels), complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.57 ARCHITECTURAL SURFACE (TEXTURED CONCRETE)

Architectural texture for concrete surfaces shall conform to the details shown on the plans and the provisions in Section 51, "Concrete Structures," of the Standard Specifications and these special provisions.

Architectural textures listed below are required at concrete surfaces shown on the plans:

- A. Architectural surface (sconce)
- B. Architectural surface (barrier)
- C. Architectural surface (pilaster)
- D. Architectural surface (pedestal)
- E. Swirled plaster texture
- F. Barrier title texture

The architectural swirled plaster texture shall simulate a formed relief constructed to the dimensions and shapes shown on the plans. Corners at the intersection of plane surfaces shall be sharp and crisp without easing or rounding. A Class 1 surface finish shall be applied to the architectural texture.

REFEREE SAMPLE

The architectural texture shall match the texture, color and pattern of the referee sample located at the Office of the District Director of Transportation at 2829 Juan Street, San Diego, CA. 92110, Telephone (619) 688-6635 available for inspection by bidders.

TEST PANEL

A test panel at least 1.25 m x 1.25 m in size shall be successfully completed at a location approved by the Engineer before beginning work on architectural textures. The test panel shall be constructed and finished with the materials, tools, equipment and methods to be used in constructing the architectural texture. If ordered by the Engineer, additional test panels shall be constructed and finished until the specified finish, texture and color are obtained, as determined by the Engineer.

The test panel approved by the Engineer shall be used as the standard of comparison in determining acceptability of architectural texture for concrete-surfaces.

FORM LINERS

Form liners shall be used for textured concrete surfaces and shall be installed in conformance with the manufacturer's recommendations, unless other methods of forming textured concrete surfaces are approved by the Engineer. Form liners shall be manufactured from an elastomeric material or a semi-elastomeric polyurethane material by a manufacturer of commercially available concrete form liners. No substitution of other types of formliner material will be allowed. Form liners shall leave crisp, sharp definition of the architectural surface. Recurring textural configurations exhibited by repeating, recognizable shadow patterns shall be prevented by proper casting of form liner patterns. Textured concrete surfaces with such recurring textural configurations shall be reworked to remove such patterns as approved by the Engineer or the concrete shall be replaced.

Form liners shall have the following properties:

Description	ASTM Designation:	Range
Elastomeric material		
Shore A hardness	D 2240	20 to 65
Tensile strength (MPa)	D 412	0.9 to 6.2
Semi-elastomeric polyurethane		
Shore D hardness	D 2240	55 to 65
Tensile strength (MPa)	D 2370	18 minimum

Cuts and tears in form liners shall be sealed and repaired in conformance with the manufacturer's recommendations. Form liners that are delaminated from the form shall not be used. Form liners with deformations to the manufactured surface caused by improper storage practices or any other reason shall not be used.

Form liners shall extend the full length of texturing with transverse joints at 2.5 m minimum spacing. Small pieces of form liners shall not be used. Grooves shall be aligned straight and true. Grooves shall match at joints between form liners. Joints in the direction of grooves in grooved patterns shall be located only in the depressed portion of the textured concrete. Adjoining liners shall be butted together without distortion, open cracks or offsets at the joints. Joints between liners shall be cleaned before each use to remove any mortar in the joint.

Adhesives shall be compatible with the form liner material and with concrete. Adhesives shall be approved by the liner manufacturer. Adhesives shall not cause swelling of the liner material.

RELEASING FORM LINERS

Products and application procedures for form release agents shall be approved by the form liner manufacturer. Release agents shall not cause swelling of the liner material or delamination from the forms. Release agents shall not stain the concrete or react with the liner material. For reliefs simulating fractured concrete or wood grain surfaces the application method shall include the scrubbing method using a natural bristle scrub brush in the direction of grooves or grain. The release agent shall coat the liner with a thin film. Following application of form release agent, the liner surfaces shall be cleaned of excess amounts of agent using compressed air. Buildup of form release agent caused by the reuse of a liner shall be removed at least every 5 uses.

Form liners shall release without leaving particles or pieces of liner material on the concrete and without pulling or breaking concrete from the textured surface. The concrete surfaces exposed by removing forms shall be protected from damage.

ABRASIVE BLASTING

The architectural texture shall be abrasive blasted with fine abrasive to remove the sheen without exposing coarse aggregate.

CURING

Concrete surfaces with architectural texture shall be cured only by the forms-in-place or water methods. Seals and curing compounds shall not be used.

MEASUREMENT AND PAYMENT

Architectural texture will be measured and paid for by the square meter.

The contract price paid per square meter for architectural texture of the types listed in the Engineer's Estimate shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in architectural texture, complete in place, including test panels, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

Full compensation for architectural treatment on pilasters, pedestals and sconces shall be considered as included in the contract price paid for items of work involved and no separate payment will be allowed therefor.

Full compensation for architectural treatment on precast concrete panels for mechanically stabilized embankment shall be considered as included in the contract price paid per square meter for earth retaining structure involved and no separate payment will be allowed therefor.

10-1.58 REINFORCEMENT

Reinforcement shall conform to the provisions in Section 52, "Reinforcement," of the Standard Specifications and these special provisions.

The Department's mechanical splices prequalified list can be found at the following internet site:

http://www.dot.ca.gov/hq/esc/approved_products_list/

The provisions of "Welding Quality Control" of these special provisions shall not apply to resistance butt welding.

When joining new reinforcing bars to existing reinforcement, sample splices shall be made using only the deformation pattern of the new reinforcement to be spliced.

Reinforcement shown on the plans to be galvanized shall be galvanized in conformance with the provisions in Section 75-1.05, "Galvanizing," of the Standard Specifications.

MEASUREMENT AND PAYMENT

Measurement and payment for reinforcement in structures shall conform to the provisions in Section 52-1.10, "Measurement," and Section 52-1.11, "Payment," of the Standard Specifications and these special provisions.

Full compensation for galvanizing steel reinforcement shall be considered as included in the prices paid for the various items of work involved and no additional compensation will be allowed therefor.

10-1.59 SHOTCRETE

Shotcrete shall conform to the provisions in Section 51, "Concrete Structures," and Section 53, "Shotcrete," of the Standard Specifications and these special provisions.

Shotcrete operations shall completely encase all reinforcement and other obstructions shown on the plans. Exceptional care shall be taken to properly encase the reinforcement and other obstructions with shotcrete.

Attention is directed to the section, "Order of Work," in these special provisions regarding furnishing preconstruction shotcrete test panels.

Except for finish coats, shotcrete shall be applied by the wet-mix process only.

Finish coats, applied by the dry-mix process, may be used only when approved by the Engineer.

Shotcrete shall have a minimum compressive strength of 22.5 MPa at 28 days or as shown on the plans, whichever is greater. No shotcrete work shall be performed prior to verification by the Engineer of the required compressive strength.

Splicing of reinforcing bars No. 22 or larger in shotcrete shall be by butt splicing only.

The Contractor shall be responsible for obtaining and testing all required preconstruction and production test cores. All coring and testing shall be at the Contractor's expense and performed in the presence of the Engineer, unless otherwise directed. The Engineer shall be notified a minimum of 24 hours prior to the Contractor performing any coring or testing operations.

All cores shall be obtained and tested for compressive strength in conformance with the requirements in ASTM Designation: C 42. Cores used for determining compressive strength shall not contain any bar reinforcement or other obstructions. The testing shall be performed at an independent testing facility approved by the Engineer. A copy of the test results shall be furnished to the Engineer within 5 days following completion of testing.

All test panels shall become the property of the Contractor and shall be disposed of in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.

PRECONSTRUCTION REQUIREMENTS

Prior to performing shotcrete work, the Contractor shall construct at least 2 preconstruction shotcrete test panels for each mixture being considered unless otherwise specified.

The nozzleperson shall have a minimum of 3000 hours experience as a nozzleperson on projects with a similar application.

At least 10 working days prior to constructing any shotcrete test panels, the Contractor shall submit to the Engineer for approval, a Quality Control Plan (QCP) for the proposed method of shotcrete placement. The plan shall include the following:

- A. The number and qualifications of nozzlepersons available to place shotcrete, the number of nozzlepersons on-site at any time during the shotcrete placement, description of their work schedule, and the procedures for avoiding fatigue of any nozzleperson.
- B. The proposed method of placing shotcrete, including, but not limited to, application rates, details of any proposed construction joints and their locations, and methods for achieving the required thickness and surface finish.
- C. The procedure for curing shotcrete surfaces.
- D. The description of a debris containment system, to be used during the cleaning of bar reinforcing steel and concrete and placing of shotcrete, as required to provide for public safety.

The Engineer shall have 10 working days to review and approve the QCP submittal after a complete plan has been received. No construction of shotcrete test panels shall be performed until the QCP is approved by the Engineer. Should the Engineer fail to complete the review within this time allowance, and if, in the opinion of the Engineer, the Contractor's controlling operation is delayed or interfered with by reason of the delay in approving the QCP, the delay will be considered a right of way delay in conformance with the provisions in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

Preconstruction shotcrete test panels shall be constructed by the nozzlepersons and application crew scheduled to do the work, using equipment, materials, mixing proportions, ambient temperatures and procedures proposed for the work. The preconstruction shotcrete test panels shall conform to the following:

- A. One shotcrete test panel, of the size determined by the Contractor, shall be unreinforced and shall have 3 cores taken from it and tested for compressive strength. The compressive strength shall be the average strength of the 3 cores, except that, if any core should show evidence of improper coring, the core shall be discarded and the compressive strength shall be the average strength of the remaining cores. The test panel shall be identified and submitted to the Engineer with the test results including a description of the mixture, proportions, and ambient temperature.
- B. One shotcrete test panel shall have the same (1) thickness, (2) bar size and amount of bar reinforcement or other obstructions and (3) positioning of bar reinforcement or obstructions as the most heavily reinforced section of shotcrete to be placed. The test panel shall be square with the length of the sides equal to at least 3 times the thickness of the most heavily reinforced section of shotcrete to be placed, but not less than 750 mm. After a minimum 7 days of cure, the test panel shall be broken by the Contractor, in the presence of the Engineer, into pieces no larger than 250 mm in greatest dimension. The surfaces of the broken pieces shall be dense and free of laminations and sand pockets, and shall verify that the bar reinforcement or other obstructions are completely encased.
- C. Both test panels shall be cured under conditions similar to the actual work.
- D. At the option of the Contractor, cores to be used for determining the compressive strength may be taken from the reinforced test panel described above in lieu of making a separate unreinforced test panel as described above. The compressive strength shall be the average strength of the 3 cores, except that, if any core should show evidence of improper coring or contains bar reinforcement or other obstructions, the core shall be discarded and the compressive strength shall be the average strength of the remaining cores. If cores are taken from the reinforced test panel, the panel shall not be broken into pieces, as described above, until it has cured for a minimum of 14 days.

The requirements for constructing preconstruction shotcrete test panels may be eliminated, when approved by the Engineer, if a test panel report and certified compressive strength test data are furnished from a State highway project with a similar application of approximately equal thickness, including similar amounts and placement of reinforcement or other obstructions. The nozzle person, proposed to be used, shall have constructed the test panel described in the test panel report. The test panel report shall list the names of the application crew, equipment used, materials, mixing proportions, ambient temperatures and procedures used to make the test panels. The certified compressive strength test data shall be for cores taken from the same test panels.

PLACING

An air blowpipe shall be used during shotcrete placement to remove rebound, overspray and other debris from the areas to receive shotcrete.

Construction joints shall be tapered, and shall conform to the provisions in Sections 51-1.13, "Bonding," of the Standard Specifications.

All overspray and rebound shall be removed prior to final set and before placement of shotcrete on adjacent surfaces.

Rebound or any other material which has already exited the nozzle shall not be reused.

Shotcrete shall be cured in conformance with the provisions of Section 90-7.03, "Curing Structures," of the Standard Specifications.

When a finish coat is to be used, all loose, uneven or excess material, glaze, and rebound shall be removed by brooming, scraping, or other means and the surface left scarified. Any surface deposits which take a final set shall be removed by abrasive blasting. Prior to placing the finish coat, the receiving surface shall be washed down with an air-water blast.

Shotcrete extending into the space shown on the plans for cast-in-place concrete shall be removed.

TESTING AND ACCEPTANCE

At least 3 production shotcrete test cores shall be taken from each 30 square meters or portion thereof of shotcrete placed each day. The cores shall be 76 mm in diameter. The location where cores are to be taken will be designated by the Engineer. Test cores shall be identified by the Contractor and a description of the core location and mixture, including proportions, shall be submitted to the Engineer with the test cores, immediately after coring. Cored holes shall be filled with mortar in conformance with the provisions in Section 51-1.135, "Mortar," of the Standard Specifications.

Upon receipt of the cores, the Engineer will perform a visual examination to determine acceptance, as described below. Within 48 hours after receipt, the Engineer will return the cores to the Contractor for compressive strength testing.

The compressive strength test shall be performed using the shotcrete production test cores described above. The compressive strength shall be the average strength of the 3 cores, except that, if any core should show evidence of improper coring, the core shall be discarded and the compressive strength shall be the average strength of the remaining cores.

The basis of acceptance for production shotcrete test cores shall be (1) that the core is dense and free of laminations and sand pockets, and shows that the reinforcement or other obstructions are completely encased and (2) the same as specified for test cylinders in the fourth and fifth paragraphs of Section 90-9.01, "General," of the Standard Specifications.

If any production test core shows signs of defective shotcrete as described in (1) above, the shotcrete represented by such test core will be rejected, unless the Contractor, at the Contractor's expense, obtains and submits evidence acceptable to the Engineer that the strength and quality of the shotcrete placed in the work are acceptable.

The surface finish of the shotcrete shall conform to the provisions of Section 51-1.18, "Surface Finishes," of the Standard Specifications.

MEASUREMENT AND PAYMENT

Full compensation for the Quality Control Plan, constructing and breaking test panels, furnishing and testing cores and patching cored holes shall be considered as included in the contract price paid per cubic meter for shotcrete and no additional compensation will be allowed therefor.

10-1.60 STEEL STRUCTURES

Construction of steel structures shall conform to the provisions in Section 55, "Steel Structures," of the Standard Specifications and these special provisions.

Attention is directed to "Welding" in Section 8, "Materials," of these special provisions.

The following substitutions of high-strength steel fasteners shall be made:

METRIC SIZE SHOWN ON THE PLANS	SIZE TO BE SUBSTITUTED
ASTM Designation: A 325M (Nominal bolt diameter (mm))	ASTM Designation: A 325 (Nominal bolt diameter (inch))
13, 12.70, or M12	1/2
16, 15.88, or M16	5/8
19, 19.05, or M20	3/4
22, 22.22, or M22	7/8
24, 25, 25.40, or M24	1
29, 28.58, or M27	1 1/8
32, 31.75, or M30	1 1/4
38, 38.10, or M36	1 1/2

MATERIALS

High-strength fastener assemblies and other bolts attached to structural steel with nuts and washers shall be zinc-coated. When direct tension indicators are used in these assemblies, the direct tension indicator and all components of the fastener assembly shall be zinc-coated by the mechanical deposition process.

ROTATIONAL CAPACITY TESTING PRIOR TO SHIPMENT TO JOB SITE

Rotational capacity tests shall be performed on all lots of high-strength fastener assemblies prior to shipment of these lots to the project site. Zinc-coated assemblies shall be tested after all fabrication, coating, and lubrication of components has been completed. One hardened washer shall be used under each nut for the tests.

The requirements of this section do not apply to high-strength cap screws or high-strength bolts used for slip base plates.

Each combination of bolt production lot, nut lot, and washer lot shall be tested as an assembly.

A rotational capacity lot number shall be assigned to each combination of lots tested. Each shipping unit of fastener assemblies shall be plainly marked with the rotational capacity lot number.

Two fastener assemblies from each rotational capacity lot shall be tested.

The following equipment, procedure, and acceptance criteria shall be used to perform rotational capacity tests on and determine acceptance of long bolts. Fasteners are considered to be long bolts when full nut thread engagement can be achieved when installed in a bolt tension measuring device:

A. Long Bolt Test Equipment:

1. Calibrated bolt tension measuring device with adequate tension capacity for the bolts being tested.
2. Calibrated dial or digital torque wrench. Other suitable tools will be required for performing Steps 7 and 8 of the Long Bolt Test Procedure. A torque multiplier may be required for large diameter bolts.
3. Spacer washers or bushings. When spacer washers or bushings are required, they shall have the same inside diameter and equal or larger outside diameter as the appropriate hardened washers conforming to the requirements in ASTM Designation: F436.

4. Steel beam or member, such as a girder flange or cross frame, to which the bolt tension measuring device will be attached. The device shall be accessible from the ground.

B. Long Bolt Test Procedure:

1. Measure the bolt length. The bolt length is defined as the distance from the end of the threaded portion of the shank to the underside of the bolt head.
2. Install the nut on the bolt so that 3 to 5 full threads of the bolt are located between the bearing face of the nut and the underside of the bolt head. Measure and record the thread stickout of the bolt. Thread stickout is determined by measuring the distance from the outer face of the nut to the end of the threaded portion of the shank.
3. Insert the bolt into the bolt tension measuring device and install the required number of washers, and additional spacers as needed, directly beneath the nut to produce the thread stickout measured in Step 2 of this procedure.
4. Tighten the nut using a hand wrench to a snug-tight condition. The snug tension shall not be less than the Table A value but may exceed the Table A value by a maximum of 2 kips.

Table A

High-Strength Fastener Assembly Tension Values to Approximate Snug-Tight Condition	
Bolt Diameter (inches)	Snug Tension (kips)
1/2	1
5/8	2
3/4	3
7/8	4
1	5
1 1/8	6
1 1/4	7
1 3/8	9
1 1/2	10

5. Match-mark the assembly by placing a heavy reference start line on the face plate of the bolt tension measuring device which aligns with 1) a mark placed on one corner of the nut, and 2) a radial line placed across the flat on the end of the bolt, or on the exposed portions of the threads of tension control bolts. Place an additional mark on the outside of the socket that overlays the mark on the nut corner such that this mark will be visible while turning the nut. Make an additional mark on the face plate, either 2/3 of a turn, one turn, or 1 1/3 turn clockwise from the heavy reference start line, depending on the bolt length being tested as shown in Table B.

Table B

Required Nut Rotation for Rotational Capacity Tests (a,b)	
Bolt Length (measured in Step 1)	Required Rotation (turn)
4 bolt diameters or less	2/3
Greater than 4 bolt diameters but no more than 8 bolt diameters	1
Greater than 8 bolt diameters, but no more than 12 bolt diameters (c)	1 1/3
<p>(a) Nut rotation is relative to bolt, regardless of the element (nut or bolt) being turned. For bolts installed by 1/2 turn and less, the tolerance shall be plus or minus 30 degrees; for bolts installed by 2/3 turn and more, the tolerance shall be plus or minus 45 degrees.</p> <p>(b) Applicable only to connections in which all material within grip of the bolt is steel.</p> <p>(c) When bolt length exceeds 12 diameters, the required rotation shall be determined by actual tests in a suitable tension device simulating the actual conditions.</p>	

- Turn the nut to achieve the applicable minimum bolt tension value listed in Table C. After reaching this tension, record the moving torque, in foot-pounds, required to turn the nut, and also record the corresponding bolt tension value in pounds. Torque shall be measured with the nut in motion. Calculate the value, T (in ft-lbs), where $T = [(the\ measured\ tension\ in\ pounds) \times (the\ bolt\ diameter\ in\ inches) / 48\ in/ft]$.

Table C

Minimum Tension Values for High-Strength Fastener Assemblies	
Bolt Diameter (inches)	Minimum Tension (kips)
1/2	12
5/8	19
3/4	28
7/8	39
1	51
1 1/8	56
1 1/4	71
1 3/8	85
1 1/2	103

- Turn the nut further to increase bolt tension until the rotation listed in Table B is reached. The rotation is measured from the heavy reference line made on the face plate after the bolt was snug-tight. Record this bolt tension.
- Loosen and remove the nut and examine the threads on both the nut and bolt.

C. Long Bolt Acceptance Criteria:

- An assembly shall pass the following requirements to be acceptable: 1) the measured moving torque (Step 6) shall be less than or equal to the calculated value, T (Step 6), 2) the bolt tension measured in Step 7 shall be greater than or equal to the applicable turn test tension value listed in Table D, 3) the nut shall be able to be

removed from the bolt without signs of thread stripping or galling after the required rotation in Step 7 has been achieved, 4) the bolt does not shear from torsion or fail during the test, and 5) the assembly does not seize before the final rotation in Step 7 is reached. Elongation of the bolt in the threaded region between the bearing face of the nut and the underside of the bolt head is expected and will not be considered a failure. Both fastener assemblies tested from one rotational capacity lot shall pass for the rotational capacity lot to be acceptable.

Table D

Turn Test Tension Values	
Bolt Diameter (inches)	Turn Test Tension (kips)
1/2	14
5/8	22
3/4	32
7/8	45
1	59
1 1/8	64
1 1/4	82
1 3/8	98
1 1/2	118

The following equipment, procedure, and acceptance criteria shall be used to perform rotational capacity tests on and determine acceptance of short bolts. Fasteners are considered to be short bolts when full nut thread engagement cannot be achieved when installed in a bolt tension measuring device:

A. Short Bolt Test Equipment:

1. Calibrated dial or digital torque wrench. Other suitable tools will be required for performing Steps 7 and 8 of the Short Bolt Test Procedure. A torque multiplier may be required for large diameter bolts.
2. Spud wrench or equivalent.
3. Spacer washers or bushings. When spacer washers or bushings are required, they shall have the same inside diameter and equal or larger outside diameter as the appropriate hardened washers conforming to the requirements in ASTM Designation: F436.
4. Steel plate or girder with a hole to install bolt. The hole size shall be 1.6 mm greater than the nominal diameter of the bolt to be tested. The grip length, including any plates, washers, and additional spacers as needed, shall provide the proper number of threads within the grip, as required in Step 2 of the Short Bolt Test Procedure.

B. Short Bolt Test Procedure:

1. Measure the bolt length. The bolt length is defined as the distance from the end of the threaded portion of the shank to the underside of the bolt head.
2. Install the nut on the bolt so that 3 to 5 full threads of the bolt are located between the bearing face of the nut and the underside of the bolt head. Measure and record the thread stickout of the bolt. Thread stickout is determined by measuring the distance from the outer face of the nut to the end of the threaded portion of the shank.
3. Install the bolt into a hole on the plate or girder and install the required number of washers and additional spacers as needed between the bearing face of the nut and the underside of the bolt head to produce the thread stickout measured in Step 2 of this procedure.
4. Tighten the nut using a hand wrench to a snug-tight condition. The snug condition shall be the full manual effort applied to the end of a 305 mm long wrench. This applied torque shall not exceed 20 percent of the maximum allowable torque in Table E.

Table E

Maximum Allowable Torque for High-Strength Fastener Assemblies	
Bolt Diameter (inches)	Torque (ft-lbs)
1/2	145
5/8	285
3/4	500
7/8	820
1	1220
1 1/8	1500
1 1/4	2130
1 3/8	2800
1 1/2	3700

5. Match-mark the assembly by placing a heavy reference start line on the steel plate or girder which aligns with 1) a mark placed on one corner of the nut and 2) a radial line placed across the flat on the end of the bolt or on the exposed portions of the threads of tension control bolts. Place an additional mark on the outside of the socket that overlays the mark on the nut corner such that this mark will be visible while turning the nut. Make 2 additional small marks on the steel plate or girder, one 1/3 of a turn and one 2/3 of a turn clockwise from the heavy reference start line on the steel plate or girder.
6. Using the torque wrench, tighten the nut to the rotation value listed in Table F. The rotation is measured from the heavy reference line described in Step 5 made after the bolt was snug-tight. A second wrench shall be used to prevent rotation of the bolt head during tightening. Measure and record the moving torque after this rotation has been reached. The torque shall be measured with the nut in motion.

Table F

Nut Rotation Required for Turn-of-Nut Installation ^(a,b)	
Bolt Length (measured in Step 1)	Required Rotation (turn)
4 bolt diameters or less	1/3
(a) Nut rotation is relative to bolt, regardless of the element (nut or bolt) being turned. For bolts installed by 1/2 turn and less, the tolerance shall be plus or minus 30 degrees.	
(b) Applicable only to connections in which all material within grip of the bolt is steel.	

7. Tighten the nut further to the 2/3-turn mark as indicated in Table G. The rotation is measured from the heavy reference start line made on the plate or girder when the bolt was snug-tight. Verify that the radial line on the bolt end or on the exposed portions of the threads of tension control bolts is still in alignment with the start line.

Table G

Required Nut Rotation for Rotational Capacity Test	
Bolt Length (measured in Step 1)	Required Rotation (turn)
4 bolt diameters or less	2/3

8. Loosen and remove the nut and examine the threads on both the nut and bolt.

C. Short Bolt Acceptance Criteria:

1. An assembly shall pass the following requirements to be acceptable: 1) the measured moving torque from Step 6 shall be less than or equal to the maximum allowable torque from Table E, 2) the nut shall be able to be removed from the bolt without signs of thread stripping or galling after the required rotation in Step 7 has been

achieved, 3) the bolt does not shear from torsion or fail during the test, and 4) the assembly shall not seize before the final rotation in Step 7 is reached. Elongation of the bolt in the threaded region between the bearing face of the nut and the underside of the bolt head will not be considered a failure. Both fastener assemblies tested from one rotational capacity lot shall pass for the rotational capacity lot to be acceptable.

INSTALLATION TENSION TESTING AND ROTATIONAL CAPACITY TESTING AFTER ARRIVAL ON THE JOB SITE

Installation tension tests and rotational capacity tests on high-strength fastener assemblies shall be performed by the Contractor prior to acceptance or installation and after arrival of the fastener assemblies on the project site. Installation tension tests and rotational capacity tests shall be performed at the job-site, in the presence of the Engineer, on each rotational capacity lot of fastener assemblies.

The requirements of this section do not apply to high-strength cap screws or high-strength bolts used for slip base plates.

Installation tension tests shall be performed on 3 representative fastener assemblies in conformance with the provisions in Section 8, "Installation," of the RCSC Specification. For short bolts, Section 8.2, "Pretensioned Joints," of the RCSC Specification shall be replaced by the "Pre-Installation Testing Procedures," of the "Structural Bolting Handbook," published by the Steel Structures Technology Center, Incorporated.

The rotational capacity tests shall be performed in conformance with the requirements for rotational capacity tests in "Rotational Capacity Testing Prior to Shipment to Job Site" of these special provisions.

At the Contractor's expense, additional installation tension tests, tests required to determine job inspecting torque, and rotational capacity tests shall be performed by the Contractor on each rotational capacity lot, in the presence of the Engineer, if 1) any fastener is not used within 3 months after arrival on the jobsite, 2) fasteners are improperly handled, stored, or subjected to inclement weather prior to final tightening, 3) significant changes are noted in original surface condition of threads, washers, or nut lubricant, or 4) the Contractor's required inspection is not performed within 48 hours after all fasteners in a joint have been tensioned.

Failure of a job-site installation tension test or a rotational capacity test will be cause for rejection of unused fasteners that are part of the rotational capacity lot.

When direct tension indicators are used, installation verification tests shall be performed in conformance with Appendix Section X1.4 of ASTM Designation: F959, except that bolts shall be initially tensioned to a value 5 percent greater than the minimum required bolt tension.

SEALING

When zinc-coated tension control bolts are used, the sheared end of each fastener shall be completely sealed with non-silicone type sealing compound conforming to the provisions in Federal Specification TT-S-230, Type II. The sealant shall be gray in color and shall have a minimum thickness of 1.3 mm. The sealant shall be applied to a clean sheared surface on the same day that the splined end is sheared off.

WELDING

Table 2.2 of AWS D1.5 is superseded by the following table:

Base Metal Thickness of the Thicker Part Joined, mm	Minimum Effective Partial Joint Penetration Groove Weld Size, * mm
Over 6 to 13 inclusive	5
Over 13 to 19 inclusive	6
Over 19 to 38 inclusive	8
Over 38 to 57 inclusive	10
Over 57 to 150 inclusive	13
Over 150	16

* Except the weld size need not exceed the thickness of the thinner part

Dimensional details and workmanship for welded joints in tubular and pipe connections shall conform to the provisions in Part A, "Common Requirements of Nontubular and Tubular Connections," and Part D, "Specific Requirements for Tubular Connections," in Section 2 of AWS D1.1.

Backing for welds, subject to computed stresses, that is left in place in the completed structure shall be a single length. Backing shall be of the same material as the structural steel being welded. Single lengths of backing shall be obtained by using a continuous strip, or may consist of lengths of backing joined by full penetration butt welds. Butt welds in the backing material shall be subject to the same type and frequency of testing as specified for the type of joint in the material being

joined. Butt welds in backing material shall be ground flush as necessary to obtain proper inspection and for proper fit-up in the welded joint with which the backing is to be used.

The requirement of conformance with AWS D1.5 shall not apply to work conforming to Section 56-1, "Overhead Sign Structures," or Section 86-2.04, "Standards, Steel Pedestals and Posts," of the Standard Specifications.

MEASUREMENT AND PAYMENT

If a portion of or all check samples are removed at a mill more than 480 air line kilometers from both Sacramento and Los Angeles, shop inspection expenses will be sustained by the State which are in addition to expenses incurred for fabrication site inspection. Payment to the Contractor for furnishing structural steel will be reduced \$2,000 for each mill located more than 480 air line kilometers from both Sacramento and Los Angeles.

The contract price paid per kilogram for structural steel (bridge) shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in furnishing and erecting structural steel, complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.61 SIGN STRUCTURES

Sign structures and foundations for overhead signs shall conform to the provisions in Section 56-1, "Overhead Sign Structures," of the Standard Specifications, "Steel Structures" of these special provisions, and the following requirements.

Before commencing fabrication of sign structures, the Contractor shall submit 2 sets of working drawings to the Engineer in conformance with the provisions in Section 5-1.02, "Plans and Working Drawings," of the Standard Specifications. The working drawings shall include sign panel dimensions, span lengths, post heights, anchorage layouts, proposed splice locations, a snugging and tensioning pattern for anchor bolts and high strength bolted connections, and details for permanent steel anchor bolt templates. The working drawings shall be supplemented with a written quality control program that includes methods, equipment, and personnel necessary to satisfy the requirements specified herein.

Working drawings shall be 559 mm x 864 mm or 279 mm x 432 mm in size and each drawing and calculation sheet shall include the State assigned designations for the sign structure type and reference as shown on the contract plans, District-County-Route-Kilometer Post, and contract number.

The Engineer shall have 20 working days to review the sign structure working drawings after a complete submittal has been received. No fabrication or installation of sign structures shall be performed until the working drawings are approved in writing by the Engineer.

Should the Engineer fail to complete the review within the time allowance and if, in the opinion of the Engineer, the Contractor's controlling operation is delayed or interfered with by reason of the delay in reviewing the sign structure working drawings, the delay will be considered a right of way delay in conformance with the provisions in Section 8-1.09, "Right of Way Delays," of the Standard Specifications.

Steel bolts not designated on the plans as high-strength (HS) or stainless steel shall be for general applications and shall conform to the requirements in ASTM Designation: A 307.

A permanent steel template shall be used to maintain the proper anchor bolt spacing.

One top nut, one leveling nut, and 2 washers shall be provided for the upper threaded portion of each anchor bolt.

Flatness of surfaces of 1) base plates that are to come in contact with concrete, grout, or washers and leveling nuts, and 2) plates in high-strength bolted connections, shall conform to the requirements in ASTM Designation: A 6/A 6M.

No holes shall be made in members unless the holes are shown on the plans or are approved in writing by the Engineer.

Longitudinal seam welds shall have 60 percent minimum penetration, except that within 150 mm of circumferential welds, longitudinal seam welds shall be complete joint penetration (CJP) groove welds. In addition, longitudinal seam welds on structures having telescopic pole segment splices shall be CJP groove welds on the female end for a length on each end equal to the designated slip fit splice length plus 150 mm.

Steel members used for overhead sign structures shall receive nondestructive testing (NDT) in conformance with AWS D1.1 and the following:

A.

Weld Location	Weld Type	Minimum Required NDT
Splice welds around the perimeter of tubular sections, poles, and arms.	CJP groove weld with backing ring	100% UT ^a or RT ^b
Longitudinal seam welds	CJP or PJP ^c groove weld	Random 25% MT ^d
Longitudinal seam welds within 150 mm of a circumferential splice.	CJP groove weld	100% UT or RT
Welds attaching base plates, flange plates, or pole or mast arm plates, to poles or arm tubes.	CJP groove weld with backing ring and reinforcing fillet	t > 4.5 mm: 100% UT and MT t < 4.5 mm: 100% MT after root weld pass & final weld pass t = pole or arm thickness
	External (top) fillet weld for socket-type connections	100% MT

^a ultrasonic testing

^b radiographic testing

^c partial joint penetration

^d magnetic particle testing

- B. The acceptance and repair criteria for UT of welded joints where any of the members are less than 8 mm thick or where tubular sections are less than 325 mm in diameter, shall conform to the requirements in AWS D1.1, Section 6.13.3.1. A written procedure approved by the Engineer shall be used when performing this UT. These written procedures shall conform to the requirements in AWS D1.1, Annex K. The acceptance and repair criteria for other welded joints receiving UT shall conform to the requirements in AWS D1.1, Section 6, Table 6.3 for cyclically loaded nontubular connections.
- C. The acceptance and repair criteria for radiographic or real time image testing shall conform to the requirements of AWS D1.1 for tensile stress welds.
- D. For longitudinal seam welds, the random locations for NDT will be selected by the Engineer. The cover pass shall be ground smooth at the locations to be tested. If repairs are required in a portion of a tested weld, the repaired portion shall receive NDT, and additional NDT shall be performed on untested portions of the weld. The additional NDT shall be performed on 25 percent of that longitudinal seam weld. After this additional NDT is performed, and if more repairs are required, then that entire longitudinal seam weld shall receive NDT.

Circumferential welds and base plate to post welds may be repaired only one time without written permission from the Engineer.

Full compensation for furnishing anchor bolt templates and for testing of welds shall be considered as included in the contract price paid per kilogram for furnish sign structure and no additional compensation will be allowed therefor.

10-1.62 ROADSIDE SIGNS

Roadside signs shall be furnished and installed at the locations shown on the plans or where designated by the Engineer and in conformance with the provisions in Section 56-2, "Roadside Signs," of the Standard Specifications and these special provisions.

Wood posts shall be pressure treated after fabrication in conformance with the provisions in Section 58, "Preservative Treatment of Lumber, Timber and Piling," of the Standard Specifications and AWP A Use Category System: UC4A, Commodity Specification A or B.

Type N, Type P, and Type R marker panels mounted on a post with a roadside sign shall be considered to be sign panels and will not be paid for as markers.

10-1.63 INSTALL ROADSIDE SIGN PANEL ON EXISTING POST

Roadside sign panels shall be installed on existing posts at the locations shown on the plans or where designated by the Engineer and in conformance with the provisions in Section 56-2.04, "Sign Panel Installation," of the Standard Specifications and these special provisions.

Cutting the ends of wood posts in the field and field application of wood preservatives shall conform to the provisions in Section 56-2.02B, "Wood Posts," of the Standard Specifications.

Two holes shall be drilled in each existing post as required to provide a breakaway feature as shown on the plans.

Existing sign panels, as shown on the plans, shall be removed and disposed of as provided in Section 15, "Existing Highway Facilities," of the Standard Specifications.

Installing roadside sign panels on existing posts will be paid for by the unit as determined from actual count in place.

The contract unit price paid for install roadside sign panel on existing post shall include full compensation for furnishing all labor, materials (except State-furnished sign panels), tools, equipment, and incidentals, and for doing all the work involved in installing roadside sign panels on existing posts (including drilling holes in existing posts, removing and disposing of existing sign panels), complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.64 SIGN PANELS

Sign panels shall be furnished by the State as provided under "Materials" of these special provisions and shall be installed at the locations shown on the plans or where designated by the Engineer and in conformance with the provisions in Section 56, "Signs," of the Standard Specifications and these special provisions.

The Contractor, shall submit a written request to the Engineer for the delivery of State-furnished sign panels for overhead sign structures and roadside signs at least 120 days in advance of their intended installation.

At the option of the Contractor, sign panels for overhead sign structures will be furnished at the site of the project or at the Department of Transportation's Warehouse, 2001 Evergreen Street, Sacramento, California 95815. In addition to the written request 120 days in advance of the intended installation, the Contractor shall, within 30 days of receiving notice that the contract has been approved, notify the Engineer in writing at which location such panels are to be delivered.

Upon receiving the sign panels the Contractor shall ensure that sign panels are stored on edge in a dry environment at all times. Sign panels shall not get wet during storage. Padding materials shall remain in place between the sign panel faces when storing signs. The first sign panel shall face away from the support. Sign panels shall not be stored in an enclosed, non-climate-controlled trailer or container in areas of high heat and humidity.

For extended periods of storage, sign panels should be stored indoors. When stored outside, for extended periods, there shall be spacing of at least 102 mm between sign panels. With both indoor and outdoor storage, sign panels shall be either free standing or leaning against each other, provided there is no pressure applied to the retroreflective face of the sign panel.

Sign panels shall not rest directly on the ground. When possible, keep the finished sign panels in the original shipping crates, or racks. The Contractor shall install sign panels in a manner that will not put pressure on the retroreflective face of the sign panel or damage the retroreflective material during the installation process.

10-1.65 FURNISH SIGN

Signs shall be fabricated and furnished in accordance with details shown on the plans, the Traffic Sign Specifications, and these special provisions.

Traffic Sign Specifications for California sign codes are available for review at the Department's internet site:

<http://www.dot.ca.gov/hq/traffops/signtech/signdel/specs.htm>

Traffic Sign Specifications for signs referenced with Federal MUTCD sign codes can be found in Standard Highway Signs Book, administered by the Federal Highway Administration, which is available for review at the following Internet website:

<http://mutcd.fhwa.dot.gov/ser-pubs.htm>

Information on cross-referencing California sign codes with the Federal MUTCD sign codes is available at the Department's internet site:

<http://www.dot.ca.gov/hq/traffops/signtech/signdel/specs.htm>

Temporary or permanent signs shall be free from blemishes that may affect the serviceability and detract from the general sign color and appearance when viewing during daytime and nighttime from a distance of 8 m. The face of each finished sign shall be uniform, flat, smooth, and free of defects, scratches, wrinkles, gel, hard spots, streaks, extrusion marks, and air bubbles. The front, back, and edges of the sign panels shall be free of router chatter marks, burns, sharp edges, loose rivets, delaminated skins, excessive adhesive over spray and aluminum marks.

SHEET ALUMINUM

Alloy and temper designations for sheet aluminum shall be in accordance with ASTM Designation: B209.

The Contractor shall furnish the Engineer a Certificate of Compliance in accordance to Section 6-1.07, "Certificates of Compliance," of the Standard Specifications for the sheet aluminum.

Sheet aluminum shall be pretreated in accordance to ASTM Designation: B449. Surface of the sheet aluminum shall be cleaned, deoxidized, and coated with a light and tightly adherent chromate conversion coating free of powdery residue. The conversion coating shall be Class 2 with a mass between 108 mg/m² and 377 mg/m², and an average mass of 269 mg/m². Following the cleaning and coating process, the sheet aluminum shall be protected from exposure to grease, oils, dust, and contaminants.

Sheet aluminum shall be free of buckles, warps, dents, cockles, burrs, and defects resulting from fabrication.
Base plate for standard route marker shall be die cut.

RETROREFLECTIVE SHEETING

The Contractor shall furnish retroreflective sheeting for sign background and legend in accordance with ASTM Designation: D4956 and "Prequalified and Tested Signing and Delineation Materials" of these special provisions.

Retroreflective sheeting shall be applied to sign panels as recommended by the retroreflective sheeting manufacturer without stretching, tearing, and damage.

Class 1, 3, or 4 adhesive backing shall be used for Type II, III, IV, VII, VIII, and IX retroreflective sheeting. Class 2 adhesive backing may also be used for Type II retroreflective sheeting. The adhesive backing shall be pressure sensitive and fungus resistant.

When the color of the retroreflective sheeting determined from instrumental testing is in dispute, the Engineer's visual test will govern.

PROCESS COLOR AND FILM

The Contractor shall furnish and apply screened process color, non-reflective opaque black film, and protective overlay film of the type, kind, and product that are approved by the manufacturer of the retroreflective sheeting.

The Contractor shall furnish the Engineer a Certificate of Compliance in accordance to Section 6-1.07, "Certificates of Compliance," of the Standard Specifications for the screened process color, non-reflective opaque black film, and protective overlay film.

The surface of the screened process color shall be flat and smooth. When the screened process colors determined from the instrumental testing in accordance to ASTM Designation: D4956 are in dispute, the Engineer's visual test will govern.

The Contractor shall provide patterns, layouts, and set-ups necessary for the screened process.

The Contractor may use green, red, blue, and brown reverse-screened process colors for background and non-reflective opaque black film or black screened process color for legend. The coefficient of retroreflection for reverse-screened process colors on white retroreflective sheeting shall not be less than 70 percent of the coefficient of retroreflection specified in ASTM Designation: D4956.

The screened process colors and non-reflective opaque black film shall have the same outdoor weatherability as that of the retroreflective sheeting.

After curing, screened process colors shall withstand removal when tested by applying 3M Company Scotch Brand Cellophane Tape No. 600 or equivalent tape over the color and removing with one quick motion at 90° angle.

SINGLE SHEET ALUMINUM SIGN

Single sheet aluminum signs shall be fabricated and furnished with or without frame. The Contractor shall furnish the sheet aluminum in accordance to "Sheet Aluminum" of these special provisions. Single sheet aluminum signs shall be fabricated from sheet aluminum alloy 6061-T6 or 5052-H38.

Single sheet aluminum signs shall not have a vertical splice in the sheet aluminum. For signs with depth greater than 1220 mm, one horizontal splice will be allowed in the sheet aluminum.

Framing for single sheet aluminum sign shall consist of aluminum channel or rectangular aluminum tubing. The framing shall have a length tolerance of ±3 mm. The face sheet shall be affixed to the frame with rivets of 5-mm diameter. Rivets shall be placed within the web of channels and shall not be placed less than 13 mm from edges of the sign panels. Rivets shall be made of aluminum alloy 5052 and shall be anodized or treated with conversion coating to prevent corrosion. The exposed portion of rivets on the face of signs shall be the same color as the background or legend where the rivets are placed.

Finished signs shall be flat within a tolerance of ±3 mm per meter when measured across the plane of the sign in all directions. The finished signs shall have an overall tolerance within ±3 mm of the detailed dimensions.

Aluminum channels or rectangular aluminum tubings shall be welded together with the inert gas shielded-arc welding process using E4043 aluminum electrode filler wires as shown on the plans. Width of the filler shall be equal to wall thickness of smallest welded channel or tubing.

FIBERGLASS REINFORCED PLASTIC PANEL SIGN

The Contractor shall furnish fiberglass reinforced plastic panel sign in accordance with ASTM Designation: D3841 and "Prequalified and Tested Signing and Delineation Materials" of these special provisions.

Fiberglass reinforced plastic shall be acrylic modified and ultraviolet stabilized for outdoor weatherability. The plastic shall contain additives designed to suppress fire ignition and flame propagation. When tested in accordance with the requirements in the ASTM Designation: D635, the extent of burning shall not exceed 25 mm.

Fiberglass reinforced plastic shall be stabilized to prevent the release solvents and monomers. The front and back surfaces of the laminate shall be clean and free of constituents and releasing agents that can interfere with the bonding of retroreflective sheeting.

The fiberglass reinforced plastic panel sign shall be weather resistant Grade II thermoset polyester laminate.

The fiberglass reinforced plastic panels shall be minimum 3.4 mm thick. Finished fiberglass reinforced plastic panel signs shall be flat within a tolerance of ± 3 mm per meter when measured across the plane of the sign in all directions. The finished signs shall have an overall tolerance within ± 3 mm of the specified dimensions.

Color of fiberglass reinforced plastic panels shall be uniform gray within Munsel range of N7.5 to N8.5.

Fiberglass reinforced plastic panels shall be cut from a single piece of laminate. Bolt holes shall be predrilled. The predrilled bolt holes, panel edges, and the front and back surfaces of the panels shall be true and smooth. The panel surfaces shall be free of visible cracks, pinholes, foreign inclusions, warping and wrinkles that can affect performance and serviceability.

10-1.66 ROCK STAINING

Rock staining shall consist of applying a penetrating oxide stain material to all continuous igneous and metamorphic rock slopes in cut areas and in areas designated by the Engineer. Continuous rock slopes are defined as areas 9.29 square meter or more in slope measurement consisting entirely of excavated rock.

Attention is directed to the provisions in, "Earthwork," elsewhere in these special provisions.

The staining material shall be applied in accordance with the printed instructions of the staining material manufacturer. A copy of such printed instructions shall be furnished to the Engineer prior to application of the material.

The staining material shall produce a spectrum of brown earth tone colors. Colors shall be such that alteration of the color and further color development after initial application can be accomplished.

Prior to applying the stain, all rock surfaces shall be cleaned by high pressure washing with water.

Before applying staining material to rock slopes, the staining system shall be applied to a 1.25 m by 1.25 m test area designated by the Engineer. The Contractor shall notify the Engineer not less than 5 working days prior to applying the staining material to the test area.

After the Engineer has approved the test results, the staining material shall be applied to rock slopes to achieve a color consistent with or as close as possible to, the approved test area color.

Rock staining will be measured and paid for by the square meter, calculated on the basis of actual slope measurements of the area covered.

The contract price paid per square meter for rock staining shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in rock staining, complete in place, including test area and any re-application necessary to achieve the required appearance, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.67 REINFORCED CONCRETE PIPE

Reinforced concrete pipe shall conform to the provisions in Section 65, "Reinforced Concrete Pipe," of the Standard Specifications and these special provisions.

Where embankment will not be placed over the top of the pipe, a relative compaction of not less than 85 percent shall be required below the pipe spring line for pipe installed using Method 1 backfill in trench, as shown on Standard Plan A62D. Where the pipe is to be placed under the traveled way, a relative compaction of not less than 90 percent shall be required unless the minimum distance between the top of the pipe and the pavement surface is the greater of 1.2 m or one half of the outside diameter of the pipe.

Except as otherwise designated by classification on the plans or in the specifications, joints for culvert and drainage pipes shall conform to the plans or specifications for standard joints.

When reinforced concrete pipe is installed in conformance with the details shown on Standard Plan A62DA, the fifth paragraph of Section 19-3.04, "Water Control and Foundation Treatment," of the Standard Specifications shall not apply.

When solid rock or other unyielding material is encountered at the planned elevation of the bottom of the bedding, the material below the bottom of the bedding shall be removed to a depth of 1/50 of the height of the embankment over the top of the culvert, but not less than 150 mm nor more than 300 mm. The resulting trench below the bottom of the bedding shall be backfilled with structure backfill material in conformance with the provisions in Section 19-3.06, "Structure Backfill," of the Standard Specifications.

The excavation and backfill below the planned elevation of the bottom of the bedding will be paid for as extra work as provided in Section 4-1.03D, "Extra Work," of the Standard Specifications.

The Outer Bedding shown on Standard Plan A62DA shall not be compacted prior to placement of the pipe.

10-1.68 CORRUGATED METAL PIPE

Corrugated steel pipe culverts shall conform to the provisions in Section 66, "Corrugated Metal Pipe," of the Standard Specifications and these special provisions.

Asphaltic mastic coating or polymeric sheet coating substituted for bituminous coating shall be placed on the outside and inside surfaces of the pipe.

Corrugated steel pipe shall be fabricated from zinc-coated steel sheet.

10-1.69 OVERSIDE DRAIN

Corrugated pipe downdrains shall conform to the provisions in Section 69, "Overside Drains," of the Standard Specifications and these special provisions.

Steel pipe downdrains shall be fabricated from zinc-coated steel sheet.

10-1.70 MISCELLANEOUS FACILITIES

Concrete pipe riser shall conform to the provisions in Section 70, "Miscellaneous Facilities," of the Standard Specifications.

10-1.71 GRATED LINE DRAIN

This work shall consist of furnishing and installing precast grated line drain, with necessary fittings, coupling systems, frames, grates and associated items as shown on the plans and in conformance with these special provisions.

The interior surface of the grated line drain, below the level of the frame and grate and associated connections, shall be smooth. Grated line drain channel sections shall be manufactured of monolithic polymer concrete with no side extensions.

Monolithic polymer concrete shall be made from a composition of aggregate and polyester resin or vinyl ester resin and shall have the following properties when tested as follows:

PROPERTY	ASTM TEST METHOD	VALUE
Tensile Strength, MPa	C 307	10 min.
Compressive Strength, MPa	C 579	80 min.
Bending Strength, MPa	C 580	20 min.
Moisture Absorption, %	C 140	0.5 max.
Chemical Resistance	C 267	Pass
Freeze/Thaw, number of cycles w/o weight loss	C 666	1600 min.

The manufacturer of the grated line drain shall furnish the Engineer a Certificate of Compliance in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications.

Grated line drain frames and grates shall be manufactured of ductile iron conforming to the provisions in Section 75-1.02, "Miscellaneous Iron and Steel," of the Standard Specifications. The frames and grates need not be galvanized or coated with asphalt paint. Bolts, nuts, frame anchors, and other connecting hardware shall conform to the provisions in Section 75-1.02, "Miscellaneous Iron and Steel," of the Standard Specifications.

Frames and grates, when installed in conformance with the manufacturer's recommendations and these special provisions, shall be classified as heavy duty (112 kN proof load) when tested in accordance with Commercial Item Description A-A-60005 for "Frames, Covers, Gratings, Steps, Manhole, Sump and Catch Basin." Frames and grates shall be matchmarked in pairs before delivery to the work and grates shall fit into the frames without rocking.

Frames shall be secured to the surrounding concrete backfill with steel anchoring rods as shown on the plans. Other methods may be used to secure the frame to the concrete backfill or grated line drain wall provided that a minimum pullout resistance of 10 kN per meter of length of grated line drain frame is maintained.

Grates and frames shall be one piece or the grates shall be removable. Removable grates shall be held in place by locking devices that are tamper resistant. Removable grates shall provide a minimum repetitive pullout resistance of 5 kN per meter of length after completion of 1000 hours of salt spray testing in conformance with the requirements in ASTM Designation: B 117. When a combination of one piece frame and grate and removable grates are used, the locations of the removable grates shall be shown on the plans.

Except for grates installed within designated pedestrian paths of travel, grates shall accept inflow of runoff through openings. The openings shall consist of a minimum of 60 percent of the total top surface area of the grate, with individual openings or slots having a dimension not greater than 50 mm measured in the direction of the grated line drain flow line. Grates installed within designated pedestrian paths of travel shall be certified as conforming to the requirements of the "Americans with Disabilities Act."

Grated line drains shall be installed in trenches excavated to the lines and grades established by the Engineer. The bottom of the trench shall be graded and prepared to provide a firm and uniform bearing throughout the entire length of the grated line drain.

Grated line drains shall be installed and jointed in conformance with the manufacturer's recommendations.

Grated line drains shall be installed to the lines and grades with sections closely jointed and secured to ensure that no separation of the line drains occurs during backfilling.

The frame or grate of the grated line drain shall not extend above the level of the surrounding concrete backfill.

Grated line drains shall be connected to new or existing drainage facilities as shown on the plans.

Excavation and backfill shall conform to the provisions in Section 19-3, "Structure Excavation and Backfill," of the Standard Specifications.

Backfill for the grated line drains shall be either minor concrete or Class 3 concrete conforming to the provisions in Section 90, "Portland Cement Concrete," of the Standard Specifications, except that minor concrete shall contain not less than 300 kg of cement per cubic meter.

Concrete backfill shall be placed in the trench as shown on the plans. Concrete backfill shall be placed against undisturbed material at the sides and bottom of the trench and in a manner that will prevent floating or shifting of the grated line drain and voids in, or segregation of, the concrete. Foreign material which falls into the trench, prior to or during placement of the concrete, shall be immediately removed. Where necessary, earth plugs shall be constructed and compacted at the ends of the planned concrete backfill to contain the concrete within the trench.

Concrete backfill shall be finished flush with the adjacent surfacing.

The surface of the concrete shall be textured with a broom or burlap drag to produce a durable skid-resistant surface.

The length the grated line drain to be paid for will be the length measured by the meter along the pavement surface as designated by the Engineer. No payment will be made for grated line drain placed in excess of the designated length.

The contract price paid per meter for grated line drain shall include full compensation for furnishing all labor, materials (including frames and grates), tools, equipment, and incidentals, and for doing all the work involved in installing grated line drains, complete in place, including excavation and backfill, connecting grated line drains to new or existing facilities, concrete collars, reinforcement, and other connecting devices, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.72 SLOPE PROTECTION

Slope protection shall be placed or constructed in conformance with the provisions in Section 72, "Slope Protection," of the Standard Specifications and these special provisions.

Rock slope protection fabric shall be woven or nonwoven type fabric, Type B.

10-1.73 SLOPE PAVING

Slopes under the ends of bridges, where shown on the plans, shall be paved in conformance with the provisions in Section 72-6, "Slope Paving," of the Standard Specifications and these special provisions.

The location of construction joints shall be subject to the approval of the Engineer. Placement of slope paving shall be scheduled so that the work, including placement, finishing, and application of curing, is completed in any section bounded by permissible construction joints on the same day that the work is started in that section.

10-1.74 MINOR CONCRETE (GUTTER)

The concrete gutter shown on the plans shall conform to the provisions in Section 73, "Concrete Curbs and Sidewalks," and Section 52, "Reinforcement," of the Standard Specifications and these special provisions.

Minor concrete (gutter) will be measured and paid for by the meter.

The contract price paid per meter for minor concrete (gutter) shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in constructing the gutter, complete in place, as shown on the plans, as specified in the Standard Specifications, and as directed by the Engineer.

10-1.75 MISCELLANEOUS CONCRETE CONSTRUCTION

Minor concrete (curb and sidewalk), minor concrete (gutter), minor concrete (concrete path) and minor concrete (textured paving) (gore paving) shall conform to the details shown on the plans, the provisions in Section 73, "Concrete Curbs and Sidewalks," of the Standard Specifications and these special provisions.

Minor concrete (concrete path) shall have a color that matches the existing concrete path. Coloring shall be integral, chemically inert, fade resistant mineral oxide or synthetic type. Concrete surfaces shall receive a medium broom finish. Brooming shall be done when the surface is sufficiently set to prevent deep scarring and shall be accomplished by drawing the broom parallel to the outside edges of the concrete surface.

Curb ramp detectable warning surface shall consist of raised truncated domes constructed or installed on curb ramps in conformance with the details shown on the plans and these special provisions. At the option of the Contractor, the detectable

warning surface shall be prefabricated, cast-in-place, or stamped into the surface of the curb ramp. The color of the detectable warning surface shall be yellow conforming to Federal Standard 595B, Color No. 33538.

Prefabricated detectable warning surface shall be in conformance with the requirements established by the Department of General Services, Division of State Architect and be attached in conformance with the manufacturer's recommendations.

Cast-in-place and stamped detectable warning surfaces shall be painted in conformance with the provisions in Section 59-6, "Painting Concrete," of the Standard Specifications.

The finished surfaces of the detectable warning surface shall be free from blemishes.

Prior to constructing the cast-in-place or stamping the detectable warning surface, the Contractor shall demonstrate the ability to produce a detectable warning surface conforming to the details shown on the plans and these special provisions by constructing a 600-mm by 600-mm test panel.

The manufacturer shall provide a written 5-year warranty for prefabricated detectable warning surfaces, guaranteeing replacement when there is defect in the dome shape, color fastness, sound-on-cane acoustic quality, resilience, or attachment. The warranty period shall begin upon acceptance of the contract.

Full compensation for constructing or furnishing and installing curb ramp detectable warning surfaces shall be considered as included in the contract price paid per cubic meter for minor concrete (curb and sidewalk) and no separate payment will be made therefor.

MINOR CONCRETE (TEXTURED PAVING) (GORE PAVING)

Minor concrete (textured paving) (gore paving) is required at concrete surfaces shown on the plans.

Attention is directed to "Earthwork," of these special provisions.

The minor concrete (textured paving) (gore paving) shall consist of concrete with an exposed aggregate finish. The concrete shall have a color closely resembling "San Diego Buff," Davis manufacturer No. 5237. Color shall be integral, chemically inert, fade resistant mineral oxide or synthetic type.

TEST PANEL

A test panel at least 1.25 m x 1.25 m in size shall be successfully completed at a location approved by the Engineer before beginning work on minor concrete (textured paving) (gore paving) to demonstrate the textured paving, including color hardener, curing and finishing compounds, and shall be submitted to the Engineer for written approval.

Minor concrete (textured paving) (gore paving) shall not be placed on the project prior to written approval by the Engineer of the samples prepared and submitted by the Contractor. In the event more than one test panel of textured paving to be placed is required by the Engineer, each additional test panel will be paid for as extra work as provided in Section 4-1.03D of the Standard Specifications.

Reinforcing bar, of the size and type shown on the plans and conforming to the provisions in Section 52, "Reinforcement," of the Standard Specifications, shall be placed in the textured paving areas as shown on the plans.

Aggregate base shall be Class 2 and shall conform to the provisions in Section 26, "Aggregate Bases," of the Standard Specifications.

Areas of minor concrete (textured paving) (gore paving) shown on the plans shall be constructed and finished in conformance with the following requirements:

- A. Coarse aggregate shall conform to the provisions for 25-mm x 4.75-mm primary size coarse aggregate in Section 90-3.02, "Coarse Aggregate Grading," of the Standard Specifications.
- B. Shotcrete shall not be used for the construction of the exposed aggregate concrete.
- C. Coarse aggregates shall be exposed to a depth of approximately 5 mm to 10 mm. Exposed aggregate surfaces shall be uniform in appearance.
- D. At the option of the Contractor, a concrete set retarder may be applied to the surface of the concrete after placing, consolidating, and finishing of the concrete has been completed. The concrete set retarder shall be commercial quality, manufactured specifically for use on the top surface of concrete and shall be applied in accordance with the manufacturer's recommendations. The retarder shall effectively retard the setting time of the cement and fine aggregate matrix deep enough and long enough to permit exposing the aggregates.
- E. Care shall be taken in placing and consolidating the concrete such that the coarse aggregate remains uniformly distributed throughout the concrete.
- F. When the mass of the concrete has set sufficiently to permit removing the matrix of cement and fine aggregate, the coarse aggregate shall be exposed with a water spray, coarse brooming, abrasive blasting, or a combination of these procedures. Removal methods shall not dislodge or loosen the coarse aggregate from embedment in the cement mortar.
- G. Immediately after the cement mortar has hardened sufficiently to resist further removal, all cement film and other loose material shall be cleaned from the exposed aggregate and all other surfaces with still brooms and water.

- H. Except when operations for exposing the aggregate are underway, concrete shall be cured by the water method or with Type (6) curing compound in conformance with the provisions in Section 90-7.01B, "Curing Compound Method," of the Standard Specifications. Areas of concrete where curing compounds are removed during the cure period shall be kept continuously wet until the end of the cure period or until the curing compound is replaced.

For payment purposes, the area in square meters of minor concrete (textured paving) (gore paving) will be determined from horizontal measurements of the finished textured paving.

The contract price paid per square meter for minor concrete (textured paving) (gore paving) shall include full compensation for furnishing all labor, materials (including welded wire fabric, where required, and aggregate base), tools, equipment, and incidentals, and for doing all the work involved in constructing textured paving, including grouted areas, complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.76 MISCELLANEOUS IRON AND STEEL

Miscellaneous iron and steel shall conform to the provisions in Section 75, "Miscellaneous Metal," of the Standard Specifications.

10-1.77 MISCELLANEOUS METAL (BRIDGE)

Miscellaneous metal (bridge) shall conform to the provisions for miscellaneous bridge metal in Section 75, "Miscellaneous Metal," of the Standard Specifications and these special provisions.

Attention is directed to "Welding" of these special provisions.

Miscellaneous metal (bridge) shall consist of the miscellaneous bridge metal items listed in Section 75-1.03, "Miscellaneous Bridge Metal," of the Standard Specifications.

10-1.78 CHAIN LINK FENCE

Chain link fence shall be Type CL – 1.8 and shall conform to the provisions in Section 80, "Fences," of the Standard Specifications.

Chain link fabric for the chain link fence Type CL-1.8 shall be vinyl-clad and black in color.

10-1.79 MARKERS AND DELINEATORS

Markers and delineators shall conform to the provisions in Section 82, "Markers and Delineators," of the Standard Specifications and these special provisions.

Markers and delineators on flexible posts shall conform to the provisions in "Prequalified and Tested Signing and Delineation Materials" of these special provisions. Flexible posts shall be made from a flexible white plastic which shall be resistant to impact, ultraviolet light, ozone, and hydrocarbons. Flexible posts shall resist stiffening with age and shall be free of burns, discoloration, contamination, and other objectionable marks or defects which affect appearance or serviceability.

Retroreflective sheeting for metal and flexible target plates shall be the retroreflective sheeting designated for channelizers, markers, and delineators conforming to the requirements in ASTM Designation: D 4956-95 and in conformance with the provisions in "Prequalified and Tested Signing and Delineation Materials" of these special provisions.

Guard railing delineators shall be installed as shown on the plans.

Guard railing delineators shall conform to the provisions in "Prequalified and Tested Signing and Delineation Materials" of these special provisions.

Guard railing delineators will be measured by the unit determined from actual count of delineators used in the work or ordered by the Engineer.

The contract unit price paid for guard railing delineators shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in guard railing delineators, complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.80 METAL BEAM GUARD RAILING

Metal beam guard railing shall be constructed in conformance with the provisions in Section 83-1, "Railings," of the Standard Specifications and these special provisions.

Attention is directed to "Order of Work" of these special provisions.

Line posts shall be wood, steel, or plastic. Blocks shall be wood or plastic.

Attention is directed to "Markers and Delineators" of these special provisions.

ALTERNATIVE IN-LINE TERMINAL SYSTEM

Alternative in-line terminal system shall be furnished and installed as shown on the plans and in conformance with these special provisions.

The allowable alternatives for an in-line terminal system shall consist of one of the following or a Department approved equal.

- (1) **TERMINAL SYSTEM (TYPE SKT)** - Terminal system (Type SKT) shall be a SKT 350 Sequential Kinking Terminal manufactured by Road Systems, Inc., located in Big Spring, Texas, and shall include items detailed for terminal system (Type SKT) shown on the plans. The SKT 350 Sequential Kinking Terminal can be obtained from the distributor, Universal Industrial Sales, P.O. Box 699, Pleasant Grove, UT 84062, Telephone (801) 785-0505 or from the distributor, Gregory Highway Products, 4100 13th Street, S.W., Canton, OH 44708, Telephone (330) 477-4800.
- (2) **TERMINAL SYSTEM (TYPE ET)** - Terminal system (Type ET) shall be an ET-2000 PLUS (4-tube system) extruder terminal as manufactured by Trinity Industries, Inc., and shall include items detailed for terminal system (Type ET) shown on the plans. The ET-2000 PLUS (4-tube system) extruder terminal can be obtained from the manufacturer, Trinity Industries, Inc., P.O. Box 99, 950 West 400S, Centerville, UT 84014, Telephone (800) 772-7976.

The Contractor shall provide the Engineer with a Certificate of Compliance from the manufacturer in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications. The Certificate of Compliance shall certify that the terminal systems furnished conform to the contract plans and specifications, conform to the prequalified design and material requirements, and were manufactured in conformance with the approved quality control program.

Terminal systems shall be installed in conformance with the manufacturer's installation instructions and these requirements. Each terminal system installed shall be identified by painting the type of terminal system in neat black letters and figures 60 mm high on the backside of the rail element between system posts numbers 4 and 5.

For terminal system (Type ET) the steel foundation tubes with soil plates attached shall be, at the Contractor's option, either driven, with or without pilot holes, or placed in drilled holes. Space around the steel foundation tubes shall be backfilled with selected earth, free of rock, placed in layers approximately 100 mm thick and each layer shall be moistened and thoroughly compacted. The wood terminal posts shall be inserted into the steel foundation tubes by hand and shall not be driven. Before the wood terminal posts are inserted, the inside surfaces of the steel foundation tubes to receive the wood posts shall be coated with a grease which will not melt or run at a temperature of 65°C or less. The edges of the wood terminal posts may be slightly rounded to facilitate insertion of the post into the steel foundation tubes.

For terminal system (Type SKT) the soil tubes shall be, at the Contractor's option, driven with or without pilot holes, or placed in drilled holes. Space around the steel foundation tubes shall be backfilled with selected earth, free of rock, placed in layers approximately 100 mm thick and each layer shall be moistened and thoroughly compacted. Wood posts shall be inserted into the steel foundation tubes by hand. Before the wood terminal posts are inserted, the inside surfaces of the steel foundation tubes to receive the wood posts shall be coated with a grease which will not melt or run at a temperature of 65°C or less. The edges of the wood posts may be slightly rounded to facilitate insertion of the post into the steel foundation tubes.

Surplus excavated material remaining after the terminal system has been installed shall be disposed of in a uniform manner along the adjacent roadway where designated by the Engineer.

The contract unit price paid for alternative in-line terminal system shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in furnishing and installing alternative in-line terminal system, complete in place, including excavation, backfill and disposal of surplus material, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

ALTERNATIVE FLARED TERMINAL SYSTEM

Alternative flared terminal system shall be furnished and installed as shown on the plans and in conformance with these special provisions.

The allowable alternatives for a flared terminal system shall consist of one of the following or a Department approved equal.

- (1) **TERMINAL SYSTEM (TYPE FLEAT)** - Terminal system (Type FLEAT) shall be a Flared Energy Absorbing Terminal 350 manufactured by Road Systems, Inc., located in Big Spring, Texas, and shall include items detailed for terminal system (Type FLEAT) shown on the plans. The Flared Energy Absorbing Terminal 350 can be obtained from the distributor, Universal Industrial Sales, P.O. Box 699, Pleasant Grove, UT 84062, Telephone (801) 785-0505 or from the distributor, Gregory Highway Products, 4100 13th Street, S.W., Canton, OH 44708, Telephone (330) 477-4800.

- (2) **TERMINAL SYSTEM (TYPE SRT)** - Terminal system (Type SRT) shall be an SRT-350 Slotted Rail Terminal (8-post system) as manufactured by Trinity Industries, Inc., and shall include items detailed for terminal system (Type SRT) shown on the plans. The SRT-350 Slotted Rail Terminal (8-post system) can be obtained from the manufacturer, Trinity Industries, Inc., P.O. Box 99, 950 West 400S, Centerville, UT 84014, Telephone (800) 772-7976.

The Contractor shall provide the Engineer with a Certificate of Compliance from the manufacturer in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications. The Certificate of Compliance shall certify that the terminal systems furnished conform to the contract plans and specifications, conform to the prequalified design and material requirements, and were manufactured in conformance with the approved quality control program.

Terminal systems shall be installed in conformance with the manufacturer's installation instructions and these requirements. Each terminal system installed shall be identified by painting the type of terminal system in neat black letters and figures 60 mm high on the backside of the rail element between system posts numbers 4 and 5.

For terminal system (Type SRT), the steel foundation tubes with soil plates attached shall be, at the Contractor's option, either driven, with or without pilot holes, or placed in drilled holes. Space around the steel foundation tubes shall be backfilled with selected earth, free of rock, placed in layers approximately 100 mm thick and each layer shall be moistened and thoroughly compacted. The wood terminal posts shall be inserted into the steel foundation tubes by hand and shall not be driven. Before the wood terminal posts are inserted, the inside surfaces of the steel foundation tubes to receive the wood posts shall be coated with a grease which will not melt or run at a temperature of 65°C or less. The edges of the wood terminal posts may be slightly rounded to facilitate insertion of the post into the steel foundation tubes.

For terminal system (Type FLEAT), the soil tubes shall be, at the Contractor's option, driven with or without pilot holes, or placed in drilled holes. Space around the steel foundation tubes shall be backfilled with selected earth, free of rock, placed in layers approximately 100 mm thick and each layer shall be moistened and thoroughly compacted. Wood posts shall be inserted into the steel foundation tubes by hand. Before the wood terminal posts are inserted, the inside surfaces of the steel foundation tubes to receive the wood posts shall be coated with a grease which will not melt or run at a temperature of 65°C or less. The edges of the wood posts may be slightly rounded to facilitate insertion of the post into the steel foundation tubes.

Surplus excavated material remaining after the terminal system has been installed shall be disposed of in a uniform manner along the adjacent roadway where designated by the Engineer.

The contract unit price paid for alternative flared terminal system shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in furnishing and installing alternative flared terminal system, complete in place, including excavation, backfill and disposal of surplus material, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.81 CHAIN LINK RAILING

Chain link railing shall conform to the provisions in Section 83-1, "Railings," of the Standard Specifications.

10-1.82 PERFORATED STEEL SCREEN

Perforated steel screen shall conform to the details shown on the plans, the provisions in Section 83-1, "Railings," of the Standard Specifications and these special provisions.

Perforated steel screen will be measured by the unit per the quantities shown on the plans.

The contract unit price paid per perforated steel screen of the types shown in the Engineer's Estimate shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in furnishing and constructing perforated steel screens, complete in place, including concrete, reinforcing steel and anchorage assemblies, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

Full compensation for furnishing and constructing connections on perforated steel screen, drilling anchor bolt holes and anchoring bolts shall be considered as included in the price paid for perforated steel screen and no additional compensation will be allowed therefor.

10-1.83 METAL BRIDGE RAILING

Tubular pipe handrailing shall conform to the provisions in Section 83-1, "Railings," of the Standard Specifications.

10-1.84 CABLE RAILING

Cable railing shall conform to the provisions in Section 83-1, "Railings," of the Standard Specifications.

10-1.85 CONCRETE BARRIER

Concrete barriers shall conform to the provisions in Section 83-2, "Barriers," of the Standard Specifications and these special provisions.

Architectural treatment for concrete barrier surfaces shall conform to "Architectural Surface (Textured Concrete)" of these special provisions.

Concrete barrier markers shall conform to the provisions in "Prequalified and Tested Signing and Delineation Materials" of these special provisions. At those locations shown on the plans, concrete barrier markers shall be cemented to the barrier in conformance with the manufacturer's recommendations.

If reinforcement is encountered during drilling before the specified depth is attained, the Engineer shall be notified. Unless the Engineer approves coring through the reinforcement, the hole will be rejected and a new hole, in which reinforcement is not encountered, shall be drilled adjacent to the rejected hole to the depth shown on the plans.

Full compensation for concrete barrier pedestal shall be considered as included in the contract price paid per meter for the various types of concrete barrier involved and no separate payment will be allowed therefor.

Full compensation for concrete sconces shall be considered as included in the contract price paid per meter for the various types of concrete barrier involved and no separate payment will be allowed therefor.

10-1.86 TRANSITION RAILING (TYPE WB)

Transition railing (Type WB) shall be furnished and installed in conformance with details shown on the plans, the provisions in Section 83-2, "Barriers," of the Standard Specifications and these special provisions.

The 10-gage rail elements shall conform to the requirements of Class B, Type 1 thrie beam guard railing as shown in AASHTO Designation: M 180. End caps shall conform to the requirements of Class A, Type 1 thrie beam guard railing as shown in AASHTO Designation: M 180.

Surplus excavated material remaining after the transitional railing (Type WB) has been constructed shall be disposed of in a uniform manner along the adjacent roadway where designated by the Engineer.

The contract unit price paid for transition railing (Type WB) shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in furnishing and installing transition railing (Type WB), complete in place, including drilling holes for wood posts, driving posts, backfill, and disposal of surplus material, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.87 CRASH CUSHION (REACT)

Crash cushion (REACT) shall be furnished and installed as shown on the plans and in conformance with the provisions in the Standard Specifications and these special provisions.

Crash cushion (REACT) shall be a multiple recoverable type, manufactured by Energy Absorption Systems, Inc. Crash cushion (REACT) and additional components shall conform to the descriptions as follows:

Contract Item Description	Manufacturer's Product Description
Crash Cushion (REACT 9SCBS)	REACT 350.9 Self Contained

The successful bidder can obtain from the following distributors the crash cushion (REACT) manufactured by Energy Absorption Systems, Inc., A Quixote Company, at One East Wacker Drive, Suite 3000, Chicago, Illinois 60601:

1. Southern California: Traffic Control Service, Inc., 1881 Betmor Lane, Anaheim, California 92805, Telephone 800-222-8274, FAX 714-937-1070.
2. Northern California: Traffic Control Service, Inc., 8585 Thys Court, Sacramento, California 95828, Telephone 800-884-8274, FAX 916-387-9734.

The price quoted by the manufacturer for Crash Cushion (REACT 9SCBS), FOB Pell City, Alabama is \$33,411, not including sales tax.

The above prices will be firm for orders placed within 30 days of contract award, and provided delivery is accepted within 90 days after the order is placed.

The price quoted for crash cushion (REACT 9SCBS) includes the concrete anchorage devices, but does not include the concrete anchor slab or the W-Beam connection to the barrier.

Crash cushion shall be installed in conformance with the manufacturer's recommendations.

Concrete anchorage devices used for attaching the crash cushion to the base slab shall be limited to those which have been provided by the manufacturer.

The concrete anchor slab shall conform to the provisions in Section 51, "Concrete Structures," and Section 52, "Reinforcement," of the Standard Specifications and these special provisions.

The concrete anchor slab shall be constructed of concrete containing not less than 350 kg of cement per cubic meter.

For crash cushion (REACT 9SCBS), W-Beam connections to the barrier shall conform to the provisions in Section 83-1, "Railings," of the Standard Specifications. The high strength bolts and nuts for W-Beam connections to the barrier shall conform to the requirements in ASTM Designation: A 325/A 325M and A 563/A 563M, respectively.

The Contractor shall furnish the Engineer one copy of the manufacturer's plan and parts list for each model installed.

The Contractor shall provide the Engineer with a Certificate of Compliance from the manufacturer in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications. The Certificate of Compliance shall certify that crash cushion conforms with the contract plans and specifications, and conforms to the prequalified design and material requirements.

Crash cushion will be measured by the unit as determined from actual count in place in the completed work.

The contract unit prices paid for crash cushion (REACT 9SCBS) shall include full compensation for furnishing all labor, materials (including anchor bolts, nuts, washers, and marker panels), tools, equipment, and incidentals, and for doing all the work involved in furnishing and installing the crash cushions, complete in place, including structure excavation, structure backfill, concrete anchor slab with bar reinforcing steel, transition plate and W-beam connector, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.88 CRASH CUSHION, SAND FILLED

Sand filled crash cushions shall be furnished and installed as shown on the plans and in conformance with these special provisions.

A sand filled crash cushion shall consist of a grouping of sand filled modules.

Crash cushions shall be installed at the following locations:

3.3 m Rt. "SD-15L" Line Station 439+90.088.

At the Contractor's option, modules for use in sand filled crash cushions shall be either Energite III Inertial Modules, Fitch Inertial Modules or Traffix Sand Barrels manufactured after March 31, 1997, or equal:

A. Energite III and Fitch Inertial Modules, manufactured by Energy Absorption Systems, Inc., One East Wacker Drive, Chicago, IL 60601-2076. Telephone 1-312-467-6750, FAX 1-800-770-6755

1. Distributor (North): Traffic Control Service, Inc., 8585 Thys Court, Sacramento, CA 95828. Telephone 1-800-884-8274, FAX 1-916-387-9734
2. Distributor (South): Traffic Control Service, Inc., 1881 Betmor Lane, Anaheim, CA 92805. Telephone 1-800-222-8274, FAX 1-714-937-1070

B. Traffix Sand Barrels, manufactured by Traffix Devices, Inc., 220 Calle Pintoresco, San Clemente, CA 92672. Telephone 1-949 361-5663, FAX 1-949 361-9205

1. Distributor (North): United Rentals, Inc., 1533 Berger Drive, San Jose, CA 95112. Telephone 1-408 287-4303, FAX 1-408 287-1929
2. Distributor (North): Statewide Safety & Sign, Inc., P.O. Box 1440, Pismo Beach, CA 93448. Telephone 1-800-559-7080, FAX 1-805 929-5786

Modules contained in the crash cushion shall be of the same type at each location. The color of the modules shall be the standard yellow color as furnished by the vendor, with black lids. The exterior components of the modules shall be formulated or processed to resist deterioration from ambient ultraviolet rays. The modules shall exhibit good workmanship free from structural flaws and objectionable surface defects.

The Contractor shall provide the Engineer with a Certificate of Compliance from the manufacturer in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications. The Certificate of Compliance shall certify that the crash cushions comply with the contract plans and specifications, conform to the prequalified design and material requirements, and were manufactured in conformance with the approved quality control program.

Sand for filling the modules shall be clean washed concrete sand of commercial quality. At the time of placing in the modules, the sand shall contain not more than 7 percent water, as determined by California Test 226.

Modules placed on bridge decks shall be provided with positioning blocks fastened to the deck surface. Positioning blocks shall be shaped as segments of a ring and placed along the inner or outer periphery of the module wall. A minimum

of 2 blocks, a minimum of one-sixth of a ring in length shall be provided for each module. Positioning blocks and fasteners shall be of a material that is corrosion and water resistant.

Module cylinders shall be filled with sand in conformance with the manufacturer's directions and to the sand capacity in kilograms for each module shown on the plans.

Lids shall be securely attached as recommended by the manufacturer.

A Type R or Type P marker panel shall be attached to the front of the crash cushion as shown on the plans, when the closest point of the crash cushion array is within 3.6 m of the traveled way. The marker panel, when required, shall be firmly fastened to the crash cushion with commercial quality hardware or by other methods approved by the Engineer.

Sand filled crash cushions, regardless of the number of modules required in each sand filled crash cushion, will be measured and paid for by the unit as crash cushion, sand filled. The quantity to be paid for will be determined from actual count of the units in place in the completed work.

The contract unit price paid for crash cushion, sand filled shall include full compensation for furnishing all labor, materials (including sand and marker panels), tools, equipment, and incidentals, and for doing all the work involved in furnishing and installing crash cushions, complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-1.89 THERMOPLASTIC TRAFFIC STRIPE AND PAVEMENT MARKING

Thermoplastic traffic stripes (traffic lines) and pavement markings shall be applied in conformance with the provisions in Section 84, "Traffic Stripes and Pavement Markings," of the Standard Specifications and these special provisions.

Thermoplastic material shall be free of lead and chromium, and shall conform to the requirements in State Specification PTH-02ALKYD.

Retroreflectivity of the thermoplastic traffic stripes and pavement markings shall conform to the requirements in ASTM Designation: D 6359-99. White thermoplastic traffic stripes and pavement markings shall have a minimum initial retroreflectivity of $250 \text{ mcd}\cdot\text{m}^{-2}\cdot\text{lx}^{-1}$. Yellow thermoplastic traffic stripes and pavement markings shall have a minimum initial retroreflectivity of $150 \text{ mcd}\cdot\text{m}^{-2}\cdot\text{lx}^{-1}$.

Where striping joins existing striping, as shown on the plans, the Contractor shall begin and end the transition from the existing striping pattern into or from the new striping pattern a sufficient distance to ensure continuity of the striping pattern.

Thermoplastic traffic stripes shall be applied at the minimum thickness and application rate as specified below. The minimum application rate is based on a solid stripe of 100 mm in width.

Minimum Stripe Thickness (mm)	Minimum Application Rate (kg/m)
2.5	0.5

Thermoplastic traffic stripes and pavement markings shall be free of runs, bubbles, craters, drag marks, stretch marks, and debris.

At the option of the Contractor, permanent traffic striping and pavement marking tape conforming to the provisions in "Prequalified and Tested Signing and Delineation Materials" of these special provisions may be placed instead of the thermoplastic traffic stripes and pavement markings specified herein. Permanent tape, if used, shall be installed in conformance with the manufacturer's specifications.

If permanent tape is placed instead of thermoplastic traffic stripes and pavement markings, the tape will be measured and paid for by the meter as thermoplastic traffic stripe and by the square meter as thermoplastic pavement marking.

10-1.90 PAINT TRAFFIC STRIPE AND PAVEMENT MARKING

Painted traffic stripes (traffic lines) and pavement markings, including traffic stripes shown on the stage construction and traffic handling sheets of the plans, shall be applied in conformance with the provisions in Section 84, "Traffic Stripes and Pavement Markings," of the Standard Specifications and these special provisions.

Attention is directed to "Order Of Work" and "Remove Traffic Stripe and Pavement Markings" of these special provisions

Traffic stripe placed as shown on the stage construction and traffic handling sheets of the plans shall be removed when no longer required for traffic handling as determined by the Engineer.

Traffic stripe and pavement marking paint shall conform to the requirements in State Specification No. PTWB-01.

The color of the painted traffic stripes and pavement markings shall conform to the requirements in ASTM Designation: D 6628-01.

Retroreflectivity of the paint traffic stripes and pavement markings shall conform to the requirements in ASTM Designation: D 6359-99. White painted traffic stripes and pavement markings shall have a minimum initial retroreflectivity of $250 \text{ mcd}\cdot\text{m}^{-2}\cdot\text{lx}^{-1}$. Yellow painted traffic stripes and pavement markings shall have a minimum initial retroreflectivity of $150 \text{ mcd}\cdot\text{m}^{-2}\cdot\text{lx}^{-1}$.

At the option of the Contractor, permanent traffic striping and pavement marking tape conforming to the provisions in "Prequalified and Tested Signing and Delineation Materials" of these special provisions may be placed instead of painted traffic stripes and pavement markings. Permanent tape, if used, shall be placed in conformance with the manufacturer's specifications.

If permanent tape is placed instead of painted traffic stripes and pavement markings, the tape will be measured and paid for by the meter as paint traffic stripe and by the square meter as paint pavement marking-of the number of coats designated in the Engineer's Estimate.

Where striping joins existing striping, as shown on the plans, the Contractor shall begin and end the transition from the existing striping pattern into or from the new striping pattern a sufficient distance to ensure continuity of the striping pattern.

10-1.91 PAVEMENT MARKERS

Pavement markers, including temporary pavement markers shown on the stage construction and traffic handling sheets of the plans, shall be placed in conformance with the provisions in Section 85, "Pavement Markers," of the Standard Specifications and these special provisions.

Attention is directed to "Remove Pavement Markers" of these special provisions regarding removal of temporary pavement markers shown on the stage construction and traffic handling sheets of the plans.

The sixth paragraph of Section 85-1.06 shall not apply to the temporary pavement markers shown on the plans.

Epoxy adhesive shall not be used to place temporary pavement markers in areas where removal of the markers will be required.

Attention is directed to "Traffic Control System For Lane Closure" of these special provisions regarding the use of moving lane closures during placement of pavement markers with bituminous adhesive.

The Contractor shall furnish the Engineer certificates of compliance for the pavement markers in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications.

Retroreflective pavement markers shall be marked as abrasion resistant on the body of the markers.

SECTION 10-2 HIGHWAY PLANTING AND IRRIGATION SYSTEMS

10-2.01 GENERAL

The work performed in connection with highway planting and irrigation systems shall conform to the provisions in Section 20, "Erosion Control and Highway Planting," of the Standard Specifications and these special provisions.

The Contractor shall notify the Engineer not less than 72 hours prior to requiring initial access to the existing irrigation controllers. When the Engineer determines that access to the controllers is required at other times, arrangements will be made to provide this access.

COST BREAK-DOWN

The Contractor shall furnish the Engineer a cost break-down for the contract lump sum items of highway planting and irrigation system. Cost break-down tables shall be submitted to the Engineer for approval within 15 working days after the contract has been approved. Cost break-down tables will be approved, in writing, by the Engineer before any partial payment will be made for the applicable items of highway planting and irrigation system involved.

Attention is directed to "Time-Related Overhead" of these special provisions regarding compensation for time-related overhead.

Cost break-downs shall be completed and furnished in the format shown in the samples of the cost break-downs included in this section. Line item descriptions of work shown in the samples are the minimum to be submitted. Additional line item descriptions of work may be designated by the Contractor. If the Contractor elects to designate additional line item descriptions of work, the quantity, value and amount for those line items shall be completed in the same manner as for the unit descriptions shown in the samples. The line items and quantities given in the samples are to show the manner of preparing the cost break-downs to be furnished by the Contractor.

The Contractor shall determine the quantities required to complete the work shown on the plans. The quantities and their values shall be included in the cost break-downs submitted to the Engineer for approval. The Contractor shall be responsible for the accuracy of the quantities and values used in the cost break-downs submitted for approval.

The sum of the amounts for the line items of work listed in each cost break-down table for highway planting and for irrigation system work shall be equal to the contract lump sum price bid for Highway Planting and Irrigation System,

respectively. Overhead and profit, except for time-related overhead, shall be included in each individual line item of work listed in a cost break-down table.

No adjustment in compensation will be made in the contract lump sum prices paid for highway planting and irrigation system due to differences between the quantities shown in the cost break-downs furnished by the Contractor and the quantities required to complete the work as shown on the plans and as specified in these special provisions.

Individual line item values in the approved cost break-down tables will be used to determine partial payments during the progress of the work and as the basis for calculating an adjustment in compensation for the contract lump sum items of highway planting and irrigation system due to changes in line items of work ordered by the Engineer. When the total of ordered changes to line items of work increases or decreases the lump sum price bid for either Highway Planting or Irrigation System by more than 25 percent, the adjustment in compensation for the applicable lump sum item will be determined in the same manner specified for increases and decreases in the total pay quantity of an item of work in Section 4-1.03B, "Increased or Decreased Quantities," of the Standard Specifications.

HIGHWAY PLANTING COST BREAK-DOWN

Contract No. 11-080944

UNIT DESCRIPTION	UNIT	APPROXIMATE QUANTITY	VALUE	AMOUNT
ROADSIDE CLEARING	LS	LUMP SUM		
CULTIVATE	M2	543		
PLANT (GROUP A)	EA	257		
PLANT (GROUP M)	EA	3390		
MULCH	M3	111		
SOIL AMENDMENT	M3	17		
COMMERCIAL FERTILIZER (PACKETS)	EA	3904		
COMMERCIAL FERTILIZER (SLOW RELEASE)	KG	44		
IRON SULFATE	KG	44		

TOTAL _____

IRRIGATION SYSTEM COST BREAK-DOWN

Contract No. 11-080944

UNIT DESCRIPTION	UNIT	APPROXIMATE QUANTITY	VALUE	AMOUNT
CHECK, TEST, REMOVE AND SALVAGE EXISTING IRRIGATION FACILITIES	LS	LUMP SUM		
CONTROL AND NEUTRAL CONDUCTORS	LS	LUMP SUM		
40 STATION IRRIGATION CONTROLLER	EA	2		
IRRIGATION CONTROLLER ENCLOSURE CABINET (SINGLE)	EA	3		
50 MM BACKFLOW PREVENTER ASSEMBLY	EA	1		
BACKFLOW PREVENTER ASSEMBLY ENCLOSURE	EA	1		
25 MM PLASTIC PIPE (SUPPLY LINE) (PR-200)	M	680		
32 MM PLASTIC PIPE (SUPPLY LINE) (PR-200)	M	20		
40 MM PLASTIC PIPE (SUPPLY LINE) (PR-200)	M	230		
65 MM PLASTIC PIPE (SUPPLY LINE) (PR-200)	M	10		
75 MM PLASTIC PIPE (SUPPLY LINE) (PR-200)	M	3120		
75 MM GALVANIZED STEEL PIPE (SUPPLY LINE)	M	220		
25 MM REMOTE CONTROL VALVE	EA	2		
40 MM REMOTE CONTROL VALVE	EA	2		
50 MM REMOTE CONTROL VALVE (MASTER)	EA	1		
50 MM FLOW SENSOR	EA	1		
50 MM GATE VALVE	EA	7		
75 MM GATE VALVE	EA	22		

UNIT DESCRIPTION	UNIT	APPROXIMATE QUANTITY	VALUE	AMOUNT
CHECK, TEST, REMOVE AND SALVAGE EXISTING IRRIGATION FACILITIES	LS	LUMP SUM		
SPRINKLER (TYPE C-2 MOD)	EA	243		
HOSE EXPANSION ASSEMBLY	M	8		

TOTAL _____

10-2.02 EXISTING HIGHWAY PLANTING

In addition to the provisions in Section 20, "Erosion Control and Highway Planting," of the Standard Specifications, work performed in connection with existing highway planting shall conform to the provisions in "Existing Highway Facilities," of these special provisions.

Replacement planting shall conform to the provisions in "Preservation of Property" of these special provisions.

MAINTAIN EXISTING PLANTED AREAS

Existing planted areas shall be maintained as directed by the Engineer. Maintaining existing planted areas will be paid for as extra work as provided in Section 4-1.03D, "Extra Work," of the Standard Specifications.

Attention is directed to "Preservation of Property" of these special provisions.

10-2.03 EXISTING HIGHWAY IRRIGATION FACILITIES

The work performed in connection with the various existing highway irrigation system facilities shall conform to the provisions in "Existing Highway Facilities," of these special provisions.

Water shall be maintained in conformance with the provisions in Section 20-5.025, "Maintain Existing Water Supply," of the Standard Specifications.

LOCATE EXISTING CROSSOVERS AND CONDUITS

Existing crossovers and conduits shown on the plans to be incorporated in the new work shall be located in conformance with the provisions for locating conduits in Section 20-5.03B, "Conduit for Irrigation Crossovers," of the Standard Specifications.

Unless otherwise directed by the Engineer, existing crossovers and conduits shown on the plans to be incorporated in the new work shall be located prior to performing work on irrigation systems.

If debris is encountered in the ends of conduits, the debris shall be removed prior to performing other work in the conduits. Removal of debris within the first one meter in these conduits shall be at the Contractor's expense. If debris is encountered in the conduits more than one meter from the ends of the conduits, the additional debris shall be removed as directed by the Engineer and the removal work will be paid for as extra work as provided in Section 4-1.03D of the Standard Specifications.

CHECK AND TEST EXISTING IRRIGATION FACILITIES

Existing irrigation facilities that are to remain and that are within those areas where work is to be performed, shall be checked for missing or damaged components and proper operation prior to performing any work. Existing irrigation facilities outside of work areas that are affected by the construction work shall also be checked for proper operation.

A written list of existing irrigation system deficiencies shall be submitted to the Engineer within 5 working days after checking the existing facilities.

Deficiencies found during checking of the existing facilities shall be corrected as directed by the Engineer. Corrective work ordered by the Engineer will be paid for as extra work as provided in Section 4-1.03D, "Extra Work," of the Standard Specifications.

Length of watering cycles for use of potable water from water meters for checking or testing existing irrigation facilities shall be as determined by the Engineer.

Additional repairs required for the existing irrigation system as ordered by the Engineer, except as otherwise provided for in "Existing Highway Irrigation Facilities" of these special provisions, will be paid for as extra work as provided in Section 4-1.03D, "Extra Work," of the Standard Specifications.

REMOVE EXISTING IRRIGATION FACILITIES

Existing irrigation facilities where shown on the plans to be removed, shall be removed. Facilities that are more than 150 mm below finished grade, excluding facilities to be salvaged, may be abandoned in place.

Immediately after disconnecting an existing irrigation facility to be removed or abandoned from an existing facility to remain, the remaining facility shall be capped or plugged, or shall be connected to a new or existing irrigation facility.

Existing backflow preventer assembly, remote control valves, gate valves and sprinklers, where shown on the plans to be removed, shall be salvaged.

The Engineer shall be given written notification of the intent to salvage existing irrigation facilities a minimum of 72 hours prior to salvaging these facilities.

Salvaged irrigation facilities shall remain the property of the State and shall be delivered to the Engineer.

A list of salvaged facilities, including the quantity and size of each item salvaged, shall be included with each delivery.

Facilities to be removed, excluding facilities to be salvaged, shall be disposed of in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.

10-2.04 HIGHWAY PLANTING

The work performed in connection with highway planting shall conform to the provisions in Section 20-4, "Highway Planting," of the Standard Specifications and these special provisions.

HIGHWAY PLANTING MATERIALS

Mulch

Mulch shall be wood chips.

Commercial Fertilizer (Slow Release)

Commercial fertilizer (slow release) shall be a pelleted or granular form, shall be slow or controlled release with a nutrient release over an 8- to 12-month period, and shall fall within the following guaranteed chemical analysis range:

Ingredient	Percentage
Nitrogen	16-21
Phosphoric Acid	6-8
Water Soluble Potash	4-12

Commercial Fertilizer (Packets)

Commercial fertilizer (packet) shall be slow or controlled release and shall be in a biodegradable packet form. The packet shall gradually release nutrients over a 12-month period. Each packet shall have a mass of 10 g \pm 1 g and shall have the following guaranteed chemical analysis:

Ingredient	Percentage
Nitrogen	20
Phosphoric Acid	10
Water Soluble Potash	5

Soil Amendment

Soil amendment shall be compost, and at the option of the Contractor, compost may be either A, B, or any combination of both:

- A. Green material consisting of chipped, shredded, or ground vegetation; or clean processed recycled wood products.
- B. Class A, exceptional quality biosolids composts, conforming to the requirements in United States Environmental Protection Agency (EPA) regulation 40 CFR, Part 503c.

Compost shall not contain paint, petroleum products, herbicides, fungicides or other chemical residues harmful to plant or animal life. Other deleterious material, plastic, glass, metal or rock shall not exceed 0.1-percent by weight or volume.

Compost shall be thermophilically processed for 15 days. During this process, the compost shall be maintained at minimum internal temperature of 55°C and be thoroughly turned at least 5 times. A 90-day curing period shall follow the thermophilic process.

Compost shall be screened through a screen no larger than 12 mm.

Compost shall measure at least 6 on the maturity and stability scale with a Solvita test kit.

A Certificate of Compliance for compost shall be furnished to the Engineer in conformance with the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications. The Certificate of Compliance shall state the Solvita maturity and stability scale test result of the compost.

ROADSIDE CLEARING

Prior to preparing planting areas, mulch areas, and erosion control (Type 1, Type 2 and Type 3) areas, or commencing irrigation trenching operations for planting areas, trash and debris shall be removed from the entire highway right of way within the project limits, excluding paved areas and existing planted areas where existing plants are to remain.

In addition to removing trash and debris, the project area shall be cleared as specified herein:

- A. Weeds shall be killed and removed within proposed mulch areas.
- B. Weeds shall be killed and removed within planting areas where plants are to be planted in groups or rows 4.6 m or less apart and from within an area extending 2 m beyond the outer limits of the groups or rows of plants.
- C. Weeds shall be killed and removed within an area 0.6-m in diameter centered at each liner plant location where the plants are planted more than 3 m apart. At locations where liner plants are to be planted less than 3 m apart, weeds shall be killed and removed within the entire area, immediately prior to cultivation.
- D. Weeds shall be killed and removed from within areas where portland cement concrete surfacing is to be placed.
- E. Roadside clearing for erosion control (Type 1, Type 2 and Type 3) shall also consist of mowing weeds in the areas to be seeded until the start of the erosion control (Type 1, Type 2 and Type 3) operation.

After the initial roadside clearing is complete, additional roadside clearing work shall be performed as necessary to maintain the areas, as specified above, in a neat appearance until the start of the plant establishment period. This work shall include the following:

- A. Trash and debris shall be removed.
- B. Rodents shall be controlled.
- C. Weed growth shall be killed before the weeds reach the seed stage of growth or exceed 150 mm in length, whichever occurs first.
- D. Weeds in plant basins, including basin walls, shall be removed by hand pulling, after the plants have been planted.

Weed Control

Weed control shall also conform to the following:

- A. Stolon type weeds shall be killed with glyphosate.
- B. Tumbleweeds shall be removed by hand pulling before the tumbleweeds reach a height of 150 mm.
- C. Removed weeds shall be disposed of outside the highway right of way in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.
- D. Areas to be mowed shall be mowed when weed height exceeds 300 mm. Weeds shall be mowed to a height of 50 mm to 150 mm.

Roadside clearing work shall not include work required to be performed as clearing and grubbing as specified in Section 16, "Clearing and Grubbing," of the Standard Specifications.

PESTICIDES

Pesticides used to control weeds shall conform to the provisions in Section 20-4.026, "Pesticides," of the Standard Specifications. Except as otherwise provided in these special provisions, pesticide use shall be limited to the following materials:

Diquat
 Glyphosate
 Sethoxydim
 Oxadiazon - 50 percent WP (Preemergent)
 Oryzalin (Preemergent)
 Trifluralin (Preemergent)
 Ammonium Sulfate

Glyphosate shall be used to kill stolon type weeds.

Oxadiazon shall be of the emulsifiable concentration or wettable powder type.

Prior to the application of preemergents, ground cover plants shall have been planted a minimum of 3 days and shall have been thoroughly watered.

A minimum of 100 days shall elapse between applications of preemergents.

Except for ground cover plants, preemergents shall not be applied within 450 mm of plants or within seeding areas.

If the Contractor elects to request the use of other pesticides on this project, the request shall be submitted, in writing, to the Engineer not less than 15 days prior to the intended use of the other pesticides. Except for the pesticides listed in these special provisions, no pesticides shall be used or applied without prior written approval of the Engineer.

Pesticides shall not be applied within the limits of the plant basins. Pesticides shall not be applied in a manner that allows the pesticides to come in contact with the foliage and woody parts of the plants.

CULTIVATE

Areas to be planted with plant (Group M) plants shall be cultivated.

Immediately prior to cultivation, soil amendment and commercial fertilizer shall be added to the areas to be cultivated. Soil amendment shall be added at the rate shown on the plans and commercial fertilizer shall be applied at the rate of 2 kilograms per 100 square meters. Soil amendment and fertilizer shall be thoroughly mixed with the soil.

After cultivation is complete and the irrigation systems have been installed and the plant holes have been excavated and backfilled, no further planting work shall be done in the cultivated areas for a period of 21 days, except the soil shall be kept sufficiently moist to germinate weeds. Weeds that germinate shall be killed.

Iron sulfate shall be applied or placed at the time of planting and at the rates shown on the Plant List and in conformance with the provisions in Section 20-4.05, "Planting," of the Standard Specifications and these special provisions.

Commercial fertilizer packets shall be placed in the backfill of each plant at the time of planting and at the rate shown on the Plant List to within 150 to 200 mm of the soil surface and approximately 25 mm from the roots. When more than one fertilizer packet is required per plant, the packets shall be distributed evenly around the root ball.

Attention is directed to "Irrigation Systems Functional Test" of these special provisions regarding functional tests of the irrigation systems. Planting shall not be performed in an area until the functional test has been completed for the irrigation system serving that area.

LINER PLANTS

Liner plants shall be furnished in containers with a minimum size of 60 mm (width) x 85 mm (depth). Liner plant containers made of biodegradable material shall not be used. All liner plants shall be removed from their containers at the time of planting.

Planting holes for liner plants shall be large enough to accommodate the total length and width of the roots, and commercial fertilizer packet.

PLANT ESTABLISHMENT WORK

The plant establishment period shall be Type 2 and shall not be less than 250 working days.

Commercial fertilizer (slow release) shall be applied to shrubs during the first week of April, July and September of each year. Commercial fertilizer shall be applied at the rates shown on the plans and shall be spread with a mechanical spreader wherever possible.

Weeds within plant basins, including basin walls, shall be controlled by hand pulling.

Weeds within mulched areas and areas where liner plants are planted shall be controlled by killing.

Weeds within erosion control (Type 1, Type 2 and Type 3) areas shall be killed with spot herbicide treatment before weeds reach the seed stage of growth or a height of 150 mm, whichever occurs first.

Weeds within median areas, pavement, curbs, sidewalk, and other surfaced areas shall be controlled by killing.

At the option of the Contractor, plants of a larger container size than those originally specified may be used for replacement plants during the first 125 working days of the plant establishment period. The use of plants of a larger container size than those originally specified for replacement plants shall be at the Contractor's expense.

After 125 working days of the plant establishment period have been completed, replacement of plants shall be No. 1 size for liner size plants, and No. 5 size for No. 1 size plants.

When ordered by the Engineer, one application of a preemergent pesticide conforming to the provisions in "Pesticides" of these special provisions, shall be applied between 40 and 50 working days prior to completion of the plant establishment period. This work will be paid for as extra work as provided in Section 4-1.03D of the Standard Specifications.

The final inspection shall be performed in conformance with the provisions in Section 5-1.13, "Final Inspection," of the Standard Specifications and shall be completed a minimum of 20 working days before the estimated completion of the contract.

When the plant (Group M) plants have reached a height of 250 mm, the plants shall be mowed to a height of 150 mm. Mowing shall be repeated as often as necessary to maintain the height of the plant (Group M) plants at 150 mm. Mowed material shall be removed and disposed of outside the highway right of way in conformance with the provisions in Section 7-1.13, "Disposal of Material Outside the Highway Right of Way," of the Standard Specifications.

Full compensation for mowing plant (Group M) plants and disposing of mowed material during the plant establishment period shall be considered as included in the contract lump sum price paid for plant establishment work and no additional compensation will be allowed therefor.

10-2.05 IRRIGATION SYSTEMS

Irrigation systems shall be furnished and installed in conformance with the provisions in Section 20-5, "Irrigation Systems," of the Standard Specifications, except materials containing asbestos fibers shall not be used.

Attention is directed to the provisions in "Obstructions" of these special provisions, regarding work over or adjacent to existing underground facilities. Excavation for proposed irrigation facilities shall not be started until the existing underground facilities have been located.

Method A pressure testing shall conform to the provisions in Section 20-5.03H(1), "Method A", of the Standard Specifications, except leaks that develop in the tested portion of the system shall be located and repaired after each test period when a drop of more than 35 kPa is indicated by the pressure gage. After the leaks have been repaired, the one hour pressure test shall be repeated and additional repairs made until the drop in pressure is 35 kPa or less.

VALVE BOXES

Valve boxes shall conform to the provisions in Section 20-2.24, "Valve Boxes," of the Standard Specifications, except as otherwise provided herein.

Valve boxes shall be precast portland cement concrete, fiberglass or reinforced plastic.

Valve boxes shall not have side openings unless otherwise shown on the plans.

Covers for concrete valve boxes shall be glass fiber reinforced plastic, plastic, or concrete, .

Covers for plastic valve boxes shall be glass fiber reinforced plastic or plastic.

Valve boxes with plastic covers shall be identified on the top surface of the covers by branding the appropriate abbreviations for the irrigation facilities contained in the valve boxes as shown on the plans. Valve boxes that contain remote control valves shall be identified by the appropriate letters and numbers (controller and station numbers). The letters and numbers shall be 50 mm in height.

Valve boxes with concrete or glass fiber reinforced plastic covers shall be identified on the top surface of the covers by labels containing the appropriate abbreviation for the irrigation facility contained in the valve box as shown on the plans. Valve boxes that contain remote control valves shall be identified by the appropriate letters and numbers (controller and station numbers). Labels for valve boxes shall conform to the provisions in Section 20-5.03F, "Valves and Valve Boxes," of the Standard Specifications.

Label material shall be plate plastic or polyurethane.

GATE VALVES

Gate valves shall be as shown on the plans and in conformance with the provisions in Section 20-2.28, "Gate Valves," of the Standard Specifications and these special provisions.

Gate valves, 75 mm and larger in size, shall be furnished with a square nut and 3 long shank keys that will operate the valve.

Gate valves, 75 mm and larger in size, shall be flanged type gate valves. Pipe flanges used to connect plastic or metal pipe to gate valves shall be metal.

Gate valves shall have a solid bronze or brass wedge.

ELECTRIC AUTOMATIC IRRIGATION COMPONENTS

Irrigation Controllers

The Remote Irrigation Control System (RICS) irrigation controllers shall be Rain Bird Maxicom controllers.

Arrangements have been made to insure that any successful bidder can obtain the specified equipment listed below from United Green Tech, 23372 South Pointe Drive, Suite B, Laguna Hills, California, 92653, telephone (949) 455-7465 or (800) 427-0779.

The quoted prices and equipment are as follows:

EQUIPMENT DESCRIPTION	QUOTED PRICE	SALES TAX	EXTENDED PRICE	QUANTITY AT THIS PRICE	CONTROLLER IDENTIFICATION
40 Station Irrigation Controller ESP-MC 40 Station Satellite Controller Assembly, Model No. RB1-40. Line Primary Protection, Model No. LPP. Master Valve Relays, Model No. MVR. Link Flow Sensing and Monitor Assembly, Model No. LFSM. Omni Pole Mount Antenna, Model No. OMNI-P. Universal 2 Multi Wire to 2 Wire Converter, Model No. UNIV2. Universal 2 Receiver, Model No. HTL-RC. TRC Receiver Card and Antenna Kit, Model No. TRC-RCA.	\$4,825.00	\$374.00	\$5,199.00	1	IC "B"
40 Station Irrigation Controller ESP-MC 40 Station Satellite Controller Assembly, Model No. RB1-40. Line Primary Protection, Model No. LPP. Master Valve Relays, Model No. MVR. Link Flow Sensing and Monitor Assembly, Model No. LFSM. Universal 2 Multi Wire to 2 Wire Converter, Model No. UNIV2. 3- Universal 2 Receiver, Model No. HTL-RC. 1- Universal 2 Receiver, Model No. HTL-PS. TRC Receiver Card and Antenna Kit, Model No. TRC-RCA.	\$4,505.00	\$349.00	\$4,854.00	1	IC "A"

Prices are guaranteed by United Green Tech until September 26, 2006.

Attention is directed to the provisions in "Electric Service (Irrigation)" of these special provisions regarding electrical power for irrigation controllers and irrigation controller enclosure cabinets.

Electric Remote Control Valves

Electric remote control valves shall conform to the provisions in Section 20-2.23, "Control Valves," of the Standard Specifications and the following:

- A. Valves shall be glass filled nylon, brass, or bronze construction.
- B. Valves shall be angle pattern (bottom inlet) or straight pattern (side inlet) as shown on the plans.
- C. Valves shall be equipped with a self flushing feature manufactured to be used with reclaimed water. Valves shall not have external tubing.
- D. Valves shall have manual external and manual internal bleed capability.
- E. Valve solenoids shall be one piece with plunger and spring secured to the solenoid.

Pull Boxes

Pull box installations shall conform to the provisions in Section 20-5.027I, "Conductors, Electrical Conduits and Pull Boxes," of the Standard Specifications.

Conductors

Low voltage, as used in this section "Conductors," shall mean 36 V or less.

Low voltage control and neutral conductors in pull boxes and valve boxes, at irrigation controller terminals, and at splices shall be marked as follows:

- A. Conductor terminations and splices shall be marked with adhesive backed paper markers or adhesive cloth wrap-around markers, with clear, heat-shrinkable sleeves sealed over the markers.
- B. Non-spliced conductors in pull boxes and valve boxes shall be marked with clip-on, "C" shaped, white extruded polyvinyl chloride sleeves. Marker sleeves shall have black, indented legends of uniform depth with transparent overlays over the legends and "chevron" cuts for alignment of 2 or more sleeves.

Markers for the control conductors shall be identified with the appropriate number or letter designations of irrigation controllers and station numbers. Markers for neutral conductors shall be identified with the appropriate number or letter designations of the irrigation controllers.

The color of low voltage neutral and control conductor insulation, except for the striped portions, shall be homogeneous throughout the entire thickness of the insulation.

Insulation for conductors may be UL listed polyethylene conforming to UL44 test standards with a minimum insulation thickness of 1.05 mm for wire sizes 10AWG and smaller.

IRRIGATION CONTROLLER ENCLOSURE CABINET

Irrigation controller enclosure cabinets shall be constructed and equipment installed in the cabinets in conformance with the details shown on the plans, the provisions of Section 86-3.04A, "Cabinet Construction," of the Standard Specifications, and these special provisions.

Electric service shall be installed in accordance with "Electric Service (Irrigation)" of these special provisions.

Irrigation controller enclosure cabinets shall be provided with cross ventilation, roof ventilation or a combination of both. The ventilation shall not compromise the weather resistance properties of the irrigation controller enclosure cabinets and shall be fabricated by the manufacturer.

The anchorage arrangement shall be inside the cabinet as shown on the plans. Dimensions of the cabinet shall be suitable for the equipment to be installed as shown on the plans and specified in these special provisions.

Irrigation controller enclosure cabinet dimensions for a single irrigation controller shall be 915 mm (Height) x 610 mm (Width) x 305 mm (Depth).

Irrigation controller enclosure cabinets shall be fabricated in conformance with the provisions in Section 86-3.04A, "Cabinet Construction," of the Standard Specifications.

Irrigation controller enclosure cabinets shall be fabricated of stainless steel.

Door locks for the irrigation controller enclosure cabinets shall be a removable-core mortise cam cylinder door lock that receives the State's lock core. The State's lock core is a "Best" construction core. Keys shall be removable from the locks in the locked position only. Door locks shall be installed in conformance with the manufacturer's written instructions and recommendations. Two keys for each door lock shall be delivered to the Engineer.

Irrigation controller enclosure cabinet door handles shall have provisions for padlocking in the latched position. Padlocks will be State-furnished as provided under "State-Furnished Materials" of these special provisions.

Mounting panels shall be fabricated of stainless steel metal sheets with a minimum thickness of 4 mm.

Inside of the doors shall have provisions for storage of the irrigation plans.

Equipment, except for field wiring, shall be installed in the cabinet in a shop prior to field installation.

IRRIGATION SYSTEMS FUNCTIONAL TEST

Functional tests for the irrigation controllers and associated automatic irrigation systems shall conform to the provisions in Section 20-5.027J, "Testing," of the Standard Specifications and these special provisions.

Tests shall demonstrate to the Engineer, through one complete cycle of the irrigation controllers in the automatic mode, that the associated automatic components of the irrigation systems operate properly. If automatic components of the irrigation systems fail a functional test, these components shall be repaired at the Contractor's expense and the testing repeated until satisfactory operation is obtained.

Associated automatic components shall include, but not be limited to, remote control valves.

Upon completion of work on an irrigation system, including correction of deficiencies and satisfactory functional tests for the systems involved, the plants to be planted in the area watered by the irrigation system may be planted provided the planting areas have been prepared as specified in these special provisions.

PIPE

Steel Pipe

Galvanized steel pipe supply lines shall be installed in conformance with the detail shown on the plans.

Plastic Pipe

Plastic pipe supply lines shall be polyvinyl chloride (PVC) 1120 or 1220 pressure rated pipe with the minimum pressure rating (PR) shown on the plans.

Plastic pipe supply lines and fittings that are 75 mm or larger in diameter on the supply side of control valves shall be the rubber ring gasket type, except when pressure rating (PR) 315 plastic pipe supply line is required.

Plastic pipe supply lines less than 75 mm in diameter shall have solvent cemented type joints. Primers shall be used on the solvent cemented type joints.

Plastic pipe supply lines (main) shall have a minimum cover of 0.45 m.

Fittings for plastic pipe supply lines with a pressure rating (PR) of 315 shall be Schedule 80.

Thrust blocks shall be installed on the main supply line in conformance with the detail shown on the plans.

BACKFLOW PREVENTER ASSEMBLIES

Backflow preventers shall conform to the provisions in Section 20-2.25, "Backflow Preventers," of the Standard Specifications and these special provisions.

Backflow preventers shall have current approval from the University of Southern California Foundation for Cross-Connection Control and Hydraulic Research (USC Foundation).

Before backflow preventer assembly installation, the Contractor shall provide the Engineer with the portion of the USC Foundation "List of Approved Backflow Prevention Assemblies" showing type of assembly, manufacturer's name, model number, edition of the manual under which the assembly was approved, approval date and the last renewal date.

The "List of Approved Backflow Prevention Assemblies" is available to Foundation Members. Membership information to join the USC Foundation is available at:

<http://www.usc.edu/dept/fccchr/membership.html>

Questions concerning the USC Foundation "List of Approved Backflow Prevention Assemblies" can be answered by calling the Foundation at toll free (866) 545-6340.

Pressure loss through the backflow preventers shall not exceed the following:

BACKFLOW PREVENTER SIZE (millimeters)	FLOW RATE (Liters per minute)	PRESSURE LOSS (kPa)
50	420	90

Backflow preventer assemblies shall be painted with a minimum of 2 applications of a commercial quality enamel paint. The color of the paint shall be light brown.

BACKFLOW PREVENTER ASSEMBLY ENCLOSURE

Enclosures shall be fabricated of structural steel angles and flattened expanded metal and shall be installed over backflow preventer assemblies on a portland cement concrete pad as shown on the plans and in conformance with these special provisions.

Metal for sides, ends and top panels shall be fabricated from No. 9 expanded metal. The flattened expanded metal openings shall be approximately 20 mm by 45 mm in size.

Expanded metal panels shall be attached to the steel frames by a series of welds, not less than 6.4 mm in length and spaced not more than 100 mm on centers, along the edges of the enclosure.

Padlocks will be State-furnished in accordance with "State-furnished Materials" of these special provisions.

Enclosures shall be galvanized, after fabrication, in conformance with the provisions in Section 75-1.05, "Galvanizing," of the Standard Specifications.

Concrete for the concrete pad shall conform to Section 90-10, "Minor Concrete," of the Standard Specifications.

Hold down bolt assemblies shall be galvanized and shall be installed when the portland cement concrete pad is still plastic. Nuts shall be hexagonal and washers shall be the lock type.

Enclosures shall be painted with one application of a commercial quality pre-treatment, vinyl wash primer and a minimum of one application of a commercial quality, exterior enamel for metal. The finish color shall be light brown.

All parts of the backflow preventer assembly enclosure, including hold down assemblies, may be constructed of stainless steel instead of standard steel materials specified above. Stainless steel enclosures shall conform to the provisions herein except galvanizing, priming and painting shall not be required. Stainless steel enclosures shall be powder coated a light brown color by the manufacturer.

The minimum clearance between the backflow preventer assembly and the backflow preventer assembly enclosure shall be 150 mm.

TESTING NEW BACKFLOW PREVENTERS

New backflow preventers shall be tested for proper operation in conformance with the provisions in Section 20-5.03J, "Check and Test Backflow Preventers," of the Standard Specifications and these special provisions.

Tests for new backflow preventers shall be satisfactorily completed after installation and before operation of the irrigation systems.

New backflow preventers shall be retested one year after the satisfactory completion of the previous test, and each year thereafter until the plant establishment period is completed. An additional test shall be provided not more than 10 days prior to acceptance of the contract.

SPRINKLERS

Sprinklers shall conform to the type, pattern, material, and operating characteristics listed in the "Sprinkler Schedule" shown on the plans.

Sprinkler (Type C-2) Modified

Sprinkler (Type C-2 Mod) shall be furnished and installed as shown on the plans, in conformance with these special provisions and as directed by the Engineer.

Drainpipe shall be commercially available, rigid, perforated, polyvinyl chloride (PVC) pipe with holes spaced not more than 150 mm on center on one side of the pipe.

The drain grate shall be a commercially available, one-piece, injection molded drain grate manufactured from structural foam polyolefins, with ultraviolet light inhibitors. The color of the drain grate shall be green.

Pea gravel for filling the drainpipe shall have a nominal diameter of 15-20 mm. Pea gravel shall be, naturally rounded aggregate, clean, washed, dry and free from clay or organic material.

HOSE EXPANSION ASSEMBLY

Hose expansion assembly shall be furnished and installed at the locations shown and in conformance with the details shown on the plans, these special provisions and as directed by the Engineer.

Hose expansion assembly shall consist of flexible hose and flanged hose fittings. Hose shall be medium or heavy weight, oil resistant, flexible, rubber or synthetic rubber cover and tube, reinforced with a minimum of 2-ply synthetic yarn or steel wire and shall be equipped with steel flanges. The hose shall be suitable for both above ground and direct burial installations. The hose and flange assembly shall have the same nominal inside diameter as the supply line and shall be rated for a minimum working pressure of 1.4 MPa.

FINAL IRRIGATION SYSTEM CHECK

A final check of existing and new irrigation facilities shall be performed not more than 30 working days and not less than 20 working days prior to acceptance of the contract.

The length of watering cycles using potable water measured by water meters for the final check of irrigation facilities will be determined by the Engineer.

Remote control valves connected to existing and new irrigation controllers shall be checked for automatic performance when the controllers are in automatic mode.

Unsatisfactory performance of irrigation facilities installed or modified by the Contractor shall be repaired and rechecked at the Contractor's expense until satisfactory performance is obtained, as determined by the Engineer.

Repair or replacement of existing irrigation facilities due to unsatisfactory performance shall conform to the provisions in "Existing Highway Irrigation Facilities" of these special provisions.

Nothing in this section "Final Irrigation System Check" shall relieve the Contractor of full responsibility for making good or repairing defective work or materials found before the formal written acceptance of the entire contract by the Director.

Full compensation for checking the irrigation systems prior to the acceptance of the contract shall be considered as included in the contract lump sum price paid for plant establishment work and no additional compensation will be allowed therefor.

SECTION 10-3. SIGNALS, LIGHTING AND ELECTRICAL SYSTEMS

10-3.01 DESCRIPTION

Traffic signals and lighting, lighting and sign illumination, lighting (city street), fiber optic communication system, high occupancy vehicle system, install concrete barrier (movable), electric service (irrigation), ramp metering systems, traffic monitoring stations, communication conduit (bridge) and sprinkler control conduit (bridge) shall conform to the provisions in Section 86, "Signals, Lighting and Electrical Systems," of the Standard Specifications and these special provisions.

Lighting equipment is included in the following structures:

- A. Via Rancho Pkwy OC (Bridge No. 57-623).
- B. North County Fair OC (Bridge No. 57-941).

Communication conduit is included in the following structures:

- A. North County Fair OC (Bridge No. 57-941).

Sprinkler control conduit for irrigation is included in the following structures:

- A. North County Fair OC (Bridge No. 57-941).

Traffic signal work shall be performed at the following locations:

- A. Route 15 Southbound ramp at Via Rancho Pkwy.
- B. Route 15 Northbound ramp at Via Rancho Pkwy.
- C. Route 15 at Plaza Del Lago Blvd.

10-3.02 COST BREAK-DOWN

Cost break-downs shall conform to the provisions in Section 86-1.03, "Cost Break-Down," of the Standard Specifications and these special provisions.

The Engineer shall be furnished a cost break-down for each contract lump sum item of work described in this Section 10-3.

The cost break-down of those lump sum items provided in the individual design sequencing packages that have signed electrical plan sheets shall be submitted to the Engineer for approval within 15 days after the individual design sequencing packages have been provided to the Contractor. The cost break-down shall be approved, in writing, by the Engineer before any partial payment for the items of electrical work will be made.

Attention is directed to "Overhead" of these special provisions regarding compensation for time-related overhead.

Cost break-downs shall be completed and furnished in the format shown in the samples of the cost break-downs included in this section.

The sum of the amounts for the line items of work listed in each cost break-down table below for electrical work shall be equal to the contract lump sum price bid for each lump sum electrical item. Overhead and profit, except for time-related overhead, shall be included in each individual line item of work listed in a cost break-down table.

Individual line item values in the approved cost break-down tables will be used to determine partial payments during the progress of the work and as the basis for calculating an adjustment in compensation for the items within the cost breakdowns of for each lump sum electrical item due to changes ordered by the Engineer. When the ordered changes to line items of work increases or decreases by more than 25 percent, the adjustment in compensation for the applicable cost breakdown item will be determined in the same manner specified for increases and decreases in the total pay quantity of an item of work in Section 4-1.03B, "Increased or Decreased Quantities," of the Standard Specifications.

The following are the quantity break-downs for the contract lump sum items of lighting and sign illumination, ramp metering, signal and lighting, and electrical systems. The quantity break-downs are included in these special provisions for the Contractor to use for bidding purposes in the absence of signed electrical plans.

The following quantity break-downs for contract lump sum items for lighting and sign illumination, ramp metering, signal and lighting, electrical systems shall be provided by the Contractor:

1. Lighting and sign illumination along Route 15 "SD15L" between stations 434+00 and 458+00. Signed electrical plans will be provided to the Contractor detailing the location of measurable components as detailed in the following table.

LIGHTING AND SIGN ILLUMINATION	UNIT DESCRIPTION	QUANTITY	PRICE	AMOUNT
Lighting Standard with foundation (EA)	36, 35	29		
	15D	9		
	RC	14		
Luminaires (EA)	ISL (85W) Sign	16		
	180W-LPS	44		
	RS	12		
Pull Boxes (EA)	No. 5 or 6	61		
	No. 5(T) or 6(T)	11		
	9A	35		
	RC	13		
Conduit (m)	53C	4620		
	78C	100		
Conductors (m)	#6	9400		
	#8	150		
	#10	620		
	#12	500		
	#14	430		
	SIC	1250		
Cabinet (EA)	Type III-BF	2		
Install Cabinet (EA)	SF Type 334	3		
Controller Cabinet (EA)	Foundation	3		
Sign Control (EA)		5		
		TOTAL		

2. Ramp metering system (location 1) on Route 15 southbound on ramp at Via Rancho Parkway. Signed electrical plans will be provided to the Contractor detailing the location of measurable components as detailed in the following table.

RAMP METERING SYSTEM(LOCATION 2)	UNIT DESCRIPTION	QUANTITY	PRICE	AMOUNT
Relocate Poles includes new foundation (EA)	1-A (2.1 m or 3 m)	2		
	15	1		
Pull Boxes (EA)	No. 5 or 6	10		
	No. 5(T) or 6(T)	5		
	RC	10		
Detectors (EA)	Loops	24		
Conductors (m)	DLC	2,500		
	9CSC	150		
	SIC	100		
	#14	200		
	#8	200		
	#6	300		
Conduit (m)	53C	300		
	78C	100		
Relocate Cabinet (EA)	SF Type 334	1		
Controller Foundation (EA)	SF Type 334	1		
		TOTAL		

4. Traffic monitoring station (Location 1) on northbound and southbound Route 15 "SD15L" from station 451 +00 to station 452+00. Signed electrical plans will be provided to the Contractor detailing the location of measurable components as detailed in the following table.

TRAFFIC MONITORING STATION	UNIT DESCRIPTION	QUANTITY	PRICE	AMOUNT
Pull Boxes (EA)	No. 5 or 6	2		
	No. 5(T) or 6(T)	7		
Detectors (EA)	Loops	30		
Conduit (m)	53C	50		
	78C	210		
Conductors (m)	DLC	5200		
	#8	200		
Install Cabinet (EA)	SF Type 334	2		
Controller Foundation (EA)		2		
		TOTAL		

5. Traffic monitoring station (Location 2) on northbound and southbound Route 15 "SD15M" from station 309 +90. Signed electrical plans will be provided to the Contractor detailing the location of measurable components as detailed in the following table.

TRAFFIC MONITORING STATION	UNIT DESCRIPTION	QUANTITY	PRICE	AMOUNT
Pull Boxes (EA)	No. 5(T) or 6(T)	2		
Detectors (EA)	Loops	12		
Conduit (m)	78C	20		
Conductors (m)	DLC	840		
	FO12	190		
		TOTAL		

6. Signal and lighting (Location 1) on Route 15 southbound ramp at Via Rancho Pkwy. Signed electrical plans will be provided to the Contractor detailing the location of measurable components as detailed in the following table.

SIGNAL AND LIGHTING (LOCATION 1)	UNIT DESCRIPTION	QUANTITY	PRICE	AMOUNT
Signal (EA)	SV-1-T	1		
	PPB	1		
	MAS	1		
	MAT	1		
Signal and Lighting Standard including foundation (EA)	26	1		
RC (EA)	Type 29 Signal Std.	1		
Relocate Pole includes new foundation (EA)	26, 1-A	1, 1		
Pull Box (EA)	No. 5 or 6	10		
	RC	4		
Video Detection System (EA)	Processors	4		
	Cameras	4		
Detectors (EA)	Loops	12		
Conduits (m)	53C	250		
	78C	150		
Conductors (m)	#8	300		
	DLC	1,500		
	3CSC	250		
	12CSC	350		
	SIC	100		
	Video Cable	250		
	EVC	250		
Miscellaneous	Install Sign (EA)	1		
Luminaires including lamp and ballast (EA)	310W	1		
		TOTAL		

FIBER OPTIC COMMUNICATION SYSTEM	UNIT DESCRIPTION	QUANTITY	PRICE	AMOUNT
Standard including foundation (EA)	CCTV 40	1		
Pull Box (EA)	6(E)(T)	13		
	Vaults	4		
Conduits (m)	MDCS(8)	1930		
	27C	720		
Conductors (m)	FO12	840		
	FO144	2500		
	OCC	850		
Install Cabinet (EA)	Type 334 (CCTV)	1		
	Camera (CCTV)	1		
Miscellaneous (EA)	Fiber Optic Splices	650		
	Fiber Optic Splice Closures	1		
	FDU	7		
	Delineators	4		
	VDSL Switch	2		
	SECU	9		
	VDSL CPE	6		
	Media Convertor	7		
	Video Encoder	1		
		TOTAL		

10. High occupancy vehicle (HOV) system along Route 15 "SD15M" between stations 311+50 and 450+00 to provide lane delineation and access control. Signed electrical plans will be provided to the Contractor detailing the location of measurable components as detailed in the following table.

HIGH OCCUPANCY VEHICLE SYSTEM	UNIT DESCRIPTION	QUANTITY	PRICE	AMOUNT
Illuminated Pavement Marker (EA)		204		
Automatic Traffic Channelizer (EA)		106		
Pull Box (EA)	6(E)(T)	25		
Conduits (m)	53C	1500		
	27C	1000		
Conductors (m)	#8	500		
	#10	3000		
	#14	1400		
Cable (m)	Illuminated Pavement Marker Control Power Cable	1000		
	Guide Wire System (Movable Barrier Guidewire)	25,600		
	Automatic Traffic Channelizer Cable	1000		
Cabinet w/foundation (EA)	Type 332 (HOV)	28		
	Back-up Power System	1		
Controller Equip. Assembly (EA)	Illuminated Pavement Marker	4		
	Automatic Traffic Channelizer	7		
	Guidewire Signal Generator	48		
Miscellaneous (EA)	Software-Illuminated Pavement Marker	1		
	Software-Automatic Traffic Channelizer	1		
Variable Message Sign (EA)	Rotary Drum Signs (One Drum Configuration)	2		
	Rotary Drum Signs (Two Drum Configuration)	4		
	Rotary Drum Signs (Three Drum Configuration)	2		
	Light Emitting Diode Arrow Board	1		
	Ground Cabinet	4		
	Fiber Modems (Single Mode)	4		
	PC Workstation and Central Software	1		
		TOTAL		

11. Lighting (city street) on Route 15 at North County Fair OC. Signed electrical plans will be provided to the Contractor detailing the location of measurable components as detailed in the following table.

Arrangements have been made to insure that any successful bidder can obtain the specified equipment listed below from O'Connor Sales Agency, 5797 Chesapeake Court, Suite 200, San Diego, Ca 92123, telephone (858) 514-4000, facsimile (858) 505-1818. The price quoted for the equipment is as follows:

The quoted prices and equipment are as follows:

Equipment Description	Quantity	Quoted Price/EA	Extended Price
SATT-MAX-1/150W/HPS/ED28-MOGUL/GREY/T-DRA-5"-3"-MOD PHOTOCELL/DRA-5-3"-10'-GREY	4	\$2,195	\$8,780
Lamp	4	\$20	\$80
		TOTAL	\$8,860

Contact the vendor for information regarding tax, shipping, handling or delivery details, purchase and payment terms, and location. The quoted equipment prices are guaranteed by O'Connor Sales Agency until October 17, 2006.

10-3.07 CONDUIT

Conduit to be installed underground shall be Type 3 unless otherwise specified.

Pull ropes for empty conduits for future use shall be a soft fiber type of not less than 12 mm diameter.

The conduit in a foundation and between a foundation and the nearest pull box shall be Type 3.

Conduit sizes shown on the plans and specified in the Standard Specifications and these special provisions are referenced to metallic type conduit. When rigid non-metallic conduit is required or allowed, the nominal equivalent industry size shall be used as shown in the following table:

Size Designation for Metallic Type Conduit	Equivalent Size for Rigid Non-metallic Conduit
21	20
27	25
41	40
53	50
63	65
78	75
103	100

When Type 3 conduit is placed in a trench (not in pavement or under portland cement concrete sidewalk), after the bedding material is placed and the conduit is installed, the trench shall be backfilled with commercial quality concrete, containing not less than 250 kg of portland cement per cubic meter, to not less than 100 mm above the conduit before additional backfill material is placed.

Multiduct conduit system (MDCS) trench and backfill requirements shall be as shown on the plans and as described elsewhere in these special provisions.

Conduit runs shown on the plans to be located behind curbs may be installed in the street, within 0.9-m of, and parallel with the face of the curb, by the "Trenching in Pavement Method" in conformance with the provisions in Section 86-2.05C, "Installation," of the Standard Specifications. Pull boxes shall be located behind the curb or at the locations shown on the plans.

After conductors have been installed, the ends of conduits terminating in pull boxes, service equipment enclosures, and controller cabinets shall be sealed with an approved type of sealing compound.

At those locations where conduit is required to be installed under pavement and existing underground facilities require special precautions in conformance with the provisions in "Obstructions" of these special provisions, conduit shall be placed by the "Trenching in Pavement Method" in conformance with the provisions in Section 86-2.05C, "Installation," of the Standard Specifications and with the details shown for "T" trench on ES-5D.

At other locations where conduit is required to be installed under pavement and if a delay to vehicles will not exceed 5 minutes, conduit may be installed by the "Trenching in Pavement Method."

At the option of the Contractor, the final 0.6-m of conduit entering a pull box in a reinforced concrete structure may be Type 4.

10-3.08 MULTIDUCT CONDUIT SYSTEM

Where multiduct conduit system (MDCS) is shown on the plans or on the cost break down of these special provisions, the system shall be of the following types as shown on the plans:

- A. A Type 3 Size 103 conduit with four Size 25 (I.D. nominal) conduits contained therein. Joints shall be keyed to mate the enclosed conduits.
- B. Size 32 (nominal) high density polyethylene conduits grouped in quantities of not less than four conduits. Requirements for high density polyethylene conduits are described in "High Density Polyethylene Conduit," in these special provisions.

All new MDCS conduits shall be cleaned with a mandrel or cylindrical soft bristled brush and blown out with compressed air until all foreign material is removed immediately prior to sealing empty conduits or installing cables. Cleaning shall be performed in the presence of the Engineer. The ends of conduits shall be sealed with an approved sealing compound. The ends of multiduct conduit system shall be sealed with sealing plugs as described in these special provisions.

Size 103 conduit on bridge structures shall be fiberglass unless otherwise shown on the plans except that the conduit contained within Size 103 conduits may be Type 3.

Size 103 conduits (and conduits contained within) and Size 32 conduits shall be either all individually factory color coded or all orange. Straight segments of Type 3 multiduct conduit shall be nominal 6 m lengths.

Joints shall be solvent welded or sealed with a gasket as recommended by the manufacturer. Joints shall lock together or be provided with a seating mark to verify proper assembly.

Bends in Type 3 conduits shall be rigid factory assembled sections designed to fit the system.

The minimum conduit bend radius in Type 3 conduits shall not be less than 1.8 meters.

Multiduct conduit system (MDCS) trench and backfill requirements shall be as shown on the plans and as described in these special provisions.

10-3.09 HIGH DENSITY POLYETHYLENE CONDUIT

GENERAL

High density polyethylene (HDPE) conduit for communications applications shall conform to the details shown on the plans, these special provisions, and as directed by the Engineer.

MATERIAL

High density polyethylene conduit shall be manufactured from high density polyethylene virgin compounds.

High density polyethylene compounds used in the manufacture of communication conduit shall conform to the following Cell Classifications specified in ASTM Designation: D 3350:

Property	Cell Classification
Density	3
Melt Index	3 or 4
Flexural modulus	4 or 5
Tensile strength	4
Environmental stress crack resistance	3
Hydrostatic design basis	0, 1, 2, 3 or 4
Ultraviolet stabilizer	C ^a

a - HDPE Resin shall contain not less than 2 ± 0.5 percent carbon black ultraviolet stabilizer

CONDUIT

High density polyethylene conduit size (nominal trade inside diameter) and location shall be as shown on the plans. Conduit shall be the smooth interior wall type.

High density polyethylene conduit shall be suitable for cable and conductor installation methods as described in Section 86 of the Standard Specifications, in these special provisions, and in "Air Blown Method" as described elsewhere in these special provisions.

High density polyethylene conduit color shall be black with orange colored stripe. Orange colored stripe shall consist of not less than 2 stripes, with longitudinal orientation, evenly spaced.

Conduit shall contain carbon black ultraviolet shielding suitable for the conduit to sustain unprotected outdoor exposure for at least one year.

Conduit shall be continuously marked with clear, distinctive and permanent markings at intervals not greater than 2 meters. The marking shall be in a contrasting color to the conduit color. The height of the marking shall be approximately 2.5 mm or larger. Conduit marking information shall include, as a minimum, the following information:

- A. Nominal Size.
- B. Dimension Ratio (DR).
- C. Manufacturer Name and Product/Model Number.
- D. Material Code.
- E. Plant Identification.
- F. Production Date.
- G. Cell Classification.

Coils and reels shall have sequential measurement markings every meter.

High density polyethylene conduit shall be DR 9 per ASTM D 3035 for controlled outside diameter.

High density polyethylene conduit shall be IPS outside diameter controlled in accordance with the manufacturer's production tolerances. The wall thickness of DR or SDR sized conduit shall be in accordance with the manufacturer's production tolerances.

High density polyethylene conduit shall meet or exceed the following:

PROPERTY	TEST METHOD (ASTM unless shown otherwise)	UNIT	VALUE (Nominal)
Material Classification	D 3350		PE33 or PE34
Density	D 1505	g/cm ³	0.941
Flow Rate	D 1238	g/10 Min.	0.40
Flexural Modulus	D 790	MPa	552
Tensile Strength	D 638	MPa	20.6
Environmental Stress Crack Resistance	D 1693	Hours	Meet Cell Classification 3
HDB at 23°C	D 2837	MPa	Meet Cell Classification 0, 1, 2, 3 or 4
UV Stabilizer	D 1603	%C	not less than 2
Hardness	D 2240	Shore D	60-68
Elongation	D 638 (50.8 mm/Min)	%, minimum	750
Brittleness Temperature	D 746	°C	<-75
Vicat Softening Temperature	D 1525	°C	123

JOINING OF CONDUIT

Conduit shall be joined by heat fusion. Heat fusion (includes electrofusion) of high density polyethylene conduit shall be by methods recommended by the conduit manufacturer, and with equipment approved for the purpose. Equipment shall not expose conduit to direct flame. Heat fusion shall be performed by conduit manufacturer certified or authorized personnel. A minimum of 2 test fusions, by each fusion operator, shall be demonstrated to the Engineer prior to performing fusion operations on any high density polyethylene conduit to be installed.

Where high density polyethylene conduit is shown on the plans to join Type 3 conduit, mechanical fittings designed for joining polyethylene conduit to another material may be used. Mechanical fittings shall be pressure rated at not less than 400 kPa, and fully thrust restrained such that the fitting does not disjoin under longitudinal load of up to 35 kg.

INSTALLATION

High density polyethylene conduit shall be installed at underground locations only.

In addition to the conduit installation methods for Type 3 conduit, as described in Section 86 of the Standard Specifications and in these special provisions, high density polyethylene conduit may be installed by Horizontal Directional Drilling (HDD) (per ASTM F1962 "Standard Guide for Use of Maxi-Horizontal Directional Drilling for Placement of Polyethylene Pipe or Conduit Under Obstacle, Including River Crossings") or "Directional Boring Method" as described elsewhere in these special provisions. Where there is a difference or conflict between requirements, the higher of the two standards shall apply.

Conduit bends, except factory bends, shall have a radius of not less than the manufacturer's recommended minimum bend radius. Where factory bends are not used, conduit shall be bent, without crimping or flattening, using the longest radius practicable.

Bending of high density polyethylene conduit shall be by methods recommended by the conduit manufacturer, and with equipment approved for the purpose. Equipment shall not expose conduit to direct flame.

Attention is directed to "Conduit" elsewhere in these special provisions regarding cleaning and sealing conduit.

The ends of high density polyethylene conduit shall be capped until the installation of cable is started.

A pull rope, conforming to Section 86-2.05C, "Installation," of the Standard Specifications shall be installed in conduits which are to receive future conductors.

CERTIFICATES OF COMPLIANCE, MATERIALS RECEIVING INSPECTION AND MANUFACTURER'S DATA

In conformance with the provisions in Section 6-1.07, "Certificates of Compliance," a Certificate of Compliance shall be furnished to the Engineer for each type of high density polyethylene conduit furnished. The certificate shall also certify that the high density polyethylene conduit complies with the requirements of these special provisions, and shall include the resin material Cell Classification, unit mass of pipe, average pipe stiffness and date of manufacture.

Conduit, when delivered to the site, which exhibits damage in excess of 10 percent of the conduit wall thickness may be rejected by the Engineer. Conduit exhibiting damage which does not meet the manufacturer's recommendations for usable conduit may also be rejected by the Engineer. Conduit sections may be repaired if approved by the Engineer. Replacement or repair of rejected conduit shall be at the Contractor's expense.

Two copies of the manufacturer's product technical specification information shall be furnished to the Engineer at least two weeks subsequent to the start of the scheduled delivery.

Two copies of the manufacturer's test data for the delivered shipment shall be furnished to the Engineer at the time of the delivery.

10-3.10 AIR BLOWN METHOD

At the Contractor's option, installation of cable into conduit, ducts or subducts may be performed using the air blown method.

The air blown method shall be an installation method that uses a mechanical device combined with a high speed flow of compressed air to place cables into conduits, ducts or subducts.

The air blown method shall conform to the following:

- A. Cable shall be installed without exceeding the cable manufacturers' tensile and compressive strength ratings.
- B. The mechanical device shall be used to provide a pushing force on the cable into the conduit.
- C. The cable installation equipment shall also have, at minimum, the following features:
 - i. Controls to regulate the flow rate of compressed air entering the conduit, duct or subduct, and any hydraulic or pneumatic pressure applied to the cable.
 - ii. Safety shutoff valves to disable the system in the event of sudden changes in pneumatic or hydraulic pressure.
 - iii. Measuring device to determine the speed of the cable during installation and the length of the cable installed.

The Contractor shall submit to the Engineer information on the proposed "Air Blown Method" planned to be used. The submittal shall include, but not be limited to, the following items:

1. Project description;
2. List or plan sheet marked to identify the conduits and cables involved;
3. Equipment description and specifications;
4. Manufacturer's test data covering the performance of the equipment and cable stress in a typical installation using cable equivalent to cable to be installed on this project; and
5. User/Installer Manual for the equipment and installation procedures.

Within 30 days after the approval of the contract, the Contractor shall submit 2 copies of the proposed "Air Blown Method" to the Engineer. The Contractor shall allow 7 days for the Engineer to review the proposed "Air Blown Method". If revisions are required, as determined by the Engineer, the Contractor shall revise and resubmit the proposed "Air Blown Method" within 5 days of receipt of the Engineer's comments and shall allow 5 days for the Engineer to review the revisions. Upon the Engineer's approval of the proposed "Air Blown Method", 2 additional copies of the proposed "Air Blown Method" incorporating the required changes shall be submitted to the Engineer. Minor changes or clarifications to the initial submittal may be made and attached as amendments to the proposed "Air Blown Method". In order to allow construction activities to proceed, the Engineer may conditionally approve, in writing, the proposed "Air Blown Method" while minor revisions or amendments are being completed.

The submitted "Air Blown Method" shall not be used until it has been approved in writing by the Engineer.

10-3.11 SEALING PLUG

Except as otherwise noted, multiduct conduit system and Size 103 conduits shall have their ends sealed with commercial preformed plugs which prevent the passage of gas, dust and water into the multiduct conduit system and Size 103 conduits.

Sealing plugs shall be removable and reusable. Plugs sealing conduit, conductor or cable shall be the split type that permits installation or removal without removing conductors or cables. Sealing plugs shall be capable of withstanding a pressure of 34.5 kPa.

Sealing plugs that seal MDCS (Size 103) shall seal the conduit and all enclosed conduits simultaneously with one self contained assembly having an adjustable resilient filler of neoprene or silicone rubber clamped between backing ends and compressed with stainless steel hardware.

Sealing plugs that seal the Size 25 or Size 32 conduits of MDCS shall seal each conduit individually with appropriate sizes and configuration to accommodate either empty conduit or those containing cable. Suitable sealing between the varying size cables and the plugs shall be provided by inserting split neoprene or silicone adapting sleeves, used singularly or in multiples, within the body of the plugs, or an equivalent method approved by the Engineer.

A sealing plug that seals an empty conduit shall have an eye or other type of capturing device (on the side of the plug that enters the conduit) to attach onto the pull rope so the pull rope will be easily accessible when the plug is removed.

10-3.12 TRACER WIRE

Tracer wire shall be provided and placed inside the MDCS conduit. The wire shall be placed in the uppermost conduit.

Tracer wire shall be a No. 8 stranded, minimum, copper conductor with Type TW, THW, RHW, or USE insulation. The tracer wire shall form a mechanically and electrically continuous line throughout the length of the trench. A minimum of 1.5 m of slack shall be extended into each pull box and fiber optic vault from each direction. The wires shall be carefully placed so as not to be damaged by backfilling operations.

Tracer wire may be spliced at intervals of not less than 150 m.

10-3.13 WARNING TAPE

Warning tape shall be provided and placed in the trench over conduits as shown on the plans. The warning tape shall be 100 mm wide with bold printed black letters of approximately 19 mm on bright orange color background, and contain the printed warning "CAUTION CALTRANS FIBER OPTIC LINE BURIED BELOW", repeated at approximately 800 mm intervals.

The printed warning shall be non-erasable and shall be rated to last with the tape for a minimum of 40 years.

The construction of the warning tape shall be such that it will not delaminate when it is wet. It shall be resistant to insects, acid, alkaline and other corrosive elements in the soil. It shall have a minimum of 712 N tensile strength per 150 mm wide strip and shall have a minimum of 700 percent elongation before breakage.

10-3.14 SLURRY CEMENT BACKFILL

The slurry cement backfill for the installation of multiduct conduit system or other conduit as shown on the plans shall conform to the provisions in Section 19, "Earthwork," of the Standard Specifications and these special provisions.

The size of the aggregate shall not be larger than 9.5 mm.

The concrete shall be pigmented a medium to dark, red or orange color by the addition of commercial quality cement pigment to the concrete mix. The red or orange concrete pigment shall be LM Scofield Company; Orange Chromix Colorant; Davis Colors; or equal.

Full compensation for furnishing and incorporating the cement pigment to achieve the color required shall be considered as included in the contract price or prices paid per meter for the conduit involved and no separate payment will be made therefor.

10-3.15 DIRECTIONAL BORING METHOD

Where jacking and drilling is shown on the plans as the required installation method, conduits may be installed by the directional boring method. Directional boring shall not be used at other locations unless approved by the Engineer. All pull boxes or vaults shall be located at the locations shown on the plans.

Minimum depth of conduit below finished grade in pavement areas shall be 2.5 m.

A listing of materials (composition and strength) and methods used in directional boring shall be submitted for the Engineer's review.

The diameter of the boring tool shall not exceed 1.5 times the outside diameter of the conduit. Mineral slurry or wetting solution shall only be used to lubricate the boring tool and to stabilize the soil surrounding the boring path. Mineral slurry or wetting solution shall be water based and environmentally safe.

Residue from directional boring operations shall be handled in the same manner as residue from slot cutting operations described in Section 86-5.01A(5), "Installation Details," of the Standard Specifications.

The directional boring equipment shall have directional control of the boring tool and have an electronic boring tool location detection system. During operation, the directional boring equipment shall be able to determine the location of the tool both horizontally and vertically.

The directional boring equipment shall be equipped with a tension measuring device that indicates the amount of tension exerted on conduit during conduit pulling operations.

Slurry cement backfill and warning tape, as shown on the plans for trench installations of conduit, are not required where the directional boring method is used. Tracer wire shall be attached to the uppermost conduit prior to conduit installation.

A representative of the Contractor must be in direct charge and control of the directional boring operation at all times.

The Engineer shall be notified in writing 2 working days in advance of starting directional boring operations. The location and equipment to be used in the boring operation shall be included in the advance notice to the Engineer. Directional boring shall only be performed in the presence of the Engineer unless otherwise notified in writing by the Engineer.

Full compensation for directional boring shall be considered as included in the contract unit price paid for the conduit involved and no additional compensation will be allowed therefor.

10-3.16 PULL BOXES

Grout shall not be placed in the bottom of pull boxes.

Where the sump of an existing pull box is disturbed by the Contractor's operation, the sump shall be reconstructed as shown on Standard Plan ES-8.

10-3.17 FIBER OPTIC VAULT

Fiber optic vault, cover and extensions (if required) shall be of the sizes and details shown on the plans and shall be precast of non-PCC material. Non-PCC material shall be resistant to fire, chemicals and ultraviolet exposure. The non-PCC material shall show no appreciable change in physical properties with exposure to the weather. Non-PCC material shall be dense and free of voids or porosity.

Covers shall be the non-skid type. Cover marking shall be "CALTRANS FIBER OPTICS" on each cover. Each cover shall have inset lifting pull slots. Cover hold down bolts or cap screws and nuts shall be of brass, stainless steel, or other non-corroding metal material.

A reinforced concrete encasement ring shall be poured around the collar of the fiber optic vault as shown on the plans. The concrete for encasement ring shall contain not less than 325 kg of cement per cubic meter.

Fiber optic vaults and covers shall be rated for AASHTO HS 20-44 loads and be installed as detailed and where shown on the plans.

Hanger assemblies shall consist of not less than 3 hangers evenly distributed. Hangers shall be made of a non-corroding material and be free of any sharp edges. Hanger assembly shall be provided for a minimum of eight fiber optic cables and be securely fastened to the side wall with the slack fiber optic cable neatly coiled.

The Contractor shall not install additional fiber optic vaults over those shown on the plans without the Engineer's written approval.

10-3.18 CONDUCTORS AND WIRING

Splices of conductors shall be insulated with heat-shrink tubing of the appropriate size after thoroughly painting the spliced conductors with electrical insulating coating.

Heat-shrink tubing shall be heated as recommended by the manufacturer.

The minimum insulation thickness, at any point, for Type USE, RHH or RHW wire shall be 1.0 mm for conductor sizes No. 14 to No. 10, inclusive, and 1.3 mm for No. 8 to No. 2, inclusive. The minimum insulation thickness, at any point, for Type THW and TW wires shall be 0.69 mm for conductor sizes No. 14 to No. 10, inclusive, 1.02 mm for No. 8, and 1.37 mm for No. 6 to No. 2, inclusive.

SIGNAL INTERCONNECT CABLE.

Signal Interconnect Cable (SIC) shall be the 6-pair type.

The ends of signal interconnect cable terminating at controller cabinets shall have crimped and soldered spade type terminals.

OPTICAL DETECTOR CABLE.

Optical detector cable (EV-C) shall meet the requirements of IPCEA-S-61-402/NEMA WC 5, Section 7.4, 600-V (ac) control cable, 75°C, Type B, and the following:

- A. The cable shall contain 3 conductors, each of which shall be No. 20 (7 x 28) stranded, tinned copper with low-density polyethylene insulation. Minimum average insulation thickness shall be 0.63-mm. Insulation of individual conductors shall be color coded: 1-yellow, 1-blue, 1-orange.
- B. The shield shall be either tinned copper braid or aluminized polyester film with a nominal 20 percent overlap. Where film is used, a No. 20 (7 x 28) stranded, tinned, bare drain wire shall be placed between the insulated conductors and the shield and in contact with the conductive surface of the shield.
- C. The jacket shall be black polyvinyl chloride with minimum ratings of 600 V(ac) and 80°C and a minimum average thickness of 1.1 mm. The jacket shall be marked as required by IPCEA/NEMA.
- D. The finished outside diameter of the cable shall not exceed 8.9 mm.
- E. The capacitance, as measured between any conductor and the other conductors and the shield, shall not exceed 157 pf per meter at 1000 Hz.
- F. The cable run between each detector and the controller cabinet shall be continuous without splices or shall be spliced only as directed by the detector manufacturer.

CATEGORY 5E CABLE

Category 5E cable shall be the unshielded, outdoor rated, non-gel filled type, and shall meet the requirements of TIA/EIA 568B.2, Category 5E Cable, and the following:

- A. The cable shall contain 8 conductors, each of which shall be No. 24 , minimum, solid bare copper conductors. Each conductor shall be insulated with polyolefin, polyethylene, polyvinyl chloride or fluorinated ethylene propylene material. Conductors shall be in twisted pairs. Color coding shall distinguish each pair: blue, blue/white; brown, brown/white; green, green/white; orange, orange/white.
- B. The cable jacket shall be rated for a minimum of 300 V and 60°C and shall be polyvinyl chloride, polyethylene, polyolefin or fluorinated ethylene propylene. The jacket shall be black, gray, or blue. The jacket shall be marked as required by NEMA. The jacket shall be marked at not more than every meter with the cable identification: manufacturer's name, product identification, number of conductors and conductor size, and voltage and temperature ratings. Cable length markings may be sequentially alternated with the cable identification markings at not more than every other meter.
- C. The finished outside diameter of the cable shall not exceed 13 mm.
- D. The cable run between components shall be continuous without splices. A minimum of one meter of slack shall be provided at each pull box, junction box or vault, and a minimum of 3 m at each cabinet. The ends of category 5E cable shall be terminated with appropriate RJ-type connectors as necessary to connect the equipment shown on the plans, or shall be terminated with crimped and soldered spade type terminals at terminal blocks where shown on the plans.
- E. Category 5E Certified installations are required for installed lengths of less than 100 m of finished cable.

10-3.19 CLOSED CIRCUIT TELEVISION CAMERA CABLE ASSEMBLY

Closed circuit television (CCTV) camera cable assembly shall conform to the provisions in Section 86, "Signals, Lighting and Electrical Systems," of the Standard Specifications and these special provisions.

The interconnect wiring between the CCTV camera assembly and the Camera Encoder Unit (CEU) shall be a composite cable that includes flexible 75-ohm coaxial cable, AC power and control cable.

The cable shall conform to the following physical characteristics:

Overall Cable

Overall Cable, Nom. weight/304.8 meters not to exceed:	132 kg
Overall Cable Minimum Bending Radius:	229 mm
All Materials, Temperature Rating, meet or exceed:	-40°C to +80°C
Overall Cable, Outside Diameter, not to exceed:	18.542 mm
Outside Jacket, Tinned Copper Braid Shield, minimum:	80%
Pulling tension, maximum:	227 kg
Overall Cable, Outside Jacket:	Black Thermoplastic Elastomer

Coax Cable

Coax Tinned Copper Braid Shield, minimum:	95%
Coax Insulation Material:	Solid Polyethylene
Coax Core Outside Diameter:	3.073 mm
Coax Outside Diameter:	4.521 mm
Coax Outside Jacket:	Cotton Braid

Single Cable - Shielded group of 3 No. 18 AWG and with a group of 4 No. 22 AWG inside cables. The individual conductors shall be color coded with PVC insulation.

Drain Wire - shall be provided for each group of cables.

COAX CABLE -	
Nominal Impedance:	75 Ω
Nominal Capacitance:	70.54 pF/m
Nominal Velocity of Propagation:	66%
Nominal Delay:	5.05 ns/m
Attenuation	
@ 1 MHz	0.0197 dB/m
@ 5 MHz	0.0892 dB/m
@ 10 MHz	0.0971 dB/m
@ 50 MHz	0.1263 dB/m
@ 100 MHz	0.1673 dB/m
Dielectric Strength:	
Nominal Shield DC Resistance @ 20°C:	0.01378 Ω /m
Nominal Conductor DC Resistance @ 20°C:	0.32808 Ω /meter
Maximum Operating Voltage:	300 V RMS

SHIELDED GROUP OF 3 #18 AWG CONDUCTORS-	
Nominal Conductor DC Resistance @ 20°C:	0.02133 Ω /m
Nominal Shield DC Resistance @ 20°C:	0.03642 Ω /m
Nominal Capacitance (to Adj. conductors and Shield)	292 pF/m

SHIELDED GROUP OF 4 #22 AWG CONDUCTORS-	
Nominal Conductor DC Resistance @20°C:	0.05151 Ω /m
Nominal Shield DC Resistance @20°C:	0.03675 Ω /m
Nominal Capacitance (to Adj. conductors and Shield)	230 pF/ m

Control cable shall be routed from the CCTV camera assembly to the camera encoder and AC power inside the camera pole. Wiring shall run continuous from source to destination without splices.

Cable slack of not less than 1 m shall be provided for equipment movement at pull boxes, vaults or cabinets. The cable shall be secured and coiled neatly.

The cables and connectors shall be installed to allow the camera and lens to be disconnected without removing the environmental camera housing.

Cable grip and J-hook shall be as shown in the contract plans.

Manufacturer's cut sheets or specifications data of all cable assemblies, including connectors with strain relief backshells, shall be submitted to the Engineer.

The Contractor shall be responsible for all testing and documentation required to establish approval and acceptance of the production, installation, and operation of these materials and equipment. A copy of the testing procedures and results shall be submitted to the Engineer for review and approval.

The camera cable assembly connector assignments for C1, C2 and C3 connectors are shown on the plans. C1, C2 and C3 connectors shall be the connectors specified or equal. All materials necessary to make the connectors functional shall be provided by the Contractor. All materials used to make the connectors shall be compatible and shall adhere to manufacturers recommendations.

For Connector 1, the connector type shall be compatible, either directly or via adapter, with male AMP 206044-1 of existing field cameras .

CONNECTOR C4 ASSIGNMENT			
PIN	FUNCTION	WIRE COLOR	WIRE GAUGE
Blade	Camera Power, AC Low	White	18 AWG
Blade	Camera Power, AC High	Black	18 AWG
Ground	Camera Power, Ground	Green	18 AWG

10-3.20 FIBER OPTIC COMMUNICATION CABLE PLANT

FIBER OPTICS GLOSSARY

Breakout.--The cable "breakout" is produced by; (1) removing the jacket just beyond the last tie-wrap point, (2) exposing 1 to 2 meters of the cable buffers, aramid strength yarn and central fiberglass strength member, and (3) cutting the aramid yarn, central strength member and the buffer tubes to expose the individual glass fibers for splicing or connection to the appropriate device.

Connector.--A mechanical device used to align and join two fibers together to provide a means for attaching to and decoupling from a transmitter, receiver, or another fiber (patch panel).

Connectorized.--The termination point of a fiber after connectors have been affixed.

Couplers.--Couplers are devices which mate fiber optic connectors to facilitate the transition of optical light signals from one connector into another. They are normally located within FDFs mounted in panels. They may also be used unmounted, to join two simplex fiber runs.

Fiber Distribution Frame (FDF).--A rack mounted system that consists of a standard equipment rack, fiber routing guides, horizontal jumper troughs and Fiber Distribution Unit (FDU).

The FDF serves as the "home" for the passive fiber optic components from cable breakout, for connection by jumpers, to the electronics.

Fiber Distribution Unit (FDU)--Is an enclosure or rack-mountable unit containing both a patch panel with couplers and a splice tray(s).

F/O.--Fiber optic.

FOIP.--Fiber optic inside plant cable.

FOP.--Fiber optic outside plant cable.

FOTP.--Fiber optic test procedure(s) as defined by EIA/TIA standards.

Jumper.--A short fiber optic cable that has connectors installed on both ends, and is typically used for connection within a FDF.

Light Source.--Portable fiber optic test equipment that, in conjunction with a power meter, is used to perform end-to-end attenuation testing. It contains a stabilized light source operating at the designed wavelength of the system under test.

Link.--A passive section of the system, the ends of which are to be connected to active components. A link may include splices and couplers. For example, a video link may be from a F/O transmitter to a video multiplexer (MUX).

Link Loss Budget.--A calculation of the overall permissible attenuation from the fiber optic transmitter (source) to the fiber optic receiver (detector).

Loose Tube Cable.--Type of cable construction in which fibers are placed in filled buffer tubes to isolate them from outside forces (stress). A flooding compound is applied to the interstitial cable core to prevent water migration and penetration. This type of cable is primarily for outdoor applications.

Optical Time Domain Reflectometer (OTDR).--Fiber optic test equipment (similar in appearance to an oscilloscope) that is used to measure the total amount of power loss between two points and the corresponding distance. It provides a visual and printed display of the relative location of system components such as fiber sections, splices and connectors and the losses that are attributed to each component or defect in the fiber.

Patchcord.--A short jumper used to join two Connector Module Housing (CMH) couplers or a CMH and an active device (electronics).

Pigtail.--Short fiber optic cable that has a connector installed on only one end.

Plenum Cable.--NEC approved cable installed in air plenums (the area between a drop ceiling and the floor above it) without the use of conduit.

Power Meter.--Portable fiber optic test equipment that, in conjunction with a light source, is used to perform end-to-end attenuation testing. It contains a detector that is sensitive to light at the designed wavelength of the system under test. Its display indicates the amount of power injected by the light source that arrives at the receiving end of the link.

Riser Cable.--NEC approved cable installed in a riser (a vertical shaft in a building connecting one floor to another).

Segment.--A section of F/O cable that is not connected to any active device and may or may not have splices per the design.

Splice.--The permanent joining of fiber ends to matching fibers.

Splice Closure.--Normally installed in a splice vault, a splice closure is an environmentally sealed container used to organize and protect splice trays. The container allows splitting or routing of fiber cables from multiple locations.

Splice Module Housing (SMH).--The SMH stores splice trays as well as pigtails and short cable lengths.

Splice Tray.--A container used to organize and protect spliced fibers.

Splice Vault.--A splice vault is used to house splice closures.

Storage Cabinet.--Designed for holding excess cable slack for protection. The storage cabinet allows the user flexibility in equipment location and the ability to pull cable back for resplicing.

Tight Buffered, Non-Breakout Cable (Tight Buffer Cable).--Type of cable construction where each glass fiber is tightly buffered (directly coated) with a protective thermoplastic coating to 900 μm (compared to 250 μm for loose tube fibers). Increased buffering is desirable over loose tube cables because of its resulting ease of handling and connectorization (increased physical flexibility, smaller bend radius requirements), and ability to meet NEC flammability requirements.

FIBER OPTIC OUTSIDE PLANT CABLE

GENERAL

Each fiber optic outside plant cable (FOP) for this project shall be all dielectric, gel filled or water blocking materials, duct type, with loose buffer tubes and shall conform to these special provisions. Cables with singlemode fibers shall contain singlemode (SM) dual-window (1310 nm and 1550 nm) fibers in the quantities shown below and on the plans. The optical fibers shall be contained within loose buffer tubes. The loose buffer tubes shall be stranded around an all dielectric central member. Aramid yarn or fiberglass shall be used as a primary strength member, and a polyethylene outside jacket shall provide for overall protection.

All fiber optic (F/O) cable on this project shall be from the same manufacturer, who is regularly engaged in the production of this material.

The cable shall comply with all the requirements of the United States Department of Agriculture Rural Electrification Administration specifications REA-PE-90 as described elsewhere in these special provisions.

Fiber Characteristics Table	
Parameters	Requirements
Type	Step Index
Core diameter	8.3 μm (nominal)
Cladding diameter	125 μm \pm 1.0 μm
Core to Cladding Offset	\leq 1.0 μm
Coating Diameter	250 μm \pm 15 μm
Cladding Non-circularity defined as: $[1-(\text{min. cladding dia} \div \text{max. cladding dia.})] \times 100$	\leq 2.0%
Proof/Tensile Test	345 MPa
Attenuation: @ 850 nm @1310 nm (SM) @1550 nm	N/A \leq 0.4 dB/km \leq 0.4 dB/km
Attenuation at the Water Peak	\leq 2.1 dB/km @ 1383 \pm 3 nm
Chromatic Dispersion:	
Zero Dispersion Wavelength	1301.5 to 1321.5 nm
Zero Dispersion Slope	\leq 0.092 ps/(nm ² *km)
Maximum Dispersion:	\leq 3.3 ps/(nm*km) for 1285 to 1330 nm $<$ 18 ps/(nm*km) for 1550 nm
Cut-Off Wavelength	$<$ 1250 nm
Numerical Aperture (measured in accordance with EIA-455-47 (FOTP-47))	N/A
Mode Field Diameter (Petermann II)	9.3 \pm 0.5 μm at 1300 nm 10.5 \pm 1.0 μm at 1550 nm

FIBER CHARACTERISTICS

Each optical fiber shall be glass and consist of a doped silica core surrounded by concentric silica cladding. All fibers in the buffer tube shall be usable fibers, and shall be sufficiently free of surface imperfections and inclusions to meet the optical, mechanical, and environmental requirements of these specifications. The required fiber grade SM shall reflect the maximum individual fiber attenuation, to guarantee the required performance of each and every fiber in the cable.

The coating shall be a dual layered, UV cured acrylate. The coating shall be mechanically or chemically strippable without damaging the fiber.

The cable shall comply with the optical and mechanical requirements over an operating temperature range of -40°C to +70°C. The cable shall be tested in accordance with EIA-455-3A (FOTP-3), "Procedure to Measure Temperature Cycling Effects on Optical Fiber, Optical Cable, and Other Passive Fiber Optic Components." The change in attenuation at extreme operational temperatures (-40°C to +70°C) for singlemode fiber shall not be greater than 0.20 dB/km, with 80 percent of the measured values no greater than 0.10 dB/km. The singlemode fiber measurement is made at 1550 nm.

For all fibers the attenuation specification shall be a maximum attenuation for each fiber over the entire operating temperature range of the cable.

Singlemode fibers within the finished cable shall meet the requirements in the following table:

Fiber Characteristics Table	
Parameters	Requirements
Type	Step Index
Core diameter	8.3 μm (nominal)
Cladding diameter	125 μm \pm 1.0 μm
Core to Cladding Offset	\leq 0.8 μm
Coating Diameter	250 μm \pm 15 μm
Cladding Non-circularity defined as: [1-(min. cladding dia \div max. cladding dia.)]x100	\leq 1.0%
Proof/Tensile Test	345 MPa, min.
Attenuation: (-40°C to +70°C) @1310 nm @1550 nm	\leq 0.4 dB/km \leq 0.3 dB/km
Attenuation at the Water Peak	\leq 2.1 dB/km @ 1383 \pm 3 nm
Chromatic Dispersion: Zero Dispersion Wavelength Zero Dispersion Slope	1301.5 to 1321.5 nm \leq 0.092 ps/(nm ² *km)
Maximum Dispersion:	\leq 3.3 ps/(nm*km) for 1285 – 1330 nm <18 ps/(nm*km) for 1550 nm
Cut-Off Wavelength	<1250 nm
Mode Field Diameter (Petermann II)	9.3 \pm 0.5 μm at 1300 nm 10.5 \pm 1.0 μm at 1550 nm

COLOR CODING

Optical fibers shall be distinguishable from others in the same buffer tube by means of color coding according to the following:

- | | |
|----------------|-----------------|
| 1. Blue (BL) | 7. Red (RD) |
| 2. Orange (OR) | 8. Black (BK) |
| 3. Green (GR) | 9. Yellow (YL) |
| 4. Brown (BR) | 10. Violet (VL) |
| 5. Slate (SL) | 11. Rose (RS) |
| 6. White (WT) | 12. Aqua (AQ) |

The colors shall be targeted in accordance with the Munsell color shades and shall meet EIA/TIA-598 "Color Coding of Fiber Optic Cables."

The color formulation shall be compatible with the fiber coating and the buffer tube filling compound, and be heat stable. It shall not fade or smear or be susceptible to migration and it shall not affect the transmission characteristics of the optical fibers and shall not cause fibers to stick together.

CABLE CONSTRUCTION

General.--The fiber optic cable shall consist of, but not be limited to, the following components:

- A. Buffer tubes
- B. Central member
- C. Filler rods
- D. Stranding
- E. Core and cable flooding
- F. Tensile strength member
- G. Ripcord
- H. Outer jacket

Buffer tubes.--Loose buffer tubes shall provide clearance between the fibers and the inside of the tube to allow for expansion without constraining the fiber. The fibers shall be loose or suspended within the tubes and shall not adhere to the inside of the tube. Each buffer tube shall contain 6 or 12 fibers.

The loose buffer tubes shall be extruded from a material having a coefficient of friction sufficiently low to allow free movement of the fibers. The material shall be tough and abrasion resistant to provide mechanical and environmental

protection of the fibers, yet designed to permit safe intentional "scoring" and breakout, without damaging or degrading the internal fibers.

Buffer tube filling compound shall be a homogenous hydrocarbon-based gel with anti-oxidant additives and used to prevent water intrusion and migration. The filling compound shall be non-toxic and dermatologically safe to exposed skin. It shall be chemically and mechanically compatible with all cable components, non-nutritive to fungus, non-hygroscopic and electrically non-conductive. The filling compound shall be free from dirt and foreign matter and shall be readily removable with conventional nontoxic solvents.

Buffer tubes shall be stranded around a central member by a method that will prevent stress on the fibers when the cable jacket is placed under strain, such as the reverse oscillation stranding process.

Each buffer tube shall be distinguishable from other buffer tubes in the cable by means of color coding as specified above for fibers.

Central Member.--The central member which functions as an anti-buckling element shall be a glass reinforced plastic rod with similar expansion and contraction characteristics as the optical fibers and buffer tubes. A linear overcoat of low density polyethylene shall be applied to the central member to achieve the optimum diameter to provide the proper spacing between buffer tubes during stranding.

Filler rods.--Fillers may be included in the cable to lend symmetry to the cable cross-section where needed. Filler rods shall be solid medium or high density polyethylene. The diameter of filler rods shall be the same as the outer diameter of the buffer tubes.

Stranding.--Completed buffer tubes shall be stranded around the overcoated central member using stranding methods, lay lengths and positioning such that the cable shall meet mechanical, environmental and performance specifications. A polyester binding shall be applied over the stranded buffer tubes to hold them in place. Binders shall be applied with sufficient tension to secure the buffer tubes to the central member without crushing the buffer tubes. The binders shall be non-hygroscopic, non-wicking (or rendered so by the flooding compound), and dielectric with low shrinkage.

Core and Cable Flooding.--The cable core interstices shall be filled with a polyolefin based compound to prevent water ingress and migration. The flooding compound shall be homogeneous, non-hygroscopic, electrically non-conductive, and non-nutritive to fungus. The compound shall also be nontoxic, dermatologically safe and compatible with all other cable components.

Tensile Strength Member.--Tensile strength shall be provided by high tensile strength aramid yarns or fiberglass which shall be helically stranded evenly around the cable core and shall not adhere to other cable components.

Ripcord.--The cable shall contain at least one ripcord under the jacket for easy sheath removal.

Outer jacket.--The jacket shall be free of holes, splits, and blisters and shall be medium or high density polyethylene (PE), or medium density cross-linked polyethylene with minimum nominal jacket thickness of $1000 \pm 76 \mu\text{m}$. Jacketing material shall be applied directly over the tensile strength members and flooding compound and shall not adhere to the aramid strength material. The polyethylene shall contain carbon black to provide ultraviolet light protection and shall not promote the growth of fungus.

The jacket or sheath shall have clear, distinctive and permanent markings showing the manufacturer's name, the words "Optical Cable", the number of fibers, "SM", year of manufacture, and sequential measurement markings every meter. The actual length of the cable shall be within $-0/+1$ percent of the length marking. The marking shall be in a contrasting color to the cable jacket. The height of the marking shall be approximately 2.5 mm.

GENERAL CABLE PERFORMANCE SPECIFICATIONS

The F/O cable shall withstand water penetration when tested with a one meter static head or equivalent continuous pressure applied at one end of a one meter length of filled cable for one hour. No water shall leak through the open cable end. Testing shall be done in accordance with EIA-455-82 (FOTP-82), "Fluid Penetration Test for Fluid-Blocked Fiber Optic Cable."

A representative sample of cable shall be tested in accordance with EIA-455-81A (FOTP-81), "Compound Flow (Drip) Test for Filled Fiber Optic Cable". No preconditioning period shall be conducted. The cable shall exhibit no flow (drip or leak) at 80°C as defined in the test method.

A representative sample of cable shall be tested in accordance with EIA-455-81A, "Compound Flow (Drip) Test for Filled Fiber Optic Cable". The test sample shall be prepared in accordance with Method A. The cable shall exhibit no flow (drip or leak) at 80°C as defined in the test method.

Crush resistance of the finished F/O cables shall be 220 N/cm applied uniformly over the length of the cable without showing evidence of cracking or splitting when tested in accordance with EIA-455-41 (FOTP-41), "Compressive Loading Resistance of Fiber Optic Cables." The average increase in attenuation for the fibers shall be ≤ 0.10 dB at 1550 nm (singlemode) for a cable subjected to this load. The cable shall not exhibit any measurable increase in attenuation after removal of load. Testing shall be in accordance with EIA-455-41 (FOTP-41), except that the load shall be applied at the rate of 3 mm to 20 mm per minute and maintained for 10 minutes.

The cable shall withstand 25 cycles of mechanical flexing at a rate of 30 ± 1 cycles/minute. The average increase in attenuation for the fibers shall be ≤ 0.20 dB at 1550 nm (singlemode) at the completion of the test. Outer cable jacket cracking or splitting observed under 10x magnification shall constitute failure. The test shall be conducted in accordance with EIA-455-104 (FOTP-104), "Fiber Optic Cable Cyclic Flexing Test," with the sheave diameter a maximum of 20 times the outside diameter of the cable. The cable shall be tested in accordance with Test Conditions I and II of (FOTP-104).

The cable shall withstand 20 impact cycles with total impact energy of 5.9 Nm. The average increase in attenuation for the fibers shall be ≤ 0.20 dB at 1550 nm (singlemode). The cable jacket shall not exhibit evidence of cracking or splitting. The test shall be conducted in accordance with EIA-455-25 (FOTP-25), "Impact Testing of Fiber Optic Cables and Cable Assemblies."

The finished cable shall withstand a tensile load of 2700 N without exhibiting an average increase in attenuation of greater than 0.20 dB. The test shall be conducted in accordance with EIA-455-33 (FOTP-33), "Fiber Optic Cable Tensile Loading and Bending Test." The load shall be applied for one-half hour in Test Condition II of the EIA-455-33 (FOTP-33) procedure.

PACKAGING AND SHIPPING REQUIREMENTS

Documentation of compliance to the required specifications shall be provided to the Engineer prior to ordering the material.

Attention is directed to "Fiber Optic Testing," elsewhere in these special provisions.

The completed cable shall be packaged for shipment on reels. The cable shall be wrapped in a weather and temperature resistant covering. Both ends of the cable shall be sealed to prevent the ingress of moisture.

Each end of the cable shall be securely fastened to the reel to prevent the cable from coming loose during transit. Four meters of cable length on each end of the cable shall be accessible for testing.

Each cable reel shall have a durable weatherproof label or tag showing the manufacturer's name, the cable type, the actual length of cable on the reel, the Contractor's name, the contract number, and the reel number. A shipping record shall also be included in a weatherproof envelope showing the above information and also include the date of manufacture, cable characteristics (size, attenuation, bandwidth, etc.), factory test results, cable identification number and any other pertinent information.

The minimum hub diameter of the reel shall be at least thirty times the diameter of the cable. The F/O cable shall be in one continuous length per reel with no factory splices in the fiber. Each reel shall be marked to indicate the direction the reel should be rolled to prevent loosening of the cable.

Two copies of the installation procedures and technical support information shall be furnished to the Engineer at least two weeks subsequent to the start of the scheduled delivery.

10-3.21 FIBER OPTIC LABELING

GENERAL

All fiber optic cables shall be labeled in a permanent and consistent manner. All labels shall be made of a material designed for permanent labeling. All labels shall be mechanically marked with permanent ink on non-metal type labels, or embossed lettering on metal type labels; hand written labels using pencil shall not be used except as noted below. Metal tags shall be constructed of stainless steel. Metal tags are required for use on fiber optic cables. Use of non-metal label materials shall be only as approved by the Engineer. At vaults and other underground locations, all labels and imprinting shall be weatherproof. Labels shall be affixed per the manufacturer's recommendations in a manner that will not cause damage to the cable, or fiber.

CABLE IDENTIFICATION

Identification used for labeling of the fiber optic and copper cables will be provided to the Contractor by the Engineer. The quantity of characters will not be more than 40 for cables and not more than 20 for individual or fibers.

LABEL PLACEMENT

Fiber Optic Cables.--All cables shall be labeled at all terminations, even if no connections or splices are made, and at all splice vault entrance and exit points.

Cable to Cable Splices.--The cable shall be labeled at entry to splice enclosure.

Cable to Fiber Distribution Units.--The cable shall be labeled at entry to the FDU. Only one cable shall be terminated in each FDU. The FDU shall be labeled on the face of the FDU. Individual connections shall be clearly marked in pencil on the face of the FDU in the designated area as directed by the Engineer.

Fibers.--Fiber labels shall be placed next to the connectors of the individual fibers.

Jumpers.--Equipment to FDU Jumpers shall be labeled at both ends. FDU to FDU jumpers shall be labeled at each end.

Pigtails.--Pigtails shall be labeled at the connector.

10-3.22 FIBER OPTIC CABLE INSTALLATION

Installation procedures shall be in conformance with the procedures specified by the cable manufacturer for the specific cable being installed. Mechanical aids may be used, provided that a tension measuring device is placed in tension to the end of the cable, and the allowable tension does not exceed the manufacturers recommended pulling tension. A calibrated break-away feature shall be employed to work in tandem with the tension measuring device and limit excessive tension by disengaging when a set tension is exceeded.

When mechanical aids are proposed for use in pulling fiber optic cable, information on the proposed methods, the time frames and requirements for submittal, review and approval, and the conditions for use of the proposed method shall conform to the requirements for information submitted as required for a proposed "Air Blown Method" as described in "Air Blown Method," elsewhere in these special provisions.

Except when the "Air Blown Method" is used, F/O cable shall be installed using a cable pulling lubricant recommended by the F/O cable or the conduit manufacturer and a non-abrasive pull tape conforming to the provisions described under "MDCS" elsewhere in these special provisions.

Splices shall be limited to locations as shown on the plans and as directed by the Engineer.

During cable installation, the bend radius shall be maintained at not less than twenty times the outside diameter of the cable. Stress relief component shall be installed at the entrance to FDU as recommended by the manufacturer

F/O cable shall be installed without splices except where specifically allowed on the plans or described in these special provisions. A minimum of 15 m of slack shall be provided at each vault without a cable splice. At fiber optic splice closures, a minimum of 9 m of each cable exiting the closure shall be stored in the vault.

Unless shown or provided otherwise, only one F/O cable shall be installed in each conduit.

10-3.23 SPLICING

Unless otherwise allowed, F/O cable splices shall be fusion type. The mean splice loss shall not exceed 0.07 dB per splice. The mean splice loss shall be obtained by measuring the loss through the splice in both directions and then averaging the resultant values.

The field splices shall connect the fibers of the two F/O cable lengths together. These splices shall be placed in a splice tray and these splice tray(s) shall then be placed in the splice closure.

Fibers of the same buffer tube, but not being spliced shall be placed in a splice tray along side spliced fibers. Buffer tubes that do not require enclosed fibers to be spliced shall not be disturbed and placed in the splice closure.

The termination splices shall connect the F/O cable span ends with pigtails. The termination splices shall be placed in a splice tray and the splice tray(s) shall then be placed in the fiber distribution unit (FDU). The individual fibers shall be looped one full turn within the splice tray to avoid micro bending. A 50 mm minimum bend radius shall be maintained during installation and after final assembly in the optical fiber splice tray. Each bare fiber shall be individually restrained in a splice tray. The optical fibers in buffer tubes and the placement of the bare optical fibers in the splice tray shall be such that there is no discernible tensile force on the optical fiber.

All splices shall be protected with a metal reinforced thermal shrink sleeve.

All fiber optic cables shall be labeled in the splice tray. Pigtail ends shall also be labeled to identify the destination of the fiber.

10-3.24 FIBER OPTIC SPLICE CLOSURE

The fiber optic field splices shall be enclosed in splice closures which shall be complete with splice organizer trays, brackets, clips, cable ties, and sealant, as needed. The splice closure shall be suitable for a direct burial or pull box application. Manufacturer's installations shall be supplied to the Engineer prior to the installation of any splice closures. Location of the splice closures shall be where a splice is required as shown on the plans, designated by the Engineer, or described in these special provisions.

The splice closure shall conform to the following specifications:

- A. Non-filled thermoplastic case.
- B. Rodent proof, water proof, re-enterable and moisture proof.
- C. Expendable from 2 cables per end to 8 cables per end by using adapter plates.
- D. Cable entry ports shall accommodate 10 mm to 25 mm diameter cables.
- E. Multiple grounding straps.
- F. Accommodate up to 8 splice trays.
- G. Suitable for "butt" or "through" cable entry configurations.
- H. Place no stress on finished splices within the splice trays.

The fiber optic splice closure shall be suitable for a temperature range of 0°C to 40°C.

Each splice shall be individually mounted and mechanically protected in the splice tray.

The Contractor shall install the fiber splice closure in the fiber optic vaults where splicing is required. The fiber optic splice closures shall be securely fastened to the fiber optic vault or wall using standard hardware as recommended by the closure manufacturer.

The Contractor shall provide all mounting hardware required to securely mount the closures to the splice vault.

The fiber splice closure shall be mounted horizontally in a manner that allows the cables to enter at the end of the closure. Not less than 9 m of each cable shall be coiled in the vault to allow the fiber splice closure to be removed for future splicing.

10-3.25 SPLICE TRAY

Each splice tray shall conform to the following:

- A. Accommodate the quantity of fusion splices as shown on the plans but not less than 12 fusion splices per tray.
- B. Place no stress on completed splices within the tray.
- C. Accommodate "butt" or "feed through" splicing applications.
- D. Be stackable with a transparent snap-on hinge cover.
- E. Accommodate buffer tubes securable with channel straps.
- F. Contain fiber retention strips.

10-3.26 PASSIVE CABLE ASSEMBLIES AND COMPONENTS

The F/O cable assemblies and components shall be compatible components, designed for the purpose intended, and manufactured by a company regularly engaged in the production of material for the fiber optic industry. All components or assemblies shall be best quality, non-corroding, with a design life of at least 20 years. All components or assemblies of the same type shall be from the same manufacturer.

10-3.27 FIBER OPTIC TESTING

GENERAL

Testing shall include the tests on elements of the passive fiber optic components: (1) at the factory, (2) after delivery to the project site but prior to installation and, (3) after installation. The Contractor shall provide all personnel, equipment, instrumentation and materials necessary to perform all testing. The Engineer shall be notified two working days prior to all field tests. The notification shall include the exact location or portion of the system to be tested.

A minimum of 15 working days prior to arrival of the cable at the site, the Contractor shall provide detailed test procedures for all field testing for the Engineer's review and approval. The procedures shall identify the tests to be performed and how the tests are to be conducted. Included in the test procedures shall be the model, manufacturer, configuration, calibration and alignment procedures for all proposed test equipment.

Documentation of all test results shall be provided to the Engineer within 2 working days after the test is completed.

FACTORY TESTING

Documentation of compliance with the fiber specifications as listed in the fiber characteristics table shall be supplied by the original fiber manufacturer. Before shipment, but while on the shipping reel, 100 percent of all fibers shall be tested for attenuation. Copies of the results shall be attached to the cable reel in a waterproof pouch and submitted to the Contractor and to the Engineer.

ARRIVAL ON SITE

The cable and reel shall be physically inspected on delivery and the attenuation shall be measured for 100 percent of the fibers. The failure of any single fiber in the cable to comply with these special provisions, is cause for rejection of the entire reel. Test results shall be recorded, dated, compared and filed with the copy accompanying the shipping reel in a weather proof envelope. Attenuation deviations from the shipping records of greater than 5 percent shall be brought to the attention

of the Engineer. The cable shall not be installed until completion of this test sequence and the Engineer provides written approval. Copies of traces and test results shall be submitted to the Engineer. If the test results are unsatisfactory, the reel of fiber optic cable shall be considered unacceptable and all records corresponding to that reel of cable shall be marked accordingly. The unsatisfactory reels of cable shall be replaced with new reels of cable at the Contractor's expense. The new reels of cable shall then be tested to demonstrate acceptability. Copies of the test results shall be submitted to the Engineer.

AFTER CABLE INSTALLATION

After the fiber optic cable has been pulled but before breakout and termination, 100 percent of all the fibers shall be tested with an OTDR for attenuation. Test results shall be recorded, dated, compared and filed with the previous copies of these tests. Copies of traces and test results shall be submitted to the Engineer. If the OTDR test results are unsatisfactory, the F/O cable segment will be unacceptable. The unsatisfactory segment of cable shall be replaced with a new segment, without additional splices, at the Contractor's expense. The new segment of cable shall then be tested to demonstrate acceptability. Copies of the test results shall be submitted to the Engineer.

Singlemode fibers shall be tested at 1310 nm and 1550 nm after arrival on site and after cable installation. Attenuation readings in one direction after arrival on site and for each direction after installation shall be recorded on the cable data sheet. The Engineer shall review and notify the Contractor of the results in writing in five working days of "arrival on site test" and in ten working days of "after cable installation test".

OUTDOOR SPLICES

At the conclusion of all outdoor splices at one location, and before they are enclosed and sealed, all splices shall be tested with the OTDR, in both directions. Splices in segments shall be tested at 1310 nm and at 1550 nm. Individual fusion splice losses shall not exceed 0.07 dB. Measurement results shall be recorded, dated, validated by the OTDR trace printout and filed with the records of the respective cable runs. Copies of traces and test results shall be submitted to the Engineer. If the OTDR test results are unsatisfactory, the splice shall be unacceptable. The unsatisfactory splice shall be replaced at the Contractor's expense. The new splice shall then be tested to demonstrate acceptability. Copies of the test results shall be submitted to the Engineer.

DISTRIBUTION INTERCONNECT PACKAGE TESTING AND DOCUMENTATION

All the components of the passive interconnect package (FDUs, pigtails, jumpers, couplers and splice trays as shown on the plans and in these special provisions) shall comprise a unit from a manufacturer who is regularly engaged in the production of the fiber optic components.

In developing the distribution interconnect package, each SC termination (pigtail or jumper) shall be tested for insertion attenuation loss with the use of an optical power meter and light source. In addition, all singlemode terminations shall be tested for return reflection loss. These values shall meet the loss requirements specified earlier and shall be recorded on a tag attached to the pigtail or jumper.

Once assembly is complete, the manufacturer shall visually verify that all tagging, including loss values, is complete. Then as a final quality control measure, the manufacturer shall do an "end to end" optical power meter/light source test from pigtail end to jumper lead end to assure continuity and overall attenuation loss values.

The final test results shall be recorded, along with previous individual component values, on a special form assigned to each FDU. The completed form shall be dated and signed by the Manufacturer's Quality Control supervisor. One copy of this form will be attached in a plastic envelope to the assembled FDU unit. Copies will be provided separately to the Contractor and to the Engineer, and shall be also be maintained on file by the manufacturer or supplier.

SYSTEM VERIFICATION AT COMPLETION

OTDR Testing.--Once the passive cabling system has been installed and is ready for activation, 100 percent of the fiber links shall be tested with the OTDR for attenuation. Print out shall include at least link number, fiber color, buffer color and cable number. Test results shall be recorded, dated, compared and filed with previous copies. A hard copy printout and an electronic copy of the traces and test results along with a licensed copy of the associated software on a DOS based 89 mm disk shall be submitted to the Engineer. If the OTDR test results are unsatisfactory the link shall be replaced at the Contractor's expense. The new link shall then be tested to demonstrate acceptability. Copies of the test results shall be submitted to the Engineer.

Power Meter and Light Source.--At the conclusion of the final OTDR testing, 100 percent of all fiber links shall be tested end to end with a power meter and light source, in accordance with EIA Optical Test Procedure 171 and in the same wavelengths specified for the OTDR tests. These tests shall be conducted in both directions. Test results shall be recorded, compared and proven to be within the design link loss budgets, and filed with the other recordings of the same links. Test results shall be submitted to the Engineer.

Link Loss Worksheet.--The Link Loss Worksheet shown in Appendix A shall be completed for 100 percent of all links in the fiber optic system, using the data gathered during cable verification. The completed worksheets shall be included as part of the system documentation.

Test Failures.--If the link loss measured from the power meter and light source exceeds the calculated link loss, or the actual location of the fiber ends does not agree with the expected location of the fiber ends (as would occur with a broken fiber), the fiber optic link will not be accepted. The unsatisfactory segments of cable, or splices shall be replaced with a new segment of cable or splice at the Contractor's expense. The OTDR testing, power meter and light source testing and Link Loss Worksheet shall be completed for the repaired link to determine acceptability. Copies of the test results shall be submitted to the Engineer. The removal and replacement of a segment of cable shall be interpreted as the removal and replacement of a single contiguous length of cable connecting two splices, two connectors or one splice and one connector. The removal of only the small section containing the failure and therefore introducing new unplanned splices, will not be allowed.

APPENDIX A

Link Loss Budget Worksheet

Contract No. _____

Contractor: _____

Approved by Caltrans: _____

Date: _____

Operator: _____

Link Number: _____

Fiber Color: _____

Buffer Color: _____

Cable No.: _____

Test Wavelength (Circle one): 1310 1550

Expected Location of fiber ends:

End 1: _____ End 2: _____

OTDR Test Results:

Forward Loss:	_____ dB	1A
Reverse Loss:	_____ dB	1B
Average Loss:	_____ dB	1C

Power Meter and Light Source Test Results:

Forward Loss:	_____ dB	2A
Reverse Loss:	_____ dB	2B
Average Loss [(2A + 2B)/2]:	_____ dB	2C

Calculated Fiber Loss:

Length of the link (from OTDR):	_____ km	3A
Allowed loss per km of fiber:	0.4 dB/km	3B
Total Allowed Loss due to the fiber (3A * 3B):	_____ dB	3C

Calculated Splice Loss:

Number of Splices in the Link:	_____	4A
Allowed Link Loss per Splice:	0.07 dB	4B
Total Allowed Loss due to Splices (4A * 4B):	_____ dB	4C

Calculated Link Loss:

Connector Loss:	0.9 dB	5A
Total Link Loss (5A + 3C + 4C):	_____ dB	5B

Cable Verification:

Compare Power Meter Average Loss to Calculated Link Loss (2C - 5B):	_____ dB	6A
---	----------	----

If the value of 6A is greater than zero, the link has failed the Test. See Test Failures elsewhere in these special provisions.

To Be Completed by Caltrans:

Resident Engineer's Signature: _____

Cable Link Accepted: _____

10-3.28 BONDING AND GROUNDING

Bonding and grounding shall conform to the provisions in Section 86-2.10, "Bonding and Grounding," of the Standard Specifications and these special provisions.

Bonding jumpers in standards with handholes and traffic pull box lid covers shall be attached by a UL listed lug using 4.5-mm diameter or larger brass or bronze bolts and shall run to the conduit or bonding wire in the adjacent pull box. The grounding jumper shall be visible after the standard has been installed and the mortar pad and cap have been placed on the foundation.

Standards without handholes shall have bonding accomplished by jumpers attached to UL listed ground clamps on each anchor bolt.

For slip base standards or slip base inserts, bonding shall be accomplished by jumpers attached to UL listed ground clamps on each anchor bolt, or a UL listed lug attached to the bottom slip base plate with a 4.5-mm diameter or larger brass or bronze bolt.

Equipment bonding and grounding conductors are required in conduits, except when the conduits contain combinations of only loop lead-in cable, fiber optic cable, or signal interconnect cable. A No. 8 minimum, bare copper wire shall run continuously in circuits, except for series lighting circuits, where No. 6 bare copper wire shall run continuously. The bonding wire size shall be increased to match the circuit breaker size in conformance with the Code, or shall be as shown on the plans. Conduits to be installed for future conductors, may omit the copper wire.

Bonding of metallic conduits in metal pull boxes shall be by means of bonding bushings and bonding jumpers connected to the bonding wire running in the conduit system.

10-3.29 SERVICE

Continuous welding of exterior seams in service equipment enclosures is not required.

Type III service equipment enclosures shall be the aluminum type.

Circuit breakers shall be the cable-in/cable-out type, mounted on non-energized clips. All circuit breakers shall be mounted vertically with the up position of the handle being the "ON" position.

Each service shall be provided with up to 2 main circuit breakers which shall disconnect ungrounded service entrance conductors.

Circuit breakers used as service disconnect equipment shall have a minimum interrupting capacity of 42 000 A, rms, for 120/240 V(ac) services.

ELECTRIC SERVICE (IRRIGATION)

Electric service (irrigation) shall be from the service points to the irrigation controllers (IC) and to the spaces provided in the irrigation controller enclosure cabinets (CEC) for irrigation controllers as shown on the plans.

The inscription on nameplates shall be the identifying letter designation used on the plans and in these special provisions, or shall be as directed by the Engineer.

Full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in installing electric service (irrigation) for irrigation controllers, complete in place, including conductors, conduit and pull boxes to the pull box adjacent to irrigation controller enclosure cabinets and irrigation controllers, as shown on the plans, as specified in these special provisions, and as directed by the Engineer shall be considered as included in the contract lump sum price paid for lighting and sign illumination and no separate payment compensation will be made therefor.

10-3.30 NUMBERING ELECTRICAL EQUIPMENT

Reflective numbers (with sheet background) will be State-furnished in conformance with the provisions in "Materials" of these special provisions.

The numbers shall be placed on the equipment where designated by the Engineer.

Where new numbers are to be placed on existing or relocated equipment, the existing numbers shall be removed.

Numbers shall be applied to a clean surface.

Where shown on the plans, equipment numbers shall be placed for all electroliers, sign lighting, and service pedestals. On service equipment enclosures, the numbers shall be placed on the front door. On electroliers, the numbers shall be placed as shown on the plans, except that the numbers shall be placed on the side nearest the roadway facing approaching traffic at a height up to 2.5-m above the base plate.

Numbers for overhead sign bridges shall be placed on both posts.

10-3.31 STATE-FURNISHED CONTROLLER ASSEMBLIES

The Model 170 controller assemblies, including controller unit, completely wired controller cabinet, battery back-up system, and inductive loop detector sensor units but without anchor bolts, will be State-furnished as provided under "Materials" of these special provisions.

The Contractor shall construct each controller cabinet foundation as shown on the plans for Model 332 and 334 cabinets (including furnishing and installing anchor bolts), shall install the controller cabinet on the foundation, and shall make field wiring connections to the terminal blocks in the controller cabinet.

A listing of field conductor terminations, in each State-furnished controller cabinet, will be furnished free of charge to the Contractor at the site of the work.

State forces will maintain controller assemblies. The Contractor's responsibility for controller assemblies shall be limited to conforming to the provisions in Section 6-1.02, "State-Furnished Materials," of the Standard Specifications.

10-3.32 VEHICLE SIGNAL FACES AND SIGNAL HEADS

Type SV-1-T mountings with 5 sections and SV-2-TD mountings shall be bolted to the standard through the upper pipe fitting in the same manner shown for bolting the terminal compartment.

Pipe fittings shall not be the aluminum type.

10-3.33 BATTERY BACKUP SYSTEM

DESCRIPTION

The battery back up system (BBS) shall consist of an external cabinet, an inverter/charger, a power transfer relay, a manual bypass switch, a temperature probe, hardware, a battery harness, and interconnect wiring. The BBS will be State-furnished as provided under "Materials" of these special provisions. The Contractor shall furnish the batteries.

A completely assembled, wired BBS and external cabinet will be State-furnished as provided under "Materials" of these special provisions. The Contractor shall construct the BBS extended foundation. The Contractor shall mount the inverter/charger, power transfer relay, and manual bypass switch on the standard EIA 483 mm rack external cabinet shelves. The Contractor shall install the batteries, and connect the battery wiring harness.

MATERIAL

The Contractor shall furnish batteries compatible with the State-furnished BBS and suitable for outdoor applications. Batteries shall:

- A. have voltage rating 12 V,
- B. be group size 24,
- C. be 75 to 80 ampere-hour at 20 hour rate,
- D. be commercially available and stocked locally,
- E. have a carrying handle,
- F. be marked with date code and maximum recharge data and recharge cycles,
- G. have 2 top mounted terminal posts with recessed thread lugs for 6.35 mm diameter, 20 thread count per 25.4 mm bolts,
- H. be fully charged when furnished, and
- I. be free from damage or deformities.

The Contractor shall provide 4 batteries per BBS installation.

The batteries shall be deep cycle, sealed prismatic lead-calcium based absorbed glass mat/valve regulated lead acid (AGM/VRLA).

The batteries shall be certified by the manufacturer to operate over a temperature range of -25°C to 74°C.

The Contractor shall submit the battery data sheet to the Engineer when the batteries are delivered to the jobsite. The data sheet shall include the following features:

- A. model number,
- B. serial number,
- C. dimensions,
- D. charts,
- E. table of discharge rating,
- F. product information,
- G. battery specifications, and
- H. conductivity reading per battery (in Siemens).

The batteries shall have a written warranty against defects in materials and workmanship from the manufacturer prorated for a period of 60 months after installation. The Contractor shall provide the Engineer with all warranty documentation prior to installation. Replacement batteries shall be provided within 5 days after receipt of failed batteries at no cost to the State except the cost of shipping the failed batteries. Replacement batteries shall be delivered the Caltrans District 11 Signal Laboratory, 7181 Opportunity Road, San Diego, CA 92111.

MOUNTING AND CONFIGURATION

The Contractor shall apply a pliable seal composed of caulking compound or mastic around the gap between the external cabinet and the controller cabinet.

Functional Testing

The BBS functional test shall include at least 30 minutes of continuous, satisfactory operation with utility power turned off. Testing will be performed in the presence of the Engineer.

MEASUREMENT AND PAYMENT

Full compensation for furnishing all labor, materials (including batteries), tools, equipment, and incidentals and for doing all the work involved in installing the battery backup system, complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer shall be considered as included in the lump sum price paid for the item of work involved and no separate compensation will be made therefor.

10-3.34 LIGHT EMITTING DIODE SIGNAL MODULE

The Contractor shall use light emitting diode (LED) signal modules as the light source for traffic signal faces with 300-mm and 200-mm circular sections, arrow sections, and 300-mm programmable visibility (PV) sections in conformance with these special provisions.

GENERAL

The Contractor shall install LED signal modules in the doorframes of standard traffic signal housings. Lamp sockets, reflectors, reflector holders, and lenses used with incandescent lamps shall not be used when LED signal modules are installed.

The 300-mm PV LED signal modules shall plug into programmable visibility housings without modifications to the housing. The PV module shall be in conformance with the provisions in Section 86-4.05, "Programmed Visibility Vehicle Signal Faces," of the Standard Specifications.

LED signal modules, including green, yellow, and red circular balls; arrow indications; and PV types shall be from the same manufacturer, and each size shall be the same model.

LED signal modules shall be sealed units with a printed circuit board, a power supply, a lens and a gasket. Signal modules shall be weatherproof after installation and connection. Circuit boards and power supplies shall be contained inside LED signal modules. Circuit boards shall conform to the requirements in Chapter 1, Section 6 of the "Transportation Electrical Equipment Specifications," published by the Department. LED module, except the PV type, shall have conductor leads for power connection and the PV module shall have a three-prong plug-in type connector.

Lenses of LED signal modules shall be integral to the units, shall be convex with a smooth outer surface, and shall be made of ultraviolet stabilized plastic or glass. The lenses shall be capable of withstanding ultraviolet exposure from direct sunlight for a minimum period of 60 months without exhibiting evidence of deterioration.

The Contractor shall seal LED signal modules in doorframes, except the PV type, with one-piece ethylene propylene rubber (EPDM) gaskets.

Lenses used with PV signal modules shall be sealed in doorframes with one-piece EPDM gaskets.

LEDs used in signal modules shall be of aluminum indium gallium phosphide (AlInGaP) technology for red and yellow indications and of gallium nitride (GaN) technology for green indications. LEDs shall be the ultra-bright type rated for 100,000 hours of continuous operation from -40°C to +74°C.

The Contractor shall wire signal and PV module LED clusters so that a total failure of one LED will result in the loss of not more than 5 percent of the signal module light output. Failure of an individual LED in a string shall not result in the loss of the entire string or any other indication.

Maximum power consumption requirements for LED signal modules shall be as follows:

LED Signal Module	Power Consumption in Watts					
	Red		Yellow		Green	
	25°C	74°C	25°C	74°C	25°C	74°C
300 mm circular	11	17	22	25	15	15
200 mm circular	8	13	13	16	12	12
300 mm arrow	9	12	10	12	11	11
300 mm arrow	9	12	10	12	11	11
300 mm PV	11	17	22	25	15	15

The minimum power consumption for LED modules shall be 6 Watt or greater.

PHYSICAL AND MECHANICAL REQUIREMENTS

The maximum weight of an LED module shall be 1.8 kg, and 0.4-kg for the PV module.

Installation of LED signal modules shall only require the removal of the optical unit components. LED signal modules shall be weather tight, fit securely to the housing (except PV types), and connect directly to electrical wiring.

Arrow modules shall conform to the requirements for arrow indications in Section 9.01 of the ITE publication "Equipment and Materials Standards, Vehicle Traffic Control Signal Heads." LEDs shall be spread evenly across the illuminated portion of the arrow area.

LED Signal Module Lens

The LED signal module shall be capable of replacing the optical unit. The lens may be tinted, or may use transparent film or materials with similar characteristics to enhance "ON/OFF" contrasts. The use of tinting or other materials to enhance "ON/OFF" contrast shall not affect chromaticity and shall be uniform across the face of the lens.

If a polymeric lens is used, a surface coating or chemical surface treatment shall be used to provide front surface abrasion resistance.

Environmental Requirements

LED signal modules shall be rated for use in the operating temperature range of -40°C to +74°C.

The Contractor shall provide LED signal modules that are protected against dust and moisture intrusion in conformance with the requirements in NEMA Standard 250 for Type 4 enclosures.

Construction

LED signal modules shall be single, self-contained devices, not requiring on-site assembly for installation into existing traffic signal housings. The power supply for LED signal modules shall be integral to the module.

Assembly and manufacturing processes for LED signal modules shall be designed to assure internal components will be adequately supported to withstand mechanical shock and vibration from high winds and other sources.

Materials

Materials used for lenses and LED signal modules shall conform to the requirements in ASTM Specification: D-3935 for the materials.

Enclosures containing the power supply or electronic components of LED signal modules shall be made of UL94VO flame-retardant materials. The lenses of LED signal modules are excluded from this requirement.

Module Identification

LED signal modules shall have the following permanently marked on the back of the module:

- A. manufacturer's name,
- B. trademark,
- C. model number,
- D. serial number,
- E. lot number,
- F. month and year of manufacture, and
- G. required operating characteristics including:
 - 1. rated voltage,
 - 2. power consumption, and
 - 3. volt-ampere.

Each module shall have a 25-mm diameter symbol identifying the module type (i.e. circle, arrow, etc.) in the color of the module. The color shall be written out in 12-mm text next to the symbol.

LED signal modules shall have prominent and permanent vertical markings for correct indexing and orientation within the signal housings. Markings shall consist of an up arrow or the word "UP" or "TOP."

PHOTOMETRIC REQUIREMENTS

Initial luminous intensity values for LED signal modules, operating at 25°C, shall meet or exceed the following minimum values:

Circular Indications (cd)						
Angle (v, h)	200 mm			300 mm		
	Red	Yellow	Green	Red	Yellow	Green
2.5, ±2.5	157	314	314	399	798	798
2.5, ±7.5	114	228	228	295	589	589
2.5, ±12.5	67	133	133	166	333	333
2.5, ±17.5	29	57	57	90	181	181
7.5, ±2.5	119	238	238	266	532	532
7.5, ±7.5	105	209	209	238	475	475
7.5, ±12.5	76	152	152	171	342	342
7.5, ±17.5	48	95	95	105	209	209
7.5, ±22.5	21	43	43	45	90	90
7.5, ±27.5	12	24	24	19	38	38
12.5, ±2.5	43	86	86	59	119	119
12.5, ±7.5	38	76	76	57	114	114
12.5, ±12.5	33	67	67	52	105	105
12.5, ±17.5	24	48	48	40	81	81
12.5, ±22.5	14	29	29	26	52	52
12.5, ±27.5	10	19	19	19	38	38
17.5, ±2.5	19	38	38	26	52	52
17.5, ±7.5	17	33	33	26	52	52
17.5, ±12.5	12	24	24	26	52	52
17.5, ±17.5	10	19	19	26	52	52
17.5, ±22.5	7	14	14	24	48	48
17.5, ±27.5	5	10	10	19	38	38

Arrow Indications Minimum Source Intensity (cd/m ²)			
	Red	Yellow	Green
Arrow Indication	5500	11 000	11 000

Minimum PV Luminous Intensity at 25°C (cd)			
	Red	Yellow	Green
2.5 degrees left	314	314	314
2.5 degrees right	314	314	314

Red and green LED signal modules shall meet or exceed the following illumination values for a minimum period of 48 months, based on normal use in traffic signal operation over an operating temperature range of -40°C to +74°C. Yellow LED signal modules shall meet or exceed the following illumination values for a minimum period of 48 months, based on normal use in traffic signal operation at 25°C:

Circular Indications (cd)						
Angle (v, h)	200 mm			300 mm		
	Red	Yellow	Green	Red	Yellow	Green
2.5, ±2.5	133	267	267	339	678	678
2.5, ±7.5	97	194	194	251	501	501
2.5, ±12.5	57	113	113	141	283	283
2.5, ±17.5	25	48	48	77	154	154
7.5, ±2.5	101	202	202	226	452	452
7.5, ±7.5	89	178	178	202	404	404
7.5, ±12.5	65	129	129	145	291	291
7.5, ±17.5	41	81	81	89	178	178
7.5, ±22.5	18	37	37	38	77	77
7.5, ±27.5	10	20	20	16	32	32
12.5, ±2.5	37	73	73	50	101	101
12.5, ±7.5	32	65	65	48	97	97
12.5, ±12.5	28	57	57	44	89	89
12.5, ±17.5	20	41	41	34	69	69
12.5, ±22.5	12	25	25	22	44	44
12.5, ±27.5	9	16	16	16	32	32
17.5, ±2.5	16	32	32	22	44	44
17.5, ±7.5	14	28	28	22	44	44
17.5, ±12.5	10	20	20	22	44	44
17.5, ±17.5	9	16	16	22	44	44
17.5, ±22.5	6	12	12	20	41	41
17.5, ±27.5	4	9	9	16	32	32

Arrow Indications Minimum Source Intensity (cd/m ²)			
	Red	Yellow	Green
Arrow Indication	5 500	11 000	11 000

Measured chromaticity coordinates of LED signal modules shall conform to the chromaticity requirements of the following table, for a minimum period of 48 months, over an operating temperature range of -40°C to +74°C.

Chromaticity Standards	
Red	Y: not greater than 0.308, nor less than 0.998 - x
Yellow	Y: not less than 0.411, nor less than 0.995 - x, nor greater than 0.452
Green	Y: not less than 0.506 - 0.519x, nor less than 0.150 + 1.068x, nor greater than 0.730 - x

Circular LED modules will be tested in conformance with California Test 604. Optical testing will be performed with LED signal modules mounted in standard traffic signal sections without visors or hoods attached to the signal sections.

LEDs for arrow indications shall be spread evenly across the illuminated portion of the arrow area. Arrow LED signal modules will be tested in conformance with California Test 3001. Optical testing will be performed with LED signal modules mounted in standard traffic signal sections without visors or hoods attached to the signal sections. LED arrow signal section indication shall provide minimum initial luminous intensity as listed herein. Measurements will be performed at the rated operating voltage of 120 V (ac).

ELECTRICAL

Maximum power consumption requirements for LED signal modules shall not exceed those listed in "General," in these special provisions. LED signal modules shall operate at a frequency of 60 Hz ± 3 Hz over a voltage range from 95 V (ac) to

135 V (ac) without perceptible flicker to the unaided eye over the voltage specified. Fluctuations of line voltage shall have no visible effect on luminous intensity of the indications. Rated voltage for measurements shall be 120 V (ac).

Wiring and terminal blocks shall conform to the provisions of Section 86-4.01C, "Electrical Components," of the Standard Specifications and to the requirements of Section 13.02 of the ITE publication "Equipment and Material Standards," Chapter 2 (Vehicle Traffic Control Signal Heads). LED modules shall have 2 secured, color coded, one-meter long conductors, 600 V, 20 AWG minimum, jacketed wires with quick disconnect terminals attached, conforming to the National Electronic Code, rated for service at 105°C, shall be provided for electrical connection for each LED signal module.

LED signal module on-board circuitry shall include voltage surge protection to withstand high repetition noise transients in conformance with the requirements in Section 2.1.6 of NEMA Standard TS-2.

LED signal modules shall be operationally compatible with currently used controller assemblies including solid state load switches, flashers and conflict monitors. When a current of 20 mA (ac) or less is applied to the unit, the voltage read across the 2 leads shall be 15 V (ac) or less.

LED signal modules and associated on-board circuitry shall meet Class A emission limits in Federal Communications Commission (FCC) Title 47, SubPart B, Section 15.

LED signal modules shall provide a power factor of 0.90 or greater.

Total harmonic distortion from current and voltage induced into an alternating current power line by LED signal modules shall not exceed 20 percent at an operating temperature of 25°C.

QUALITY ASSURANCE PROGRAM

The Contractor shall supply modules of an approved model number and from pre-qualified manufacturers appearing on the current California Department of Transportation Pre-Qualified LED Traffic Signal Module List at:

http://www.dot.ca.gov/hq/esc/approved_products_list

LED signal modules shall be manufactured in conformance with a vendor quality assurance (QA) program. The QA program shall include design and production. Production quality assurance shall include statistically controlled routine tests to ensure minimum performance levels of LED signal modules built to meet these specifications.

The manufacturer shall have a documented problem resolutions process. Documentation of the QA process test results and problem resolution records shall be kept on file for a minimum period of five years.

LED signal module components and subassemblies that may affect reliability or performance shall be traceable to the original manufacturers.

Production Quality Assurance Testing

Production quality assurance testing shall be performed on each LED signal module prior to shipment. Failure to conform to the requirements of a production quality test shall be cause for rejection. The manufacturer shall retain test results for five years for warranty purposes.

Specified parameters shall be measured and used for quality comparison of production modules (rated power, etc.).

LED signal modules shall be tested for specified initial intensity after burn-in. The burn-in period shall consist of signal modules being energized at rated voltage for a 30 minute stabilization period before the measurements are made. A single point measurement with a correlation to the minimum initial luminous intensity requirements in "Photometric Requirements" of these special provisions for circular modules may be used. The ambient temperature for this measurement shall be 25°C.

LED signal modules shall be tested for luminous intensity requirements in "Photometric Requirements" of these special provisions.

LED signal modules shall be tested for required power factor after burn-in.

LED signal modules shall be tested by measuring current flow in amperes after burn-in. The measured current values shall be compared against current values resulting from design qualification measurements. The current flow shall not exceed the specified value. The measured ampere values with rated voltage shall be recorded as volt-ampere on the product labels.

LED signal modules shall be visually inspected for exterior physical damage or assembly anomalies. The surface of the lens shall be free of scratches, abrasions, cracks, chips, discoloration, or other defects. Defects shall be cause for rejection.

CERTIFICATE OF COMPLIANCE

The Contractor shall provide the Engineer a Certificate of Compliance from the manufacturer, in conformance with the provisions of Section 6-1.07, "Certificates of Compliance," of the Standard Specifications. The certificate shall certify that the LED signal modules comply with the requirements of these specifications. The certificate shall also include a copy of applicable test reports on the LED signal modules.

QUALITY ASSURANCE TESTING

The Department will test LED shipments. Testing will be completed within 30 days after delivery to the Transportation Laboratory. Circular LED signal modules will be tested in conformance with California Test 604 and these special provisions. Arrow signal modules will be tested in conformance with California Test 3001 and these special provisions. Optical testing will be performed with the module mounted in a standard traffic signal section, but without a visor or hood attached to the section or housing. All parameters of the specification may be tested on the modules.

The Contractor shall ship the LED modules and a list of LED module serial numbers intended for this job, at the Contractor's expense, to the Transportation Laboratory for testing. Delays resulting from submittal of non-compliant materials shall not relieve the Contractor from executing the contract within the allotted time. In the event of LED module failures and when re-testing is required, the Contractor shall be responsible for providing new LED modules and allowing a minimum of 30 days to test them. The Contractor shall pay shipping and handling costs related to re-testing. Delay generated due to re-submittal and re-testing shall be the responsibility of the Contractor and no extra time will be granted to the Contractor.

WARRANTY

In addition to meeting the performance requirements for the minimum period of 48 months, the Contractor shall provide the Engineer with a written warranty from the manufacturer against defects in materials and workmanship for LED signal modules for a period of 60 months after installation of LED signal modules. Replacement LED signal modules shall be provided within 5 days after receipt of failed LED signal modules at no cost to the Department. Warranty documentation shall be given to the Engineer prior to installation. Replacement LED signal modules shall be delivered to the Caltrans District 11 Signal Laboratory, 7181 Opportunity Road, San Diego, CA 92111.

10-3.35 LIGHT EMITTING DIODE PEDESTRIAN SIGNAL FACE MODULES

The Contractor will provide and install light emitting diode (LED) "UPRAISED HAND" and "WALKING PERSON" pedestrian signal face (PSF) modules in standard Type A pedestrian signal housings as the light source and as shown on the plans and in conformance with these special provisions.

Incandescent Lamp-s in existing type A pedestrian signals housing shall be replaced with LED pedestrian signal face (PSF) modules, as shown on the plans and in conformance to these special provisions.

GENERAL

PSF modules shall be designed to mount in standard Type A housings. PSF modules shall be designed to mount behind or replace face plates of standard Type A housings in conformance with the requirements of the Institute of Transportation Engineers (ITE) Standards: "Pedestrian Traffic Control Signal Indications," the Manual on Uniform Traffic Control Devices (MUTCD), and MUTCD California Supplement. Where existing Type A pedestrian signal faces contain both incandescent and LED light sources, both light sources shall be removed and replaced by a new LED combination pedestrian signal face module in conformance with these special provisions.

PSF modules used on this project shall be from a single manufacturer.

Circuit boards and power supplies shall be contained inside the PSF LED modules. Circuit boards shall conform to the requirements in Chapter 1, Section 6 of the "Transportation Electrical Equipment Specifications," (TEES) published by the Department.

The PSF LEDs shall utilize the appropriate technology to achieve the required color and shall be the ultra bright type rated for 100,000 hour continuous operation over a temperature range from -40°C to $+74^{\circ}\text{C}$.

Individual PSF LEDs shall be wired so that a catastrophic loss or the failure of one or more LEDs will result in the loss of not more than 5 percent of the PSF module light output. Failure of an individual LED in a string shall not result in the loss of the entire string or any other indication.

Photometric Requirements

Each module shall emit an average luminous intensity of at least 3,750 candela/m² for "Hand" and 5,300 candela/m² for "Walking Person" symbol at the time of initial testing at 25°C and throughout 48 months of operation over a temperature range of -40°C to $+73^{\circ}\text{C}$.

The color output of the module shall conform to the requirements of Section 5.3 in the ITE Publication: Equipment and Material Standards, Chapter 3 (Pedestrian Traffic Control Signal Indications). "Hand shall be Portland Orange. "Walking Person": shall be lunar white. Height and width of each symbol shall not be less than 250 mm and 165 mm respectively.

Uniformity ratio of illuminated symbols shall not exceed 4 to 1 between the highest luminance area and the lowest luminance area. The measured chromaticity coordinates of PSF LED modules shall conform to the requirements for chromaticity in Section 5.3.2.1 and Figure C of the VTCSH standards.

PSF LED modules shall be rated for a minimum useful life of 48 months. All modules shall meet all parameters of this specification during this period.

Physical and Mechanical Requirements

PSF LED modules shall be designed as retrofit replacement for existing optical units of signal lamps, or existing pedestrian signal faces with both LED and incandescent light sources, and shall not require special tools for installation. PSF modules shall fit into pedestrian signal section housings built in conformance with the ITE Publication: Equipment and Materials Standards, Chapter 2 "Vehicle Traffic Control Signal Heads" (VTCSH) without modification to the housing.

If a specific mounting orientation is required, each module shall have prominent and permanent marking for correct indexing and orientation within a signal housing. The marking shall consist of an up arrow or the word "UP" or "TOP."

Environmental Requirements

PSF LED modules shall be rated for use over the operating temperature range of -40° C to +74° C.

Construction

PSF LED modules shall be single, self-contained devices, not requiring on-site assembly for installation into standard Type A housings. Combination "UPRAISED HAND"/"WALKING PERSON" section housings, without the reflectors, shall be used.

Power supplies for PSF LED modules shall be integral to the modules.

Assembly and manufacturing processes for PSF LED modules shall be designed to assure all internal components will be adequately supported to withstand mechanical shock and vibration from high winds and other sources.

Materials

Material used for PSF LED modules shall conform to the requirements in ASTM specifications D-3935.

Enclosures containing either the power supply or electronic components of the PSF LED module, excluding the lens, shall be made of UL94VO flame-retardant materials.

Module Identification

PSF LED modules shall have the manufacturer's name, trademark, model number, serial number, lot number, month and year of manufacture, and required operating characteristics permanently marked on the back of the module. Required operating characteristics shall include rated voltage, power consumption and volt-ampere (VA).

ELECTRICAL

PSF LED module power consumption shall not exceed the following maximum watts:

PSF module	Power Consumption @ 25°C	Power Consumption @ 74°C
UPRAISED HAND	10.0 W	12.0 W
WALKING PERSON	9.0 W	12.0 W

PSF LED modules shall operate at a frequency of 60 Hz ± 3 Hz over a voltage range from 95 V (ac) to 135 V (ac) without perceptible flicker to the unaided eye. Fluctuations of line voltage shall have no visible effect on the luminous intensity of the indications. Rated voltage for all measurements shall be 120 V (ac).

PSF LED module on-board circuitry shall include voltage surge protection to withstand high-repetition noise transients in conformance with the requirements in Section 2.1.6 of NEMA Standard TS2.

Wiring and terminal blocks shall conform to the requirements of Section 13.02 of the ITE Publication: Equipment and Material Standards, Chapter 2, "Vehicle Traffic Control Signal Heads."

PSF LED modules shall be operationally compatible with currently used controller assemblies including solid state load switches, flashers and conflict monitors. When a current of 20 mA (ac) or less is applied to the unit, the voltage read across the PSF module shall be 15 V (ac) or less.

PSF LED modules and associated on-board circuitry shall meet Class A electronic noise emission limits of Federal Communications Commission (FCC) regulation: Title 47, SubPart B, Section 15.

PSF LED modules shall provide a power factor of 0.90 or greater.

Total harmonic distortion from current and voltage induced into an alternating current power line by PSF LED modules shall not exceed 20 percent at an operating temperature of 25°C.

QUALITY ASSURANCE PROGRAM

The Contractor shall supply modules of an approved model number and from pre-qualified manufacturers appearing on the current California Department of Transportation Pre-Qualified LED Traffic Signal Module List at:

http://www.dot.ca.gov/hq/esc/approved_products_list

PSF LED modules shall be manufactured in conformance with a vendor quality assurance (QA) program. The QA program shall include design and production. Production quality assurance shall include statistically controlled routine tests to ensure minimum performance levels of PSF LED signal modules built to meet these specifications.

The manufacturer shall have a documented problem resolutions process. Documentation of the QA process test results and problem resolution records shall be kept on file for a minimum period of five years.

PSF LED module components and subassemblies, that may affect reliability or performance, shall be traceable to the original manufacturers.

Production Quality Assurance Testing

Production quality assurance testing shall be performed on each PSF LED module prior to shipment. Failure to conform to the requirements of a production quality test shall be cause for rejection. The manufacturer shall retain test results for five years for warranty purposes.

Specified parameters shall be measured and used for quality comparison of production modules (rated power, etc.).

PSF LED modules shall be tested for specified initial intensity after burn-in. The burn-in period shall consist of signal modules being energized at rated voltage for a 30 minute stabilization period before the measurements are made. A single point measurement with a correlation to the minimum initial luminous intensity requirements in "Photometric Requirements" of these special provisions for circular modules may be used. The ambient temperature for this measurement shall be +25°C.

PSF LED modules shall be tested for luminous intensity requirements in "Photometric Requirements" of these special provisions.

PSF LED modules shall be tested for required power factor after burn-in.

PSF LED modules shall be tested by measuring current flow in amperes after burn-in. The measured current values shall be compared against current values resulting from design qualification measurements. The current flow shall not exceed the specified value. The measured ampere values with rated voltage shall be recorded as volt-ampere on the product labels.

PSF LED modules shall be visually inspected for exterior physical damage or assembly anomalies. The surface of the lens shall be free of scratches, abrasions, cracks, chips, discoloration, or other defects. Defects shall be cause for rejection.

CERTIFICATE OF COMPLIANCE

The Contractor shall provide the Engineer a Certificate of Compliance from the manufacturer, in conformance with the provisions of Section 6-1.07, "Certificates of Compliance," of the Standard Specifications. The certificate shall certify that the PSF LED modules comply with the requirements of these specifications. The certificate shall also include a copy of applicable test reports on the PSF modules.

QUALITY ASSURANCE TESTING

The State will test all PSF LED module shipments. Testing will be completed within 30 days after delivery to the Transportation Laboratory. PSF LED modules shall be tested in conformance with California Test 610 and these special provisions. Optical testing will be performed with the module mounted in Type A housing. All parameters of the specification may be tested.

The Contractor shall ship the PSF LED modules and a list of all PSF LED module serial numbers intended for this job, at the Contractor's expense, to the Transportation Laboratory for testing. Delays resulting from submittal of non-compliant materials shall not relieve the Contractor from executing the contract within the allotted time. In the event of PSF LED module failures and when re-testing is required, the contractor shall be responsible for providing new PSF LED modules and allowing a minimum of 30 days to retest them. The contractor shall pay all shipping and handling costs related to re-testing. Delay generated due to re-submittal and re-testing shall be the responsibility of the contractor and no extra time will be granted to the contractor.

WARRANTY

The manufacturer shall provide a written warranty against defects in materials and workmanship for the PSF LED modules for a period of 60 months after installation of the PSF LED modules. Replacement PSF LED modules shall be provided within 5 days after receipt of failed PSF modules at no cost to the State. All warranty documentation shall be given to the Engineer prior to installation. Replacement PSF LED modules shall be delivered to the Caltrans District 11 Signal Laboratory, 7181 Opportunity Road, San Diego, CA 92111.

10-3.36 ILLUMINATED PAVEMENT MARKER SYSTEM

The Contractor shall furnish and install illuminated pavement marker (IPM) system in accordance with the Standard Specifications, the details shown on the plans, and these special provisions.

GENERAL

IPM system shall consist of the following:

- A. Illuminated pavement markers.
- B. IPM controller assembly.
- C. Battery back-up power system.

IPM system shall be rated at 120 V(ac), 60 (Hz), from 12 V(dc) to 24 V(dc), with a maximum rating of 10 W.

In daytime conditions, active light emitting diode (LED) light sources of IPMs shall be visible at a minimum of 120 m in advance of the IPM.

In hours of darkness, active LED light sources of IPMs shall be visible, by persons with vision of or corrected to 20/20, at a distance equal to or greater than the performance distance of retroreflective pavement markers of the same color that are subjected to illumination of legal high beam headlights.

In nighttime conditions, the IPM system shall utilize a dimming feature. Levels of dimming shall be adjustable. Nighttime/Daytime sensing shall be automatic with manual testing override switch.

Illuminated pavement markers shall be designed for mounting onto a base plate assembly installed in the pavement or a base can assembly mounted on the pavement. IPMs shall be moisture and corrosion resistant.

ILLUMINATED PAVEMENT MARKER

Illuminated pavement marker shall consist of a housing, base plate, LED light source, refractor (if necessary), and lens.

Illuminated pavement marker shall be a low-profile design not exceeding 7 mm above the surrounding pavement surface when installed.

Externally visible portions of the housing shall not have reflective components or such components shall be positioned or shaded as part of the manufactured housing in such a way as to minimize reflection from an ambient light source, e.g. sunlight or vehicle headlights. IPMs with non-active LED light sources shall visually blend in with the surrounding pavement.

The IPM shall utilize a uni-directional light source.

The IPM shall resist all stresses imposed by impact, rollover and static loads of vehicular traffic without damage to the fitting or to vehicle tires. The IPM shall be protected against dust and moisture intrusion to protect internal components.

The overall weight of the IPM shall not exceed 10 kg.

Housing shall be of modular design with the main casting manufactured in nylon or aluminum alloy, suitably protected against corrosion and finished or color impregnated in matte black closely matching the surrounding asphalt concrete pavement.

LED light sources shall utilize Aluminum Indium Gallium Phosphide (AlInGaP) technology or Gallium Nitride (GaN) technology and shall be the ultra-bright type rated for 100 000 hours of continuous operation from -40°C to +74°C. The LED color shall be white with a peak wavelength from 590 nanometers to 600 nanometers. LEDs shall have a 30 degree viewing angle. Luminance of each IPM shall be a minimum of x candela per square meter measured in accordance with California Test 606.

Individual LEDs shall be wired so that a total failure of one LED will result in the loss of not more than 5 percent of the signal module light output. Failure of an individual LED in a string shall not result in the loss of the entire string or any other indication.

LED cluster replacement shall be easily effected from the bottom or top of the housing.

IPM CONTROLLER ASSEMBLY

Completely wired controller cabinet, but without IPM controller unit(s) and anchor bolts, will be State-furnished as provided under "Materials" of these special provisions..

The Contractor shall furnish and install controller units compatible with IPM operation, wiring, and electrical components for operation of the IPM system.

BACK-UP POWER SYSTEM

The battery backup system (BBS) will be State-furnished as provided under "Materials" of these special provisions. The Contractor shall furnish the batteries. Attention is directed to "Battery Backup System" elsewhere in these special provisions.

INSTALLATION

Unless otherwise shown on the plans, the IPM shall extend not more than 7 mm above the pavement surface. IPM shall be installed in accordance with the manufacturer's specifications.

IPMs shall be placed on the alignment and location shown on the plans, or directed by the Engineer. The IPMs shall be placed uniformly, straight on tangent alignment and on a true arc on curved alignment. Individual aiming of the IPMs shall be as recommended by the manufacturer. All layout work necessary to place the IPMs to the proper alignment and aim shall be performed by the Contractor.

TESTING AND DOCUMENTATION

Only one type of illuminated pavement marker shall be used on the project. A sample illuminated pavement marker, product documentation and installation, operation and maintenance manuals together with a detailed parts list of the type of illuminated pavement marker proposed for use on the project shall be submitted to the Engineer for approval not less than 10 working days prior to placement on the project.

Prior to installation, a selection of illuminated pavement markers as determined by the Engineer, but not more than 10 units from each batch of 100, shall be bench tested for operation. Each selected IPM shall be energized at full intensity for a continuous period of 24 hours without failure. Any defective units shall be considered to fail the entire batch. Replacement units shall be provided and testing performed again.

The entire system, including the IPMs, control units, and battery backup system, shall be tested as a whole for proper operation after the installation of the system has been completed. The functional test shall consist of not less than 5 days of continuous, satisfactory operation. If unsatisfactory performance of the system develops, the condition shall be corrected and the test shall be repeated until the 5 days of continuous, satisfactory operation is obtained.

Replacement and repair of failed system components, including IPMs, control units, and necessary testing or retesting, shall be at the Contractor's expense.

CERTIFICATE OF COMPLIANCE

The Contractor shall provide the Engineer a Certificate of Compliance from the manufacturer, in conformance with the provisions of Section 6-1.07, "Certificates of Compliance," of the Standard Specifications. The certificate shall certify that the illuminated pavement markers comply with the requirements of these specifications. The certificate shall also include a copy of all applicable test reports on the illuminated pavement markers.

WARRANTY

The manufacturer shall provide a written warranty against defects in materials and workmanship for illuminated pavement markers for a period of 24 months after installation of illuminated pavement markers. Replacement illuminated pavement markers shall be provided within 5 days after receipt of failed illuminated pavement markers at no cost to the State, except the cost of shipping the failed illuminated pavement markers. All warranty documentation shall be given to the Engineer prior to installation. Replacement illuminated pavement markers shall be delivered to Caltrans Maintenance Electrical Shop at 7181 Opportunity Road, San Diego, CA 92111.

MEASUREMENT AND PAYMENT

Full compensation for illuminated pavement marker system shall be considered as included in the contract lump sum price paid for high occupancy vehicle system and no separate payment will be made therefor.

10-3.37 AUTOMATIC TRAFFIC CHANNELIZER SYSTEM

This work shall consist of furnishing and installing automatic traffic channelizer (ATC) units, automatic traffic channelizer controller assemblies, remote operation console units, conduit, conductors, cables and pull boxes in accordance with the details shown on the plans, the Standard Specifications and these special provisions.

MATERIALS

Automatic Traffic Channelizer Unit

Automatic traffic channelizer unit shall be an electro-mechanically operated unit. Each unit shall consist of, but not be limited to, a post and a housing. The housing shall contain the retracted post. The motor, wiring and any other components necessary for operation of the unit may be contained in the housing or be appurtenant to the housing making it one assembly.

The automatic traffic channelizer unit shall be an environmentally sealed unit designed for operation in an external environment. Automatic traffic channelizer units shall be designed for easy maintenance. Posts and post housing (including

appurtenances) shall be replaceable without requiring any additional excavation. Any additional unit (not the foundation) to contain the housing in a field installation shall be considered as part of the ATC unit.

The overall weight of the post and post housing assembly shall not exceed 12 kg.

Provisions for underground drainage away from the post housing shall be incorporated into the installation of the automatic traffic channelizer unit.

Post

The post shall be composed of polyvinyl chloride, polyethylene compound or polyurethane compound.

The post shall be not less than 75 mm nor more than 100 mm in width or diameter. To facilitate ease of raising and retraction of the post, the upper portion of the post may be reduced by the thickness necessary to receive retroreflective bands for the dimension defined from the upper limit to the lower limit of the bands as described below, without decreasing the post wall thickness. The minimum post height range when fully raised shall be 900 mm \pm 25 mm to 1200 mm \pm 25 mm above the surrounding grade. All units shall be of the same nominal height. In the retracted position the post top shall be flush with the surrounding pavement.

The post shall be a full-view direction channelizer. A minimum of 2 retroreflective bands, each not less than 75 mm wide, shall be mounted a minimum of 38 mm apart and at a height on the post so that one retroreflective band will be between 0.8-m and 0.9-m above the roadway surface.

Retroreflective bands shall be white and shall be fabricated from flexible reflective sheeting as specified elsewhere in these special provisions. The retroreflective bands shall be visible at a distance of 300 m at night under illumination of legal high beam headlights, by persons with vision of or corrected to 20/20.

Posts shall be of a fluorescent orange, red-orange or predominantly orange color.

Posts shall be resistant to ultraviolet and infrared radiation.

Posts shall not show noticeable fading when exposed to 900 hours weatherometer exposure per either ASTM G154, ISO 4892-3, ISO DIS 11507, or equivalent test. Significant yellowing, darkening, fading, or changes in average tensile strength or elongation greater than 35 percent shall constitute a failure.

Posts shall be flexible or collapsible upon impact by a vehicle. The posts shall be capable of returning themselves to an upright position after repeated vehicle impacts. The aboveground portion of the automatic traffic channelizers shall be tested and certified to meet the crashworthy requirements of NCHRP-350 or equivalent.

Motor

The raising and retraction of the post shall be by a motor-driven method. The post may be raised by ratchet, gear or direct drive methods.

Motor shall be the reversible type and rated 24 V(dc), continuous and intermittent duty cycle, maximum current 5 A. Overload protection shall be provided.

Automatic traffic channelizer controller assemblies

Automatic traffic channelizer controller assemblies shall house necessary power supply (120/240 V to 24 V(dc), field control panel (providing individual unit control and status indicators), terminal blocks, and any additional necessary equipment to provide for not less than eight automatic traffic channelizer units.

Automatic traffic channelizer controller assemblies shall be operational and functional for ATC units across up to 150 meters of control and power cable.

Remote operation console units

Remote operation console units shall monitor ATC controller assemblies and provide redundant ATC control and status indicators. Remote operation console units shall be operational and functional for ATC controller assemblies across up to 1000 meters of control cable. Remote operation console units shall also be configured with alerts/alarms (LED/tone) set to trigger when a unit is not responding or has failed. Alerts/alarms shall have a reset or silent override switch. Status indicators shall include fully retracted and fully raised indicators.

Conduit, conductors, cables and pull boxes

Conduit, conductors, cables and pull boxes shall conform to the requirements elsewhere in these special provisions.

INSTALLATION

Automatic traffic channelizers shall be placed on the alignment and location shown on the plans, or directed by the Engineer. The centerline of each unit shall be normal to the pavement surface at that location. The size of the hole for the ATC unit, type of backfill material and concrete foundation around the post housing shall conform to the details as recommended by the manufacturer.

TESTING

Only one type of automatic traffic channelizer shall be used on the project. A sample post, product documentation and installation and maintenance manuals of the type of automatic traffic channelizer proposed for use on the project shall be submitted to the Engineer for approval not less than 10 working days prior to placement on the project.

Prior to installation, each ATC unit shall be bench tested for extension and retraction operation. Each ATC unit shall extend and retract smoothly and completely without binding. The bench test shall be a cycling rate of (raised full height and retracted completely) twice in one minute for 10 consecutive minutes. All defective units shall be replaced or repaired and the replacement units retested before installation.

The entire system, including the ATC units and control units, shall be tested as a whole for proper operation after the installation of the system has been completed.

Each installed ATC unit shall be verified for operation in the presence of the Engineer and the ATC post raise or retraction time shall not be less than 5 seconds. The test setting shall be the cycling rate of (raised full height and retracted completely) twice in one minute for 10 consecutive minutes. Acceptance test shall consist of successfully completing this test once a day for 5 consecutive days. During the 5 consecutive days, any failed operation (cycling test or other use) of the ATC unit shall constitute failure of the Acceptance Test.

Automatic traffic channelizer controller assemblies and remote operation console units shall be tested for sensing the mock conditions indicating a operational and non-operational or failed ATC unit.

Replacement and repair of failed system components, including ATC units, automatic traffic channelizer controller assemblies and remote operation console units, and necessary testing or retesting, shall be at the Contractor's expense.

CERTIFICATE OF COMPLIANCE

The Contractor shall provide the Engineer a Certificate of Compliance from the manufacturer, in conformance with the provisions of Section 6-1.07, "Certificates of Compliance," of the Standard Specifications. The certificate shall certify that the automatic traffic channelizers comply with the requirements of these specifications. The certificate shall also include a copy of all applicable test reports on the automatic traffic channelizers.

WARRANTY

The manufacturer shall provide a written warranty against defects in materials and workmanship for automatic traffic channelizers for a period of 24 months after installation of automatic traffic channelizers. Replacement automatic traffic channelizers shall be provided within 5 days after receipt of failed automatic traffic channelizers at no cost to the State, except the cost of shipping the failed units. All warranty documentation shall be given to the Engineer prior to installation. Replacement automatic traffic channelizers shall be delivered to Caltrans Maintenance Electrical Shop at 7181 Opportunity Road, San Diego, CA 92111.

MEASUREMENT AND PAYMENT

Full compensation for automatic traffic channelizer system shall be considered as included in the contract lump sum price paid for high occupancy vehicle system and no separate payment will be made therefor.

10-3.38 CLOSED CIRCUIT TELEVISION CAMERA ASSEMBLY

Closed circuit television (CCTV) camera assembly shall conform to the provisions in Section 86, "Signals, Lighting and Electrical Systems," of the Standard Specifications and these special provisions.

GENERAL

Prototype equipment will not be allowed. All equipment shall be current standard production units.

The CCTV camera assembly shall consist of the following components:

- A. Camera
- B. Motorized zoom lens
- C. Environmental enclosure with sun shield or shroud
- D. Pan/tilt drive unit
- E. Iris control circuit devices
- F. AC step-down transformer

The CCTV camera assembly shall have all necessary wiring, cables, and connectors. All CCTV camera assemblies shall be plug compatible, interchangeable and suitable for use with the CCTV camera cable assembly described in these special provisions.

CAMERA

All cameras supplied shall meet the following specifications.

Performance

PARAMETER	SPECIFICATION
Optical Device	CCD, Color, interline transfer
Optical Ccd Format Size	6.3 mm format
Horizontal Resolution	460 television lines (minimum)
Sensitivity	1 lux @ 1/60 s shutter speed (measured with fl.6 lens)
Scanning System	525 lines 2:1 interlace

Closed circuit television camera assembly components shall be rated for NEMA 4X, IP 66 or IP 67.

The camera shall be equipped with an electronic shutter with adjustable speeds ranging from 1/60 second to 1/30,000 second.

Electrical

PARAMETER	SPECIFICATION
Operating Voltage	120 V(ac) \pm 10% (external adapter allowed)
Power Consumption	50 W (Maximum)
Video Output Signal	Standard NTSC color TV
Video Output Connector	Standard BNC bulkhead on rear of camera
Signal To Noise Ratio	>48 dB
Synchronization	Internal sync or phase adjustable line lock
Video Output Level	1.0 V p-p (75 Ω composite)
Gain Control	Automatic
Automatic Back Focus (Automatic White Balance)	Required

Programming shall be stored non-volatile memory and the CCTV assembly shall be firmware updateable via serial communication.

Environmental

PARAMETER	SPECIFICATION
Operating Temperature	-10°C to 50°C
Storage Temperature	-40°C to 60°C
Operating Humidity	20 to 80% non-condensing
Storage Humidity	20 to 90% non-condensing

CLOSED CIRCUIT TELEVISION CAMERA LENS

The CCTV camera lens shall meet the following specifications.

PARAMETER	SPECIFICATION
Format	6.3 mm format
Iris	Motorized , with automatic and manual adjust modes
Operating temperature	-10°C to +50°C
Focal Length	Maximum not less than 80 mm (Optical power not less than 21X)
Lens Aperture	F1.6 - F3.6
Horizontal angle of view at Maximum Focal Length	Not less than 2.2° for 6.3 mm format camera

The lens shall have motors for zoom, focus and iris.

The lens shall have capability for focus and zoom preset positions. A telescopic converter or extender shall not be used to achieve required focal length range.

Electrical

When the power is removed from the lens, the lens iris shall automatically close.

The motorized-iris cable shall be strain relieved or sufficiently rugged such that the cable will not fail at the point where it leaves the lens assembly.

Optical

When the camera is pointed at a very bright object and or when the camera and lens is first turned on, the image produced by the lens and camera combination shall not optically "oscillate" (i.e., produce an image that alternates from too light to too dark) or otherwise be unstable.

Each lens shall have an automatic, motor-driven iris with manual override.

The lens shall include mechanical or electrical means to protect the motors from over running in the extreme position.

The iris shall be controlled directly through the camera in automatic mode and from any keyboard connected into the camera system in the manual mode. The automatic iris shall provide continuous aperture adjustments of the lens as determined by the amount of light reaching the camera imager. The power supply and electronics for iris motor shall be contained within the environmental housing.

Environmental

PARAMETER	SPECIFICATION
Operating Temperature	-25.6°C to 50°C (minimum range).
Storage Temperature	-40°C to -10°C
Operating Humidity	20 to 80% non-condensing
Storage Humidity	20 to 90% non-condensing

Installation

The Contractor shall make all the necessary adjustments on different components of the CCTV camera assembly. This includes the back-focus and tracking adjustments on the lens and color balancing of the camera.

The Contractor shall ensure the back-focus adjustment on the camera is such that the lens focus is properly set and maintained when adjusting the focal length from zoom to wide angle. The Contractor shall make this adjustment with the lens iris at full open position. This adjustment shall be made such that when the zoom is adjusted from long range (telephoto) to wide angle, no refocusing is necessary.

ENVIRONMENTAL ENCLOSURE

The environmental enclosure shall be the sealed, pressurized type, designed to withstand exposure to sand, dust, fungus, and salt atmosphere, and house the assembled camera, motorized zoom lens and all internal wiring. It shall operate on a voltage range of 120 V(ac) ±10 percent power source. The enclosure shall include an internal thermostatically controlled heater assembly to minimize external faceplate condensation. The Contractor has the option of providing a sealed, pressurized Integrated Optics Cartridge (IOC) housed in a NEMA 4X rated enclosure.

The enclosure shall include a sun shield or shroud to provide protection from direct solar radiation.

The enclosure or IOC shall be pressurized with 34 kPa dry nitrogen . The enclosure shall have a valve for pressurizing. In addition, a pressure relief valve with a 137 kPa rating shall be provided to protect the enclosure from overcharging.

The notation "CAUTION - PRESSURIZED" shall be printed on the enclosure. The letter height shall be at least 6.3 mm.

Performance

The housing unit shall have lens preset capabilities.

The housing shall not interfere with the widest viewing angle of the motorized zoom lens.

Physical

PARAMETER	SPECIFICATION
Construction	All aluminum
Finish	White, light beige or gray baked enamel or polyester powder coat
Weight	Less than 21 kg excluding heater
Camera Mounting	Platform mount with adjustment fore and aft

The camera lens shall be positioned in the center of the housing window.

Any enclosure supplied shall include a sun shield or shroud to protect the housing from the direct rays of the sun. The sun shroud shall be made specifically for the model of enclosure that is selected.

Shock And Vibration

The camera enclosure shall not incur any physical damage after a shock, return to normal operation immediately and operate within the specified vibration (see Note 1 below table).

PARAMETER	SPECIFICATION
Shock	Up to 5 G while in non-operation mode
Vibration	5-60 Hz with 2.1 mm total excursion, and 5 G rms vibration from 60 to 1000 Hz

Note 1: Where the manufacturer's cut sheet or specification data does not contain shock and vibration data a listing of at least 2 project sites with identical equipment, with similar installation conditions and similar traffic patterns showing continuous functional performance of at least 2 years may be substituted.

Installation

The Contractor shall apply an approved weather-resistant spray to the inside of the connectors before engaging the connectors.

PAN AND TILT UNIT

The pan and tilt unit will consist of the pan and tilt unit itself along with any electrical or communication interfaces required to perform the functions specified. The pan and tilt unit shall be designed to operate under a full range of environmental conditions.

Performance

PARAMETER	SPECIFICATION
Braking: Pan And Tilt	Mechanical or Electrical to limit coast
Overload Protection	Motors: Impedance protected
Angular Travel	Pan: 0 to 355° Horizontal, Continuous Tilt: +30° Up to -80° Down
Pan Speed	0.1°/s to 40°/s variable-speed
Tilt Speed	0.1°/s to 20°/s variable-speed
Pan And Tilt Position Preset	Positions camera to a predetermined azimuth, elevation and lens position (Minimum of 64 Presets)

Physical Specifications

PARAMETER	SPECIFICATION
Pan & Tilt Worms	Ground and polished Stainless Steel
Pan & Tilt Worm Gears	Non-metallic material
Mounting (Base)	178 mm ± 3.2 mm diameter bolt circle Check Plans
Camera Mount	Compatible with camera housing
Bearings on Rotating Surfaces	Heavy duty roller type
Overload Protection	Provided - internal
OPERATING TEMPERATURE	-23.3°C to 60°C
CONSTRUCTION	Corrosion resistant steel or aluminum
FINISH	Weather resistant paint or polyurethane
SEALS	“O” ring or gaskets for all weather protection of pan and tilt unit and cables.

The pan and tilt unit with camera assembly mounted shall withstand a wind load of 129 km/h.

The cable connector shall be fully weather protected.

Access into pan/tilt for routine maintenance or adjustments shall not require removal of the pan and tilt from the installation site, nor removal of the camera enclosure from the pan/tilt unit. Access cover shall be readily removable regardless of the tilt position.

External body components shall be manufactured from aluminum that have been anodized, painted or coated to prevent oxidation and corrosion.

Pan And Tilt Stops

The pan and tilt unit shall have pan and tilt stops. The settings of these pan and tilt stops shall be determined by the Engineer.

Installation

The Engineer will notify the Contractor of the pan and tilt presets and stops for the pan and tilt unit for the Contractor to set prior to camera assembly installation check. Installation check shall be done by the Contractor in the presence of the Engineer. The test of the operation (zoom, iris, etc.) of the pan and tilt unit may be performed at the CCTV Cabinet adjacent to the camera or by remote keyboard location at the Contractor's option. The Contractor shall furnish a color video monitor, for testing only, to view the actual camera image. Upon completion of the installation, the Engineer will verify operation of the pan and tilt unit. Any additional adjustments necessary to restore the presets and stops to acceptable parameters shall be at the Contractor's expense.

The Contractor shall provide five copies of the operation and maintenance manuals for the pan and tilt unit.

OVERALL REQUIREMENTS

The complete unit, including the pan/tilt unit shall not exceed 199 mm wide x 442 mm high x 381 mm deep. Any external cables shall not interfere with or limit the continuous pan and tilt operation. The camera control protocol used by the camera assembly shall be either an open public domain protocol, Pelco D, or other protocol convertible to Pelco D via translator. All functions described shall be available using the described protocol. If a protocol other than Pelco D is proposed, the Contractor shall provide a version of Baxall's camera control software "PC Control" or latest equivalent version that includes the new protocol as a choice for the new camera locations. The version of camera control software shall not interfere with the operation of any other camera locations that use Pelco D. All camera control functions shall be through the RS-422 communications interface.

OPERATOR FUNCTIONS	
Pan Right	Pan Left
Tilt Up	Tilt Down
Zoom In	Zoom Out
Focus Near	Focus Far
Iris Open	Iris Close
Iris Manual	Iris Auto
Pan Stop	Tilt Stop
Zoom Stop	Focus Stop
Iris Stop	
ADMINISTRATIVE FUNCTIONS	
Status Query	Set Char. Display
Activate Char. Display	Blank Char. Display
Set Preset Position	Go to Preset Position
Set Relay	Reset Relay
Turn on Camera	Turn off Camera
Wiper on	Wiper off
Heater Control	

Camera Control and Configuration

The existing system keyboard is a BAXALL Keyboard Part Number ZKX3-J. A copy of the keyboard manual is available for review upon request.

Pan and Tilt Position Presets shall be programmable via the system keyboard.

The following operator basic functions shall be controlled via the system keyboard:

Pan Left, Pan Right and Pan Stop controlled by Joystick.

Tilt Up, Tilt Down and Tilt Stop controlled by Joystick.

Zoom In, Zoom Out and Zoom Stop controlled by Zoom In and Zoom Out button.

Focus Near, Focus Far and Focus Stop controlled by Near Focus and Far Focus button.

Iris Open, Iris Close and Iris Stop controlled by Open Iris and Close Iris button.

Camera selections made by numeric keypad on system keyboard.

Monitor selections made by numeric keypad on system keyboard.

The Stop actions for all Pan, Tilt, Zoom, Focus and Iris features will be issued once the Joystick, Zoom, Focus and Iris buttons are released.

The camera administrative functions shall be accessible via system keyboard or by software installed on a personal computer. If the software method is used, the camera manufacturers menu system may be used.

SYSTEM TESTING AND DOCUMENTATION

The Contractor shall be responsible for all testing and documentation required for approval and acceptance of the production, installation, and operation of these materials and equipment. The following identifies the specific quality control requirements for testing and documentation.

The Contractor shall test all cables after installation with connectors attached for continuity and shorts or grounds.

The Contractor shall adjust and set limit stops to the pan/tilt unit at each camera site to prevent the view of the areas outside of the roadway system. The final settings shall be approved by the Engineer.

The Contractor shall perform a local functional test at each of the CCTV locations. At the Contractor's option the test may be performed directly at the CCTV cabinet or remotely via keyboard or keyboard and personal computer. The Contractor shall demonstrate to the Engineer all the CCTV features. The Contractor shall provide all the test equipment.

The Contractor shall arrange to have a technician, qualified to work on the closed circuit television assembly and employed by the closed circuit television assembly manufacturer or the manufacturer's representative, present at the time the equipment is turned on.

The Contractor shall provide four sets of documentation containing complete specifications and operation details of each of the components of the CCTV camera assembly. The documentation shall also include wiring diagrams showing wire colors, functions, and pin assignments for connecting these components to each other and to the encoder.

PRE-ACCEPTANCE TESTING

Each closed circuit television system shall be subjected to tests as outlined herein. All testing will be performed by Department personnel, arranged by the Engineer, and in the presence of the Contractor. The Contractor shall notify the Engineer in writing fifteen days prior to the scheduled testing. The Contractor shall provide all necessary equipment required to access the CCTV equipment for testing.

CERTIFICATE OF COMPLIANCE

The Contractor shall provide the Engineer a Certificate of Compliance from the manufacturer, in conformance with the provisions of Section 6-1.07, "Certificates of Compliance," of the Standard Specifications. The certificate shall certify that the closed circuit television camera assembly complies with the requirements of these specifications. The certificate shall also include a copy of all applicable test reports on the closed circuit television camera assembly.

10-3.39 VARIABLE MESSAGE SIGN

Variable message sign (VMS) shall be furnished and installed as shown on the plans, and as specified in these special provisions.

Variable message sign shall be a retroreflective rotary drum sign type as manufactured by Skyline Products, Inc., or equal, and shall include all the items detailed for variable message sign as shown on the plans, and as specified in these special provisions.

Arrangements have been made to insure that any successful bidder can obtain the specified equipment listed below from Skyline Products, Inc., Telephone (800) 759-9046. The price quoted for the equipment is as follows:

The quoted prices and equipment are as follows:

Equipment Description	Quantity	Quoted Price/EA	Extended Price
Rotary Drum Signs (One Drum Configuration)	2	\$32,500	\$65,000
Rotary Drum Signs (Two Drum Configuration)	4	\$48,500	\$194,000
Rotary Drum Signs (Three Drum Configuration)	2	\$66,500	\$133,000
Light Emitting Diode Arrow Board	1	\$75,000	\$75,000
Ground Cabinet	4	\$14,850	\$59,400
Fiber Modems (Single Mode)	4	\$1,200	\$4,800
Central Software-Client Server	1	\$20,000	\$20,000
PC Workstation for Central Software	1	\$3,000	\$3,000
On-Site Commissioning Support	1	\$7,500	\$7,500
Shipping	1	10,500	10,500
On-Site Training	1	\$5,000	\$5,000
		TOTAL	\$577,200

Contact the vendor for information regarding tax, shipping, handling or delivery details, purchase and payment terms, and location. The quoted equipment prices are guaranteed by Skyline Products, Inc. for 365 days from October 26, 2005.

10-3.40 MEDIA CONVERTER

Media converter shall conform to the details shown on the plans and shall be in conformance with these special provisions.

Media converter optical link range shall be suitable for the operational distances shown on the plan sheets.

Media converter may be the standalone type or may be the modular design type - card/slot, chassis mounted configuration. The chassis shall provide for the quantity of ports as shown on the plans.

Media converter shall be the single mode fiber interface type.

Media converter shall be a 10/100Base-TX to 100Base-FX single-mode converter with SC-Type connector and have the following features:

MEDIA CONVERTER	
FEATURE	PARAMETER/REMARKS
Ports	RJ-45 (10/100Base-TX)
	100°Mbps duplex fiber port with SC-Type connector (single-mode)
10/100 Base-TX port	Automatically senses 10°Mbps or 100°Mbps connection speed, Auto-negotiates half- or full-duplex mode, Auto-selects MDI/MDI-X media type
Fiber port	Half /full-duplex mode selector
Network media	100Base-TX and 100Base-FX: Single-Mode fiber optic cable 8/125°µm or 9/125°µm, full-duplex to 20°km
Serial Console Port	RS232
Protocol	SNMP manageable through SNMP-enabled networking management system via console or add-on module
Data Transfer Rate	100°Mbps (Half-Duplex), 200°Mbps (Full-Duplex)
Status LED indicators	power, copper link/activity, fiber optic link/activity, half/full duplex mode
Mounting	Standalone or Slot/Chassis Configuration as required
Power Supply	Supply voltage range 100 V to 135 V at 60°Hz. Standalone units: Internal power supply (maximum power consumption 6°W) or external power supply (maximum power consumption 14°W) Chassis units: only one power supply permitted
Power Adapter	Temperature: Operating: 0 to 35°C
	Humidity: Operating: up to 85% (non-condensing)
Standards Compliance	IEEE 802.3; FCC: Class A or Class B, 10/100Base-TX, 100Base-FX
Warranty	not less than 5 years for media and chassis (excludes power supplies, fans and lasers)

10-3.41 SERIAL TO ETHERNET CONVERSION UNIT

Serial to ethernet conversion unit (SECU) shall conform to the details shown on the plans and shall be in conformance with these special provisions.

Serial to ethernet conversion unit (SECU) shall have the following features:

SERIAL TO ETHERNET CONVERSION UNIT (SECU)	
FEATURE	PARAMETER/REMARKS
Support Protocols	ARP, UDP, TCP, Telnet, ICMP
Serial Device Support	Asynchronous, 7 or 8 bit with or without parity
Network Interface	Ethernet, 10BaseT
Network Connector	RJ45
Serial Interface	RS232, RS422, RS485, DCE Configuration
Serial Interface Connector	DB25 Female
Data Rates	300 bps to 115 Kbps, Must transmit and receive 3600 bytes of serial data without interruption
Control Lines	RTS, CTS, DSR, DCD, DTR
DCD Control Line	Must frame data on receive line
Software Flow Control	XON, XOFF
Hardware Flow Control	CTS/RTS
Management	SNMP, Local console port log in or Telnet log in, Menu driven user selection
Indicators	Good Link, Network transmit/receive data, RS232, Transmit/Receive Data
Indicator Type	LED
Operating Mode	Client or Server Unit
Client Mode	Communications up to 7 Server units on IP list
Client Mode Addressing	IP Addressable
Server Mode	Communicates with Client Unit
Dimensions (nominal) (HxWxD)	Maximum 23 mm x 64 mm x 90 mm
Operating Temperature	5 to 50°C
Power	110 V(ac), 10 W

10-3.42 CUSTOMER PREMISES EQUIPMENT

Customer premises equipment (CPE) for very high speed digital subscriber line (VDSL) shall conform to the details shown on the plans and shall be in conformance with these special provisions.

Customer premises equipment (CPE) shall operate as a pair with VDSL switch unit to extend 10/100BaseT ethernet network signaling over a single twisted pair of conductors as shown on the plans and have the following features:

CPE PERFORMANCE	
FEATURE	PARAMETER/REMARKS
Line Coding Standard	VDSL
Minimum VDSL Line Rate	1.5 Mbps at 800 meters
VDSL Line Rate	Configurable
VDSL Connector	Terminal Block or RJ21 (or RJ11) Connector with 1.5 meter Copper Pigtail per plans
Network Connector	RJ45 for 10/100BaseT Ethernet
Network Interface	Autosensing 10/100BaseT, Full Duplex/Half Duplex
	IEEE 802.3 10BaseT Compliant
	IEEE 802.3u 100BaseT Compliant
Protocol Support	TCP/IP, UDP/IP, TELNET, SNMP, VLAN
Unit Designation	CPE
Unit Operability	Must work with VDSL Switch Unit
Serial Console Port	RS232
Identification	IP Addressable
Indicators	Power, "Good Link", Transmit/Receive Data
Indicator Type	LED
Software Updates	Via Serial Port or Network Port
Configuration	Via Serial Port or Network Port
Dimensions (nominal) (HxWxD)	(available cabinet space as shown on plans)
Operating Temperature	0 to 45°C
Operating Voltage	110 V(ac)

10-3.43 VERY HIGH SPEED DIGITAL SUBSCRIBER LINE SWITCH

Very high speed digital subscriber line (VDSL) switch unit shall conform to the details shown on the plans and shall be in conformance with these special provisions.

Very high speed digital subscriber line switch unit shall operate as a pair with customer premises equipment (CPE) to extend 10/100BaseT ethernet network signaling over a single twisted pair of conductors as shown on the plans and have the following features:

VDSL SWITCH PERFORMANCE	
FEATURE	PARAMETER/REMARKS
Unit Designation	VDSL Switch
Unit Operability	Must work with VDSL CPE Unit
Line Coding Standard	VDSL
Minimum VDSL Line Rate	1.5 Mbps at 800 meters
VDSL Ports	8
VDSL Connector	Terminal Block or RJ21 Connector with 1.5 meter Copper Pigtail per plans
Network Ports	10/100/1000Base-TX
Network Connector	RJ45 for 10/100 BaseT Ethernet
Network Interface	Autosensing 10/100BaseT, Full Duplex/Half Duplex
	IEEE 802.3 10BaseT Compliant
	IEEE 802.3u 100BaseT Compliant
MAC Address	Configurable to at least 1000 MAC addresses
Protocol Support	TCP/IP, UDP/IP, TELNET, SNMP, VLAN, Spanning Tree
Standards Support	IEEE 802.1d Spanning Tree Algorithm, IEEE 802.1p Priority Queuing, IEEE 802.1q VLAN Tagging, IEEE 802.3x Port Trunking, IEEE 802.3x Flow Control, IEEE 802.3 Ethernet, IEEE 802.3u Fast Ethernet, RFC 854 Telnet
Serial Console Port	RS232
Identification	IP Addressable
Indicators	Power, "Good Link", Transmit/Receive Data
Indicator Type	LED
Software Updates	Via Serial Port or Network Port
Configuration	Via Serial Port or Network Port
Dimensions (nominal) (HxWxD)	(available cabinet space as shown on plans)
Operating Temperature	0 to 50°C
Operating Voltage	110 V(ac)
Relative Humidity	10 to 90% (noncondensing) - operating

10-3.44 CERTIFICATE OF COMPLIANCE

For the equipment listed below, the Contractor shall provide the Engineer a Certificate of Compliance from the manufacturer, in conformance with the provisions of Section 6-1.07, "Certificates of Compliance," of the Standard Specifications. The certificate shall certify that the equipment complies with the requirements of the equipment specifications elsewhere in these special provisions. The certificate shall also include a copy of all applicable test reports.

1. Serial to ethernet conversion unit.
2. Very high speed digital subscriber line switch.
3. Customer premises equipment.

10-3.45 TESTING

For the equipment listed below, the Contractor shall provide the Engineer copy of the manufacturer's product specification sheets and the manufacturer's product diagnostic test (date of test, standards or procedures used, and test results). The values, standards, and procedures in the product specification sheets, diagnostic test and the special provisions will be used as the basis for acceptance testing.

1. Serial to ethernet conversion unit
2. Very high speed digital subscriber line switch
3. Customer premises equipment

For acceptance testing, throughput values at each component (equipment and connecting cables) shall meet the manufacturer's expected performance values. Any component failing to properly process incoming values or to produce proper output values will be rejected.

The condition shall be corrected and the test shall be repeated until satisfactory values are obtained. Replacement and repair of failed equipment and necessary testing or retesting, shall be at the Contractor's expense.

10-3.46 VIDEO ENCODER

Video encoder shall conform to the details shown on the plans and shall be in conformance with these special provisions.

Video encoder shall be Baxall, IP-ENC-1-R, Destiny IP Encoder Product (Single Channel Codec), or equal.

Arrangements have been made to insure that any successful bidder can obtain the specified equipment listed below directly from: Baxall USA, Inc., Sales and Commercial Support, 7454 Far Hill Drive, Colorado Springs, Colorado 80922, telephone (877) 422-9255, facsimile (719) 282-6781.

The quoted prices and equipment are as follows:

Equipment Description	Quantity	Quoted Price/EA	Extended Price
IP-ENC1-R	1	\$998	\$998
		TOTAL	\$998

Contact Baxall USA, Inc. for information on tax, shipping, handling or delivery location. Prices for IP-ENC-1-R are guaranteed by Baxall USA, Inc. for one year from the date of the quote, August 10, 2005.

10-3.47 GUIDE WIRE SYSTEM

Guide wire system shall conform to the details shown on the plans and these special provisions.

Guide wire shall conform to the provisions in "Conductors and Wiring" of these special provisions.

Guide wire installed in portland cement concrete shall be filled with elastomeric sealant or hot-melt rubberized asphalt sealant, or shall be filled with an epoxy sealant conforming to the provisions in Section 95-2.09, "Epoxy Sealant for Inductive Loops (State Specification 8040-06)," of the Standard Specifications.

10-3.48 STATE-FURNISHED MOVABLE BARRIER

The movable barrier will be State-furnished as provided under "Materials" of these special provisions. The movable barrier is a sectional concrete barrier with a cross-sectional profile similar to Type 60 Series concrete barrier. Individual barrier elements are approximately 680 kg and approximately 1 m in length.

The Contractor shall install the movable barrier, and verify the field placement and alignment relative to the guide wire, as shown on the plans. Attention is directed to "Guide Wire System" elsewhere in these special provisions.

The Contractor's responsibility for movable barrier shall be limited to conforming to the provisions in Section 6-1.02, "State-Furnished Materials," of the Standard Specifications.

The contract unit price paid per meter for install movable barrier shall include full compensation for furnishing all labor, materials (except State-furnished movable barrier), tools, equipment, and incidentals, and for doing all the work involved in installing movable barrier, complete in place, including verifying the field placement and alignment relative to the guide wire, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

10-3.49 DETECTORS

Loop detector sensor units will be State-furnished in conformance with the provisions in "Materials" of these special provisions.

Loop detector lead-in cable shall be Type B.

Like-numbered detector loops, when shown on the plans, shall be connected to the same detector lead-in cable.

For Type E detector loops, sides of the slot shall be vertical and the minimum radius of the slot entering and leaving the circular part of the loop shall be 40 mm. Slot width shall be a maximum of 20 mm. Loop wire for circular loops shall be Type 2. Slots of circular loops shall be filled with elastomeric sealant or hot melt rubberized asphalt sealant.

The depth of loop sealant above the top of the uppermost loop wire in the sawed slots shall be 50 mm, minimum.

The ends of loop detector lead-in cables terminating at a controller cabinet with double row barrier terminal blocks shall have crimped and soldered ring terminals, otherwise the ends shall have approximately 19 mm of insulation removed and the exposed wire soldered.

10-3.50 VIDEO IMAGE VEHICLE DETECTION SYSTEM

This work furnishes a Video Image Vehicle Detection System (VIVDS) for operating traffic signals on all approaches shown on the plans and includes an initial site analysis, set-up and system configuration, calibration of the system, performance accuracy verification and training.

MATERIALS LIST AND DRAWINGS

The Contractor shall submit a proposed list of materials before commencing work and drawings and other data before the completion of the contract:

- A. **Certificate of Compliance** - Provide a Certificate of Compliance and report on the final installed configuration reviewed and approved by the manufacturer.
- B. **Site Analysis Report** - Evaluate and provide a written analysis for each detection site recommending the optimum video sensor placement approved by the manufacturer.
- C. **Lane Configuration** - Provide a diagram of each sensor assembly placement, mounting height, selected lens viewing angle and illustration of how the detection zone will map into reporting contact outputs as well as how output connector pins or wire terminals correspond to the lane assignments.
- D. **Configuration Record** - Provide a Windows PC compatible Compact Disk (CD) that contains the final zone designs as well as calibration settings formatted to allow the same configuration to be re-installed and used in the event of disputed performance.
- E. **Mounting and Wiring Information** - Provide one set of the approved diagrams detailing wiring and service connections, covered on each side with clear self-adhesive plastic and placed in a heavy-duty plastic envelope. Secure the envelope to the inside of the cabinet door or at a location designated by the Engineer.
- F. **Communication Protocol** - Provide a document that completely defines the unit's communication protocol (message structure organization, data packet length as well as information necessary to make use of such messages) as well as all information needed for operating the system from a remote Windows based Personal Computer (PC).
- G. **Programming Software** - Provide a PC compatible Compact Disk (CD) that contains set-up and calibration software which observes the vehicular traffic, allows placement of detection zones and adjustment of the detection sensitivity.
- H. **Sensor Accuracy Analysis** - Submit to the Engineer a VIVDS accuracy analysis, including original video recordings as well as DVD or CD copies of the video images covering the analysis periods within fifteen days of accuracy testing.
- I. **Acceptance Testing Schedule** - Submit an acceptance testing schedule to the Engineer for approval fifteen days prior to acceptance testing of the VIVDS. Acceptance testing shall be separate from the sensor accuracy testing noted in the previous paragraph.
- J. **Acceptance Testing Documentation** - Provide documentation necessary to utilize the support equipment that is organized so that the Engineer will be able to perform acceptance testing using the documentation without assistance from the Contractor.
- K. **Training** - Provide a copy of the training material to the Engineer for approval 30 days prior to the training.

FUNCTIONAL REQUIREMENTS

The VIVDS shall consist of enclosed and environmentally protected Video Image Sensor assemblies (VIS) and mounting hardware assemblies installed on poles or mast-arms as shown on the plans. The assemblies shall include necessary Video Detection Units (VDU), image processors, extension modules as well as power supplies, surge suppression, cables, connectors and wiring to a State-Furnished Type 332 traffic control cabinet.

The VIS image sensor and lens shall be housed in an environmentally sealed enclosure, watertight and dust tight to NEMA 4 standards. The enclosure shall include a thermostat controlled heater to prevent condensation and assure proper lens operation at low temperatures and an adjustable sun shield with provision to divert water from the sensor field of view. The assembly shall have waterproof connections for power, control and video signal cables and wiring.

The VIVDS shall include necessary hardware and software for designing the necessary detection pattern or zones at the intersection or approach. The detection zones shall be created with a graphic user interface designed to allow a trained VIVDS system operator to configure and calibrate a lane in less than 15 minutes. The system shall support normal operation of existing detection zones while a zone is being added or modified. The zone shall flash or change color on a viewing monitor whenever a vehicle is detected.

The VIVDS shall include software and firmware that detects vehicle presence and count, the means to set-up detection zones, test the VIVDS performance as well as view the video scenes and operate the system from a remote location.

The system shall allow the user to define detection zones or elements and to set detection outputs for presence or pulse operation. The number of optically isolated detection outputs shall be equal to the detection zones shown on the plans plus one spare output for every approach.

The VIVDS shall support a minimum of two separate detection pattern or zone arrangements that can be automatically enacted by timed schedule from the traffic controller or by a remote operator over a network connection. The system shall detect low-visibility conditions including fog and inclement weather and respond by selecting a predefined detection pattern and, when necessary, placing all defined detection zones into a constant call mode. VIVDS outputs shall assume a fail-safe "on" or "call" for presence detection in the event of loss of video signal or power failure and recover from a power failure by restoring normal operation within three minutes without manual intervention. The system shall maintain the configuration and calibration information in memory while powered off for at least 90 days.

The VIVDS shall detect the presence of vehicles at the limit line and loop positions shown on the plans and provide corresponding VIVDS contact outputs to the Model 170E or Model 2070 input files. The system shall detect vehicle presence at the limit line with 98% accuracy for each approach and over each one hour test period. The system shall not miss the detection of more than 3% of the vehicles present and not indicate more than 5% false vehicle readings for any traffic movement. Detected vehicle presence shall be indicated in 0.25 seconds or less of occurrence and the VIVDS shall hold presence for vehicles stopped in a detection zone for up to 10 minutes.

The VIVDS shall count vehicles with a better than 95 percent accuracy for each approach over each one hour test period and when compared to video recorded vehicle observations. The VIVDS shall be able to locally store for remote retrieval per lane vehicle count data in 10, 20,30, and 60 minute intervals for a minimum period of one week (168 hours).

The VDU front panel shall have indications for power, communication, presence of video input for each video sensor as well as the real time detector output operation. A test switch shall have positions that allow the user to place either a constant or momentary call for each approach. The indications shall be visible in daylight from 1.5°m away.

A pull down flat panel video display (with a minimum 8 inch screen and as recommended by the VIVDS manufacturer as suitable for the application intended) shall be furnished and installed in the 332 cabinet for viewing video detector images and for diagnostic testing. Each VIVDS system shall have video connections that support the NTSC video output format and means shall be included that allow the user to switch to any video signal at an intersection. The system is to allow independent viewing of any scene while video recording any other scene without interfering with the operation of the system outputs.

The VIVDS shall have a serial communication port that supports sensor unit setup, diagnostics and operation from a local Windows PC compatible laptop. The VIVDS shall have an ethernet port/connector and include necessary software to support remote real-time viewing and operation over a Wide Area Network (WAN) connection.

TECHNICAL REQUIREMENTS

System elements shall be designed to operate continuously in an outdoor traffic monitoring and control environment, 24 hours a day. Manufacturing quality and electronic components shall support a minimum mean time between failure (MTBF) of ten (10) years.

The video image sensor assembly (VIS) shall include the video sensor, a zoom lens and weathertight enclosure. The video sensor shall use a Charged Coupled Device (CCD) element and support NTSC and RS170 video output formats with resolution of not less than 360 horizontal lines. The video sensor shall include an Auto-Gain Control circuit (AGC), have a minimum sensitivity to scene luminance from 0.1 lux to 10,000 lux and produce a usable video image of vehicles, under all roadway lighting conditions and regardless of the time of day. The sensor shall have a motorized lens with variable focus and zoom control with an aperture of f/1.4 or better. The focal length shall allow +/- 50% adjustment of the detection scene.

The enclosed video image sensor assembly (VIS) shall operate from -34°C to +74°C and 0 percent to 95 percent relative humidity, weigh less than 3 kg and present less than 930 sq cm of effective wind surface to any direction.

Sensor unit mounting hardware shall be stainless steel or be treated to withstand 250 hours of salt fog exposure under ASTM Designation: B117 conditions without any visible corrosive damage.

The VDU including image processors, extension modules and video output assemblies shall insert into the controller input file slots using the edge connector to obtain limited 24VDC power and to provide contact closure outputs. Cabling to a "D" connector on the front of the VDU is acceptable. No rewiring to the standards 332 cabinet shall be allowed. The controller cabinet resident modules shall conform to the requirements detailed in Chapter 1 as well as Sections 5.2.8, 5.2.8.1, 5.2.8.2, 5.4.1, 5.4.5, 5.4.5, and 5.4.6, 5.5.1, 5.5.5, and 5.5.6 of the Transportation Electrical Equipment Specifications (TEES)

The VIVDS shall operate from 95 to 135 VAC service per NEMA TS-1. The VIS sensor assembly, excluding the heater circuit, shall draw less than 10 watts of power. The power supply or transformer for the VIVDS shall meet the following minimum requirements:

Item	Power Supply	Transformer
Power Cord	Standard 120VAC, 3 prong cord, at least 1 meter in length (may be added by Contractor)	Standard 120VAC, 3 prong cord, at least 1 meter in length (may be added by Contractor)
Type	Switching mode type	Class 2
Rated Power	Two time (2x) full system load	Two time (2x) full system load
Operating Temperature	-35°C to 74°C	-35°C to 74°C
Operating Humidity Range	From 5 to 95 percent	From 5 to 95 percent
Input Voltage	From 90°V(ac) to 135°V(ac)	From 90°V(ac) to 135°V(ac)
Input Frequency	60 Hz +/- 3 Hz	60 Hz +/- 3 Hz
Inrush Current	Cold start, 25 A max. at 115 V	N/A
Output Voltage	As required by the VIVDS	As required by the VIVDS
Overload Protection	From 105 percent to 150 percent in output pulsing mode	Power limited at >150%
Over Voltage Protection	From 115 percent to 135 percent of rated output voltage	N/A
Setup, Rise, Hold Up	800 ms, 50 ms, 15 ms at 115°V(ac)	N/A
Withstand Voltage	I/P-0/P:3 kV, I/P-FG:1.5 kV, for 60 seconds	I/P-0/P:3 kV, I/P-FG:1.5 kV, for 60 seconds
Working Temperature	Not to exceed 70°C@30% load	Not to exceed 70°C@30% load
Safety Standards	UL 1012, TUV EN60950	UL 1585
EMC Standards	EN55022 Class B, EN61000-4-2, 3, 4, 5	N/A

Transient protection that complies with IEEE Standard 587-1980 Category C shall be included for all field terminated circuits. Video connections shall be isolated from ground.

Equipment, parts and support equipment required by the Engineer for acceptance testing shall be new and conform with the manufacturer's recommendations. The date of manufacture, as shown by date codes or serial numbers of electronic circuit assemblies, shall not be older than six months from the scheduled start date of this installation. No substitutions of materials shall be allowed that deviate from the list of materials approved by the Engineer.

CONSTRUCTION AND TESTING

The Contractor may be required to perform a field demonstration of the VIVDS at a particular site selected to approximate the conditions under which the system will need to operate for the project. During the demonstration the unit must prove it can meet the requirements of this SSP. The Engineer has the right to reject the material if the demonstration fails to show the device compliant.

The Contractor shall perform the following:

1. Provide personnel skilled in the physical installation of video detection including selection of correct camera locations, the right cabling and connector connection as well as zone design, VIVDS set-up and calibration. Conduct a site analysis of each installation and provide a written recommendation for optimum camera placement prior to installation.
2. Provide the number of video image sensors (VIS) to cover vehicle detection for every approach shown on the plans. Install the corresponding Video Detection Units (VDU) in a State Furnished Model 170E or Model 2070 controller assembly. Install the VIS power supply or transformer on a standard DIN rail using standard mounting hardware and wire power conductors to DIN rail mounted terminal blocks in the controller cabinet as directed by the Engineer.
3. Wire each VIS sensor assembly to the controller cabinet with a connectorized wiring harness that includes all power and control wiring as well as coaxial video cable and attach with standard Mil Type and rated plugs. The cable type and wire characteristics (rated for 600 V and 75°C, minimum) shall meet the manufacturer's recommendations for the respective VIS to cabinet distances of the project. Run wiring and cables continuously (without splices) between the VIS sensor and controller cabinet. Coil a minimum of two meter slack in the bottom of the controller cabinet or as directed by the Engineer. Terminate the serial data communication output conductors at TB-0, and continue for a minimum of three meters to a DB9F connector for setup and diagnostic access. Coil and tape the ends of unused and spare conductors to prevent accidental contact to other circuits. Label conductors inside the cabinet for the functions as depicted in the approved detailed diagrams.
4. Adjust the lens to view 110% of the largest detection area dimension. Create the detection zones or elements to meet the performance requirements of this SSP. Logically combine zones or elements into reporting contact outputs

that are equivalent to the detection loops shown on the plans with the detection accuracy required by this specification.

5. Verify the performance of each unit individually and submit the recorded medium and other materials to the Engineer at the conclusion of the performance test. The accuracy of each unit shall be determined and documented so that each unit may be approved or rejected separately by the Engineer. Failure to submit the materials at the conclusion of testing invalidates the test. The recorded media serves as acceptance evidence and shall not be used for calibration. The calibration shall have been completed prior to testing and verification.
6. Verify the limit line presence detection accuracy by comparing the VIVDS performance to observations of recorded video images for the same period. Record time stamped video images with superimposed vehicle presence detection and count indication and transfer the images for the selected analysis periods to a DVD or CD media for viewing on a PC. Video record each approach for two sixty minute periods that span dusk and dawn, separately covering the day to night and night to day transitions and including no less than 250 vehicles for each approach and each test period. Provide all software needed for image conversion and analysis. The Contractor shall make a copy of the recording medium for the Contractor's use.

Presence detection accuracy shall be based on the observed operation of the detection contact outputs where such outputs can be logical combinations of several detection zones or elements. Detection errors shall be defined as follows:

#	Error	Description
1	False Detection	When an output reports a vehicle presence when no vehicle is observed
2	Failure to Detect	When a vehicle is present in the zone or at the limit line and the output fails to report a presence
3	Drop After Detection	When a vehicle is initially detected but the output report is dropped while the vehicle remains present.

The presence detection accuracy for an approach shall be determined by the formula $100(1 - \{NE/TC\})$ where TC = the Traffic Count observed from the media recording for the period, and NE = Net Errors observed over the same period. Net errors are obtained by adding the number of observed false calls (error 1 above) while subtracting the number of missed vehicle events and dropped vehicle presence events (errors 2 and 3 above) for each period. The $\{NE/TC\}$ shall be an absolute value. The VIVDS shall not indicate more than 5% in false vehicle readings(error 1 above), not miss the detecting of more than 3% of the vehicles present (errors 2 and 3 above) and the resulting presence detection accuracy shall be at least 98 percent.

The VIVDS vehicle count accuracy shall be determined by the formula $100(1 - DC/TC)$ where DC = the Detector Vehicle Count and TC = the Traffic Count observed from the media recording for the period. Vehicle count accuracy shall be better than 95 percent for each test period.

The Engineer will review the data findings and accept or reject the results within 7 days. Determination of any vehicle anomalies or unusual occurrences will be decided by the Engineer. Data or counts that are not agreed upon by the Engineer shall be considered errors and count against the unit's calibration. If the Engineer determines that the VIVDS does not meet the performance requirements, the Contractor will have seven days to re-calibrate and re-test the unit and re-submit new test data. Following three failed attempts, the Contractor shall replace the VIVDS system with a new unit.

The Contractor shall notify the Engineer 15 working days before the unit is ready for acceptance testing. Acceptance testing shall be scheduled to be accomplished before the end of the normal work shift. The Contractor shall demonstrate the operation of all VIS cameras and VDU units satisfy the functional requirements of these special provisions.

The Contractor shall also: 1) Provide all equipment, documentation, materials and personnel required for acceptance testing of the system, 2) Provide the Engineer with a list of any special tools needed for the acceptance testing, operation and maintenance of the system, and 3) Provide programming and software required to support the VIVDS system, installed in the appropriate equipment at the time of acceptance testing, and used for the acceptance test.

Repair, replacement, and retesting of video image vehicle detection system components due to failure or rejection shall be at the Contractor's expense.

WARRANTY

The Contractor shall provide the manufacturer's written warranty against defects in materials and workmanship for video image sensor assemblies and video detection units for a period of 24 months after installation of the video image sensor assemblies and video detection units. After final acceptance of the video image vehicle detection system, replacement video image sensor assemblies and video detection units shall be provided within 10 days after receipt of failed units at no cost to the State, except the cost of shipping the failed video image sensor assemblies and video detection units. All warranty documentation shall be given to the Engineer prior to installation. Replacement video image sensor assemblies and video

detection units shall be delivered to the Caltrans District 11 Signal Laboratory, 7181 Opportunity Road, San Diego, CA 92111.

TRAINING

Provide a training course of not less than two eight-hour (excluding lunch break) days in duration by a factory authorized representative for up to 10 students selected by the Engineer. The content of the training shall include instruction on how to align, program, adjust, calibrate and maintain the unit. Provide all materials and equipment for the training. Give the Engineer 15 working days notice prior to the training. The training time shall be agreed upon by the Engineer and the Contractor. If no agreement can be reached, the Engineer shall determine the time. A training area will be provided by the State at the Kearny Mesa Construction Office, located at 7177 Opportunity Road, San Diego, CA, 92111.

Full compensation for video detection image system and providing a two-day training class shall be considered as included in the contract lump sum price paid for signal and lighting at various locations involved and no separate payment will be made therefore.

10-3.51 LUMINAIRES

Low pressure sodium luminaires shall be the cutoff type.

10-3.52 SIGN LIGHTING FIXTURES-INDUCTION

Induction sign lighting fixtures shall conform to the provisions for mercury sign lighting fixtures in Section 86-6.05, "Sign Lighting Fixtures-Mercury," of the Standard Specifications and these special provisions.

Each fixture shall consist of a housing with door, a reflector, refractor or a lens, a lamp, a power coupler, a high frequency generator and a fuse block.

Fixtures shall have a minimum average rating of 60 000 hours. Fixtures shall be for a wattage of 87 W, 120/240 V(ac). The power factor of the fixtures shall be greater than 90 percent and the total harmonic distortion shall be less than 10 percent. Fixtures shall be Underwriter's Laboratories (UL) approved for wet locations and be Federal Communications Commission (FCC) Class A listed.

The mass of the fixture shall not exceed 20 kg. The manufacturer's brand name, trademark, model number, serial number and date of manufacture shall be located on the packaged assembly and permanently marked on the outside and inside of the housing.

MATERIALS

Mounting Assembly

The mounting assembly may be either cast aluminum, hot-dip galvanized steel plate or steel plate that has been galvanized and finished with a polymeric coating system or the same finish that is used for the housing.

Housing

Housings shall have a door designed to hold a refractor or lens. Housing doors shall be designed to be opened without the use of special tools. Housings and doors shall have a powder coat or polyester paint finish of a gray color resembling unfinished fabricated aluminum.

The maximum height of the fixture shall not be greater than 325 mm above the top of the mounting channels.

Reflector

Reflectors may be designed to be removed as a unit that includes the lamp and power coupler.

Refractor

Refractors or lenses shall have smooth exteriors. Lenses shall be flat or convex. Convex lenses shall be made from heat resistant, high-impact resistant, tempered glass.

Convex lenses shall be designed or shielded so that no fixture luminance is visible when the fixture is approached directly from the rear and the viewing level is the bottom of the fixture. When a shield is used it shall be an integral part of the door casting.

Lamp

Each fixture shall be furnished with a 85-W induction lamp. Interior lamp walls shall be fluorescent phosphor coated. Lamp light output shall be at least 70 percent at 60 000 hours. Lamps shall have a minimum color-rendering index of 80. Lamps shall be rated at a color temperature of 4 000°K. Lamps shall be removable without the use of tools.

Power Coupler

Power couplers shall consist of a construction base with antenna, heat sink and electrical connection cable. The power coupler shall be designed so that it can be removed with common hand tools.

High Frequency Generator

High frequency generators shall start and operate lamps at an ambient temperature of -25°C or greater for the rated life of the lamp.

Generator output frequency shall be 2.65 MHz \pm 10 percent. The generator radio frequency interference shall meet the requirements of the Federal Communications Commission Title 47, Part 18, regulations concerning harmful interference.

High frequency generators shall operate continuously at ambient air temperatures from -25°C to 25°C without reduction in generator life. High frequency generators shall have a design life of at least 100 000 hours at 55°C.

High frequency generators shall be capable of being replaced with common hand tools. Conductor terminals shall be identified as to the component terminal to which they connect.

High frequency generators shall be mounted to use the fixture upon which they are mounted as a heat sink.

A Certificate of Compliance conforming to the provisions in Section 6-1.07, "Certificates of Compliance," of the Standard Specifications, and a copy of the high frequency generator test methods and results shall be submitted by the manufacturer with each lot of fixtures. The certificate shall state that the high frequency generators meet the requirements of this section and the generator specifications of the lamp manufacturer.

10-3.53 FIBER DISTRIBUTION UNIT

The Contractor shall furnish and install all related equipment to interface the fiber distribution unit (FDU) to the incoming fiber optic communication cables.

The units shall accommodate the fiber optic cable described elsewhere in these special provisions.

Type A FDU shall accommodate termination of not less than 60 individual fibers.

Type C FDU shall accommodate termination of 12 individual fibers.

The FDU shall provide interconnect capability and shall include the following:

1. A patch panel to terminate singlemode fiber with SC type connector feed through adapters.
2. Storage for splice trays.

The patch panel shall be hinged to provide easy access and maintenance. Brackets shall be provided to spool the incoming fiber a minimum of three turns, each turn of not less than 250 mm in length, before separating out individual fibers to the splice tray. Strain relief shall be provided for the incoming fiber optic cable. All fibers shall be terminated and identified in the FDU.

The FDU (Type A) shall be 475 mm rack mountable and not to exceed 435 mm (W) x 500 mm (H) x 375 mm (D).

The FDU (Type C) shall be 475 mm rack mountable and not to exceed 435 mm (W) x 50 mm (H) x 305 mm (D).

10-3.54 PAYMENT

The contract lump sum price or prices paid for signal and lighting shall include highway lighting at intersections in connection with signals only.

Other roadway lighting, except lighting (city street), on the project shall be considered as included in the contract lump sum price paid for lighting and sign illumination.

Full compensation for hauling and stockpiling electrical materials shall be considered as included in the contract price paid for the item requiring the material to be salvaged and no additional compensation will be allowed therefor.

The contract lump sum price paid for fiber optic communication system shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in fiber optic communication system, complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

The contract lump sum price paid for lighting (city street) shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in lighting (city street), complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

The contract lump sum price paid for high occupancy vehicle system shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in fiber optic communication system, complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

Full compensation for hauling and stockpiling electrical materials shall be considered as included in the contract price paid for the item requiring the material to be salvaged and no additional compensation will be allowed therefor.

The contract lump sum price paid for fiber optic communication system shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in fiber optic communication system, complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

The contract lump sum price paid for lighting (city street) shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in lighting (city street), complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

The contract lump sum price paid for high occupancy vehicle system shall include full compensation for furnishing all labor, materials, tools, equipment, and incidentals, and for doing all the work involved in fiber optic communication system, complete in place, as shown on the plans, as specified in the Standard Specifications and these special provisions, and as directed by the Engineer.

SECTION 11. (BLANK)

SECTION 12. (BLANK)

SECTION 13. (BLANK)

SECTION 14 FEDERAL REQUIREMENTS FOR FEDERAL-AID CONSTRUCTION PROJECTS

GENERAL.—The work herein proposed will be financed in whole or in part with Federal funds, and therefore all of the statutes, rules and regulations promulgated by the Federal Government and applicable to work financed in whole or in part with Federal funds will apply to such work. The "Required Contract Provisions, Federal-Aid Construction Contracts, "Form FHWA 1273, are included in this Section 14. Whenever in said required contract provisions references are made to "SHA contracting officer," "SHA resident engineer," or "authorized representative of the SHA," such references shall be construed to mean "Engineer" as defined in Section 1-1.18 of the Standard Specifications.

PERFORMANCE OF PREVIOUS CONTRACT.—In addition to the provisions in Section II, "Nondiscrimination," and Section VII, "Subletting or Assigning the Contract," of the required contract provisions, the Contractor shall comply with the following:

The bidder shall execute the CERTIFICATION WITH REGARD TO THE PERFORMANCE OF PREVIOUS CONTRACTS OR SUBCONTRACTS SUBJECT TO THE EQUAL OPPORTUNITY CLAUSE AND THE FILING OF REQUIRED REPORTS located in the proposal. No request for subletting or assigning any portion of the contract in excess of \$10,000 will be considered under the provisions of Section VII of the required contract provisions unless such request is accompanied by the CERTIFICATION referred to above, executed by the proposed subcontractor.

NON-COLLUSION PROVISION.—The provisions in this section are applicable to all contracts except contracts for Federal Aid Secondary projects.

Title 23, United States Code, Section 112, requires as a condition precedent to approval by the Federal Highway Administrator of the contract for this work that each bidder file a sworn statement executed by, or on behalf of, the person, firm, association, or corporation to whom such contract is to be awarded, certifying that such person, firm, association, or corporation has not, either directly or indirectly, entered into any agreement, participated in any collusion, or otherwise taken any action in restraint of free competitive bidding in connection with the submitted bid. A form to make the non-collusion affidavit statement required by Section 112 as a certification under penalty of perjury rather than as a sworn statement as permitted by 28, USC, Sec. 1746, is included in the proposal.

PARTICIPATION BY MINORITY BUSINESS ENTERPRISES IN SUBCONTRACTING.—Part 23, Title 49, Code of Federal Regulations applies to this Federal-aid project. Pertinent sections of said Code are incorporated in part or in its entirety within other sections of these special provisions.

Schedule B—Information for Determining Joint Venture Eligibility

(This form need not be filled in if all joint venture firms are minority owned.)

1. Name of joint venture _____
2. Address of joint venture _____
3. Phone number of joint venture _____
4. Identify the firms which comprise the joint venture. (The MBE partner must complete Schedule A.) _____

 - a. Describe the role of the MBE firm in the joint venture. _____
 - b. Describe very briefly the experience and business qualifications of each non-MBE joint venturer: _____

5. Nature of the joint venture's business _____

6. Provide a copy of the joint venture agreement.
7. What is the claimed percentage of MBE ownership? _____
8. Ownership of joint venture: (This need not be filled in if described in the joint venture agreement, provided by question 6.).
 - a. Profit and loss sharing.
 - b. Capital contributions, including equipment.
 - c. Other applicable ownership interests.

9. Control of and participation in this contract. Identify by name, race, sex, and "firm" those individuals (and their titles) who are responsible for day-to-day management and policy decision making, including, but not limited to, those with prime responsibility for:

a. Financial decisions _____

b. Management decisions, such as:

(1) Estimating _____

(2) Marketing and sales _____

(3) Hiring and firing of management personnel _____

(4) Purchasing of major items or supplies _____

c. Supervision of field operations _____

Note.—If, after filing this Schedule B and before the completion of the joint venture's work on the contract covered by this regulation, there is any significant change in the information submitted, the joint venture must inform the grantee, either directly or through the prime contractor if the joint venture is a subcontractor.

Affidavit

"The undersigned swear that the foregoing statements are correct and include all material information necessary to identify and explain the terms and operation of our joint venture and the intended participation by each joint venturer in the undertaking. Further, the undersigned covenant and agree to provide to grantee current, complete and accurate information regarding actual joint venture work and the payment therefor and any proposed changes in any of the joint venture arrangements and to permit the audit and examination of the books, records and files of the joint venture, or those of each joint venturer relevant to the joint venture, by authorized representatives of the grantee or the Federal funding agency. Any material misrepresentation will be grounds for terminating any contract which may be awarded and for initiating action under Federal or State laws concerning false statements."

_____	_____
Name of Firm	Name of Firm
_____	_____
Signature	Signature
_____	_____
Name	Name
_____	_____
Title	Title
_____	_____
Date	Date

Date _____

State of _____

County of _____

On this ____ day of _____, 20__, before me appeared (Name) _____, to me personally known, who, being duly sworn, did execute the foregoing affidavit, and did state that he or she was properly authorized by (Name of firm) _____ to execute the affidavit and did so as his or her free act and deed.

Notary Public _____

Commission expires _____

[Seal]

Date _____

State of _____

County of _____

On this ____ day of _____, 20__, before me appeared (Name) _____ to me personally known, who, being duly sworn, did execute the foregoing affidavit, and did state that he or she was properly authorized by (Name of firm) _____ to execute the affidavit and did so as his or her free act and deed.

Notary Public _____

Commission expires _____

[Seal]

**REQUIRED CONTRACT PROVISIONS
FEDERAL-AID CONSTRUCTION CONTRACTS**

I. GENERAL

1. These contract provisions shall apply to all work performed on the contract by the contractor's own organization and with the assistance of workers under the contractor's immediate superintendence and to all work performed on the contract by piecework, station work, or by subcontract.
2. Except as otherwise provided for in each section, the contractor shall insert in each subcontract all of the stipulations contained in these Required Contract Provisions, and further require their inclusion in any lower tier subcontract or purchase order that may in turn be made. The Required Contract Provisions shall not be incorporated by reference in any case. The prime contractor shall be responsible for compliance by any subcontractor or lower tier subcontractor with these Required Contract Provisions.
3. A breach of any of the stipulations contained in these Required Contract Provisions shall be sufficient grounds for termination of the contract.
4. A breach of the following clauses of the Required Contract Provisions may also be grounds for debarment as provided in 29 CFR 5.12:

Section I, paragraph 2;
Section IV, paragraphs 1, 2, 3, 4, and 7;
Section V, paragraphs 1 and 2a through 2g.

5. Disputes arising out of the labor standards provisions of Section IV (except paragraph 5) and Section V of these Required Contract Provisions shall not be subject to the general disputes clause of this contract. Such disputes shall be resolved in accordance with the procedures of the U.S. Department of Labor (DOL) as set forth in 29 CFR 5, 6, and 7. Disputes within the meaning of this clause include disputes between the contractor (or any of its subcontractors) and the contracting agency, the DOL, or the contractor's employees or their representatives.
6. Selection of Labor - During the performance of this contract, the contractor shall not:
 - a. discriminate against labor from any other State, possession, or territory of the United States (except for employment preference for Appalachian contracts, when applicable, as specified in Attachment A), or
 - b. employ convict labor for any purpose within the limits of the project unless it is labor performed by convicts who are on parole, supervised release, or probation.

II. NONDISCRIMINATION

(Applicable to all Federal-aid construction contracts and to all related subcontracts of \$10,000 or more.)

1. **Equal Employment Opportunity:** Equal employment opportunity (EEO) requirements not to discriminate and to take affirmative action to assure equal opportunity as set forth under laws, executive orders, rules, regulations (28 CFR 35, 29 CFR 1630, and 41 CFR 60) and orders of the Secretary of Labor as modified by the provisions prescribed herein, and imposed pursuant to 23 U.S.C. 140 shall constitute the EEO and specific affirmative action standards for the contractor's project activities under this contract. The Equal Opportunity Construction Contract Specifications set forth under 41 CFR 60-4.3 and the provisions of the American Disabilities Act of 1990 (42 U.S.C. 12101 et seq.) set forth under 28 CFR 35 and 29 CFR 1630 are incorporated by reference in this contract. In the execution of this contract, the contractor agrees to comply with the following minimum specific requirement activities of EEO:
 - a. The contractor will work with the State highway agency (SHA) and the Federal Government in carrying out EEO obligations and in their review of his/her activities under the contract.
 - b. The contractor will accept as his operating policy the following statement:

"It is the policy of this Company to assure that applicants are employed, and that employees are treated during employment, without regard to their race, religion, sex, color, national origin, age or disability. Such action

shall include: employment, upgrading, demotion, or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship, preapprenticeship, and/or on-the-job training."

2. **EEO Officer:** The contractor will designate and make known to the SHA contracting officers an EEO Officer who will have the responsibility for and must be capable of effectively administering and promoting an active contractor program of EEO and who must be assigned adequate authority and responsibility to do so.
3. **Dissemination of Policy:** All members of the contractor's staff who are authorized to hire, supervise, promote, and discharge employees, or who recommend such action, or who are substantially involved in such action, will be made fully cognizant of, and will implement, the contractor's EEO policy and contractual responsibilities to provide EEO in each grade and classification of employment. To ensure that the above agreement will be met, the following actions will be taken as a minimum:
 - a. Periodic meetings of supervisory and personnel office employees will be conducted before the start of work and then not less often than once every six months, at which time the contractor's EEO policy and its implementation will be reviewed and explained. The meetings will be conducted by the EEO Officer.
 - b. All new supervisory or personnel office employees will be given a thorough indoctrination by the EEO Officer, covering all major aspects of the contractor's EEO obligations within thirty days following their reporting for duty with the contractor.
 - c. All personnel who are engaged in direct recruitment for the project will be instructed by the EEO Officer in the contractor's procedures for locating and hiring minority group employees.
 - d. Notices and posters setting forth the contractor's EEO policy will be placed in areas readily accessible to employees, applicants for employment and potential employees.
 - e. The contractor's EEO policy and the procedures to implement such policy will be brought to the attention of employees by means of meetings, employee handbooks, or other appropriate means.
4. **Recruitment:** When advertising for employees, the contractor will include in all advertisements for employees the notation: "An Equal Opportunity Employer." All such advertisements will be placed in publications having a large circulation among minority groups in the area from which the project work force would normally be derived.
 - a. The contractor will, unless precluded by a valid bargaining agreement, conduct systematic and direct recruitment through public and private employee referral sources likely to yield qualified minority group applicants. To meet this requirement, the contractor will identify sources of potential minority group employees, and establish with such identified sources procedures whereby minority group applicants may be referred to the contractor for employment consideration.
 - b. In the event the contractor has a valid bargaining agreement providing for exclusive hiring hall referrals, he is expected to observe the provisions of that agreement to the extent that the system permits the contractor's compliance with EEO contract provisions. (The DOL has held that where implementation of such agreements have the effect of discriminating against minorities or women, or obligates the contractor to do the same, such implementation violates Executive Order 11246, as amended.)
 - c. The contractor will encourage his present employees to refer minority group applicants for employment. Information and procedures with regard to referring minority group applicants will be discussed with employees.
5. **Personnel Actions:** Wages, working conditions, and employee benefits shall be established and administered, and personnel actions of every type, including hiring, upgrading, promotion, transfer, demotion, layoff, and termination, shall be taken without regard to race, color, religion, sex, national origin, age or disability. The following procedures shall be followed:
 - a. The contractor will conduct periodic inspections of project sites to insure that working conditions and employee facilities do not indicate discriminatory treatment of project site personnel.

- b. The contractor will periodically evaluate the spread of wages paid within each classification to determine any evidence of discriminatory wage practices.
- c. The contractor will periodically review selected personnel actions in depth to determine whether there is evidence of discrimination. Where evidence is found, the contractor will promptly take corrective action. If the review indicates that the discrimination may extend beyond the actions reviewed, such corrective action shall include all affected persons.
- d. The contractor will promptly investigate all complaints of alleged discrimination made to the contractor in connection with his obligations under this contract, will attempt to resolve such complaints, and will take appropriate corrective action within a reasonable time. If the investigation indicates that the discrimination may affect persons other than the complainant, such corrective action shall include such other persons. Upon completion of each investigation, the contractor will inform every complainant of all of his avenues of appeal.

6. Training and Promotion:

- a. The contractor will assist in locating, qualifying, and increasing the skills of minority group and women employees, and applicants for employment.
- b. Consistent with the contractor's work force requirements and as permissible under Federal and State regulations, the contractor shall make full use of training programs, i.e., apprenticeship, and on-the-job training programs for the geographical area of contract performance. Where feasible, 25 percent of apprentices or trainees in each occupation shall be in their first year of apprenticeship or training. In the event a special provision for training is provided under this contract, this subparagraph will be superseded as indicated in the special provision.
- c. The contractor will advise employees and applicants for employment of available training programs and entrance requirements for each.
- d. The contractor will periodically review the training and promotion potential of minority group and women employees and will encourage eligible employees to apply for such training and promotion.

7. Unions: If the contractor relies in whole or in part upon unions as a source of employees, the contractor will use his/her best efforts to obtain the cooperation of such unions to increase opportunities for minority groups and women within the unions, and to effect referrals by such unions of minority and female employees. Actions by the contractor either directly or through a contractor's association acting as agent will include the procedures set forth below:

- a. The contractor will use best efforts to develop, in cooperation with the unions, joint training programs aimed toward qualifying more minority group members and women for membership in the unions and increasing the skills of minority group employees and women so that they may qualify for higher paying employment.
- b. The contractor will use best efforts to incorporate an EEO clause into each union agreement to the end that such union will be contractually bound to refer applicants without regard to their race, color, religion, sex, national origin, age or disability.
- c. The contractor is to obtain information as to the referral practices and policies of the labor union except that to the extent such information is within the exclusive possession of the labor union and such labor union refuses to furnish such information to the contractor, the contractor shall so certify to the SHA and shall set forth what efforts have been made to obtain such information.
- d. In the event the union is unable to provide the contractor with a reasonable flow of minority and women referrals within the time limit set forth in the collective bargaining agreement, the contractor will, through independent recruitment efforts, fill the employment vacancies without regard to race, color, religion, sex, national origin, age or disability; making full efforts to obtain qualified and/or qualifiable minority group persons and women. (The DOL has held that it shall be no excuse that the union with which the contractor has a collective bargaining agreement providing for exclusive referral failed to refer minority employees.) In the event the union referral practice prevents the contractor from meeting the obligations pursuant to Executive Order 11246, as amended, and these special provisions, such contractor shall immediately notify the SHA.

8. **Selection of Subcontractors, Procurement of Materials and Leasing of Equipment:** The contractor shall not discriminate on the grounds of race, color, religion, sex, national origin, age or disability in the selection and retention of subcontractors, including procurement of materials and leases of equipment.
- a. The contractor shall notify all potential subcontractors and suppliers of his/her EEO obligations under this contract.
 - b. Disadvantaged business enterprises (DBE), as defined in 49 CFR 23, shall have equal opportunity to compete for and perform subcontracts which the contractor enters into pursuant to this contract. The contractor will use his best efforts to solicit bids from and to utilize DBE subcontractors or subcontractors with meaningful minority group and female representation among their employees. Contractors shall obtain lists of DBE construction firms from SHA personnel.
 - c. The contractor will use his best efforts to ensure subcontractor compliance with their EEO obligations.
9. **Records and Reports:** The contractor shall keep such records as necessary to document compliance with the EEO requirements. Such records shall be retained for a period of three years following completion of the contract work and shall be available at reasonable times and places for inspection by authorized representatives of the SHA and the FHWA.
- a. The records kept by the contractor shall document the following:
 - (1) The number of minority and non-minority group members and women employed in each work classification on the project;
 - (2) The progress and efforts being made in cooperation with unions, when applicable, to increase employment opportunities for minorities and women;
 - (3) The progress and efforts being made in locating, hiring, training, qualifying, and upgrading minority and female employees; and
 - (4) The progress and efforts being made in securing the services of DBE subcontractors or subcontractors with meaningful minority and female representation among their employees.
 - b. The contractors will submit an annual report to the SHA each July for the duration of the project, indicating the number of minority, women, and non-minority group employees currently engaged in each work classification required by the contract work. This information is to be reported on Form FHWA-1391. If on-the-job training is being required by special provision, the contractor will be required to collect and report training data.

III. NONSEGREGATED FACILITIES

(Applicable to all Federal-aid construction contracts and to all related subcontracts of \$10,000 or more.)

- a. By submission of this bid, the execution of this contract or subcontract, or the consummation of this material supply agreement or purchase order, as appropriate, the bidder, Federal-aid construction contractor, subcontractor, material supplier, or vendor, as appropriate, certifies that the firm does not maintain or provide for its employees any segregated facilities at any of its establishments, and that the firm does not permit its employees to perform their services at any location, under its control, where segregated facilities are maintained. The firm agrees that a breach of this certification is a violation of the EEO provisions of this contract. The firm further certifies that no employee will be denied access to adequate facilities on the basis of sex or disability.
- b. As used in this certification, the term "segregated facilities" means any waiting rooms, work areas, restrooms and washrooms, restaurants and other eating areas, time clocks, locker rooms, and other storage or dressing areas, parking lots, drinking fountains, recreation or entertainment areas, transportation, and housing facilities provided for employees which are segregated by explicit directive, or are, in fact, segregated on the basis of race, color, religion, national origin, age or disability, because of habit, local custom, or otherwise. The only exception will be for the disabled when the demands for accessibility override (e.g. disabled parking).

- c. The contractor agrees that it has obtained or will obtain identical certification from proposed subcontractors or material suppliers prior to award of subcontracts or consummation of material supply agreements of \$10,000 or more and that it will retain such certifications in its files.

IV. PAYMENT OF PREDETERMINED MINIMUM WAGE

(Applicable to all Federal-aid construction contracts exceeding \$2,000 and to all related subcontracts, except for projects located on roadways classified as local roads or rural minor collectors, which are exempt.)

1. General:

- a. All mechanics and laborers employed or working upon the site of the work will be paid unconditionally and not less often than once a week and without subsequent deduction or rebate on any account [except such payroll deductions as are permitted by regulations (29 CFR 3)] issued by the Secretary of Labor under the Copeland Act (40 U.S.C. 276c) the full amounts of wages and bona fide fringe benefits (or cash equivalents thereof) due at time of payment. The payment shall be computed at wage rates not less than those contained in the wage determination of the Secretary of Labor (hereinafter "the wage determination") which is attached hereto and made a part hereof, regardless of any contractual relationship which may be alleged to exist between the contractor or its subcontractors and such laborers and mechanics. The wage determination (including any additional classifications and wage rates conformed under paragraph 2 of this Section IV and the DOL poster (WH-1321) or Form FHWA-1495) shall be posted at all times by the contractor and its subcontractors at the site of the work in a prominent and accessible place where it can be easily seen by the workers. For the purpose of this Section, contributions made or costs reasonably anticipated for bona fide fringe benefits under Section 1(b)(2) of the Davis-Bacon Act (40 U.S.C. 276a) on behalf of laborers or mechanics are considered wages paid to such laborers or mechanics, subject to the provisions of Section IV, paragraph 3b, hereof. Also, for the purpose of this Section, regular contributions made or costs incurred for more than a weekly period (but not less often than quarterly) under plans, funds, or programs, which cover the particular weekly period, are deemed to be constructively made or incurred during such weekly period. Such laborers and mechanics shall be paid the appropriate wage rate and fringe benefits on the wage determination for the classification of work actually performed, without regard to skill, except as provided in paragraphs 4 and 5 of this Section IV.
- b. Laborers or mechanics performing work in more than one classification may be compensated at the rate specified for each classification for the time actually worked therein, provided, that the employer's payroll records accurately set forth the time spent in each classification in which work is performed.
- c. All rulings and interpretations of the Davis-Bacon Act and related acts contained in 29 CFR 1, 3, and 5 are herein incorporated by reference in this contract.

2. Classification:

- a. The SHA contracting officer shall require that any class of laborers or mechanics employed under the contract, which is not listed in the wage determination, shall be classified in conformance with the wage determination.
- b. The contracting officer shall approve an additional classification, wage rate and fringe benefits only when the following criteria have been met:
 - (1) the work to be performed by the additional classification requested is not performed by a classification in the wage determination;
 - (2) the additional classification is utilized in the area by the construction industry;
 - (3) the proposed wage rate, including any bona fide fringe benefits, bears a reasonable relationship to the wage rates contained in the wage determination; and
 - (4) with respect to helpers, when such a classification prevails in the area in which the work is performed.
- c. If the contractor or subcontractors, as appropriate, the laborers and mechanics (if known) to be employed in the additional classification or their representatives, and the contracting officer agree on the classification and wage rate (including the amount designated for fringe benefits where appropriate), a report of the action taken shall be

sent by the contracting officer to the DOL, Administrator of the Wage and Hour Division, Employment Standards Administration, Washington, D.C. 20210. The Wage and Hour Administrator, or an authorized representative, will approve, modify, or disapprove every additional classification action within 30 days of receipt and so advise the contracting officer or will notify the contracting officer within the 30-day period that additional time is necessary.

- d. In the event the contractor or subcontractors, as appropriate, the laborers or mechanics to be employed in the additional classification or their representatives, and the contracting officer do not agree on the proposed classification and wage rate (including the amount designated for fringe benefits, where appropriate), the contracting officer shall refer the questions, including the views of all interested parties and the recommendation of the contracting officer, to the Wage and Hour Administrator for determination. Said Administrator, or an authorized representative, will issue a determination within 30 days of receipt and so advise the contracting officer or will notify the contracting officer within the 30-day period that additional time is necessary
- e. The wage rate (including fringe benefits where appropriate) determined pursuant to paragraph 2c or 2d of this Section IV shall be paid to all workers performing work in the additional classification from the first day on which work is performed in the classification.

3. Payment of Fringe Benefits:

- a. Whenever the minimum wage rate prescribed in the contract for a class of laborers or mechanics includes a fringe benefit which is not expressed as an hourly rate, the contractor or subcontractors, as appropriate, shall either pay the benefit as stated in the wage determination or shall pay another bona fide fringe benefit or an hourly case equivalent thereof.
- b. If the contractor or subcontractor, as appropriate, does not make payments to a trustee or other third person, he/she may consider as a part of the wages of any laborer or mechanic the amount of any costs reasonably anticipated in providing bona fide fringe benefits under a plan or program, provided, that the Secretary of Labor has found, upon the written request of the contractor, that the applicable standards of the Davis-Bacon Act have been met. The Secretary of Labor may require the contractor to set aside in a separate account assets for the meeting of obligations under the plan or program.

4. Apprentices and Trainees (Programs of the U.S. DOL) and Helpers:

a. Apprentices:

- (1) Apprentices will be permitted to work at less than the predetermined rate for the work they performed when they are employed pursuant to and individually registered in a bona fide apprenticeship program registered with the DOL, Employment and Training Administration, Bureau of Apprenticeship and Training, or with a State apprenticeship agency recognized by the Bureau, or if a person is employed in his/her first 90 days of probationary employment as an apprentice in such an apprenticeship program, who is not individually registered in the program, but who has been certified by the Bureau of Apprenticeship and Training or a State apprenticeship agency (where appropriate) to be eligible for probationary employment as an apprentice.
- (2) The allowable ratio of apprentices to journeyman-level employees on the job site in any craft classification shall not be greater than the ratio permitted to the contractor as to the entire work force under the registered program. Any employee listed on a payroll at an apprentice wage rate, who is not registered or otherwise employed as stated above, shall be paid not less than the applicable wage rate listed in the wage determination for the classification of work actually performed. In addition, any apprentice performing work on the job site in excess of the ratio permitted under the registered program shall be paid not less than the applicable wage rate on the wage determination for the work actually performed. Where a contractor or subcontractor is performing construction on a project in a locality other than that in which its program is registered, the ratios and wage rates (expressed in percentages of the journeyman-level hourly rate) specified in the contractor's or subcontractor's registered program shall be observed.
- (3) Every apprentice must be paid at not less than the rate specified in the registered program for the apprentice's level of progress, expressed as a percentage of the journeyman-level hourly rate specified in

the applicable wage determination. Apprentices shall be paid fringe benefits in accordance with the provisions of the apprenticeship program. If the apprenticeship program does not specify fringe benefits, apprentices must be paid the full amount of fringe benefits listed on the wage determination for the applicable classification. If the Administrator for the Wage and Hour Division determines that a different practice prevails for the applicable apprentice classification, fringes shall be paid in accordance with that determination.

- (4) In the event the Bureau of Apprenticeship and Training, or a State apprenticeship agency recognized by the Bureau, withdraws approval of an apprenticeship program, the contractor or subcontractor will no longer be permitted to utilize apprentices at less than the applicable predetermined rate for the comparable work performed by regular employees until an acceptable program is approved.

b. Trainees:

- (1) Except as provided in 29 CFR 5.16, trainees will not be permitted to work at less than the predetermined rate for the work performed unless they are employed pursuant to and individually registered in a program which has received prior approval, evidenced by formal certification by the DOL, Employment and Training Administration.
- (2) The ratio of trainees to journeyman-level employees on the job site shall not be greater than permitted under the plan approved by the Employment and Training Administration. Any employee listed on the payroll at a trainee rate who is not registered and participating in a training plan approved by the Employment and Training Administration shall be paid not less than the applicable wage rate on the wage determination for the classification of work actually performed. In addition, any trainee performing work on the job site in excess of the ratio permitted under the registered program shall be paid not less than the applicable wage rate on the wage determination for the work actually performed.
- (3) Every trainee must be paid at not less than the rate specified in the approved program for his/her level of progress, expressed as a percentage of the journeyman-level hourly rate specified in the applicable wage determination. Trainees shall be paid fringe benefits in accordance with the provisions of the trainee program. If the trainee program does not mention fringe benefits, trainees shall be paid the full amount of fringe benefits listed on the wage determination unless the Administrator of the Wage and Hour Division determines that there is an apprenticeship program associated with the corresponding journeyman-level wage rate on the wage determination which provides for less than full fringe benefits for apprentices, in which case such trainees shall receive the same fringe benefits as apprentices.
- (4) In the event the Employment and Training Administration withdraws approval of a training program, the contractor or subcontractor will no longer be permitted to utilize trainees at less than the applicable predetermined rate for the work performed until an acceptable program is approved.

c. Helpers:

Helpers will be permitted to work on a project if the helper classification is specified and defined on the applicable wage determination or is approved pursuant to the conformance procedure set forth in Section IV.2. Any worker listed on a payroll at a helper wage rate, who is not a helper under an approved definition, shall be paid not less than the applicable wage rate on the wage determination for the classification of work actually performed.

5. **Apprentices and Trainees (Programs of the U.S. DOT):**

Apprentices and trainees working under apprenticeship and skill training programs which have been certified by the Secretary of Transportation as promoting EEO in connection with Federal-aid highway construction programs are not subject to the requirements of paragraph 4 of this Section IV. The straight time hourly wage rates for apprentices and trainees under such programs will be established by the particular programs. The ratio of apprentices and trainees to journeymen shall not be greater than permitted by the terms of the particular program.

6. **Withholding:**

The SHA shall upon its own action or upon written request of an authorized representative of the DOL withhold, or cause to be withheld, from the contractor or subcontractor under this contract or any other Federal contract with the same prime contractor, or any other Federally-assisted contract subject to Davis-Bacon prevailing wage

requirements which is held by the same prime contractor, as much of the accrued payments or advances as may be considered necessary to pay laborers and mechanics, including apprentices, trainees, and helpers, employed by the contractor or any subcontractor the full amount of wages required by the contract. In the event of failure to pay any laborer or mechanic, including any apprentice, trainee, or helper, employed or working on the site of the work, all or part of the wages required by the contract, the SHA contracting officer may, after written notice to the contractor, take such action as may be necessary to cause the suspension of any further payment, advance, or guarantee of funds until such violations have ceased.

7. **Overtime Requirements:**

No contractor or subcontractor contracting for any part of the contract work which may require or involve the employment of laborers, mechanics, watchmen, or guards (including apprentices, trainees, and helpers described in paragraphs 4 and 5 above) shall require or permit any laborer, mechanic, watchman, or guard in any workweek in which he/she is employed on such work, to work in excess of 40 hours in such workweek unless such laborer, mechanic, watchman, or guard receives compensation at a rate not less than one-and-one-half times his/her basic rate of pay for all hours worked in excess of 40 hours in such workweek.

8. **Violation:**

Liability for Unpaid Wages; Liquidated Damages: In the event of any violation of the clause set forth in paragraph 7 above, the contractor and any subcontractor responsible thereof shall be liable to the affected employee for his/her unpaid wages. In addition, such contractor and subcontractor shall be liable to the United States (in the case of work done under contract for the District of Columbia or a territory, to such District or to such territory) for liquidated damages. Such liquidated damages shall be computed with respect to each individual laborer, mechanic, watchman, or guard employed in violation of the clause set forth in paragraph 7, in the sum of \$10 for each calendar day on which such employee was required or permitted to work in excess of the standard work week of 40 hours without payment of the overtime wages required by the clause set forth in paragraph 7.

9. **Withholding for Unpaid Wages and Liquidated Damages:**

The SHA shall upon its own action or upon written request of any authorized representative of the DOL withhold, or cause to be withheld, from any monies payable on account of work performed by the contractor or subcontractor under any such contract or any other Federal contract with the same prime contractor, or any other Federally-assisted contract subject to the Contract Work Hours and Safety Standards Act, which is held by the same prime contractor, such sums as may be determined to be necessary to satisfy any liabilities of such contractor or subcontractor for unpaid wages and liquidated damages as provided in the clause set forth in paragraph 8 above.

V. STATEMENTS AND PAYROLLS

(Applicable to all Federal-aid construction contracts exceeding \$2,000 and to all related subcontracts, except for projects located on roadways classified as local roads or rural collectors, which are exempt.)

1. **Compliance with Copeland Regulations (29 CFR 3):**

The contractor shall comply with the Copeland Regulations of the Secretary of Labor which are herein incorporated by reference.

2. **Payrolls and Payroll Records:**

- a. Payrolls and basic records relating thereto shall be maintained by the contractor and each subcontractor during the course of the work and preserved for a period of 3 years from the date of completion of the contract for all laborers, mechanics, apprentices, trainees, watchmen, helpers, and guards working at the site of the work.
- b. The payroll records shall contain the name, social security number, and address of each such employee; his or her correct classification; hourly rates of wages paid (including rates of contributions or costs anticipated for bona fide fringe benefits or cash equivalent thereof the types described in Section 1(b)(2)(B) of the Davis Bacon Act); daily and weekly number of hours worked; deductions made; and actual wages paid. In addition, for Appalachian contracts, the payroll records shall contain a notation indicating whether the employee does, or does not, normally reside in the labor area as defined in Attachment A, paragraph 1. Whenever the Secretary of Labor, pursuant to Section IV, paragraph 3b, has found that the wages of any laborer or mechanic include the amount of any costs reasonably anticipated in providing benefits under a plan or program described in Section 1(b)(2)(B) of the Davis Bacon Act, the contractor and each subcontractor shall maintain records which show

that the commitment to provide such benefits is enforceable, that the plan or program is financially responsible, that the plan or program has been communicated in writing to the laborers or mechanics affected, and show the cost anticipated or the actual cost incurred in providing benefits. Contractors or subcontractors employing apprentices or trainees under approved programs shall maintain written evidence of the registration of apprentices and trainees, and ratios and wage rates prescribed in the applicable programs.

- c. Each contractor and subcontractor shall furnish, each week in which any contract work is performed, to the SHA resident engineer a payroll of wages paid each of its employees (including apprentices, trainees, and helpers, described in Section IV, paragraphs 4 and 5, and watchmen and guards engaged on work during the preceding weekly payroll period). The payroll submitted shall set out accurately and completely all of the information required to be maintained under paragraph 2b of this Section V. This information may be submitted in any form desired. Optional Form WH-347 is available for this purpose and may be purchased from the Superintendent of Documents (Federal stock number 029-005-0014-1), U.S. Government Printing Office, Washington, D.C. 20402. The prime contractor is responsible for the submission of copies of payrolls by all subcontractors.
- d. Each payroll submitted shall be accompanied by a "Statement of Compliance," signed by the contractor or subcontractor or his/her agent who pays or supervises the payment of the persons employed under the contract and shall certify the following:
 - (1) that the payroll for the payroll period contains the information required to be maintained under paragraph 2b of this Section V and that such information is correct and complete;
 - (2) that such laborer or mechanic (including each helper, apprentice, and trainee) employed on the contract during the payroll period has been paid the full weekly wages earned, without rebate, either directly or indirectly, and that no deductions have been made either directly or indirectly from the full wages earned, other than permissible deductions as set forth in the Regulations, 29 CFR 3;
 - (3) that each laborer or mechanic has been paid not less than the applicable wage rate and fringe benefits or cash equivalent for the classification of work performed, as specified in the applicable wage determination incorporated into the contract.
- e. The weekly submission of a properly executed certification set forth on the reverse side of Optional Form WH-347 shall satisfy the requirement for submission of the "Statement of Compliance" required by paragraph 2d of this Section V.
- f. The falsification of any of the above certifications may subject the contractor to civil or criminal prosecution under 18 U.S.C. 1001 and 31 U.S.C. 231.
- g. The contractor or subcontractor shall make the records required under paragraph 2b of this Section V available for inspection, copying, or transcription by authorized representatives of the SHA, the FHWA, or the DOL, and shall permit such representatives to interview employees during working hours on the job. If the contractor or subcontractor fails to submit the required records or to make them available, the SHA, the FHWA, the DOL, or all may, after written notice to the contractor, sponsor, applicant, or owner, take such actions as may be necessary to cause the suspension of any further payment, advance, or guarantee of funds. Furthermore, failure to submit the required records upon request or to make such records available may be grounds for debarment action pursuant to 29 CFR 5.12.

VI. RECORD OF MATERIALS, SUPPLIES, AND LABOR

1. On all Federal-aid contracts on the National Highway System, except those which provide solely for the installation of protective devices at railroad grade crossings, those which are constructed on a force account or direct labor basis, highway beautification contracts, and contracts for which the total final construction cost for roadway and bridge is less than \$1,000,000 (23 CFR 635) the contractor shall:
 - a. Become familiar with the list of specific materials and supplies contained in Form FHWA-47, "Statement of Materials and Labor Used by Contractor of Highway Construction Involving Federal Funds," prior to the commencement of work under this contract.

- b. Maintain a record of the total cost of all materials and supplies purchased for and incorporated in the work, and also of the quantities of those specific materials and supplies listed on Form FHWA-47, and in the units shown on Form FHWA-47.
 - c. Furnish, upon the completion of the contract, to the SHA resident engineer on Form FHWA-47 together with the data required in paragraph 1b relative to materials and supplies, a final labor summary of all contract work indicating the total hours worked and the total amount earned.
2. At the prime contractor's option, either a single report covering all contract work or separate reports for the contractor and for each subcontract shall be submitted.

VII. SUBLETTING OR ASSIGNING THE CONTRACT

1. The contractor shall perform with its own organization contract work amounting to not less than 30 percent (or a greater percentage if specified elsewhere in the contract) of the total original contract price, excluding any specialty items designated by the State. Specialty items may be performed by subcontract and the amount of any such specialty items performed may be deducted from the total original contract price before computing the amount of work required to be performed by the contractor's own organization (23 CFR 635).
 - a. "Its own organization" shall be construed to include only workers employed and paid directly by the prime contractor and equipment owned or rented by the prime contractor, with or without operators. Such term does not include employees or equipment of a subcontractor, assignee, or agent of the prime contractor.
 - b. "Specialty Items" shall be construed to be limited to work that requires highly specialized knowledge, abilities, or equipment not ordinarily available in the type of contracting organizations qualified and expected to bid on the contract as a whole and in general are to be limited to minor components of the overall contract.
2. The contract amount upon which the requirements set forth in paragraph 1 of Section VII is computed includes the cost of material and manufactured products which are to be purchased or produced by the contractor under the contract provisions.
3. The contractor shall furnish (a) a competent superintendent or supervisor who is employed by the firm, has full authority to direct performance of the work in accordance with the contract requirements, and is in charge of all construction operations (regardless of who performs the work) and (b) such other of its own organizational resources (supervision, management, and engineering services) as the SHA contracting officer determines is necessary to assure the performance of the contract.
4. No portion of the contract shall be sublet, assigned or otherwise disposed of except with the written consent of the SHA contracting officer, or authorized representative, and such consent when given shall not be construed to relieve the contractor of any responsibility for the fulfillment of the contract. Written consent will be given only after the SHA has assured that each subcontract is evidenced in writing and that it contains all pertinent provisions and requirements of the prime contract.

VIII. SAFETY - ACCIDENT PREVENTION

1. In the performance of this contract the contractor shall comply with all applicable Federal, State, and local laws governing safety, health, and sanitation (23 CFR 635). The contractor shall provide all safeguards, safety devices and protective equipment and take any other needed actions as it determines, or as the SHA contracting officer may determine, to be reasonably necessary to protect the life and health of employees on the job and the safety of the public and to protect property in connection with the performance of the work covered by the contract.
2. It is a condition of this contract, and shall be made a condition of each subcontract, which the contractor enters into pursuant to this contract, that the contractor and any subcontractor shall not permit any employee, in performance of the contract, to work in surroundings or under conditions which are unsanitary, hazardous or dangerous to his/her health or safety, as determined under construction safety and health standards (29 CFR 1926) promulgated by the Secretary of Labor, in accordance with Section 107 of the Contract Work Hours and Safety Standards Act (40 U.S.C. 333).
3. Pursuant to 29 CFR 1926.3, it is a condition of this contract that the Secretary of Labor or authorized representative thereof, shall have right of entry to any site of contract performance to inspect or investigate the matter of

compliance with the construction safety and health standards and to carry out the duties of the Secretary under Section 107 of the Contract Work Hours and Safety Standards Act (40 U.S.C. 333).

IX. FALSE STATEMENTS CONCERNING HIGHWAY PROJECTS

In order to assure high quality and durable construction in conformity with approved plans and specifications and a high degree of reliability on statements and representations made by engineers, contractors, suppliers, and workers on Federal-aid highway projects, it is essential that all persons concerned with the project perform their functions as carefully, thoroughly, and honestly as possible. Willful falsification, distortion, or misrepresentation with respect to any facts related to the project is a violation of Federal law. To prevent any misunderstanding regarding the seriousness of these and similar acts, the following notice shall be posted on each Federal-aid highway project (23 CFR 635) in one or more places where it is readily available to all persons concerned with the project:

Notice To All Personnel Engaged On Federal-Aid Highway Projects

18 U.S.C. 1020 READS AS FOLLOWS:

"Whoever being an officer, agent, or employee of the United States, or any State or Territory, or whoever, whether a person, association, firm, or corporation, knowingly makes any false statement, false representation, or false report as to the character, quality, quantity, or cost of the material used or to be used, or the quantity or quality of the work performed or to be performed, or the cost thereof in connection with the submission of plans, maps, specifications, contracts, or costs of construction on any highway or related project submitted for approval to the Secretary of Transportation; or

Whoever knowingly makes any false statement, false representation, false report or false claim with respect to the character, quality, quantity, or cost of any work performed or to be performed, or materials furnished or to be furnished, in connection with the construction of any highway or related project approved by the Secretary of Transportation; or

Whoever knowingly makes any false statement or false representation as to material fact in any statement, certificate, or report submitted pursuant to provisions of the Federal-aid Roads Act approved July 1, 1916, (39 Stat. 355), as amended and supplemented;

Shall be fined not more than \$10,000 or imprisoned not more than 5 years or both."

X. IMPLEMENTATION OF CLEAN AIR ACT AND FEDERAL WATER POLLUTION CONTROL ACT

(Applicable to all Federal-aid construction contracts and to all related subcontracts of \$100,000 or more.)

By submission of this bid or the execution of this contract, or subcontract, as appropriate, the bidder, Federal-aid construction contractor, or subcontractor, as appropriate, will be deemed to have stipulated as follows:

1. That any facility that is or will be utilized in the performance of this contract, unless such contract is exempt under the Clean Air Act, as amended (42 U.S.C. 1857 et seq., as amended by Pub.L. 91-604), and under the Federal Water Pollution Control Act, as amended (33 U.S.C. 1251 et seq., as amended by Pub.L. 92-500), Executive Order 11738, and regulations in implementation thereof (40 CFR 15) is not listed, on the date of contract award, on the U.S. Environmental Protection Agency (EPA) List of Violating Facilities pursuant to 40 CFR 15.20.
2. That the firm agrees to comply and remain in compliance with all the requirements of Section 114 of the Clean Air Act and Section 308 of the Federal Water Pollution Control Act and all regulations and guidelines listed thereunder.
3. That the firm shall promptly notify the SHA of the receipt of any communication from the Director, Office of Federal Activities, EPA, indicating that a facility that is or will be utilized for the contract is under consideration to be listed on the EPA List of Violating Facilities.
4. That the firm agrees to include or cause to be included the requirements of paragraph 1 through 4 of this Section X in every nonexempt subcontract, and further agrees to take such action as the government may direct as a means of enforcing such requirements.

XI. CERTIFICATION REGARDING DEBARMENT, SUSPENSION, INELIGIBILITY AND VOLUNTARY EXCLUSION

1. Instructions for Certification - Primary Covered Transactions:

(Applicable to all Federal-aid contracts - 49 CFR 29)

- a. By signing and submitting this proposal, the prospective primary participant is providing the certification set out below.
- b. The inability of a person to provide the certification set out below will not necessarily result in denial of participation in this covered transaction. The prospective participant shall submit an explanation of why it cannot provide the certification set out below. The certification or explanation will be considered in connection with the department or agency's determination whether to enter into this transaction. However, failure of the prospective primary participant to furnish a certification or an explanation shall disqualify such a person from participation in this transaction.
- c. The certification in this clause is a material representation of fact upon which reliance was placed when the department or agency determined to enter into this transaction. If it is later determined that the prospective primary participant knowingly rendered an erroneous certification, in addition to other remedies available to the Federal Government, the department or agency may terminate this transaction for cause of default.
- d. The prospective primary participant shall provide immediate written notice to the department or agency to whom this proposal is submitted if any time the prospective primary participant learns that its certification was erroneous when submitted or has become erroneous by reason of changed circumstances.
- e. The terms "covered transaction," "debarred," "suspended," "ineligible," "lower tier covered transaction," "participant," "person," "primary covered transaction," "principal," "proposal," and "voluntarily excluded," as used in this clause, have the meanings set out in the Definitions and Coverage sections of rules implementing Executive Order 12549. You may contact the department or agency to which this proposal is submitted for assistance in obtaining a copy of those regulations.
- f. The prospective primary participant agrees by submitting this proposal that, should the proposed covered transaction be entered into, it shall not knowingly enter into any lower tier covered transaction with a person who is debarred, suspended, declared ineligible, or voluntarily excluded from participation in this covered transaction, unless authorized by the department or agency entering into this transaction.
- g. The prospective primary participant further agrees by submitting this proposal that it will include the clause titled "Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion-Lower Tier Covered Transaction," provided by the department or agency entering into this covered transaction, without modification, in all lower tier covered transactions and in all solicitations for lower tier covered transactions.
- h. A participant in a covered transaction may rely upon a certification of a prospective participant in a lower tier covered transaction that is not debarred, suspended, ineligible, or voluntarily excluded from the covered transaction, unless it knows that the certification is erroneous. A participant may decide the method and frequency by which it determines the eligibility of its principals. Each participant may, but is not required to, check the nonprocurement portion of the "Lists of Parties Excluded From Federal Procurement or Nonprocurement Programs" (Nonprocurement List) which is compiled by the General Services Administration.
- i. Nothing contained in the foregoing shall be construed to require establishment of a system of records in order to render in good faith the certification required by this clause. The knowledge and information of participant is not required to exceed that which is normally possessed by a prudent person in the ordinary course of business dealings.
- j. Except for transactions authorized under paragraph f of these instructions, if a participant in a covered transaction knowingly enters into a lower tier covered transaction with a person who is suspended, debarred, ineligible, or voluntarily excluded from participation in this transaction, in addition to other remedies available to the Federal Government, the department or agency may terminate this transaction for cause or default.

2. Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion — Primary Covered Transactions:

- a. The prospective primary participant certifies to the best of its knowledge and belief, that it and its principals:
 - (1) Are not presently debarred, suspended, proposed for debarment, declared ineligible, or voluntarily excluded from covered transactions by any Federal department or agency;
 - (2) Have not within a 3-year period preceding this proposal been convicted of or had a civil judgement rendered against them for commission of fraud or a criminal offense in connection with obtaining, attempting to obtain, or performing a public (Federal, State or local) transaction or contract under a public transaction; violation of Federal or State antitrust statutes or commission of embezzlement, theft, forgery, bribery, falsification or destruction of records, making false statements, or receiving stolen property;
 - (3) Are not presently indicted for or otherwise criminally or civilly charged by a governmental entity (Federal, State or local) with commission of any of the offenses enumerated in paragraph 1b of this certification; and
 - (4) Have not within a 3-year period preceding this application/proposal had one or more public transactions (Federal, State or local) terminated for cause or default.
- b. Where the prospective primary participant is unable to certify to any of the statements in this certification, such prospective participant shall attach an explanation to this proposal.

3. Instructions for Certification - Lower Tier Covered Transactions:

(Applicable to all subcontracts, purchase orders and other lower tier transactions of \$25,000 or more - 49 CFR 29)

- a. By signing and submitting this proposal, the prospective lower tier is providing the certification set out below.
- b. The certification in this clause is a material representation of fact upon which reliance was placed when this transaction was entered into. If it is later determined that the prospective lower tier participant knowingly rendered an erroneous certification, in addition to other remedies available to the Federal Government, the department or agency with which this transaction originated may pursue available remedies, including suspension and/or debarment.
- c. The prospective lower tier participant shall provide immediate written notice to the person to which this proposal is submitted if at any time the prospective lower tier participant learns that its certification was erroneous by reason of changed circumstances.
- d. The terms "covered transaction," "debarred," "suspended," "ineligible," "primary covered transaction," "participant," "person," "principal," "proposal," and "voluntarily excluded," as used in this clause, have the meanings set out in the Definitions and Coverage sections of rules implementing Executive Order 12549. You may contact the person to which this proposal is submitted for assistance in obtaining a copy of those regulations.
- e. The prospective lower tier participant agrees by submitting this proposal that, should the proposed covered transaction be entered into, it shall not knowingly enter into any lower tier covered transaction with a person who is debarred, suspended, declared ineligible, or voluntarily excluded from participation in this covered transaction, unless authorized by the department or agency with which this transaction originated.
- f. The prospective lower tier participant further agrees by submitting this proposal that it will include this clause titled "Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion-Lower Tier Covered Transaction," without modification, in all lower tier covered transactions and in all solicitations for lower tier covered transactions.
- g. A participant in a covered transaction may rely upon a certification of a prospective participant in a lower tier covered transaction that is not debarred, suspended, ineligible, or voluntarily excluded from the covered transaction, unless it knows that the certification is erroneous. A participant may decide the method and frequency by which it determines the eligibility of its principals. Each participant may, but is not required to, check the Nonprocurement List.

- h. Nothing contained in the foregoing shall be construed to require establishment of a system of records in order to render in good faith the certification required by this clause. The knowledge and information of participant is not required to exceed that which is normally possessed by a prudent person in the ordinary course of business dealings.
- i. Except for transactions authorized under paragraph e of these instructions, if a participant in a covered transaction knowingly enters into a lower tier covered transaction with a person who is suspended, debarred, ineligible, or voluntarily excluded from participation in this transaction, in addition to other remedies available to the Federal Government, the department or agency with which this transaction originated may pursue available remedies, including suspension and/or debarment.

4. Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion — Lower Tier Covered Transactions:

- a. The prospective lower tier participant certifies, by submission of this proposal, that neither it nor its principals is presently debarred, suspended, proposed for debarment, declared ineligible, or voluntarily excluded from participation in this transaction by any Federal department or agency.
- b. Where the prospective lower tier participant is unable to certify to any of the statements in this certification, such prospective participant shall attach an explanation to this proposal.

XII. CERTIFICATION REGARDING USE OF CONTRACT FUNDS FOR LOBBYING

(Applicable to all Federal-aid construction contracts and to all related subcontracts which exceed \$100,000 - 49 CFR 20)

- 1. The prospective participant certifies, by signing and submitting this bid or proposal, to the best of his or her knowledge and belief, that:
 - a. No Federal appropriated funds have been paid or will be paid, by or on behalf of the undersigned, to any person for influencing or attempting to influence an officer or employee of any Federal agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with the awarding of any Federal contract, the making of any Federal grant, the making of any Federal loan, the entering into of any cooperative agreement, and the extension, continuation, renewal, amendment, or modification of any Federal contract, grant, loan, or cooperative agreement.
 - b. If any funds other than Federal appropriated funds have been paid or will be paid to any person for influencing or attempting to influence an officer or employee of any Federal agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with this Federal contract, grant, loan, or cooperative agreement, the undersigned shall complete and submit Standard Form-LLL, "Disclosure Form to Report Lobbying," in accordance with its instructions.
- 2. This certification is a material representation of fact upon which reliance was placed when this transaction was made or entered into. Submission of this certification is a prerequisite for making or entering into this transaction imposed by 31 U.S.C. 1352. Any person who fails to file the required certification shall be subject to a civil penalty of not less than \$10,000 and not more than \$100,000 for each such failure.
- 3. The prospective participant also agrees by submitting his or her bid or proposal that he or she shall require that the language of this certification be included in all lower tier subcontracts, which exceed \$100,000 and that all such recipients shall certify and disclose accordingly.

FEDERAL-AID FEMALE AND MINORITY GOALS

In accordance with Section II, "Nondiscrimination," of "Required Contract Provisions Federal-aid Construction Contracts" the following are the goals for female utilization:

Goal for Women (applies nationwide).....(percent) 6.9

The following are goals for minority utilization:

CALIFORNIA ECONOMIC AREA

		Goal (Percent)
174	Redding, CA: Non-SMSA Counties CA Lassen; CA Modoc; CA Plumas; CA Shasta; CA Siskiyou; CA Tehama.	6.8
175	Eureka, CA Non-SMSA Counties CA Del Norte; CA Humboldt; CA Trinity.	6.6
176	San Francisco-Oakland-San Jose, CA: SMSA Counties: 7120 Salinas-Seaside-Monterey, CA CA Monterey. 7360 San Francisco-Oakland CA Alameda; CA Contra Costa; CA Marin; CA San Francisco; CA San Mateo. 7400 San Jose, CA CA Santa Clara. 7485 Santa Cruz, CA. CA Santa Cruz. 7500 Santa Rosa, CA CA Sonoma. 8720 Vallejo-Fairfield- Napa, CA CA Napa; CA Solano Non-SMSA Counties CA Lake; CA Mendocino; CA San Benito	28.9 25.6 19.6 14.9 9.1 17.1 23.2
177	Sacramento, CA: SMSA Counties: 6920 Sacramento, CA CA Placer; CA Sacramento; CA Yolo. Non-SMSA Counties CA Butte; CA Colusa; CA El Dorado; CA Glenn; CA Nevada; CA Sierra; CA Sutter; CA Yuba.	16.1 14.3
178	Stockton-Modesto, CA: SMSA Counties: 5170 Modesto, CA CA Stanislaus. 8120 Stockton, CA CA San Joaquin. Non-SMSA Counties CA Alpine; CA Amador; CA Calaveras; CA Mariposa; CA Merced; CA Tuolumne.	12.3 24.3 19.8

	Goal (Percent)
179 Fresno-Bakersfield, CA	
SMSA Counties:	
0680 Bakersfield, CA CA Kern.	19.1
2840 Fresno, CA CA Fresno.	26.1
Non-SMSA Counties CA Kings; CA Madera; CA Tulare.	23.6
180 Los Angeles, CA:	
SMSA Counties:	
0360 Anaheim-Santa Ana-Garden Grove, CA CA Orange.	11.9
4480 Los Angeles-Long Beach, CA CA Los Angeles.	28.3
6000 Oxnard-Simi Valley-Ventura, CA CA Ventura.	21.5
6780 Riverside-San Bernardino-Ontario, CA. CA Riverside; CA San Bernardino.	19.0
7480 Santa Barbara-Santa Maria-Lompoc, CA CA Santa Barbara.	19.7
Non-SMSA Counties CA Inyo; CA Mono; CA San Luis Obispo.	24.6
181 San Diego, CA:	
SMSA Counties	
7320 San Diego, CA. CA San Diego.	16.9
Non-SMSA Counties CA Imperial.	18.2

In addition to the reporting requirements set forth elsewhere in this contract the Contractor and subcontractors holding subcontracts, not including material suppliers, of \$10,000 or more, shall submit for every month of July during which work is performed, employment data as contained under Form FHWA PR-1391 (Appendix C to 23 CFR, Part 230), and in accordance with the instructions included thereon.

FEDERAL REQUIREMENT TRAINING SPECIAL PROVISIONS

As part of the Contractor's equal employment opportunity affirmative action program, training shall be provided as follows:

The Contractor shall provide on-the-job training to develop full journeymen in the types of trades or job classification involved.

The goal for the number of trainees or apprentices to be trained under the requirements of this special provision will be 25.

In the event the Contractor subcontracts a portion of the contract work, he shall determine how many, if any, of the trainees or apprentices are to be trained by the subcontractor, provided however, that the Contractor shall retain the primary responsibility for meeting the training requirements imposed by this special provision. The Contractor shall also insure that this Training Special Provision is made applicable to such subcontract. Where feasible, 25 percent of trainees or apprentices in each occupation shall be in their first year of apprenticeship or training.

The number of trainees or apprentices shall be distributed among the work classifications on the basis of the Contractor's needs and the availability of journeymen in the various classifications within a reasonable area of recruitment. Prior to commencing work, the Contractor shall submit to the Department for approval the number of trainees or apprentices to be trained in each selected classification and training program to be used. Furthermore, the Contractor shall specify the starting time for training in each of the classifications. The Contractor will be credited for each trainee or apprentice employed by him on the contract work who is currently enrolled or becomes enrolled in an approved program and will be reimbursed for such trainees or apprentices as provided hereinafter.

Training and upgrading of minorities and women toward journeymen status is a primary objective of this Training Special Provision. Accordingly, the Contractor shall make every effort to enroll minority and women trainees or apprentices (e.g., by conducting systematic and direct recruitment through public and private sources likely to yield minority and women trainees or apprentices) to the extent such persons are available within a reasonable area of recruitment. The Contractor will be responsible for demonstrating the steps that he has taken in pursuance thereof, prior to a determination as to whether the Contractor is in compliance with this Training Special Provision. This training commitment is not intended, and shall not be used, to discriminate against any applicant for training, whether a member of a minority group or not.

No employee shall be employed as a trainee or apprentice in any classification in which he has successfully completed a training course leading to journeyman status or in which he has been employed as a journeyman. The Contractor should satisfy this requirement by including appropriate questions in the employee application or by other suitable means. Regardless of the method used the Contractor's records should document the findings in each case.

The minimum length and type of training for each classification will be as established in the training program selected by the Contractor and approved by both the Department and the Federal Highway Administration. The Department and the Federal Highway Administration will approve a program if it is reasonably calculated to meet the equal employment opportunity obligations of the Contractor and to qualify the average trainee or apprentice for journeyman status in the classification concerned by the end of the training period. Furthermore, apprenticeship programs registered with the U.S. Department of Labor, Bureau of Apprenticeship and Training, or with the State of California, Department of Industrial Relations, Division of Apprenticeship Standards recognized by the Bureau and training programs approved but not necessarily sponsored by the U.S. Department of Labor, Manpower Administration, Bureau of Apprenticeship and Training shall also be considered acceptable provided it is being administered in a manner consistent with the equal employment obligations of Federal-aid highway construction contracts. Approval or acceptance of a training program shall be obtained from the State prior to commencing work on the classification covered by the program. It is the intention of these provisions that training is to be provided in the construction crafts rather than clerk-typists or secretarial-type positions. Training is permissible in lower level management positions such as office engineers, estimators, timekeepers, etc., where the training is oriented toward construction applications. Training in the laborer classification may be permitted provided that significant and meaningful training is provided and approved by the division office. Some offsite training is permissible as long as the training is an integral part of an approved training program and does not comprise a significant part of the overall training.

Except as otherwise noted below, the Contractor will be reimbursed 80 cents per hour of training given an employee on this contract in accordance with an approved training program. As approved by the Engineer, reimbursement will be made for training of persons in excess of the number specified herein. This reimbursement will be made even though the Contractor receives additional training program funds from other sources, provided such other source does not specifically prohibit the Contractor from receiving other reimbursement. Reimbursement for offsite training indicated above may only be made to the Contractor where he does one or more of the following and the trainees or apprentices are concurrently employed on a Federal-aid project; contributes to the cost of the training, provides the instruction to the trainee or apprentice or pays the trainee's or apprentice's wages during the offsite training period.

No payment shall be made to the Contractor if either the failure to provide the required training, or the failure to hire the trainee or apprentice as a journeyman, is caused by the Contractor and evidences a lack of good faith on the part of the Contractor in meeting the requirements of this Training Special Provision. It is normally expected that a trainee or apprentice

will begin his training on the project as soon as feasible after start of work utilizing the skill involved and remain on the project as long as training opportunities exist in his work classification or until he has completed his training program. It is not required that all trainees or apprentices be on board for the entire length of the contract. A Contractor will have fulfilled his responsibilities under this Training Special Provision if he has provided acceptable training to the number of trainees or apprentices specified. The number trained shall be determined on the basis of the total number enrolled on the contract for a significant period.

Only trainees or apprentices registered in a program approved by the State of California's State Administrator of Apprenticeship may be employed on the project and said trainees or apprentices shall be paid the standard wage specified under the regulations of the craft or trade at which they are employed.

The Contractor shall furnish the trainee or apprentice a copy of the program he will follow in providing the training. The Contractor shall provide each trainee or apprentice with a certification showing the type and length of training satisfactorily completed.

The Contractor will provide for the maintenance of records and furnish periodic reports documenting his performance under this Training Special Provision.