

DEPARTMENT OF TRANSPORTATION
DIVISION OF ENGINEERING SERVICES
OFFICE ENGINEER, MS 43
1727 30TH STREET
P.O. BOX 168041
SACRAMENTO, CA 95816-8041
FAX (916) 227-6214
TTY 711



*Flex your power!
Be energy efficient!*

April 12, 2010

11-Imp-8-R31.3
11-261514

Addendum No. 1

Dear Contractor:

This addendum is being issued to the contract for CONSTRUCTION ON STATE HIGHWAY IN IMPERIAL COUNTY NEAR EL CENTRO AT SUNBEAM REST AREAS (EASTBOUND AND WESTBOUND).

Submit bids for this work with the understanding and full consideration of this addendum. The revisions declared in this addendum are an essential part of the contract.

Bids for this work will be opened on Thursday, April 29, 2010.

This addendum is being issued to revise the Project Plans and the Notice to Bidders and Special Provisions.

Project Plan Sheets 1, 58 and 61 are revised. Copies of the revised sheets are attached for substitution for the like-numbered sheets.

In the Notice to Bidders and Special Provisions, in the Registered Persons signature and seal sheet, the signature and seal sheets are added as attached.

In the Special Provisions, Section 12-2.06, "SEPTIC SEWAGE TREATMENT SYSTEM," subsection "PART 2 - PRODUCTS," subsection "SEPTIC TANK," subheading "Septic, Recirculation, and Effluent Storage Tanks," the first paragraph is revised as follows:

"Septic tanks, recirculation tank, and effluent storage tank shall be factory manufactured fiberglass cylindrical tanks meeting the standards of UL: 1316 with single wall construction. The tanks shall have fiberglass cloth reinforcing. The tanks shall be designed for H-20 loading at a depth of 7-feet and listed and approved by the International Association of Plumbing and Mechanical Officials (IAPMO) and marked accordingly, or the design shall be stamped and certified by a California Registered Engineer as meeting the general industry standards necessary to comply with these standards."

In the Special Provisions, Section 12-2.06, "SEPTIC SEWAGE TREATMENT SYSTEM," subsection "PART 2 - PRODUCTS," subsection "SEPTIC TANK," subheading "Septic, Recirculation, and Effluent Storage Tanks," the fourth paragraph is revised as follows:

"Manufacturers shall warrant the tanks not to fail from internal or exterior corrosion for a period of 1 year from date of purchase. The warranty shall not contain disclaimers for the influent constituents specified to be removed."

In the Special Provisions, Section 12-2.07, "RECIRCULATING SAND FILTER SYSTEM," subsection "PART 2 - PRODUCTS," the twelfth paragraph is revised as follows:

"Risers: Risers for the recirculating sand filter shall be as shown on the plans, a minimum of 12" in nominal diameter. The risers shall be buried to the depth as shown on the plans. Risers shall extend 3" above the original grade to allow for settlement and to ensure positive drainage away from the riser. To ensure product compatibility, risers, covers, and attachment components shall be supplied by a single manufacturer."

11-Imp-8-R31.3
11-261514

In the Special Provisions, Section 12-2.07, "RECIRCULATING SAND FILTER SYSTEM," subsection "PART 2 - PRODUCTS," the sixteenth paragraph is revised as follows:

"Distribution Valve: Distribution valve shall have a 1.5-inch inlet and five 1.5-inch outlet valves and made of PVC. The distribution valve shall have a flow range to 150 gpm, a pressure rating up to 150 psi, and be made of high strength non-corrosive ABS polymer. Distribution valve shall be installed inside a PVC riser and PVC watertight insulated riser cover."

In the Special Provisions, Section 12-11.01, "EFFLUENT TURBINE DUPLEX FILTERED PUMP SYSTEM," subsection "PART 2 - PRODUCTS," subsection "COMPONENTS," subheading "Septic Tank, Urinal Septic Tank, and Effluent Storage Tank Control Panels;," Item No. 2 under the tenth paragraph is revised as follows:

"2. NEMA-4X, padlockable latch, deadfront with inner door and weather tight enclosure and including a cooling system for the control panel."

In the Special Provisions, Section 12-11.01, "EFFLUENT TURBINE DUPLEX FILTERED PUMP SYSTEM," subsection "PART 2 - PRODUCTS," subsection "COMPONENTS," subheading "Recirculation Tank Control Panel;," Item No. 2 under the eleventh paragraph is revised as follows:

"2. NEMA-4X, padlockable latch, deadfront with inner door and weather tight enclosure and including a cooling system for the control panel."

To Bid book holders:

Inquiries or questions in regard to this addendum must be communicated as a bidder inquiry and must be made as noted in the Notice to Bidders section of the Notice to Bidders and Special Provisions.

Indicate receipt of this addendum by filling in the number of this addendum in the space provided on the signature page of the Bid book.

Submit bids in the Bid book you now possess. Holders who have already mailed their book will be contacted to arrange for the return of their book.

Inform subcontractors and suppliers as necessary.

Addendum No. 1
Page 3
April 12, 2010

11-Imp-8-R31.3
11-261514

This addendum and attachments are available for the Contractors' download on the Web site:

http://www.dot.ca.gov/hq/esc/oe/project_ads_addenda/11/11-261514

If you are not a Bid book holder, but request a book to bid on this project, you must comply with the requirements of this letter before submitting your bid.

Sincerely,

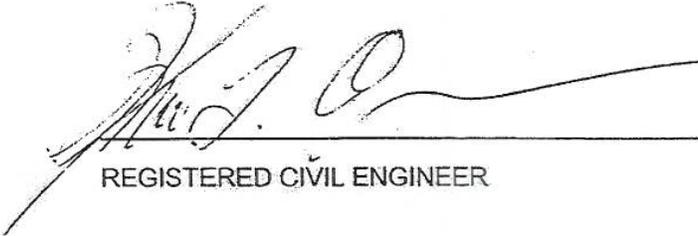
ORIGINAL SIGNED BY

IGNACIO SANCHEZ DEL REAL
Acting Office Chief
Office of Plans, Specifications & Estimates
Office Engineer
Division of Engineering Services

Attachment

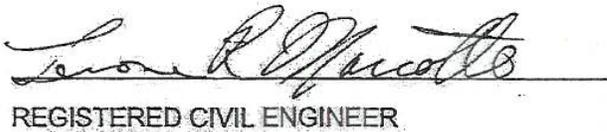
CONTRACT NO. 11-261514

**The special provisions contained herein
have been prepared by or under the
direction of the following Registered Persons.
STRUCTURES**


REGISTERED CIVIL ENGINEER

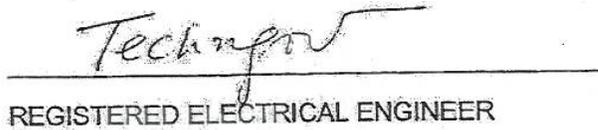


WATER AND WASTEWATER


REGISTERED CIVIL ENGINEER



ELECTRICAL (STRUCTURES)


REGISTERED ELECTRICAL ENGINEER



MECHANICAL


REGISTERED MECHANICAL ENGINEER

