



FRONT VIEW
SIDE VIEW
TYPE III-CF SERVICE EQUIPMENT ENCLOSURE (TYPICAL)
DETAIL A

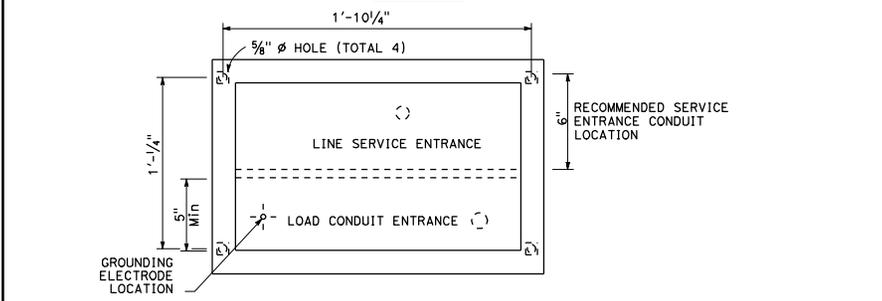

BASE FOR TYPE III-C SERVICE EQUIPMENT ENCLOSURE
DETAIL B

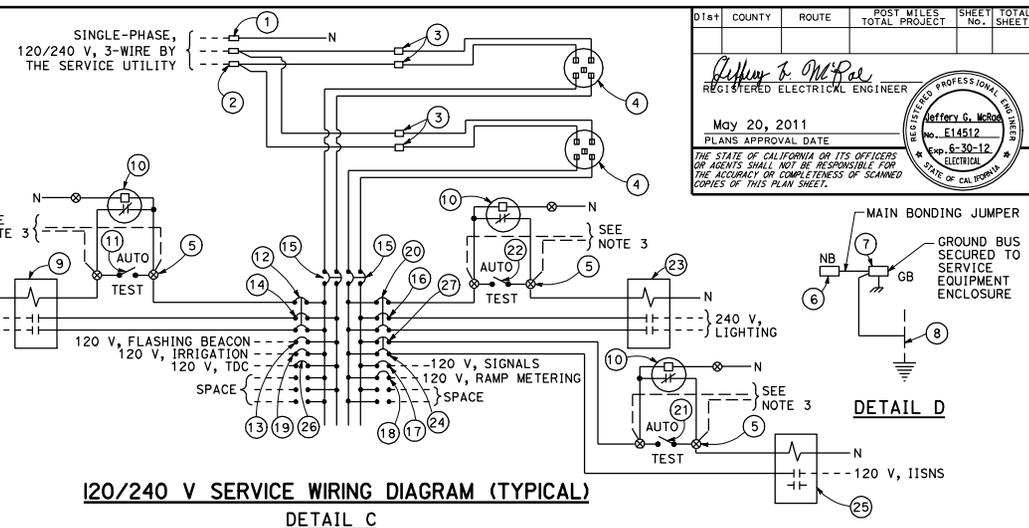

120/240 V SERVICE WIRING DIAGRAM (TYPICAL)
DETAIL C

TYPE III-C SERVICE EQUIPMENT ENCLOSURE LEGEND (120/240 V)

ITEM	COMPONENT	NAMEPLATE DESCRIPTION	ITEM	COMPONENT	NAMEPLATE DESCRIPTION
(1)	NEUTRAL LUG		(14)	30 A, 240 V, 2P, CB	SIGN ILLUMINATION
(2)	LANDING LUG (NOTE 6)		(15)	100 A, 240 V, 2P, CB	MAIN BREAKER
(3)	TEST BYPASS FACILITY		(16)	30 A, 240 V, 2P, CB	LIGHTING
(4)	METER SOCKET AND SUPPORT		(17)	50 A, 120 V, 1P, CB	SIGNALS
(5)	TERMINAL BLOCKS		(18)	30 A, 120 V, 1P, CB	RAMP METERING
(6)	NEUTRAL BUS		(19)	20 A, 120 V, 1P, CB	IRRIGATION
(7)	GROUND BUS		(20)	15 A, 120 V, 1P, CB	LIGHTING CONTROL
(8)	GROUNDING ELECTRODE		(21)	15 A, 1P, TEST SWITCH	IISNS TEST SWITCH
(9)	30 A, 2P, NO CONTACTOR	SIGN ILLUMINATION	(22)	15 A, 1P, TEST SWITCH	LIGHTING TEST SWITCH
(10)	PHOTOELECTRIC UNIT (NOTE 7)	PEU	(23)	60 A, 2P, NO CONTACTOR	LIGHTING
(11)	15 A, 1P, TEST SWITCH	SIGN ILLUMINATION TEST SWITCH	(24)	15 A, 120 V, 1P, CB	IISNS
(12)	15 A, 120 V, 1P, CB	SIGN ILLUMINATION CONTROL	(25)	30 A, 2P, NO CONTACTOR	IISNS
(13)	15 A, 120 V, 1P, CB	FLASHING BEACON	(26)	20 A, 120 V, 1P, CB	TELEPHONE DEMARCATION CABINET
			(27)	15 A, 120 V, 1P, CB	IISNS CONTROL

- NOTES:**
- Voltage ratings of service equipment shall conform to the service voltages indicated on the plans.
 - Unless otherwise indicated on the plans, service equipment items shall be provided for each service equipment enclosure as shown.
 - Connect to remote test switch mounted on lighting standards, sign post or structure when required.
 - Items (1) and (6) shall be isolated from the service equipment enclosure.
 - Meter sockets shall be 5 clip type.
 - The landing lug shall be suitable for multiple conductors.
 - Type I photoelectric control shall be used unless otherwise indicated on the plans.
 - Item (2), (20) and (27) shall be ganged operated CB.

D16+	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET TOTAL SHEETS
------	--------	-------	--------------------------	--------------------

May 20, 2011
 PLANS APPROVAL DATE
 THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

Jeffery G. McFar
 REGISTERED ELECTRICAL ENGINEER
 No. E14512
 Exp. 6-30-12
 PROFESSIONAL ENGINEER
 STATE OF CALIFORNIA

STATE OF CALIFORNIA
 DEPARTMENT OF TRANSPORTATION
ELECTRICAL SYSTEMS
(SERVICE EQUIPMENT ENCLOSURE AND
TYPICAL WIRING DIAGRAM
TYPE III-C SERIES)

NO SCALE