




**CASE A**

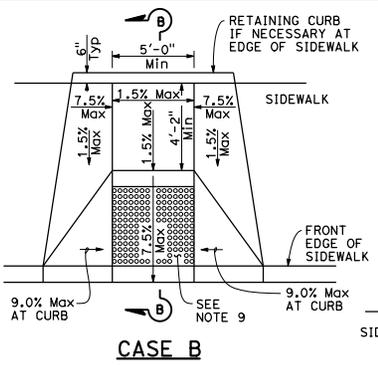


**CASE B**

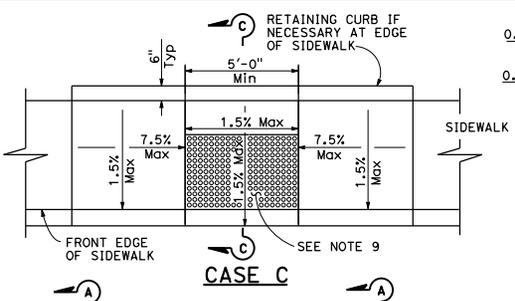


**CASE C**

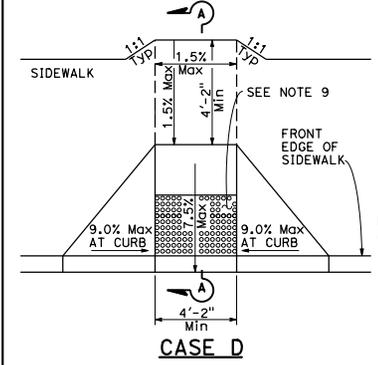


**CASE D**

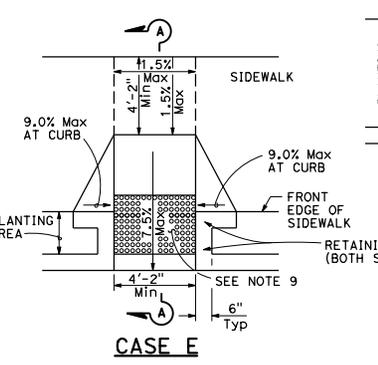


**CASE E**

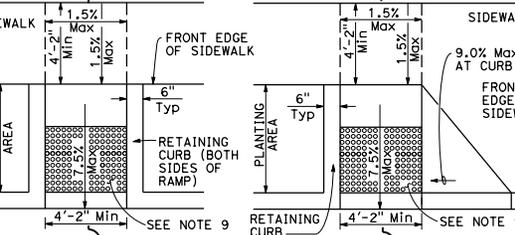


**CASE F**

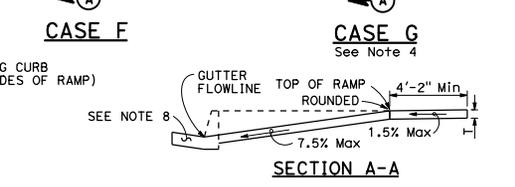


**CASE G**

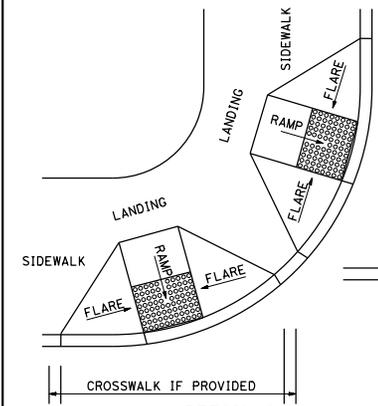


**DETAIL A**

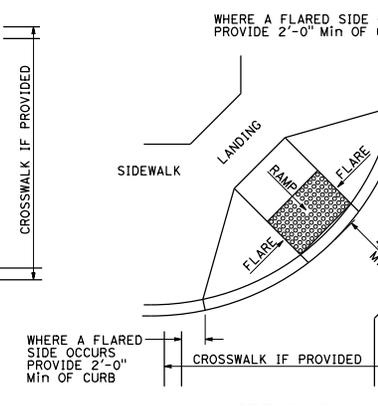


**DETAIL B**

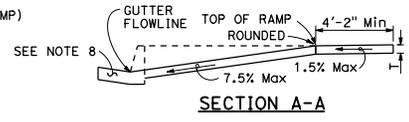


**SECTION A-A**

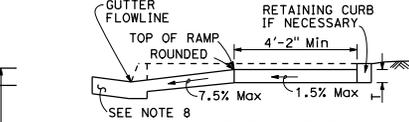


**SECTION B-B**

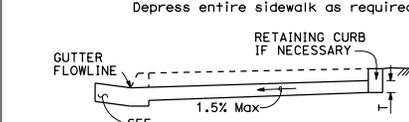

**SECTION C-C**

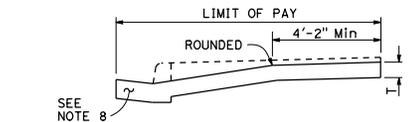

**RETOFIT PAY LIMITS**



**RAISED TRUNCATED DOME**

**NOTES:**

1. As site conditions dictate, Case A through Case G curb ramps may be used for corner installations similar to those shown in Detail A and Detail B. The case of curb ramps used in Detail A do not have to be the same. Case A through Case G curb ramps also may be used at mid block locations, as site conditions dictate.
2. If distance from curb to back of sidewalk is too short to accommodate ramp and 4'-2" platform (landing) as shown in Case A, the sidewalk may be depressed longitudinally as in Case B or C or may be widened as in Case D.
3. When ramp is located in center of curb return, crosswalk configuration must be similar to that shown for Detail B.
4. As site conditions dictate, the retaining curb side and the flared side of the Case G ramp shall be constructed in reversed position.
5. If located on a curve, the sides of the ramp need not be parallel, but the minimum width of the ramp shall be 4'-2".
6. Side slope of ramp flares vary uniformly from a maximum of 9.0% at curb to conform with longitudinal sidewalk slope adjacent to top of the ramp, except in Case C and Case F.
7. Transitions from ramps and landing to walks, gutters or streets shall be flush (no lip) and free of abrupt changes.
8. Counter slopes of adjoining gutters and road surfaces immediately adjacent to and within 24 inches of the curb ramp shall not be steeper than 1V:20H (5.0%). Gutter pan slope shall not exceed 1" of depth for each 2'-0" of width.
9. Curb ramps shall have a detectable warning surface that extends the full width and 3'-0" depth of the ramp. A 4'-0" wide detectable warning surface may be used on a 4'-2" wide curb ramp. Detectable Warning Surfaces shall conform to the requirements in the Standard Specifications.
10. Sidewalk and ramp thickness, "T", shall be 3/2" minimum.
11. Utility pull boxes, manholes, vaults and all other utility facilities within the boundaries of the curb ramp will be relocated or adjusted to grade by the owner prior to, or in conjunction with, curb ramp construction.
12. Detectable warning surface may have to be cut to allow removal of utility covers while maintaining full detectable warning width and depth.



**RAISED TRUNCATED DOME PATTERN (IN-LINE)  
DETECTABLE WARNING SURFACE**

See Note 9

STATE OF CALIFORNIA  
DEPARTMENT OF TRANSPORTATION  
**CURB RAMP DETAILS**

NO SCALE

**A88A**

Dist#	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET TOTAL SHEETS

*H. David Cordova*  
REGISTERED CIVIL ENGINEER

October 30, 2015  
PLANS APPROVAL DATE

THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

REGISTERED PROFESSIONAL ENGINEER  
Hector David Cordova  
No. C41957  
Exp. 3-31-16  
CIVIL  
STATE OF CALIFORNIA