DIST	COUNTY	ROUTE	KILOMETER POST TOTAL PROJECT	SHEET No	TOTAL SHEETS
04	SF	80	13.2/13.9	61R1	1204

Caltrans Metric

Robert E. Bethel
REGISTERED MECHANICAL ENGINEER

12-6-04
PLANS APPROVAL DATE

REGISTERED PROFESSIONAL ENGINEER
ROBERT E. BETHEL
No. M018543
Exp. 9/30/06
MECHANICAL
STATE OF CALIFORNIA

T.Y. LIN / MOFFATT & NICHOL
825 BATTERY STREET
SAN FRANCISCO, CA 94111

The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.

Caltrans now has a web site! To get to the web site, go to http://www.dot.ca.gov

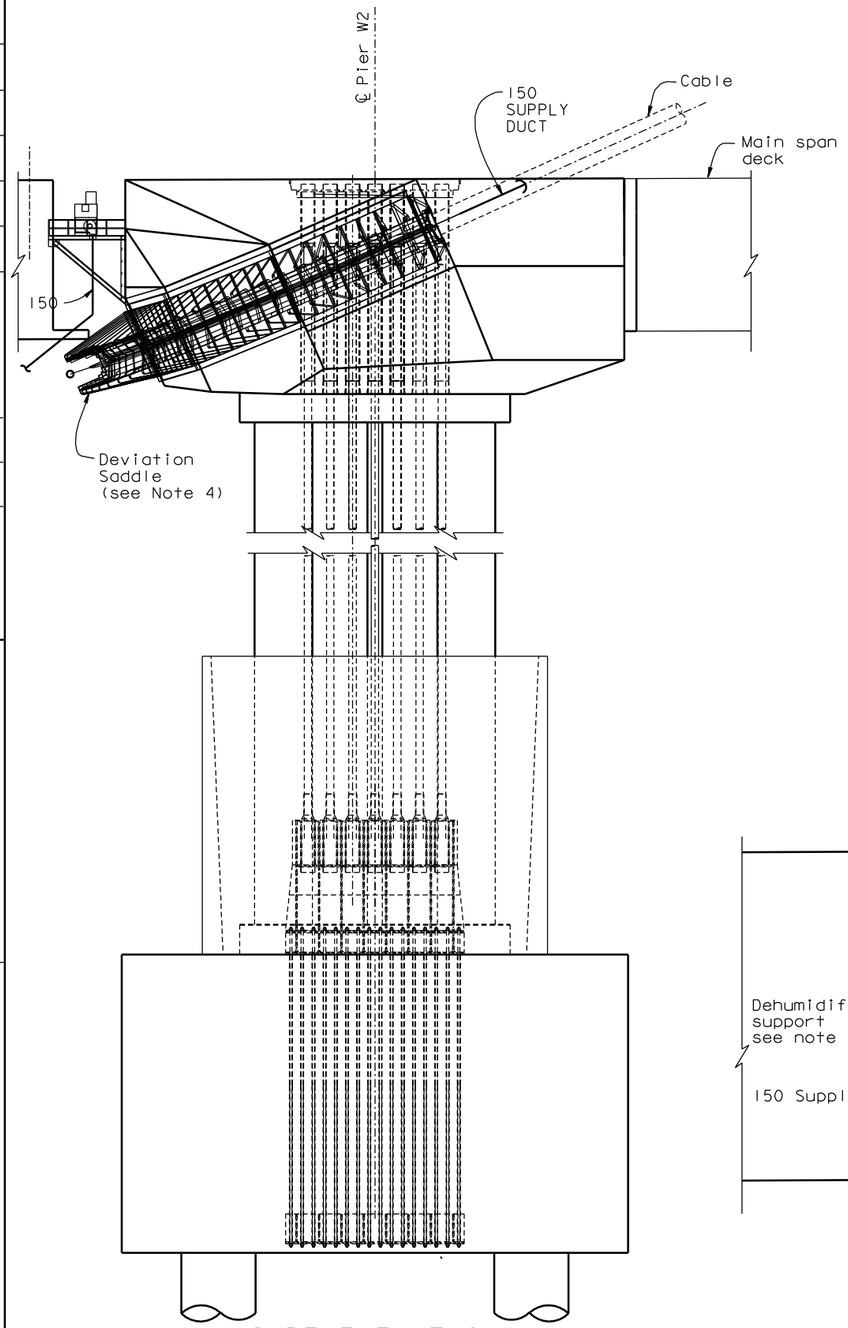

SIDE ELEVATION
1:100

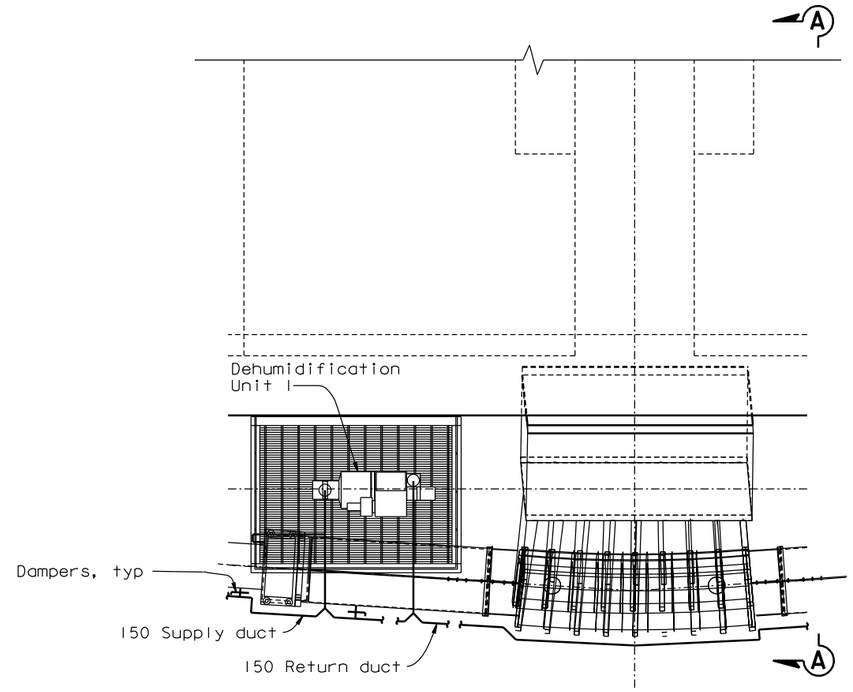

DETAIL A
1:80

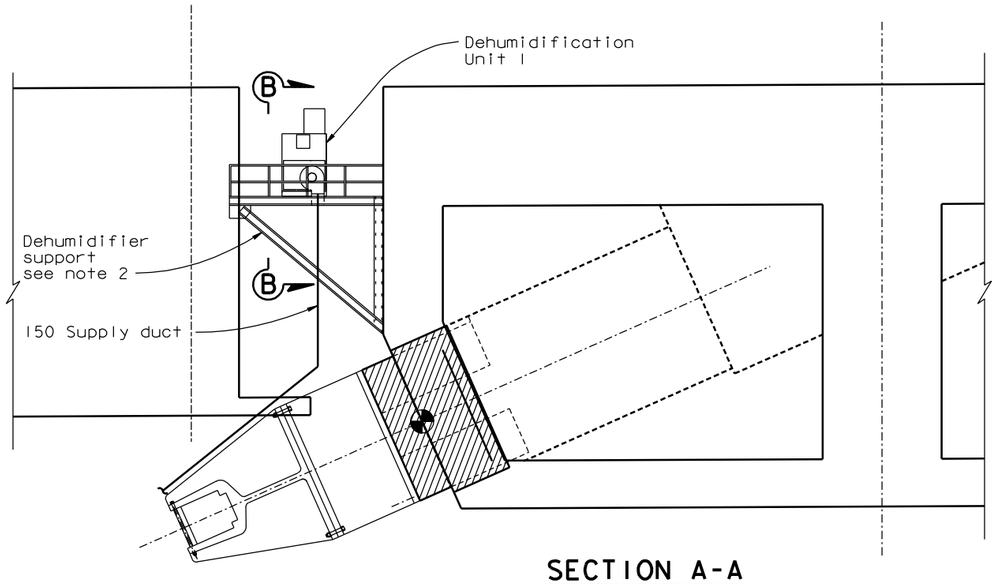

SECTION A-A
1:50

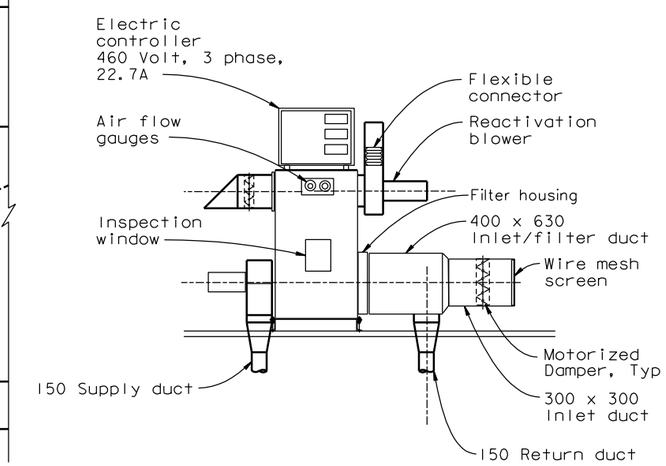

SECTION B-B (See Note 5) 1
1:20

REGISTERED PROFESSIONAL ENGINEER
Jal N. Birdy
No. C 41547
Exp. 12/31/07
CIVIL
STATE OF CALIFORNIA

FOR REVISIONS ONLY

MARK	DATE	DESCRIPTIONS	BY	CH'D	CCO#
1	05/23/07	DEHUMIDIFICATION SYSTEM	JB	AS	32

REVISIONS

CONTRACT CHANGE ORDER NO. ____
SHEET ____ OF ____

NOTES:

1. For location of Detail A, see "West Cable Anchorage Dehumidification Detail No.1" sheet.
2. For dehumidifier support, see Bridge Plans.
3. For duct connection to cable shroud, see Bridge Plans.
4. Views of deviation saddle are for illustration only. For deviation saddle details, see "West Deviation Saddle Details" sheets.
5. Exhaust shall be oriented away from service personnel. Exhast duct may be extended out or down. It may also be extended up, provided a rain hood is used.

WEST CABLE ANCHORAGE DEHUMIDIFICATION DETAIL NO. 2

ALL DIMENSION ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN

M-25

SAS STRUCTURE

STATE OF CALIFORNIA - DEPARTMENT OF TRANSPORTATION

Caltrans

DESIGN OVERSIGHT: Bob Zandipour

CALCULATED/DESIGNED BY: ES | DATE: 5/3/02 | REVISED BY
CHECKED BY: RB | 5/3/02 | DATE REVISED

DATE PLOTTED => 21 MAY 2007
TIME PLOTTED => 11:31:39

LAST REVISION 00-00-00

FOR REDUCED PLANS ORIGINAL SCALE IS IN MILLIMETERS 0 20 40 60 80

FILE => I:\bb\04-012001\sas\contract plans and cco\cco\in progress\cco#32\40120fub025.dgn
USERNAME => vignatovsky
CU 04251
EA 0120F1