



STATE OF CALIFORNIA - DEPARTMENT OF TRANSPORTATION	DESIGN OVERSIGHT	CALCULATED/DESIGNED BY	RG	DATE	REVISD BY
Caltrans	BEHZAD GOLEMOHAMMADI	CHECKED BY	RR	7/07	DATE REVISED

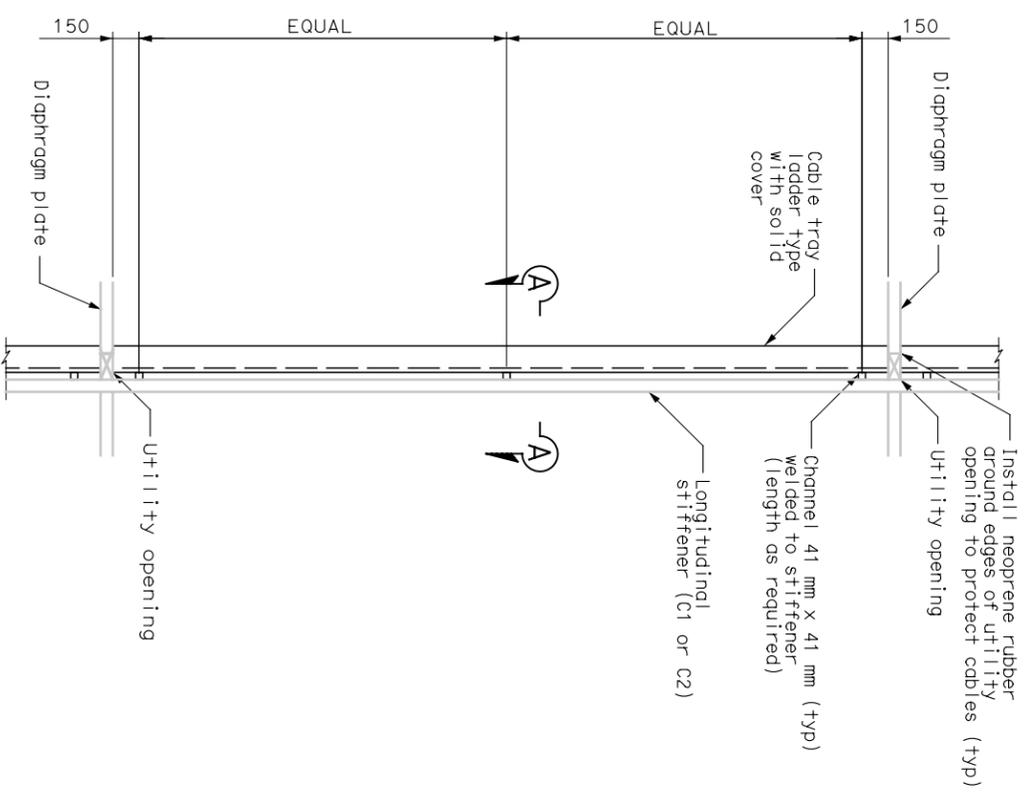


DETAIL 1
ELEVATION VIEW

TOWER CABLE TRAY
TYPICAL INSTALLATION
SCALE: 1:20

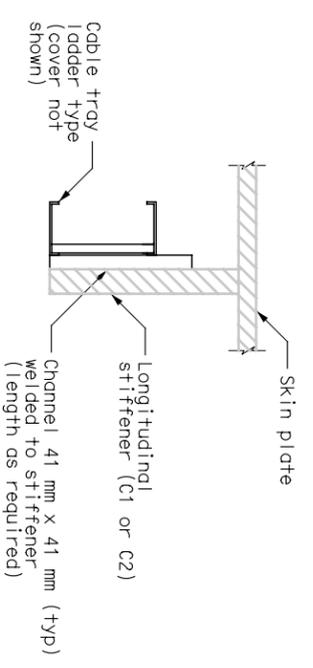


SECTION A-A

SCALE: 1:10

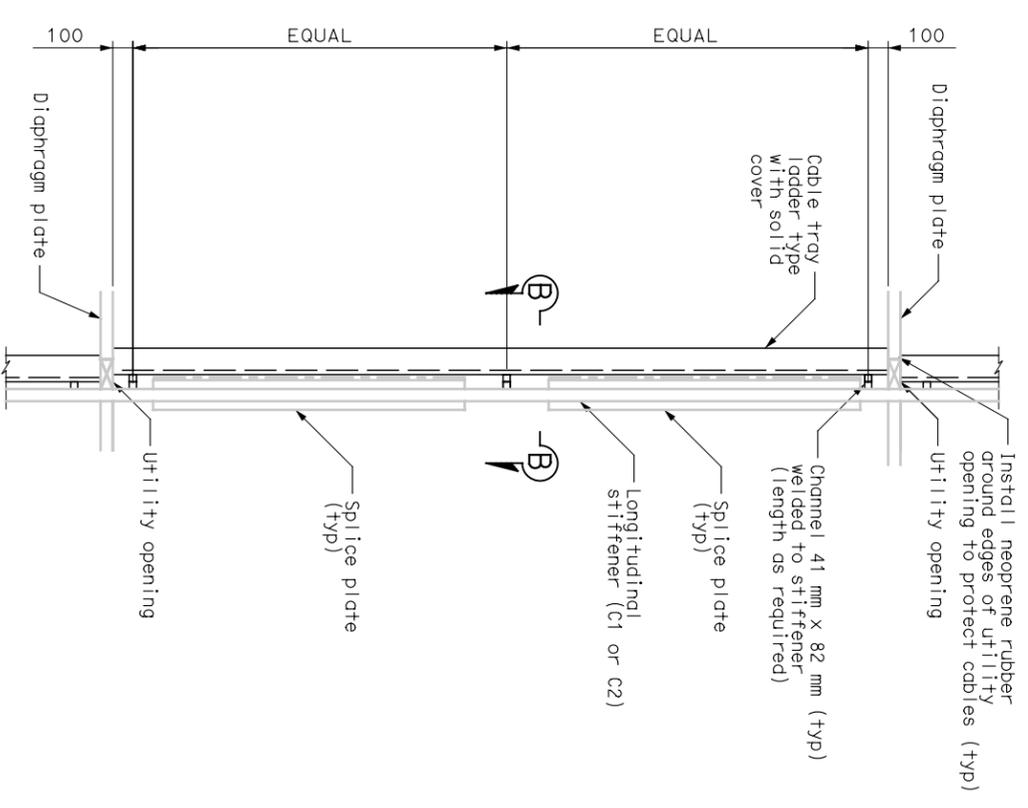


DETAIL 2
ELEVATION VIEW

TOWER CABLE TRAY
TYPICAL INSTALLATION
ALONG SPLICE PLATE
SCALE: 1:20

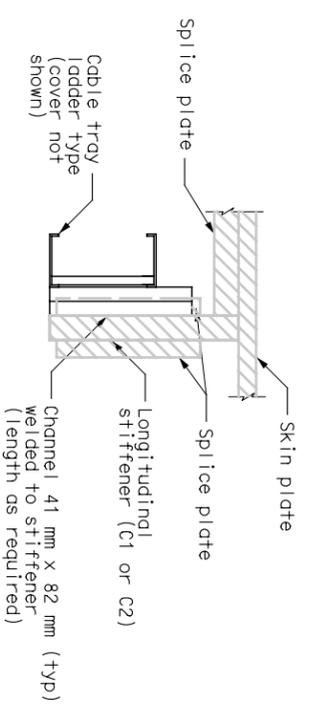

SECTION B-B

SCALE: 1:10

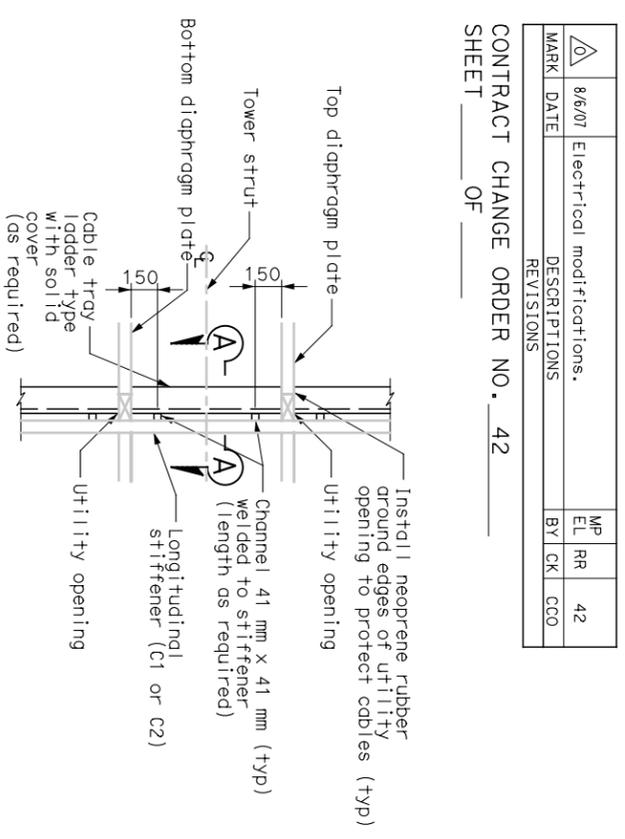

DETAIL 3
ELEVATION VIEW

TOWER CABLE TRAY
TYPICAL INSTALLATION
ALONG TOWER STRUT AREA
SCALE: 1:20

NOTES:

1. TOS/Communication cable trays shall be installed along C2 stiffeners.
2. 600V cable trays shall be installed along C1 stiffeners.
3. See Sheets E-270B AND E-270C for cable trays location.

DETAILS
TOWER AND SUSPENSION CABLE
CABLE TRAY LOCATION

SCALE AS NOTED

E-270A



DIST	COUNTY	ROUTE	KILOMETER POST TOTAL PROJECT	SHEET NO.	TOTAL SHEETS
04	SF	80	13.2/13.9	27551R01	1204

REGISTERED ELECTRICAL ENGINEER DATE 8/24/07
 REGISTERED PROFESSIONAL ENGINEER
 MARVEL TAMM
 9/29/2008
 E 8851
 STATE OF CALIFORNIA
 ELECTRICAL ENGINEER

PLANS APPROVAL DATE
 PB POWER, Inc.
 A Parsons Brinckerhoff Company
 303 Second St., Suite 700N
 San Francisco, CA 94107-1317

The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.
 Caltrans now has a web site. To get to the web site, go to <http://www.adot.ca.gov>

REVISIONS	MP	EL	RR	42
MARK	DATE	DESCRIPTIONS	BY	CK
8/6/07		Electrical modifications.		

CONTRACT CHANGE ORDER NO. 42
 SHEET ___ OF ___

ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN.
 FOR REDUCED PLANS ORIGINAL SCALE 1:5 IN MILLIMETERS

DGN FILE => I:\3103\ms\pse\ssas_s\truc\cc0\ssas_cc042\04-0120F1_027\ss1r0.dgn
 USERNAME => xantonio

CU 04251
 EA 0120F1