STATE OF CALIFORNIA - DEPARTMENT OF TRANSPORTATION	DESIGN OVERSIGHT	CALCULATED/ DESIGNED BY	RG	DATE 3/07	REVISED BY
Caltrans	BEHZAD GOLEMOHAMMADI	CHECKED BY	RR	7/07	DATE REVISED

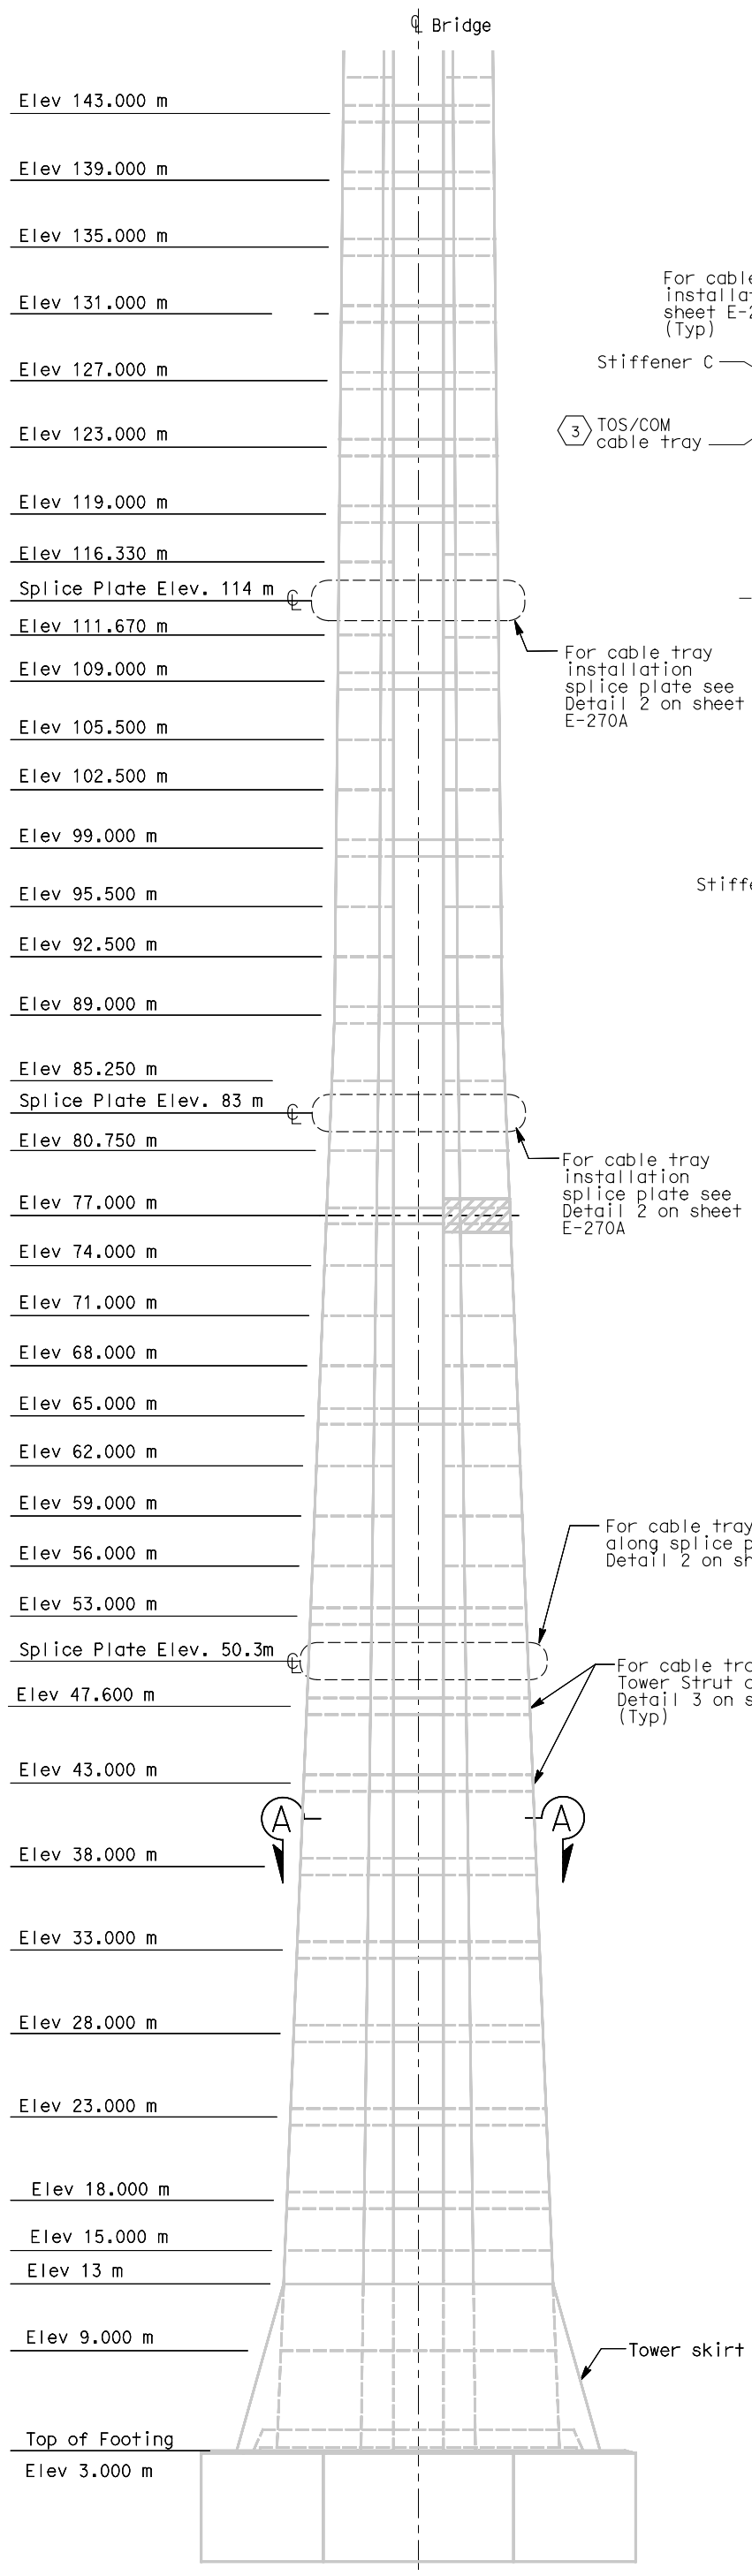

ELEVATION VIEW
1:250

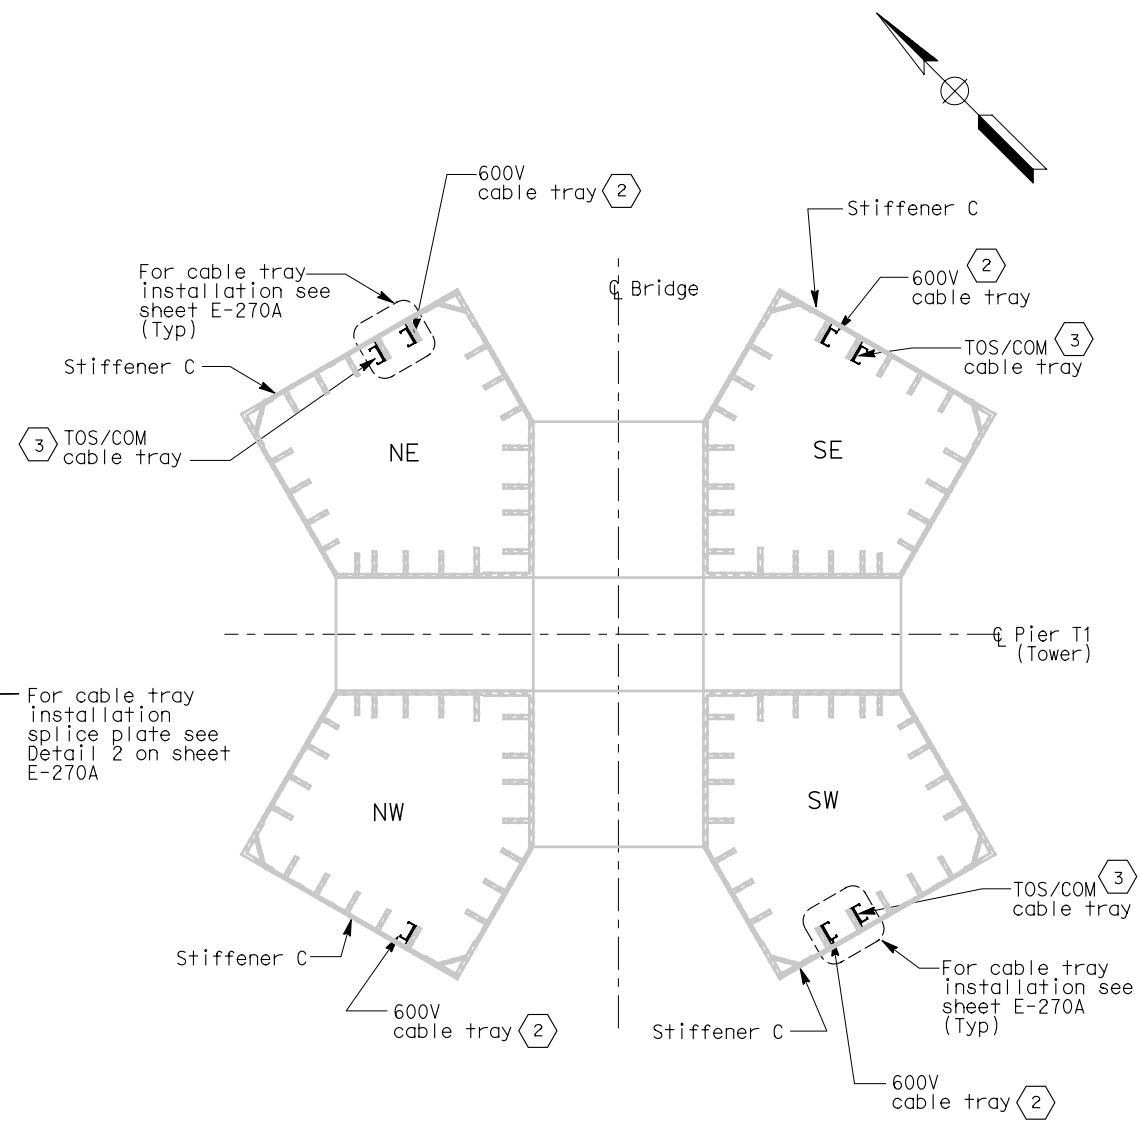

SECTION A-A 1 4
CABLE TRAY LAYOUT PLAN
NO SCALE

MARK	DATE	DESCRIPTIONS	BY	CK
0	8/6/07	Electrical modifications.	MP EL	RR
		REVISIONS		CCO

CONTRACT CHANGE ORDER NO. 42
SHEET ____ OF ____

SHEET NOTE:

1. For cable tray tag numbers see sheet E-270B.
2. 600V cable trays shall be installed along C1 stiffeners.
3. TOS/COM cable trays shall be installed along C2 stiffeners.
4. All cable tray installed in the tower shall be ladder type with cover.

NOTE:

1. Reference:
   For conduit and cable tray schedule see sheets starting at E-401.

Caltrans Electric

REGISTERED ELECTRICAL ENGINEER 8/24/07 DATE

PLANS APPROVAL DATE

PB POWER, Inc.
A Parsons Brinckerhoff Company
303 Second St., Suite 700N
San Francisco, CA 94107-1317

REGISTERED PROFESSIONAL ENGINEER MAXWELL FUMIO TAKAKI No. E 8651 Exp. 9/30/2008 ELECTRICAL STATE OF CALIFORNIA

The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.

Caltrans now has a web site! To get to the web site, go to http://www.dot.ca.gov

DIST	COUNTY	ROUTE	KILOMETER POST TOTAL PROJECT	SHEET No	TOTAL SHEETS
04	SF	80	13.2/13.9	275S3R0	1204

ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN.

FOR REDUCED PLANS ORIGINAL SCALE IS IN MILLIMETERS 0 20 40 60 80

DGN FILE =>t:\13103\ms\pse\sgs struc\cco\sgs cco42\04-0120f1_027\5s3r0.dgn
USERNAME =>antonio

DETAILS
TOWER AND SUSPENSION CABLE CABLE TRAY LOCATION
SCALE AS NOTED

E-270C

CU 04251 EA 0120F1

LAST REVISION 00-00-00
DATE PLOTTED => 11/16/2007
TIME PLOTTED => 9:42:40 AM