


DIST	COUNTY	ROUTE	KILOMETER POST TOTAL PROJECT	SHEET No	TOTAL SHEETS
04	SF	80	13.2/13.9	191R1	1204

Jens Erlingsson 12/19/02
 REGISTERED ELECTRICAL ENGINEER DATE
 12-6-04
 PLANS APPROVAL DATE
PB POWER, Inc.
 A Parsons Brinckerhoff Company
 303 Second St., Suite 700N
 San Francisco, CA 94107-1317

The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.
 Caltrans now has a web site! To get to the web site, go to: <http://www.dot.ca.gov>

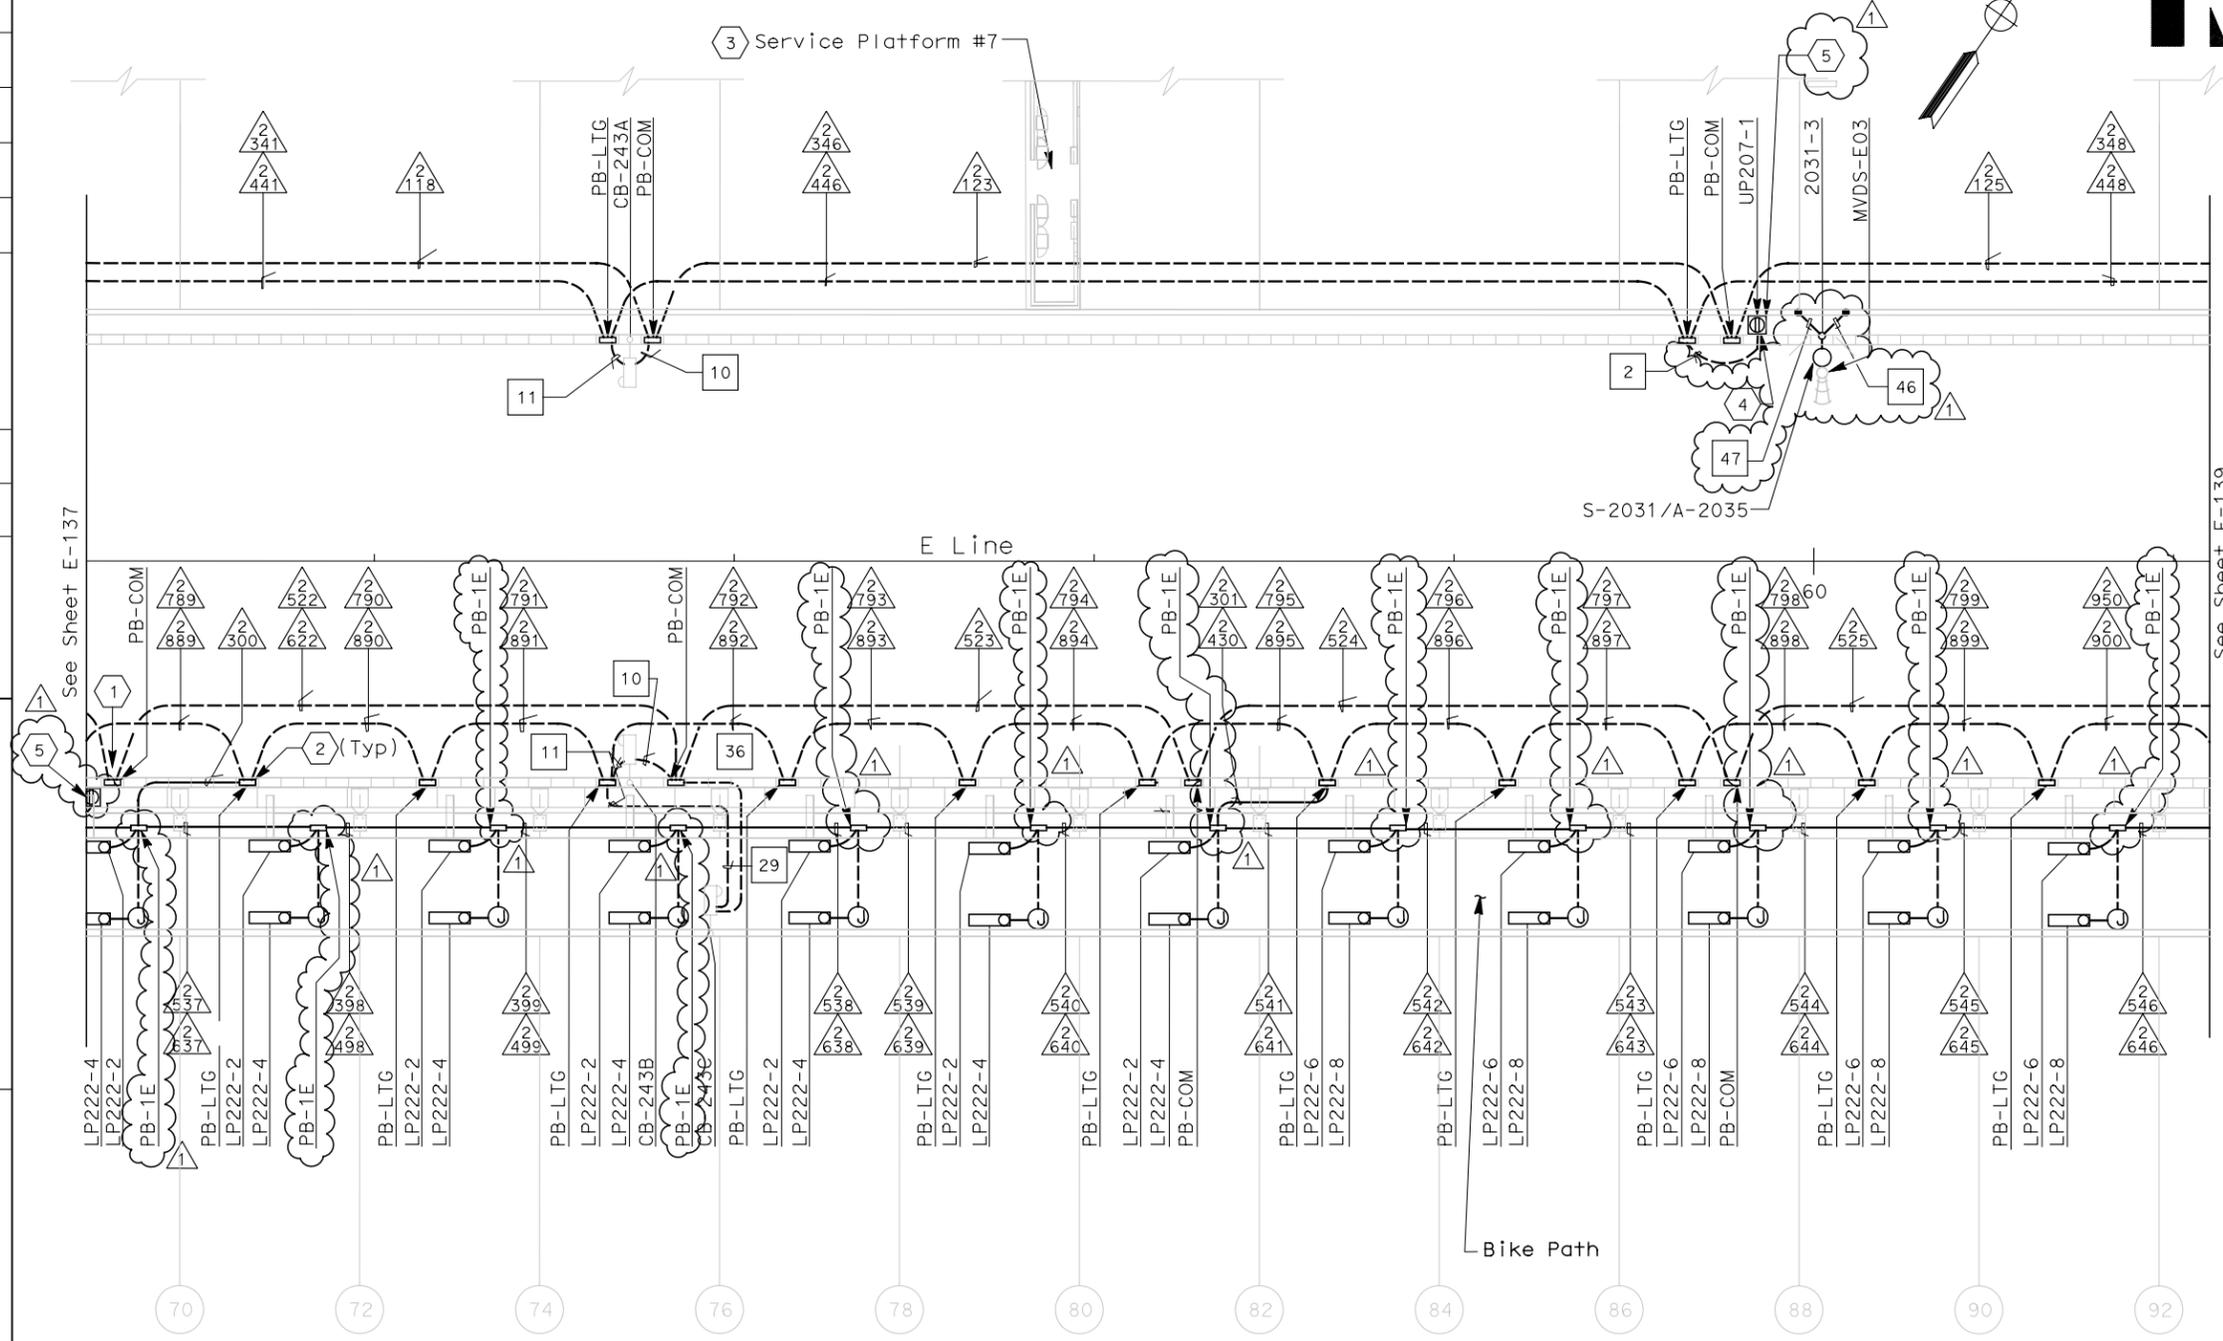

- SHEET NOTES:**
- ① Conduit from barrier pullbox or other equipment down into Girder Box, see sheet E-184.
 - ② For conduit to tower and suspension cable lighting, see sheet E-229.
 - ③ Contractor shall furnish and install UP-207 and LP-222 per sheet E-74. For complete scope of work on platform and other related work not shown on this sheet, see Electrical Special Provisions.
 - ④ Conduit down to girder for MVDS, see sheet E-184.
 - ⑤ Roadway Barrier Receptacle, see Detail 1, sheet E-162.

- NOTES:**
1. References:
 - For typical details and locations of conduit connections to light poles, barrier outlet boxes, call boxes, overhead sign lighting, CMS, CCTV and MVDS, see sheets E-160 thru E-162 and E-169.
 - TOS equipment is shown for conduit routing only. For typical details of TOS controller and devices, see sheets E-344 through E-357.
 - For types of pull boxes, splice boxes and enclosures, see sheet E-169.
 - For circuit and conduit/cable tray schedules, see sheets starting at E-401.
 2. For Roadway Level Call Boxes, refer to sheet E-396.
 3. For Roadway level, Bike Path and Belvedere Lighting Fixture Schedules, see sheets E-146, E-147 and E-165.
 4. For Roadway level and Bike Path Call Box Schedule, see sheet E-397.
 5. For number of lighting fixtures (main tower lights) see lighting schedule sheets E-271 and E-272.
 6. All conduits and fittings routed exposed between the Bike Path and the roadway shall be galvanized rigid steel, PVC coated.
 7. See sheets E-160 thru E-165 for conduit locations.

SAS SUPERSTRUCTURE - CONDUIT PLAN

SAS SUPERSTRUCTURE ROADWAY EASTBOUND LIGHTING AND ELECTRICAL SYSTEMS

SCALE 1:200

MARK	DATE	DESCRIPTIONS	MP EL	RR	CCO
1	8-06-07	Electrical modifications.			42



Hannell Fumio Takaki
 FOR REVISION ONLY

CONTRACT CHANGE ORDER NO. 42
 SHEET ____ OF ____

THIS PLAN ACCURATE FOR ELECTRICAL WORK ONLY.

ALL DIMENSIONS ARE IN METERS UNLESS OTHERWISE SHOWN
 FOR REDUCED PLANS ORIGINAL SCALE IS IN MILLIMETERS

DGN FILE => \13103\ms\pse\sas struc\cco\sas cco42\04-0120f1_0191r01.dgn
 USERNAME => USER
 CU 04251

EA 0120F1

DATE PLOTTED => 12/19/2007
 TIME PLOTTED => \$TIME
 LAST REVISION 00-00-00