

DIST	COUNTY	ROUTE	KILOMETER POST TOTAL PROJECT	SHEET No	TOTAL SHEETS
04	SF	80	13.2/13.9	192R1	1204

Jens Erlingsson 12/19/02
 REGISTERED ELECTRICAL ENGINEER DATE


12-6-04
 PLANS APPROVAL DATE

PB POWER, Inc.
 A Parsons Brinckerhoff Company
 303 Second St., Suite 700N
 San Francisco, CA 94107-1317

Jens Erlingsson
 REGISTERED PROFESSIONAL ENGINEER
 No. 8249
 Exp. 9/30/06
 ELECTRICAL
 STATE OF CALIFORNIA

The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.

To get to the web site, go to: <http://www.dot.ca.gov>

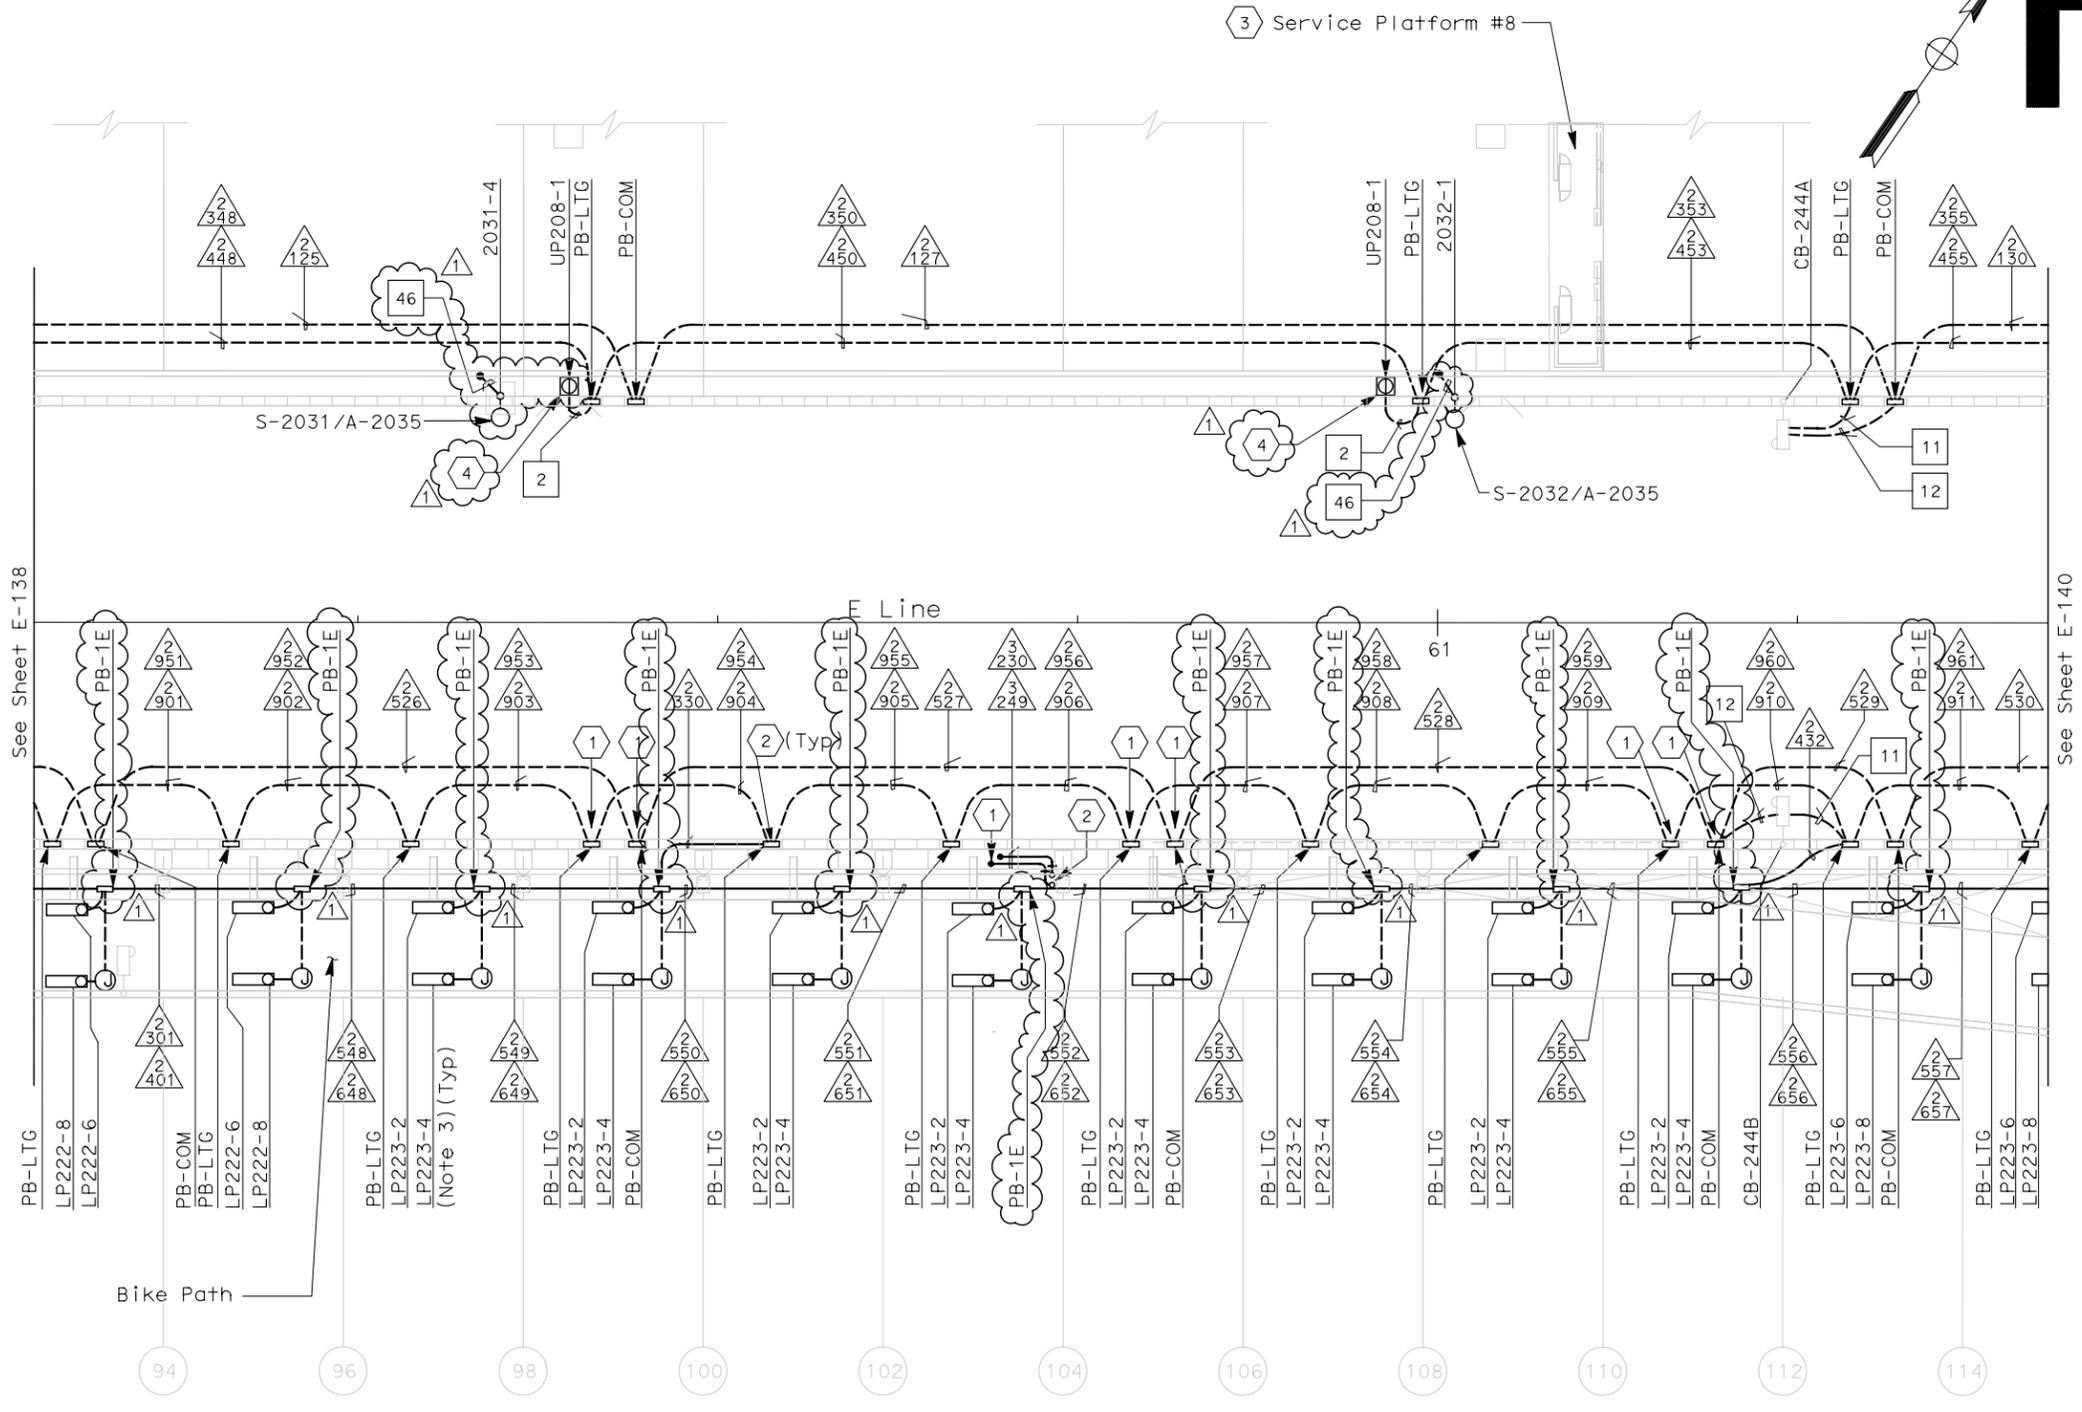

- SHEET NOTES:**
- ① Conduit from barrier pullbox or other equipment down into Girder Box, see sheet E-185.
 - ② Contractor shall furnish and install UP-208 and LP-223 per sheet E-75. For complete scope of work on platform and other related work not shown on this sheet, see Electrical Special Provisions.
 - ③ For conduit to tower and suspension cable lighting, see sheet E-230.
 - ④ Roadway Barrier Receptacle, see Detail 1, sheet E-162.

- NOTES:**
1. References:
 - For typical details and locations of conduit connections to light poles, barrier outlet boxes, call boxes, overhead sign lighting, CMS, CCTV and MVDS, see sheets E-160 thru E-162 and E-169.
 - TOS equipment is shown for conduit routing only. For typical details of TOS controller and devices, see sheets E-344 through E-357.
 - For types of pull boxes, splice boxes and enclosures, see sheet E-169.
 - For circuit and conduit/cable tray schedules, see sheets starting at E-401.
 2. For Roadway Level Call Boxes, refer to sheet E-396.
 3. For Roadway level, Bike Path and Belvedere Lighting Fixture Schedules, see sheets E-146, E-147 and E-165.
 4. For Roadway level and Bike Path Call Box Schedule, see sheet E-397.
 5. For number of lighting fixtures (main tower lights) see lighting schedule sheets E-271 and E-272.
 6. All conduits and fittings routed exposed between the Bike Path and the roadway shall be rigid galvanized steel, PVC coated.
 7. See sheets E-160 thru E-165 for conduit locations.

SAS SUPERSTRUCTURE - CONDUIT PLAN

MARK	DATE	DESCRIPTIONS	BY	CK	CCO
△	8-06-07	Electrical modifications.	MP	RR	42
REVISIONS					

CONTRACT CHANGE ORDER NO. 42
 SHEET ____ OF ____



M. F. Tanaka
 FOR REVISION ONLY

SAS SUPERSTRUCTURE ROADWAY EASTBOUND LIGHTING AND ELECTRICAL SYSTEMS

SCALE 1:200

THIS PLAN ACCURATE FOR ELECTRICAL WORK ONLY.

ALL DIMENSIONS ARE IN METERS UNLESS OTHERWISE SHOWN



DGN FILE =>+:\13103\ms\pse\sas struc\cco\sas cco4\04-0120f1_0192r01.dgn
 USERNAME =>#USER

DATE PLOTTED => 12/19/2007
 TIME PLOTTED => \$TIME
 LAST REVISION 00-00-00