




DIST	COUNTY	ROUTE	KILOMETER TOTAL PROJECT	POST No	SHEET No	TOTAL SHEETS
04	SF	80	13.2/13.9	27551	1204	

 8/24/07
 REGISTERED ELECTRICAL ENGINEER DATE

PLANS APPROVAL DATE _____
 PB POWER, Inc.
 A Parsons Brinckerhoff Company
 303 Second St., Suite 700N
 San Francisco, CA 94107-1317


The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.

Caltrans now has a web site! To get to the web site, go to <http://www.dot.ca.gov>




MARK	DATE	DESCRIPTIONS	BY	CK	CCO
△	8/6/07	Electrical modifications.	MP	RR	42
REVISIONS					

CONTRACT CHANGE ORDER NO. 42
 SHEET _____ OF _____

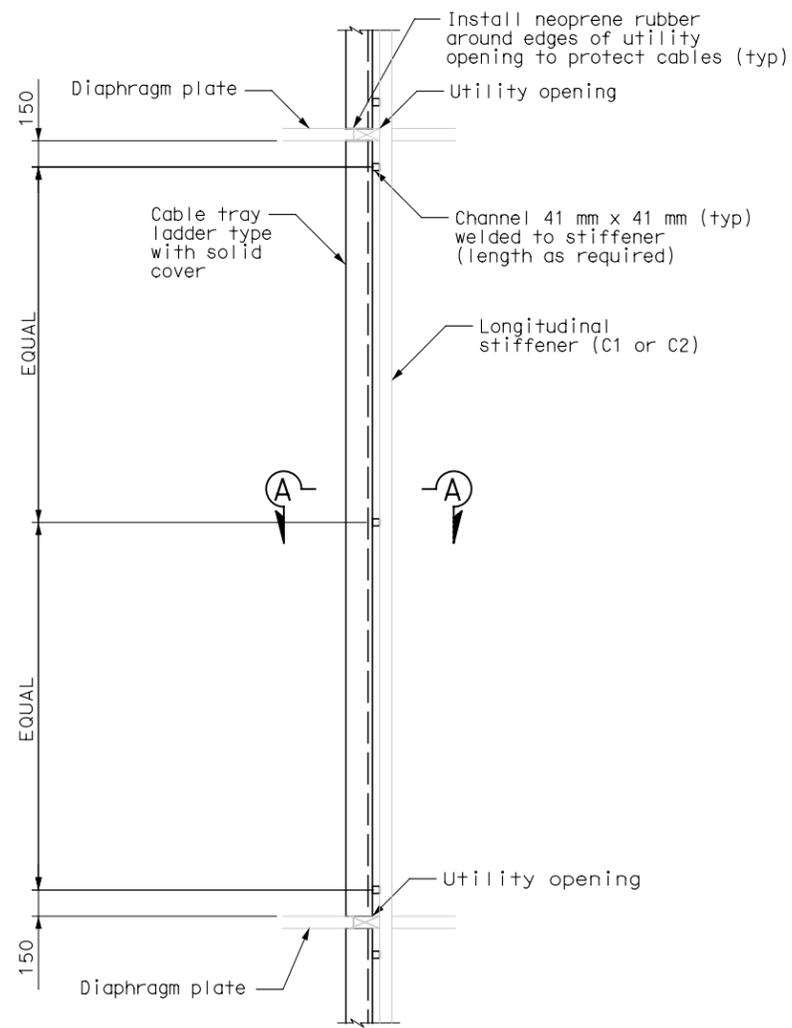


**DETAIL 1
ELEVATION VIEW**

TOWER CABLE TRAY
 TYPICAL INSTALLATION
 SCALE: 1:20

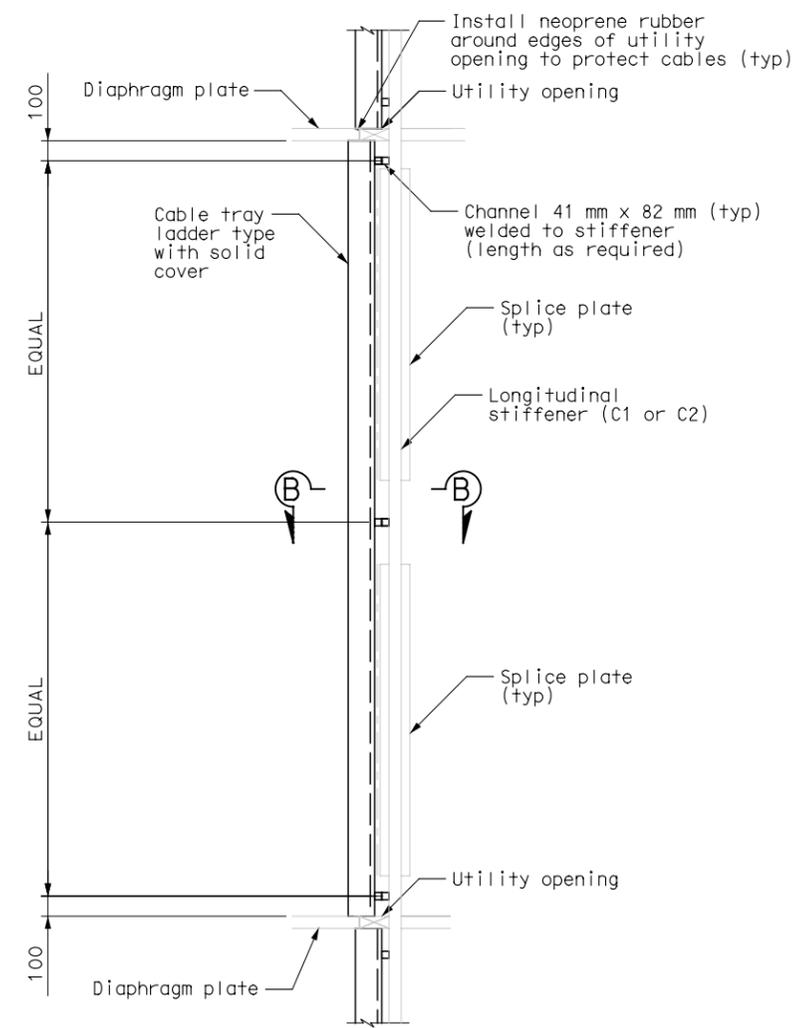


**DETAIL 2
ELEVATION VIEW**

TOWER CABLE TRAY
 TYPICAL INSTALLATION
 ALONG SPLICE PLATE
 SCALE: 1:20

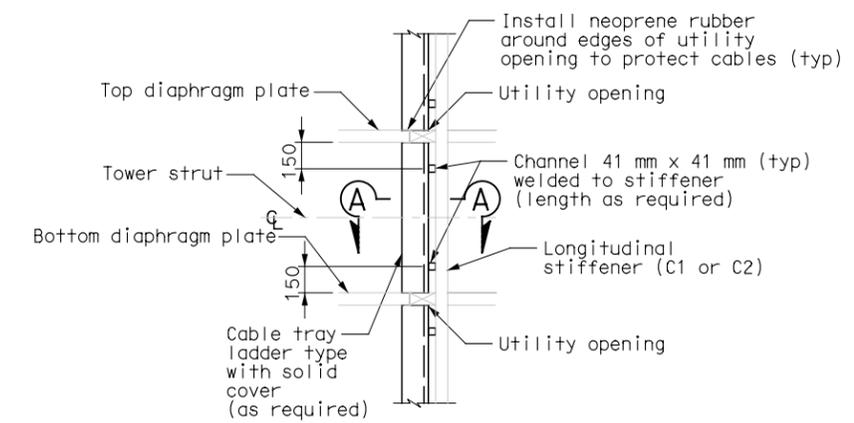


**DETAIL 3
ELEVATION VIEW**

TOWER CABLE TRAY
 TYPICAL INSTALLATION
 ALONG TOWER STRUT AREA
 SCALE: 1:20

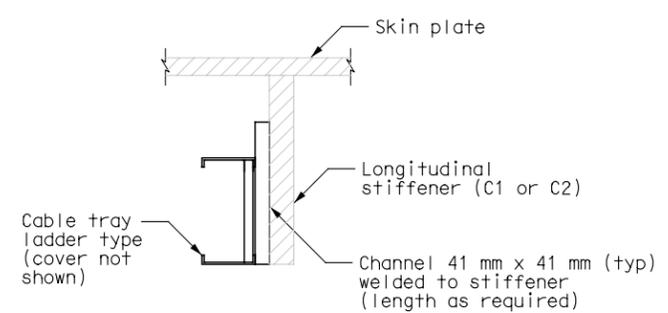

SECTION A-A
SCALE: 1:10

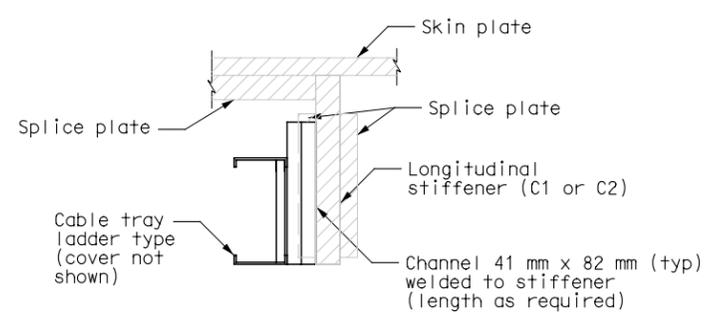

SECTION B-B
SCALE: 1:10


NOTES:

1. TOS/Communication cable trays shall be installed along C2 stiffeners.
2. 600V cable trays shall be installed along C1 stiffeners.
3. See Sheets E- 270B AND E-270C for cable trays location.
4. Provide strut channels on C1 and C2 stiffeners in each tower shaft from elevations 3 m through 143 m.

**DETAILS
TOWER AND SUSPENSION CABLE
CABLE TRAY LOCATION**
SCALE AS NOTED

E-270A

ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN.
 FOR REDUCED PLANS ORIGINAL SCALE IS IN MILLIMETERS



DGN FILE =>+:\13103\ms\pse\sas struc\cco\sas cco42\04-0120f1_0275s01.dgn
 USERNAME =>#USER
 CU 04251

EA 0120F1

STATE OF CALIFORNIA - DEPARTMENT OF TRANSPORTATION
 DESIGN OVERSIGHT
 BEHZAD GOLEMOHAMMADI
 REVISIONS: 00-00-00
 DATE PLOTTED => 12/19/2007
 TIME PLOTTED => \$TIME

