


STATE OF CALIFORNIA - DEPARTMENT OF TRANSPORTATION
Caltrans
 DESIGN OVERSIGHT
 BEHZAD GOLEMOHAMMADI
 CALCULATED/DESIGNED BY
 CHECKED BY
 REVISIONS
 DATE 8/02
 FK IAH 8/02
 REVISOR
 DATE REVISOR



SAN FRANCISCO BAY

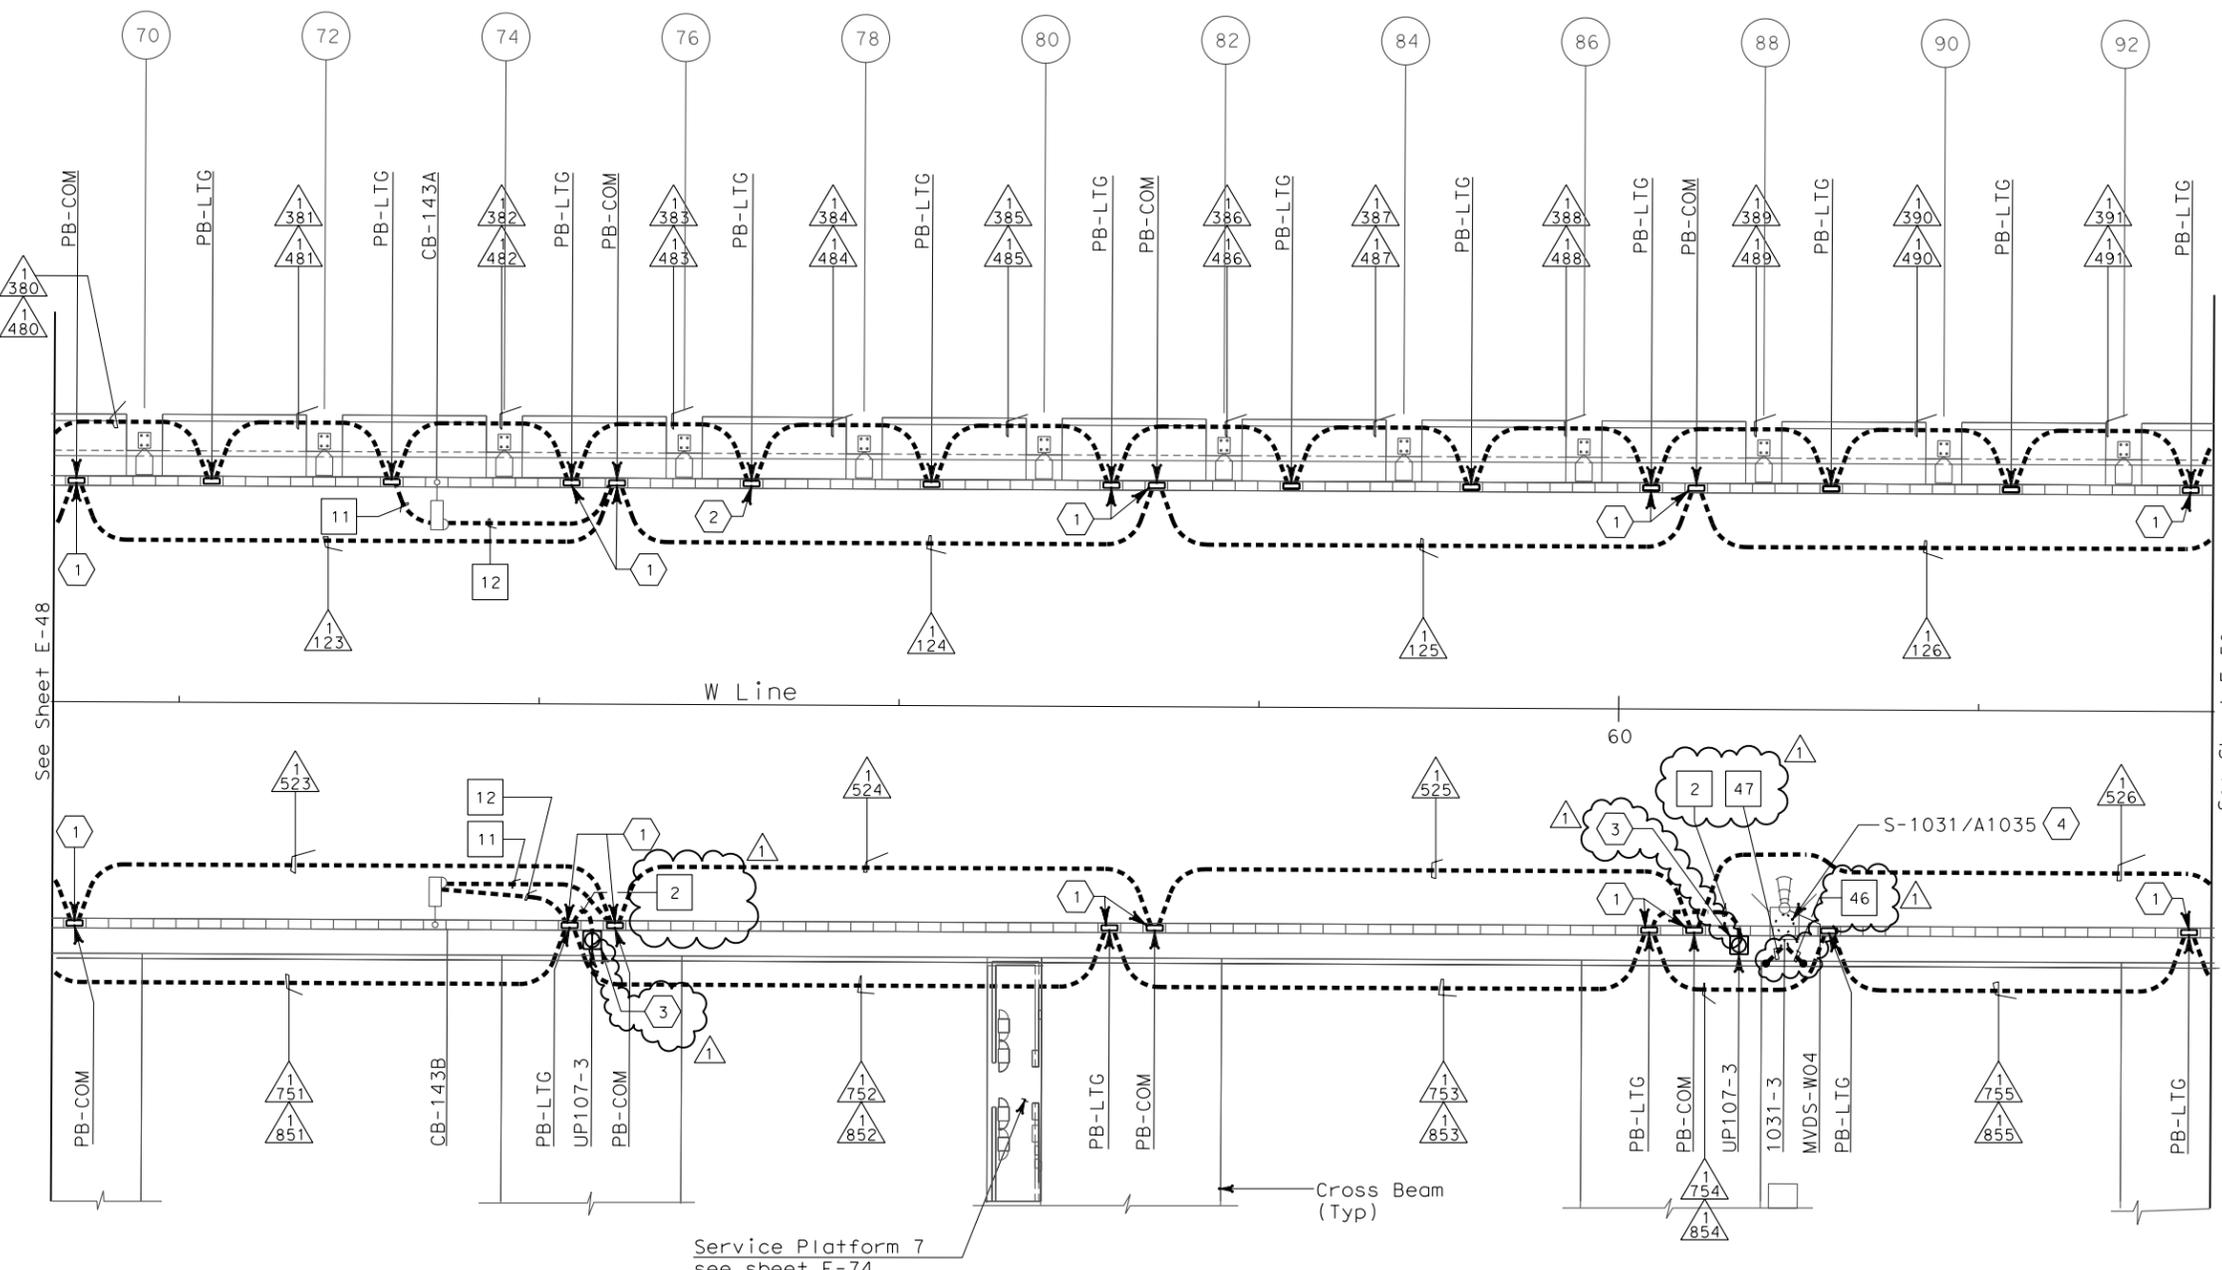

| DIST | COUNTY | ROUTE | KILOMETER TOTAL PROJECT | POST PROJECT | SHEET NO | TOTAL SHEETS |
|------|--------|-------|-------------------------|--------------|----------|--------------|
| 04 | SF | 80 | 13.2/13.9 | | 120R1 | 1204 |

REGISTERED ELECTRICAL ENGINEER
 JENS ERLINGSSON
 No. 8249
 Exp. 9/30/06
 ELECTRICAL
 STATE OF CALIFORNIA

12-19-02
 REGISTERED ELECTRICAL ENGINEER DATE

12-6-04
 PLANS APPROVAL DATE

PB POWER, Inc.
 A Parsons Brinckerhoff Company
 303 Second St., Suite 700N
 San Francisco, CA 94107-1317

The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.

Caltrans now has a web site! To get to the web site, go to <http://www.dot.ca.gov>

- SHEET NOTES:**
- Conduit from barrier pullbox or other equipment down into Girder, See sheet E-99.
 - For conduit to Suspend Lighting, See sheet E-229. Typ for all PB-LTG located on the north side of the roadway.
 - Roadway Barrier Receptacle, see Detail 1, sheet E-68.
 - Light pole, luminaires and lowering device are state furnished and installed by contractor.

- NOTES:**
- References:
 - For typical details and locations of conduit connections to light poles, barrier outlet boxes, call boxes, overhead sign lighting, CCTV and MVDS, see E-66, E-67 and E-68.
 - TOS equipment is shown for conduit routing only. For typical details of TOS controller and devices, see sheet E-344 through E-357.
 - For types of pullboxes, splice boxes and enclosures, see sheet E-83.
 - For circuit and conduit/cable tray schedules, see sheets starting at E-401.
 - For Roadway Call Boxes refer to sheet E-396.
 - For Roadway Level Lighting Pole Schedules, see sheet E-82.
 - For Roadway Level Call Box Schedule, see sheet E-397.
 - For number of lighting fixtures (main tower lights), see lighting schedule sheets E-271 and E-272.
 - See sheets E-66 thru E-68 for conduit locations.

CONDUIT PLAN



FOR REVISION ONLY

| REQUEST FOR INFORMATION NOT ADDRESSED IN THIS CCO REMAIN IN FORCE | | | | | |
|---|----------|--------------------------|----|------|------|
| MARK | DATE | DESCRIPTIONS | BY | CH'D | CCO# |
| 1 | 02/19/08 | ELECTRICAL MODIFICATIONS | MP | RR | 42 |
| | | REVISIONS | | | |

CONTRACT CHANGE ORDER NO. _____
 SHEET _____ OF _____

SAS SUPERSTRUCTURE ROADWAY WESTBOUND LIGHTING AND ELECTRICAL SYSTEMS

SCALE 1:200

THIS PLAN IS ACCURATE FOR ELECTRICAL WORK ONLY.

FOR REDUCED PLANS ORIGINAL SCALE IS IN MILLIMETERS

DGN FILE => T:\13103\MS\pse\SAS Struc\CCO\SAS CC042\04-0120F1_0120R01.dgn
 USERNAME => ilorico
 CU 04251

EA 0120F1

DATE PLOTTED => 3/17/2008
 TIME PLOTTED => 3:53:43 PM
 LAST REVISION 00-00-00