


STATE OF CALIFORNIA - DEPARTMENT OF TRANSPORTATION
Caltrans
 DESIGN OVERSIGHT
 BEHZAD GOLEMOHAMMADI
 CALCULATED/DESIGNED BY EDC
 CHECKED BY CYF
 DATE 08/02
 REVISED BY
 DATE REVISED

DIST	COUNTY	ROUTE	KILOMETER TOTAL PROJECT	POST PROJECT	SHEET No	TOTAL SHEETS
04	SF	80	13.2/13.9		188R1	1204

Caltrans
Metric
Jens Erlingsson 12/19/02
 REGISTERED ELECTRICAL ENGINEER DATE
 12-6-04
 PLANS APPROVAL DATE
 PB POWER, Inc.
 A Parsons Brinckerhoff Company
 303 Second St., Suite 700N
 San Francisco, CA 94107-1317
 The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.
 Caltrans now has a web site! To get to the web site, go to: <http://www.dot.ca.gov>

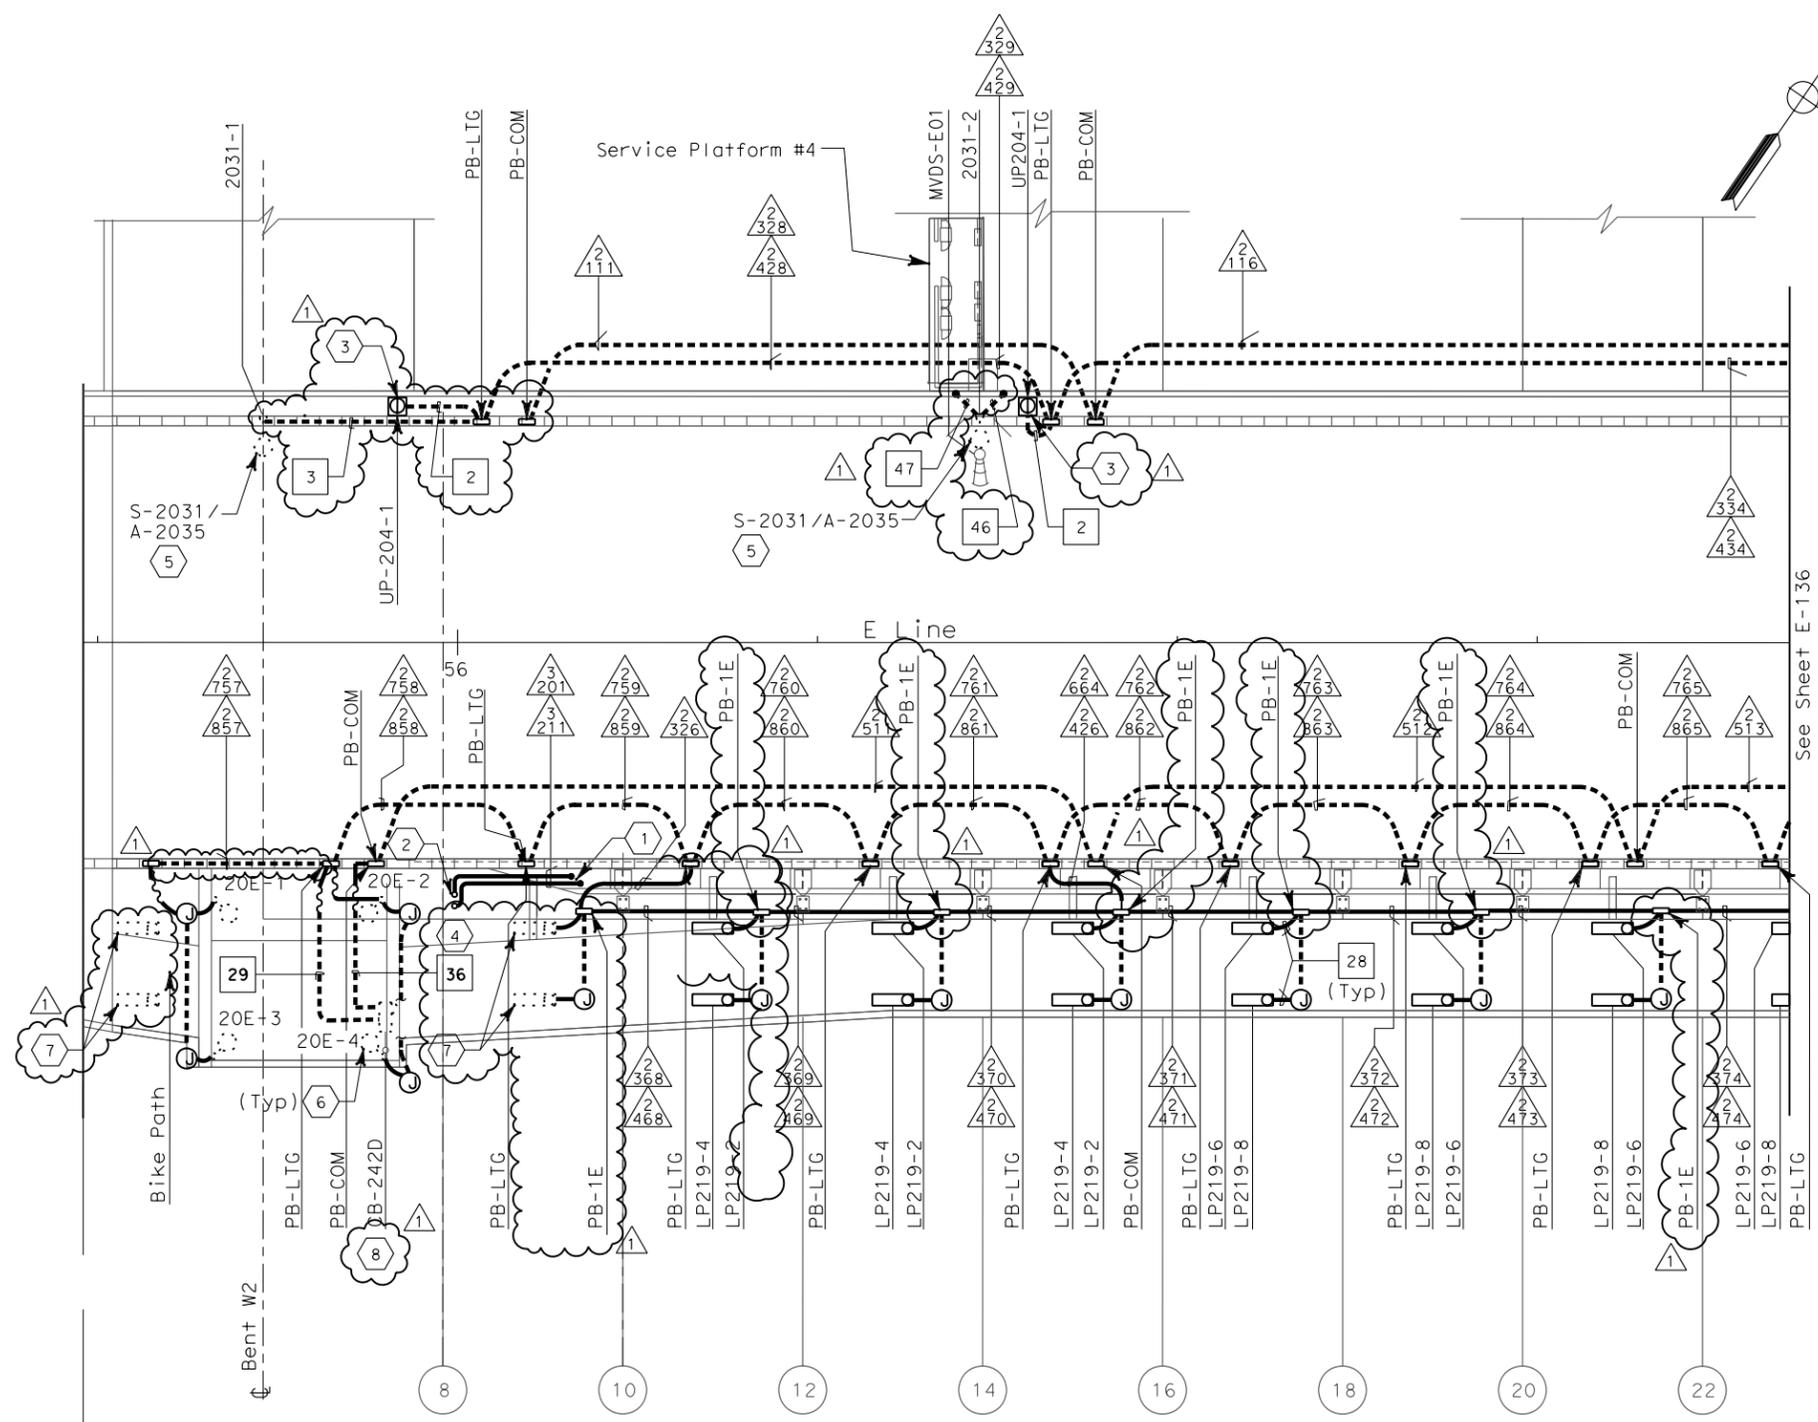

- SHEET NOTES:**
- 1 Conduit from barrier pull box or other equipment down into Girder Box, see sheet E-181.
 - 2 For conduit to suspension cable lighting, see sheet E-226.
 - 3 Roadway Barrier Receptacle, see Detail 1, sheet E-162.
 - 4 Contractor shall coil 30 meters inside cable tray for feed into PB-COM by others.
 - 5 Light pole, luminaires and lowering device are state furnished and installed by contractor.
 - 6 Belvedere light poles and luminaires are state furnished and installed by others.
 - 7 Railing lights are contractor furnished and installed by others.
 - 8 Call box is state furnished and installed by contractor.

1. References:
- For typical details and locations of conduit connections to light poles, barrier outlet boxes, call boxes, overhead sign lighting, CMS, CCTV and MVDS, see sheets E-160 thru E-162 and E-169.
 - TOS equipment is shown for conduit routing only. For typical details of TOS controller and devices, see sheets E-344 through E-357.
 - For types of pull boxes, splice boxes and enclosures, see sheet E-169.
 - For circuit and conduit/cable tray schedules, see sheets starting at E-401.
2. For Roadway level, Bike Path and Belvedere Lighting Fixture Schedules and wiring diagrams see sheets E-146, E-147 and E-165.
 3. For Roadway level and Bike Path Call Box Schedule, see sheet E-397.
 4. For number of lighting fixtures (main tower lights) see lighting schedule sheets E-271 and E-272.
 5. All conduits and fittings routed exposed between the Bike Path and the roadway shall be galvanized rigid steel, PVC coated.
 6. See sheets E-160 thru E-165 for conduit locations.
 7. For Belvedere Lighting Fixture installation, see sheet E-173.

SAS SUPERSTRUCTURE - CONDUIT PLAN

SAS SUPERSTRUCTURE ROADWAY EASTBOUND LIGHTING AND ELECTRICAL SYSTEMS
 SCALE 1:200




M. F. Tarkenton
 FOR REVISION ONLY

REQUEST FOR INFORMATION NOT ADDRESSED IN THIS CCO REMAIN IN FORCE					
1	02/19/08	ELECTRICAL MODIFICATIONS	MP	RR	42
MARK	DATE	DESCRIPTIONS	BY	CH'D	CCO#
REVISIONS					

CONTRACT CHANGE ORDER NO. _____
 SHEET _____ OF _____

THIS PLAN ACCURATE FOR ELECTRICAL WORK ONLY.

ALL DIMENSIONS ARE IN METERS UNLESS OTHERWISE SHOWN.
 FOR REDUCED PLANS ORIGINAL SCALE IS IN MILLIMETERS



DGN FILE => T:\13103\MSvps\SAS Struc\CCO\SAS CC042\04-0120F1_0188R01.dgn
 USERNAME => ilorico
 CU 04251

EA 0120F1

DATE PLOTTED => 3/17/2008
 TIME PLOTTED => 4:37:15 PM
 LAST REVISION 00-00-00