





DIST	COUNTY	ROUTE	KILOMETER TOTAL PROJECT	POST PROJECT	SHEET No	TOTAL SHEETS
04	SF	80	13.2/13.9		289R1	1204


12/19/02
 REGISTERED ELECTRICAL ENGINEER DATE
 12-6-04
 PLANS APPROVAL DATE
 PB POWER, Inc.
 A Parsons Brinckerhoff Company
 303 Second St., Suite 700N
 San Francisco, CA 94107-1317
 The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.
 Caltrans now has a web site! To get to the web site, go to <http://www.dot.ca.gov>



STATE OF CALIFORNIA - DEPARTMENT OF TRANSPORTATION
 DESIGN OVERSIGHT
 BEHZAD GOLEMOHAMMADI
 REVISIONS
 DATE 10/01
 REVISOR
 DATE 11/01
 REVISOR
 CALCULATED BY
 DESIGNED BY
 CHECKED BY
 DATE 10/01
 REVISOR
 DATE 11/01
 REVISOR
 STATE OF CALIFORNIA
 Caltrans

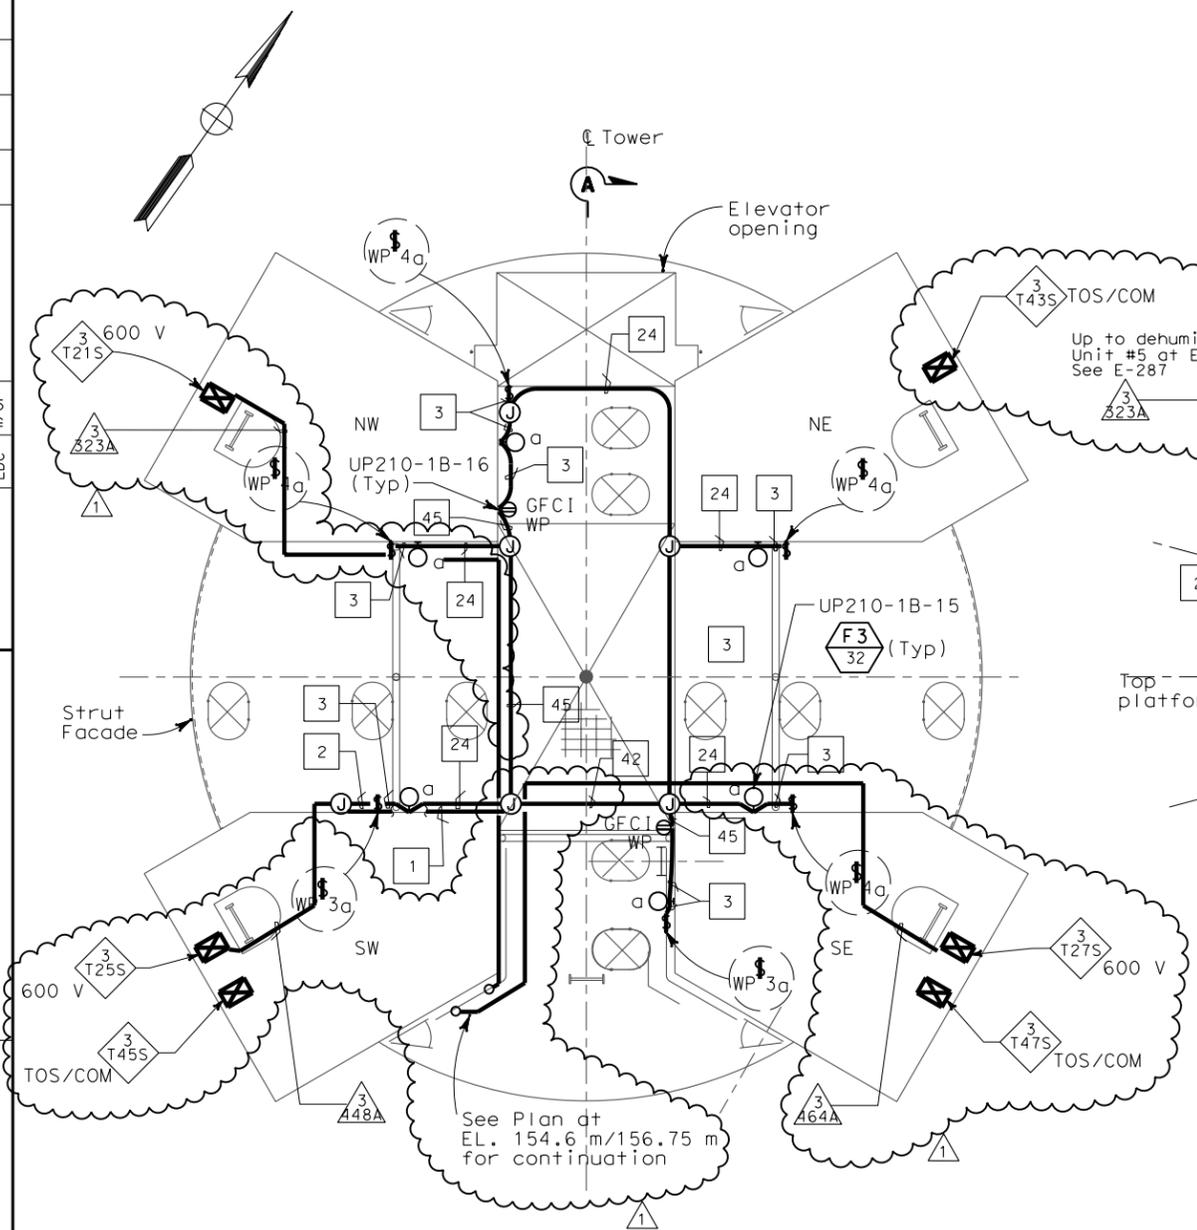

PLAN AT ELEV 139.85 m
SCALE: 1:40

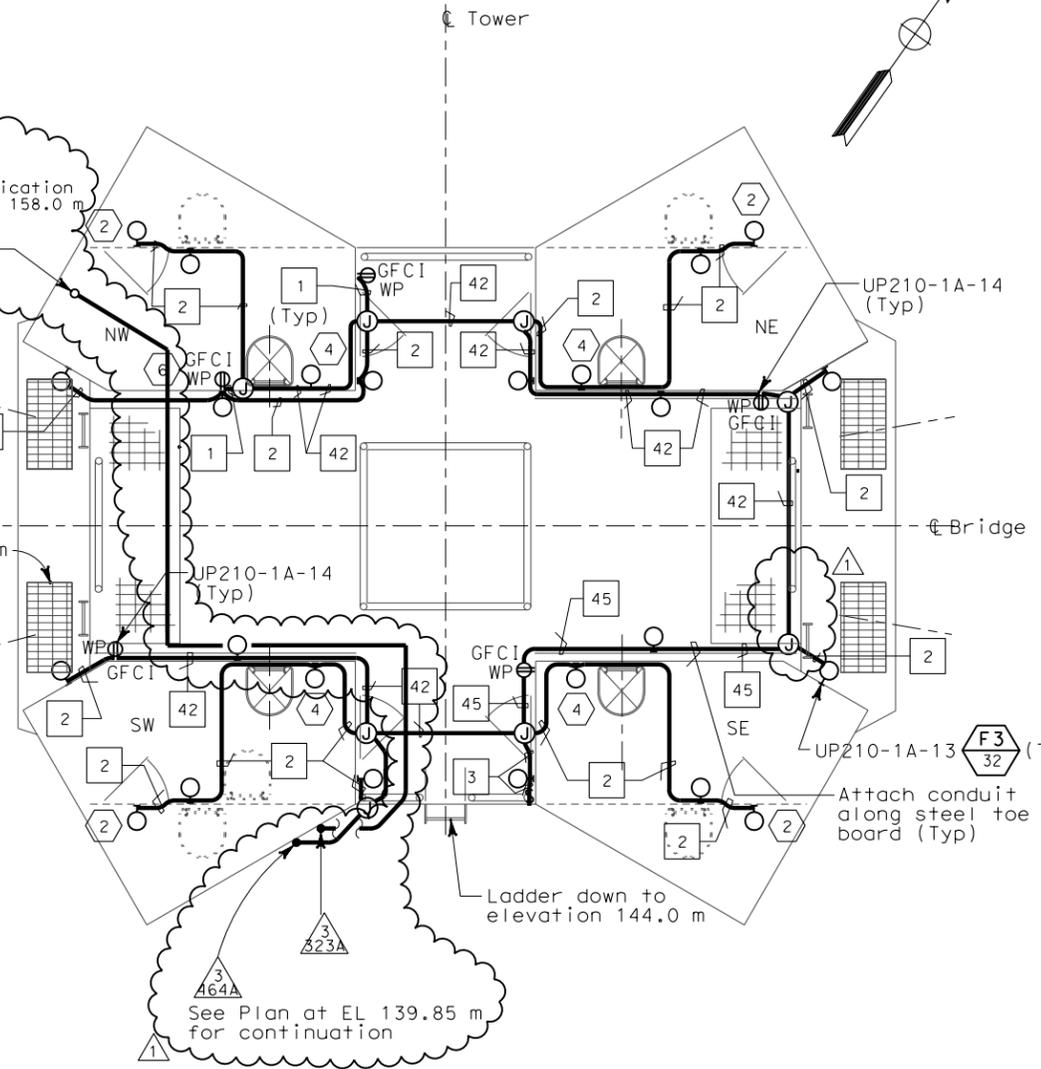

PLAN AT ELEVATIONS 154.6 m TO 156.75 m
SCALE: 1:40

SHEET NOTES:

- 1 Deleted.
- 2 Fixture mounting height elevation shall be 158.5 m.
- 3 Deleted.
- 4 Fixture mounting height elevation shall be 159.25 m.
- 5 Conduit from elevation 89.85 up to elevation 156.75.
- 6 Receptacle mounting height elevation shall be 158.450 m.

NOTES:

1. References:
 - For utility panels UP210-1A and UP210-1B, panel schedules see sheets E-279 and E-280.
 - For types of pull boxes, splice boxes and enclosures, see sheets E-83 and E-169.
 - For conduit and cable tray schedules, see sheets starting at E-401.
 - For lighting installation details, see sheet E-267.
 - For lighting fixture schedule, see sheet E-263.
 - For sections A-A and J-J, see sheet E-287.
 - For typical conduit installation details, see sheet E-268.
 - For vertical conduit runs support system, see sheet E-287.
2. All conduits and fittings routed exposed at grating shall be rigid galvanized steel, PVC coated.
3. Fixture mounting height shall be 2.125 m above floor/platform elevation UNO.
4. Electrical conduits shall enter the tower shafts between stiffeners A3 and A4 only. For conduit entry details, see Structural Utility drawings.
5. For other related work not shown on this sheet, see Electrical Special Provisions.

REQUEST FOR INFORMATION NOT ADDRESSED IN THIS CCO REMAIN IN FORCE					
1	02/19/08	ELECTRICAL MODIFICATIONS	MP	RR	42
MARK	DATE	DESCRIPTIONS	BY	CH'D	CCO#
		REVISIONS			

CONTRACT CHANGE ORDER NO. _____
SHEET _____ OF _____



FOR REVISION ONLY

THIS PLAN ACCURATE FOR ELECTRICAL WORK ONLY.

ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN



DGN FILE => T:\13103\MS\pse\SAS Struc\CCO\SAS CC042\04-0120F1_0289R01.dgn
USERNAME => ilorico
CU 04251

EA 0120F1

**DETAILS
TOWER AND SUSPENSION CABLE
TOWER POWER AND LIGHTING**

SCALE 1:50

E-286

DATE PLOTTED => 3/17/2008
 TIME PLOTTED => 5:28:19 PM
 LAST REVISION 00-00-00