




STATE OF CALIFORNIA - DEPARTMENT OF TRANSPORTATION
Caltrans
 DESIGN OVERSIGHT
 BEHZAD GOLEMOHAMMADI

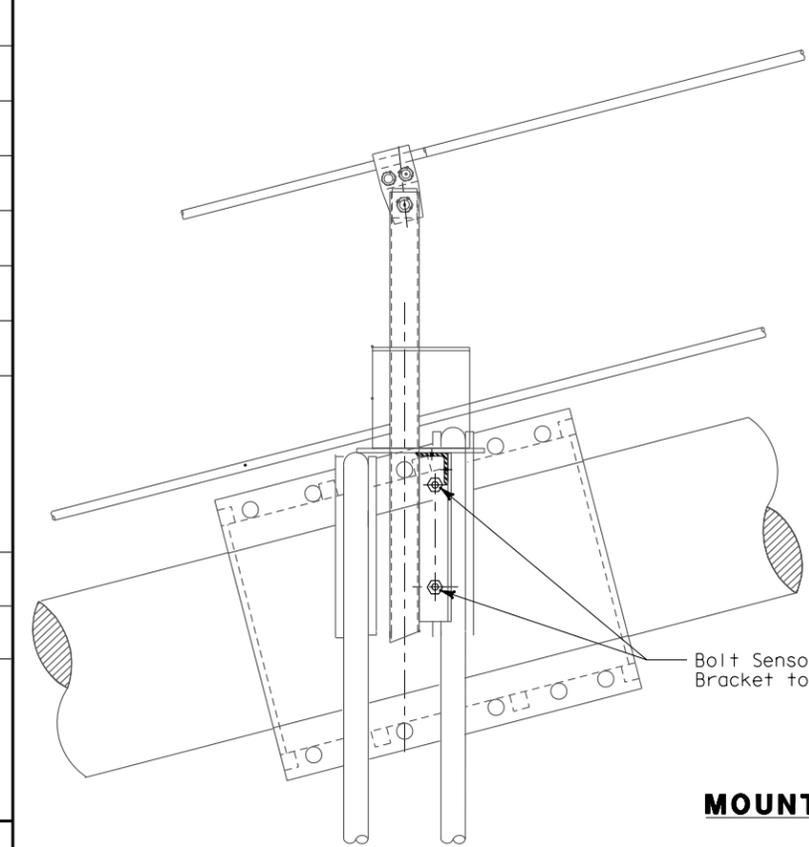


MOUNTING BRACKET
NO SCALE

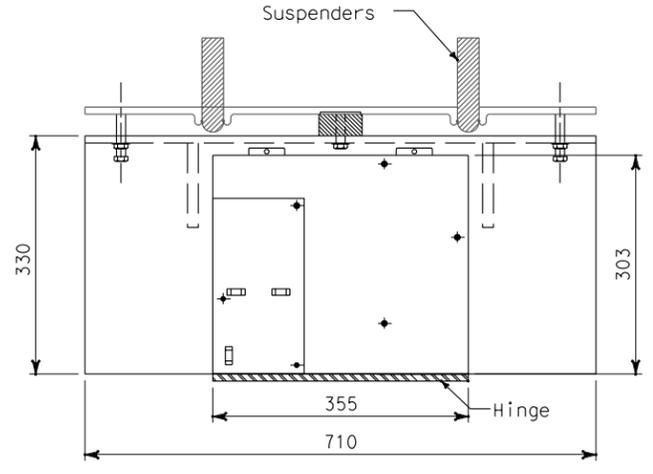


TYPE 6
SENSOR ENCLOSURE
NUMBER 21-3
STAINLESS STEEL BOX
NO SCALE

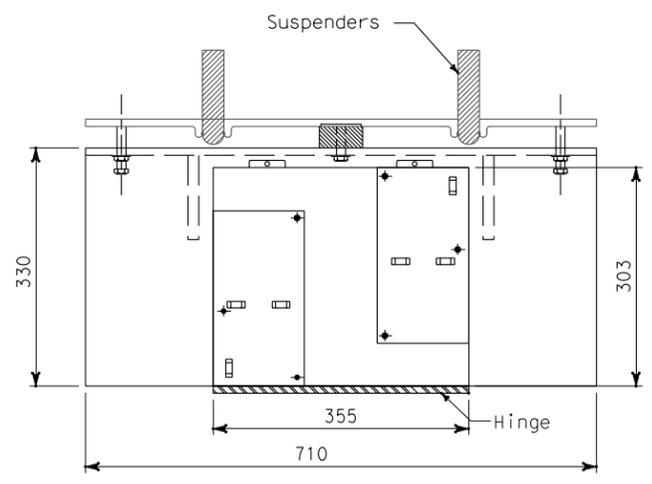

TYPE 6
SENSOR ENCLOSURE
NUMBER 35-3
STAINLESS STEEL BOX
NO SCALE

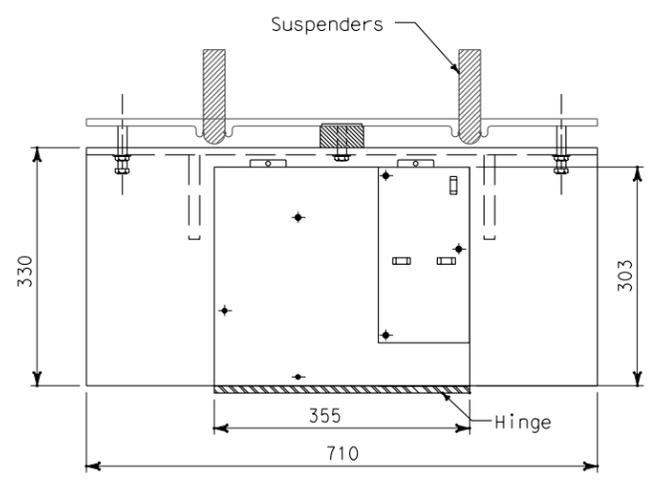

TYPE 6
SENSOR ENCLOSURE
NUMBER 22-3, 36-3
STAINLESS STEEL BOX
NO SCALE

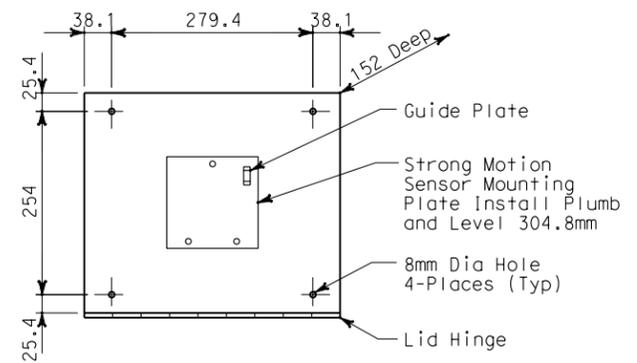

TYPE 7
SENSOR ENCLOSURE
STAINLESS STEEL BOX
NO SCALE

NOTES:

- For other related work not shown on this drawing, see Electrical Special Provisions.
- References:
 - For sensors and recorder schedules, see sheets E-379, E-380 and E-381.
 - For cable block diagram, see sheets E-382, E-383 and E-384.
 - For general notes of the strong motion detection system, see sheet E-361.
 - For circuit and conduit/cable tray schedules, see sheets starting at E-401.
- All conduits and fittings located outside or inside pier shall be rigid galvanized steel, PVC coated.
- For sensor enclosures bolt hole details, see AS-sheets.
- For stanchion details, see Structural sheets.

DIST	COUNTY	ROUTE	KILOMETER TOTAL PROJECT	POST TOTAL PROJECT	SHEET No	TOTAL SHEETS
04	SF	80	13.2/13.9	343R1	1204	


12/19/02
 REGISTERED ELECTRICAL ENGINEER DATE

12-6-04
 PLANS APPROVAL DATE

PB POWER, Inc.
 A Parsons Brinckerhoff Company
 303 Second St., Suite 700N
 San Francisco, CA 94107-1317

The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.

Caltrans now has a web site! To get to the web site, go to <http://www.dot.ca.gov>



REQUEST FOR INFORMATION NOT ADDRESSED IN THIS CCO REMAIN IN FORCE						
MARK	DATE	DESCRIPTIONS	BY	CH'D	CCO#	
▲	02/19/08	ELECTRICAL MODIFICATIONS	MP	RR	42	
		REVISIONS				

CONTRACT CHANGE ORDER NO. _____
 SHEET _____ OF _____




FOR REVISION ONLY

DETAILS
STRONG MOTION DETECTION SYSTEM
SUSPENSION CABLE SENSOR ENCLOSURES AND MOUNTING
 SCALE AS NOTED

E-377

THIS PLAN IS ACCURATE FOR ELECTRICAL WORK ONLY.

ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN.



DGN FILE => T:\13103\MS\pse\SAS Struc\CCO\SAS CC042\04-0120f1_0343R01.dgn
 USERNAME => llorico
 CU 04251

EA 0120F1

DATE PLOTTED => 3/17/2008
 TIME PLOTTED => 5:30:29 PM
 LAST REVISION 00-00-00