
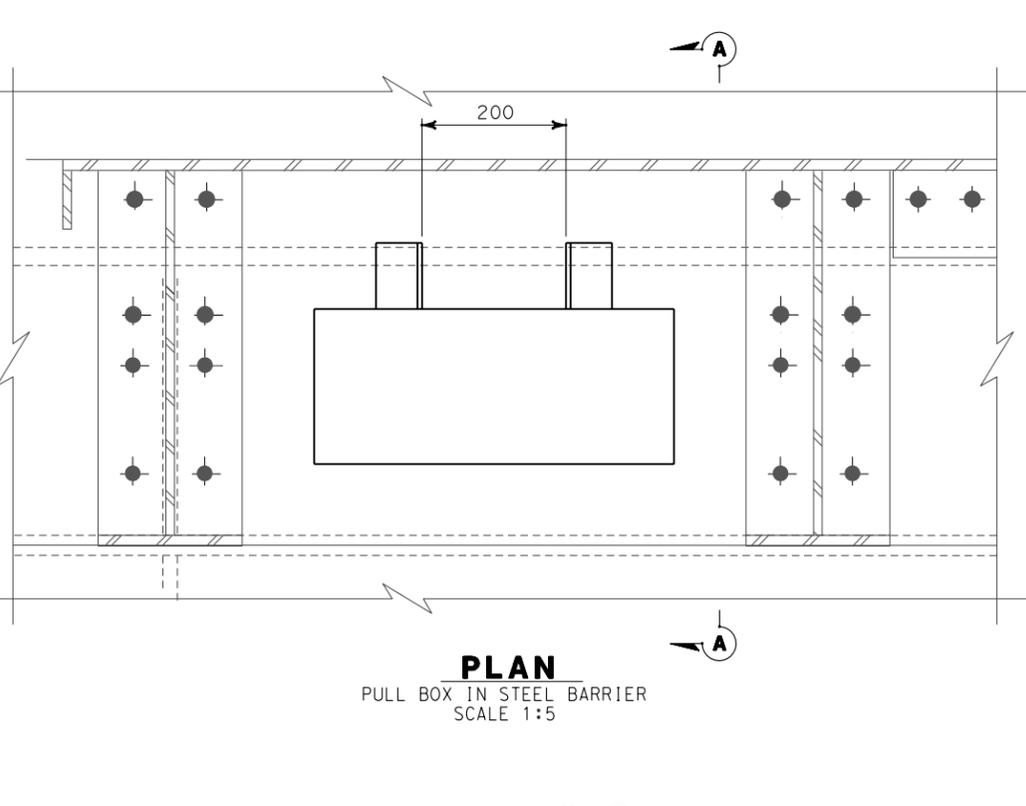


STATE OF CALIFORNIA - DEPARTMENT OF TRANSPORTATION  
**Caltrans**  
 DESIGN OVERSIGHT  
 BEHZAD GOLEMOHAMMADI

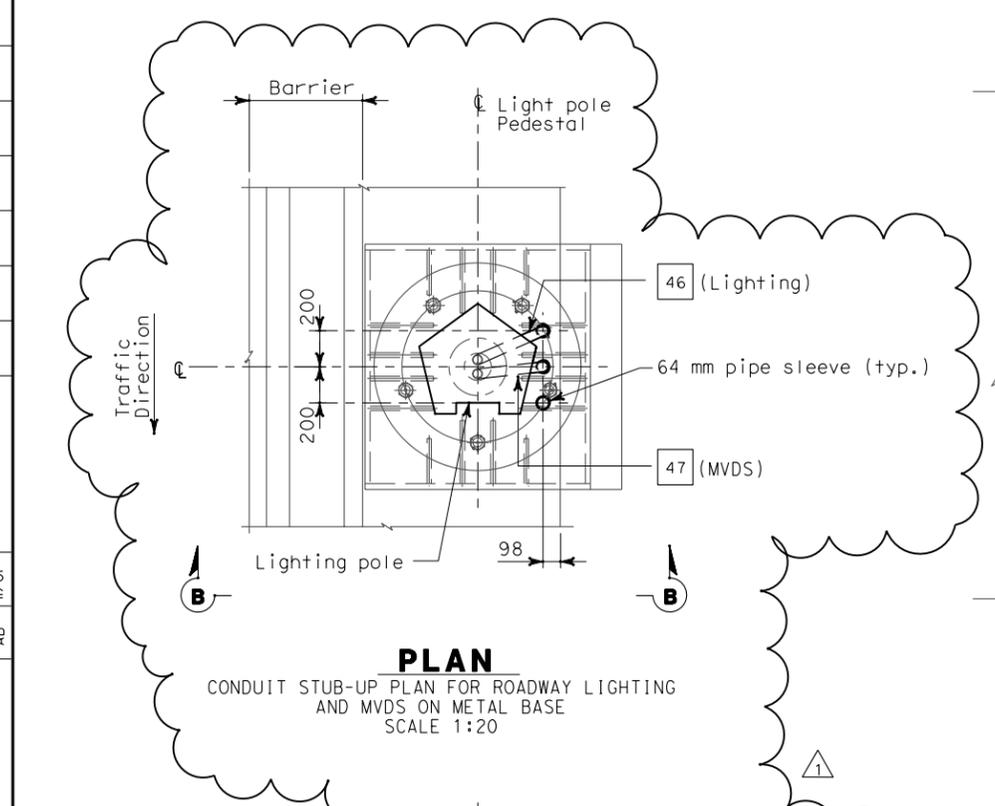

DIST	COUNTY	ROUTE	KILOMETER TOTAL PROJECT	POST PROJECT	SHEET No	TOTAL SHEETS
04	SF	80	13.2/13.9		209R1	1204

12/19/02  
 REGISTERED ELECTRICAL ENGINEER DATE




12-6-04  
 PLANS APPROVAL DATE

PB POWER, Inc.  
 A Parsons Brinckerhoff Company  
 303 Second St., Suite 700N  
 San Francisco, CA 94107-1317

The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.

Caltrans now has a web site! To get to the web site, go to <http://www.dot.ca.gov>

- SHEET NOTES:**
- ① Bond grounding bushing to ground lug of lighting pole with #6 bare copper wire.
  - ② Deleted
  - ③ Conduit penetration thru girder plate and lighting pole metal base, see Utility Detail No. 1 of Superstructure and Tower Drawings. To prevent moisture from passing inside the sleeve, the Contractor shall install sealant between the sleeve and conduit.

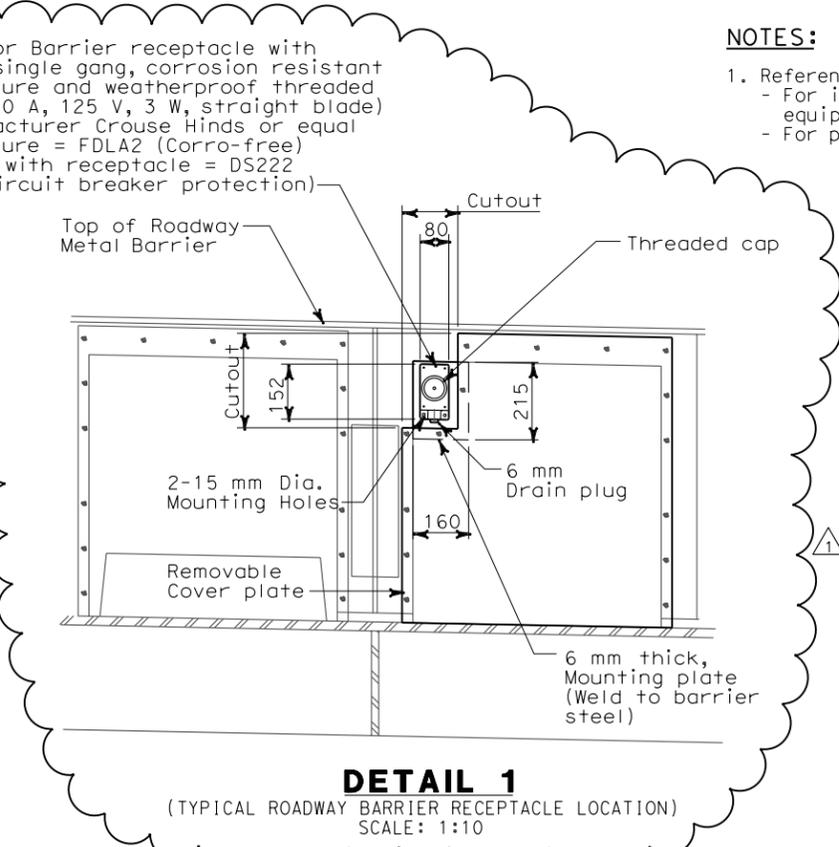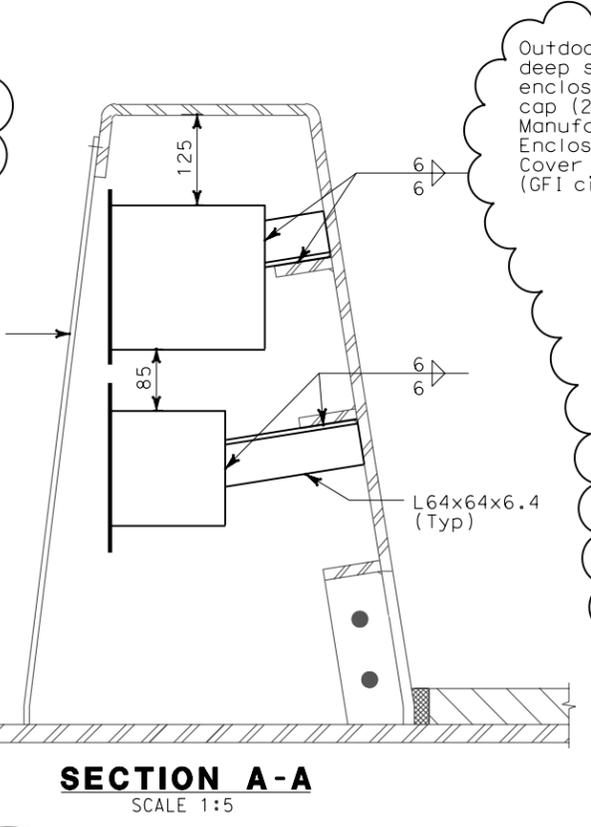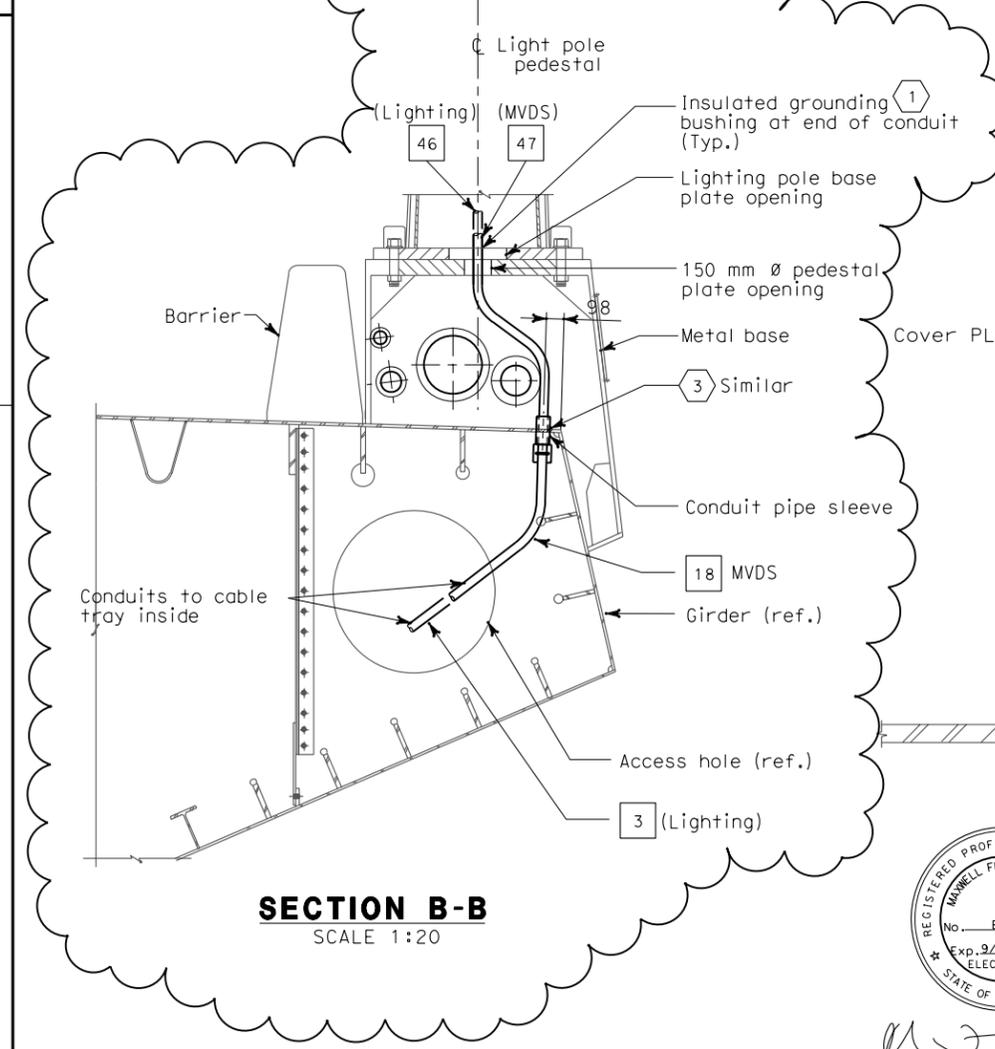

- NOTES:**
1. References:  
 - For installation and typical details of TOS equipment, see sheets E-341 thru E-357.  
 - For pull box schedule, see sheet E-169



*M. F. Takaki*  
 REGISTERED ELECTRICAL ENGINEER  
 FOR REVISION ONLY

REQUEST FOR INFORMATION NOT ADDRESSED IN THIS CCO REMAIN IN FORCE					
①	02/19/08	ELECTRICAL MODIFICATIONS	MP	RR	42
MARK	DATE	DESCRIPTIONS	BY	CH'D	CCO#
		REVISIONS			

CONTRACT CHANGE ORDER NO. \_\_\_\_\_  
 SHEET \_\_\_\_\_ OF \_\_\_\_\_

**DETAILS**  
**SAS SUPERSTRUCTURE ROADWAY EASTBOUND**  
**CONDUIT LOCATIONS**  
 SCALE AS NOTED

**E-162**

FOR REDUCED PLANS ORIGINAL SCALE IS IN MILLIMETERS

DGN FILE => T:\13103\MS\pse\SAS Struc\CCO\SAS CC042\04-0120f1\_0209R1.dgn  
 USERNAME => ilorico  
 CU 04251

EA 0120F1

DATE PLOTTED => 5/9/2008  
 TIME PLOTTED => 2:21:51 PM  
 00-00-00