



DEHUMIDIFICATION UNIT #2 PLAN- AT ELEV. 9.0 m
 NO SCALE

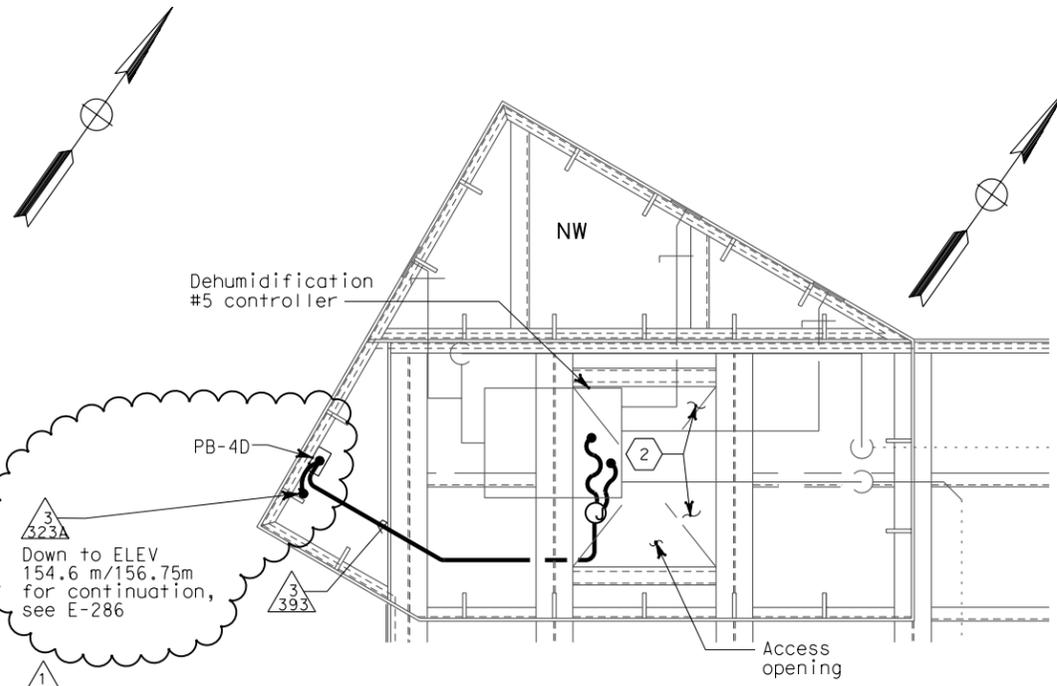

DEHUMIDIFICATION UNIT #5 PLAN- AT ELEV. 158.0 m
 SCALE: 1:20

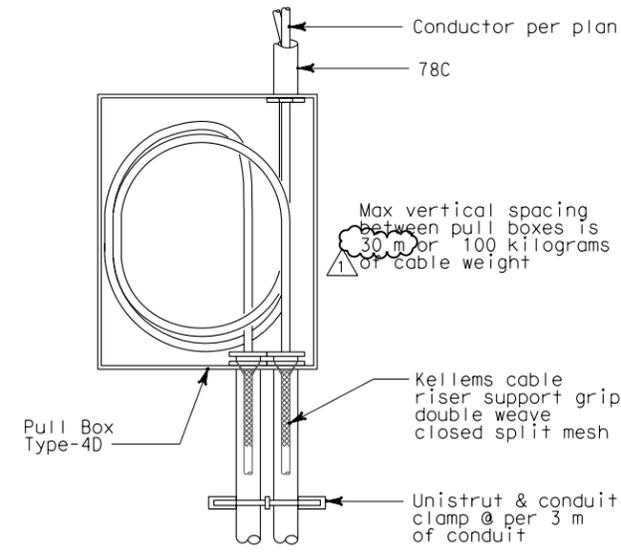

CABLE AND CONDUIT SUPPORT SYSTEM FOR VERTICAL CABLE RUNS
 SCALE: 1:10




DIST	COUNTY	ROUTE	KILOMETER TOTAL PROJECT	POST PROJECT	SHEET No	TOTAL SHEETS
04	SF	80	13.2/13.9		290R1	1204

Jens Erlingsson 12/19/02
 REGISTERED ELECTRICAL ENGINEER DATE

12-6-04
 PLANS APPROVAL DATE

PB POWER, Inc.
 A Parsons Brinckerhoff Company
 303 Second St., Suite 700N
 San Francisco, CA 94107-1317

The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.
 Caltrans now has a web site! To get to the web site, go to <http://www.dot.ca.gov>



- SHEET NOTES:**
- 1 Deleted.
 - 2 For lighting and receptacles in this area, see plan at elevations 154.6 m to 156.75 m on sheet E-268.
 - 3 Deleted.
 - 4 For lighting and receptacles in this area, see sheet E-266.

- NOTES:**
1. References:
 - For types of pull boxes, splice boxes and enclosures, see sheets E-83 and E-169.
 - For conduit and cable tray schedules, see sheets starting at E-401.
 - For typical conduit installation details, see sheet E-268.
 2. For other related work not shown on this sheet, see Electrical Special Provisions.



M. F. Takai
 FOR REVISION ONLY

REQUEST FOR INFORMATION NOT ADDRESSED IN THIS CCO REMAIN IN FORCE					
1	02/19/08	ELECTRICAL MODIFICATIONS	MP	RR	42
MARK	DATE	DESCRIPTIONS	BY	CH'D	CCO#
REVISIONS					

CONTRACT CHANGE ORDER NO. _____
 SHEET _____ OF _____

DETAILS
TOWER AND SUSPENSION CABLE
TOWER POWER AND LIGHTING
 SCALE AS NOTED

DATE PLOTTED => 5/9/2008
 TIME PLOTTED => 2:25:12 PM
 LAST REVISION 00-00-00