


STATE OF CALIFORNIA - DEPARTMENT OF TRANSPORTATION  
**Caltrans**  
 DESIGN OVERSIGHT  
 BEHZAD GOLEMOHAMMADI  
 CALCULATED/DESIGNED BY  
 CHECKED BY  
 REVISIONS  
 DATE 8/02  
 DATE 8/02  
 REVISED BY  
 DATE REVISED

DIST	COUNTY	ROUTE	KILOMETER TOTAL PROJECT	POST PROJECT	SHEET No	TOTAL SHEETS
04	SF	80	13.2/13.9		118R1	1204

**Caltrans**  
**Metric**  
 REGISTERED ELECTRICAL ENGINEER  
 JENS ERLINGSSON  
 No. 8249  
 Exp. 9/30/06  
 ELECTRICAL  
 STATE OF CALIFORNIA  
 12/19/02  
 PLANS APPROVAL DATE  
 PB POWER, Inc.  
 A Parsons Brinckerhoff Company  
 303 Second St., Suite 700N  
 San Francisco, CA 94107-1317  
 The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.  
 Caltrans now has a web site! To get to the web site, go to <http://www.dot.ca.gov>

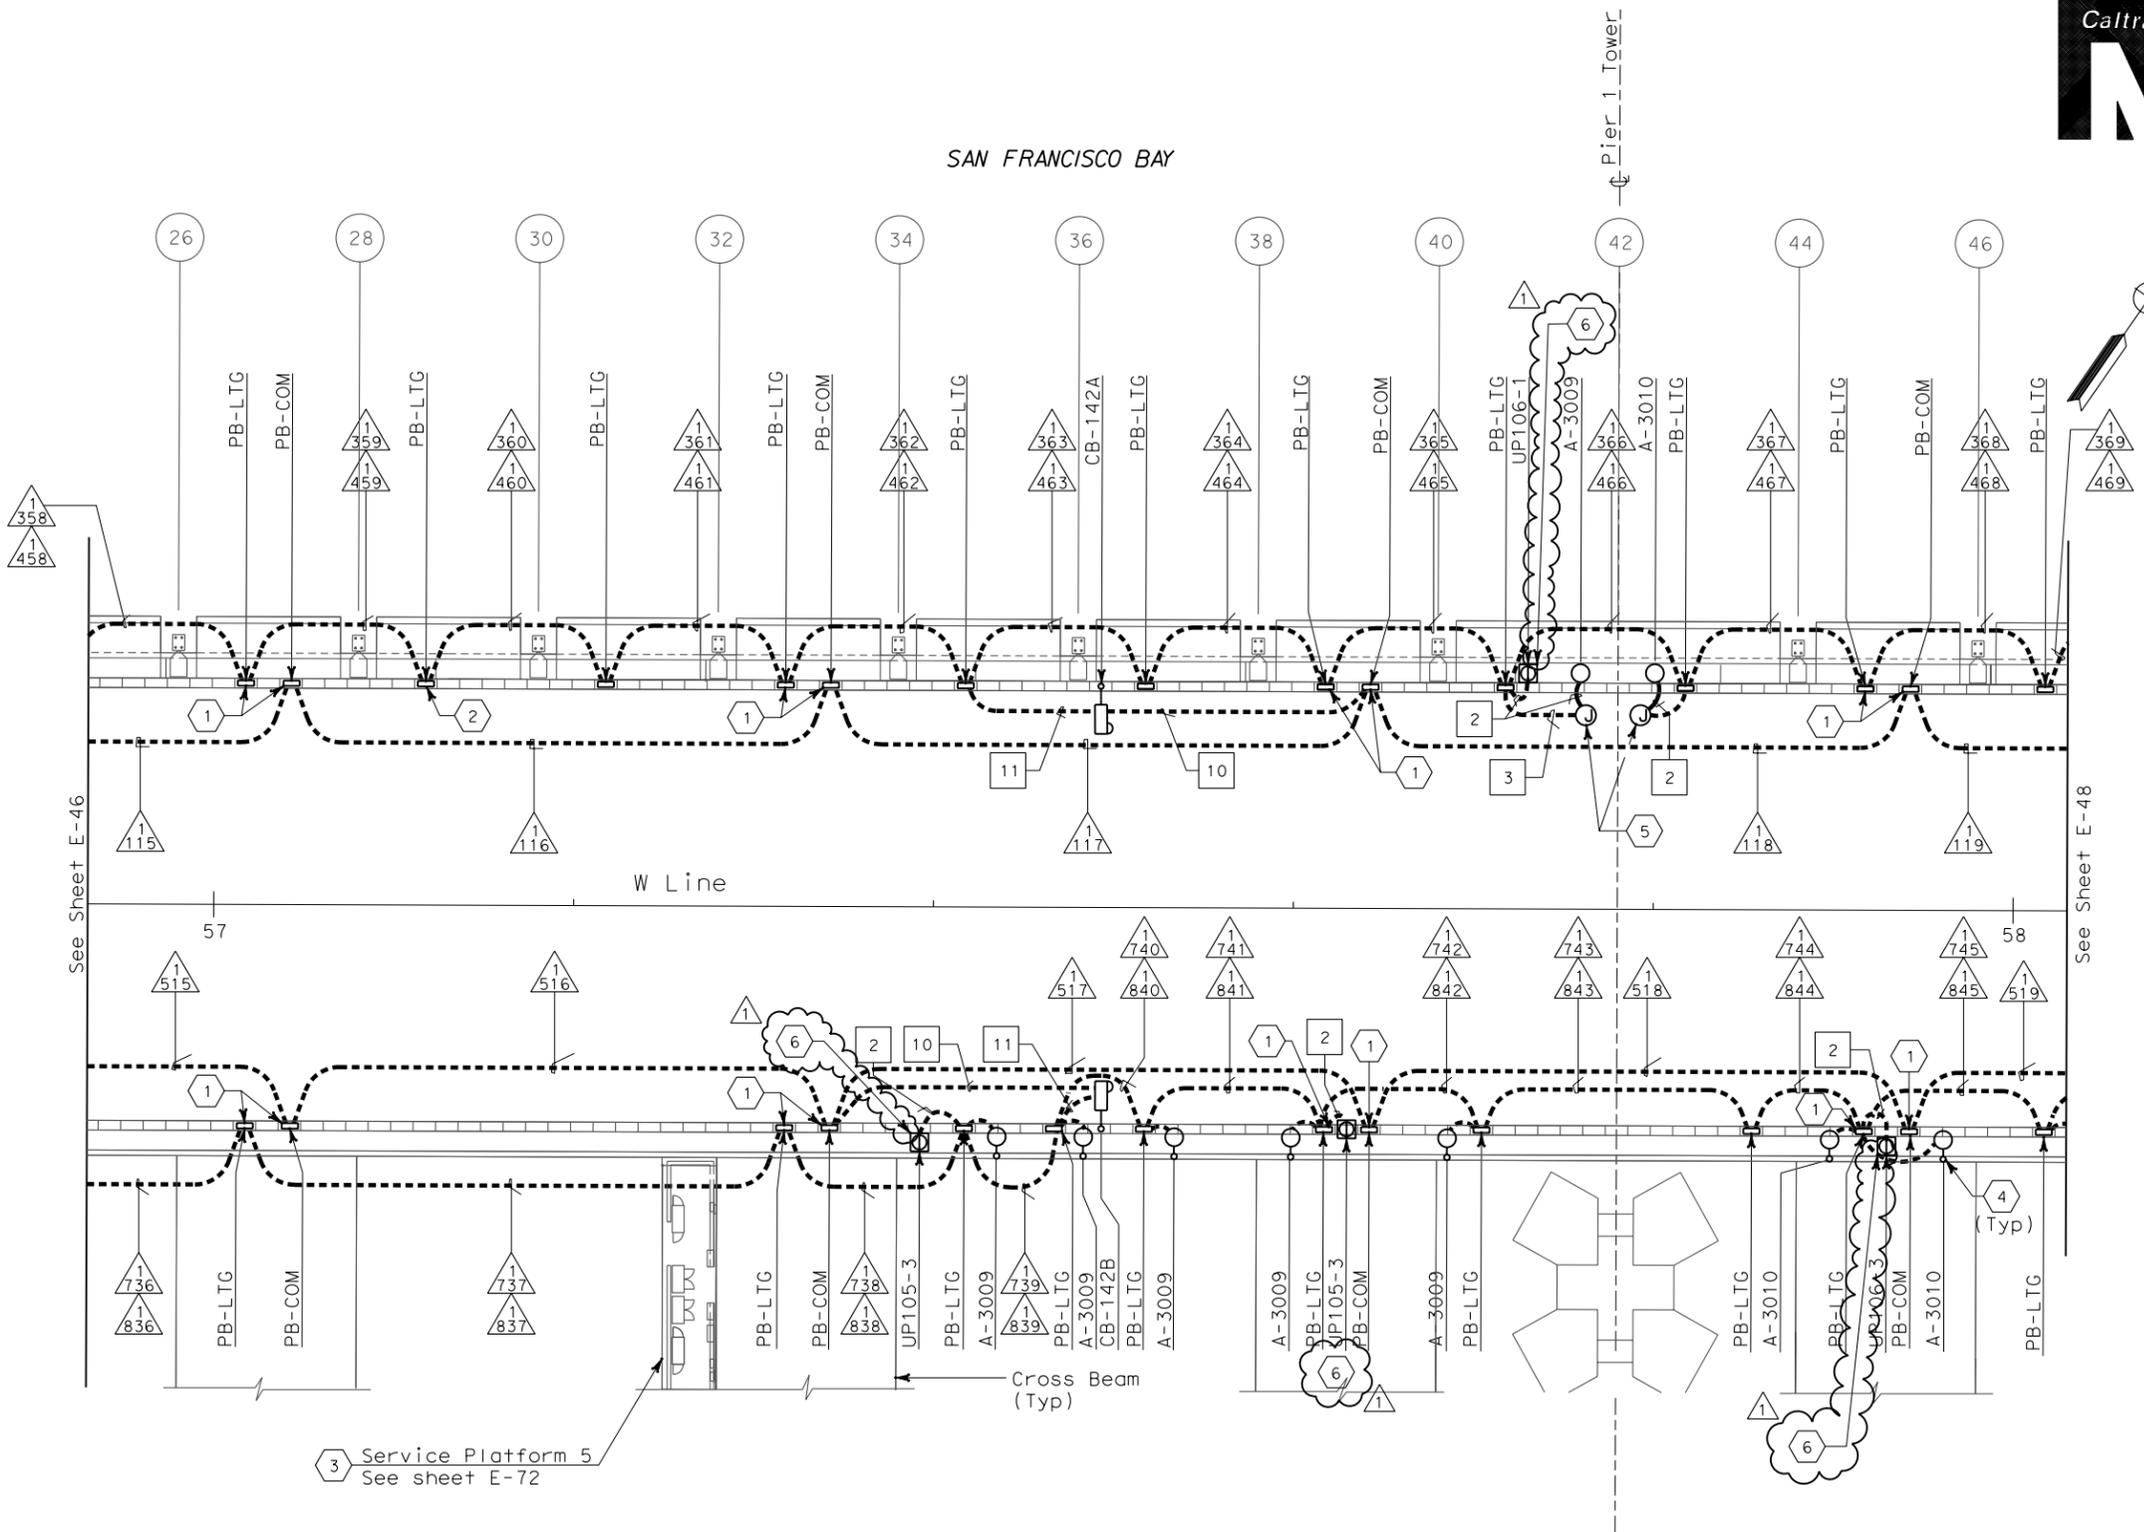

- SHEET NOTES:**
- Conduit from barrier pullbox or other equipment down into Girder, See sheet E-97.
  - For conduit to Suspend Lighting, See sheet E-227. Typ for all PB-LTG located on the north side of the roadway.
  - Contractor shall furnish and install UP-105 per sheet E-72. For complete scope of work on platform and other related work not shown on this sheet, see Electrical Special Provisions.
  - See sheet E-67 for pylon floodlight conduit location.
  - Type PB-1C junction box is used on suspender brackets.
  - Roadway Barrier Receptacle, see Detail 1, sheet E-68.

- NOTES:**
- References:
    - For typical details and locations of conduit connections to light poles, barrier outlet boxes, call boxes, overhead sign lighting, CCTV and MVDS, see sheets E-67, E-68 and E-68.
    - TOS equipment is shown for conduit routing only. For typical details of TOS controller and devices, see sheets E-344 through E-357.
    - For types of pullboxes, splice boxes and enclosures, see sheet E-83.
    - For circuit and conduit/cable tray schedules, see sheets starting at E-401.
  - For Roadway Call Boxes, refer to sheet E-396.
  - For Roadway Level Lighting Pole Schedule, see sheet E-82.
  - For Roadway Level Call Box Schedule, see sheet E-397.
  - For number of lighting fixtures (main tower lights), see lighting schedule sheets E-271 and E-272.

REQUEST FOR INFORMATION NOT ADDRESSED IN THIS CCO REMAIN IN FORCE

MARK	DATE	DESCRIPTIONS	MP EL	RR	CCO#
1	02/19/08	ELECTRICAL MODIFICATIONS			42
REVISIONS					

CONTRACT CHANGE ORDER NO. \_\_\_\_\_  
 SHEET \_\_\_\_\_ OF \_\_\_\_\_

**CONDUIT PLAN**

**SAS SUPERSTRUCTURE ROADWAY WESTBOUND LIGHTING AND ELECTRICAL SYSTEMS**

SCALE 1:200



FOR REVISION ONLY

THIS PLAN IS ACCURATE FOR ELECTRICAL WORK ONLY.

FOR REDUCED PLANS ORIGINAL SCALE 15 IN MILLIMETERS

DGN FILE => T:\13103\MS\pse\SAS Struc\CCO\SAS CC042\04-0120F1\_018R01.dgn  
 USERNAME => Hlorico

CU 04251

EA 0120F1

DATE PLOTTED => 4/4/2008  
 TIME PLOTTED => 2:57:25 PM  
 LAST REVISION 00-00-00