


STATE OF CALIFORNIA - DEPARTMENT OF TRANSPORTATION  
**Caltrans**  
 DESIGN OVERSIGHT  
 BEHZAD GOLEMOHAMMADI



DIST	COUNTY	ROUTE	KILOMETER TOTAL PROJECT	POST PROJECT	SHEET No	TOTAL SHEETS
04	SF	80	13.2/13.9		354R1	1204

JENS ERLINGSSON 12/19/02  
 REGISTERED ELECTRICAL ENGINEER DATE  
 12-6-04  
 PLANS APPROVAL DATE  
 PB POWER, Inc.  
 A Parsons Brinckerhoff Company  
 303 Second St., Suite 700N  
 San Francisco, CA 94107-1317  
 The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.  
 Caltrans now has a web site! To get to the web site, go to <http://www.dot.ca.gov>

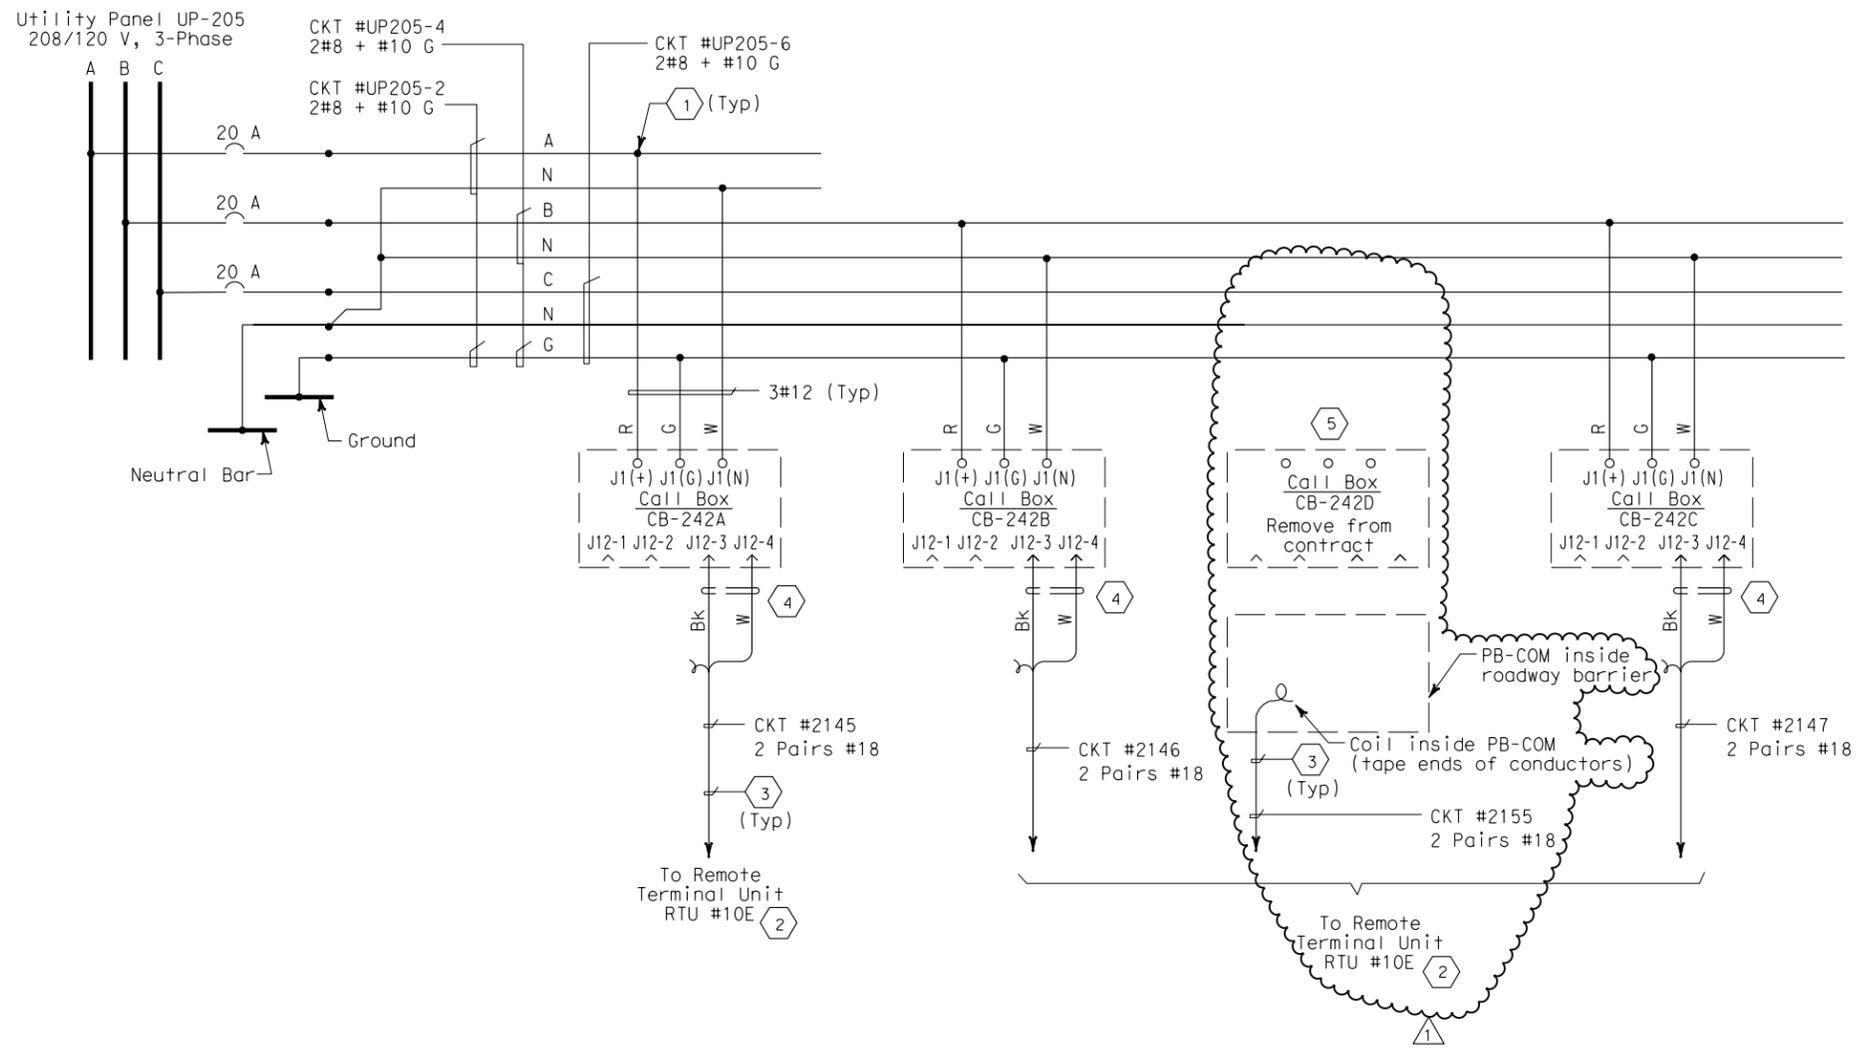

- SHEET NOTES:**
- 1 Conductors spliced inside PB-Ltg.
  - 2 For continuation, see RTU #10E connection diagrams sheet E-331.
  - 3 Data cable 1-2 pairs #18 shielded with overall shield. Coil and tape end of pair #2 inside Call Box.
  - 4 The Contractor shall install resistors, approximately equal to the impedance ( $Z_0$ ) of the twisted pairs, at the extreme ends of the multidrop network.
  - 5 Not deleted from contract, installed by others.

- NOTE:**
1. References:  
 - For panel schedules, see sheets E-151.  
 - For circuit and conduit/cable tray schedules, see sheets starting at E-401.  
 - For call boxes schedule, see sheet E-397.



*M. F. Tark*  
 FOR REVISION ONLY

REQUEST FOR INFORMATION NOT ADDRESSED IN THIS CCO REMAIN IN FORCE


MP	EL	RR	42
MARK	DATE	DESCRIPTIONS	BY CH'D CCO#
		REVISIONS	

CONTRACT CHANGE ORDER NO. \_\_\_\_\_  
 SHEET \_\_\_\_\_ OF \_\_\_\_\_

**DETAILS**  
**CALL BOX SYSTEM**  
**CALL BOX WIRING DIAGRAM**  
 NO SCALE

**E-399**

ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN.  
 FOR REDUCED PLANS ORIGINAL SCALE IS IN MILLIMETERS



DATE PLOTTED => 4/4/2008  
 TIME PLOTTED => 5:03:09 PM  
 00-00-00