

STATE OF CALIFORNIA - DEPARTMENT OF TRANSPORTATION
Caltrans
 DESIGN OVERSIGHT
 BEHZAD GOLEHAMMADI




DIST	COUNTY	ROUTE	KILOMETER POST TOTAL PROJECT	SHEET No	TOTAL SHEETS
04	SF	80	13.2/13.9	354R1	1204

12/19/02
 REGISTERED ELECTRICAL ENGINEER DATE
Jens Erlingsson
 No. 8249
 Exp. 9/30/06
 ELECTRICAL
 STATE OF CALIFORNIA

12-6-04
 PLANS APPROVAL DATE
PB POWER, Inc.
 A Parsons Brinckerhoff Company
 303 Second St., Suite 700N
 San Francisco, CA 94107-1317

The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.
 Caltrans now has a web site! To get to the web site, go to <http://www.dot.ca.gov>

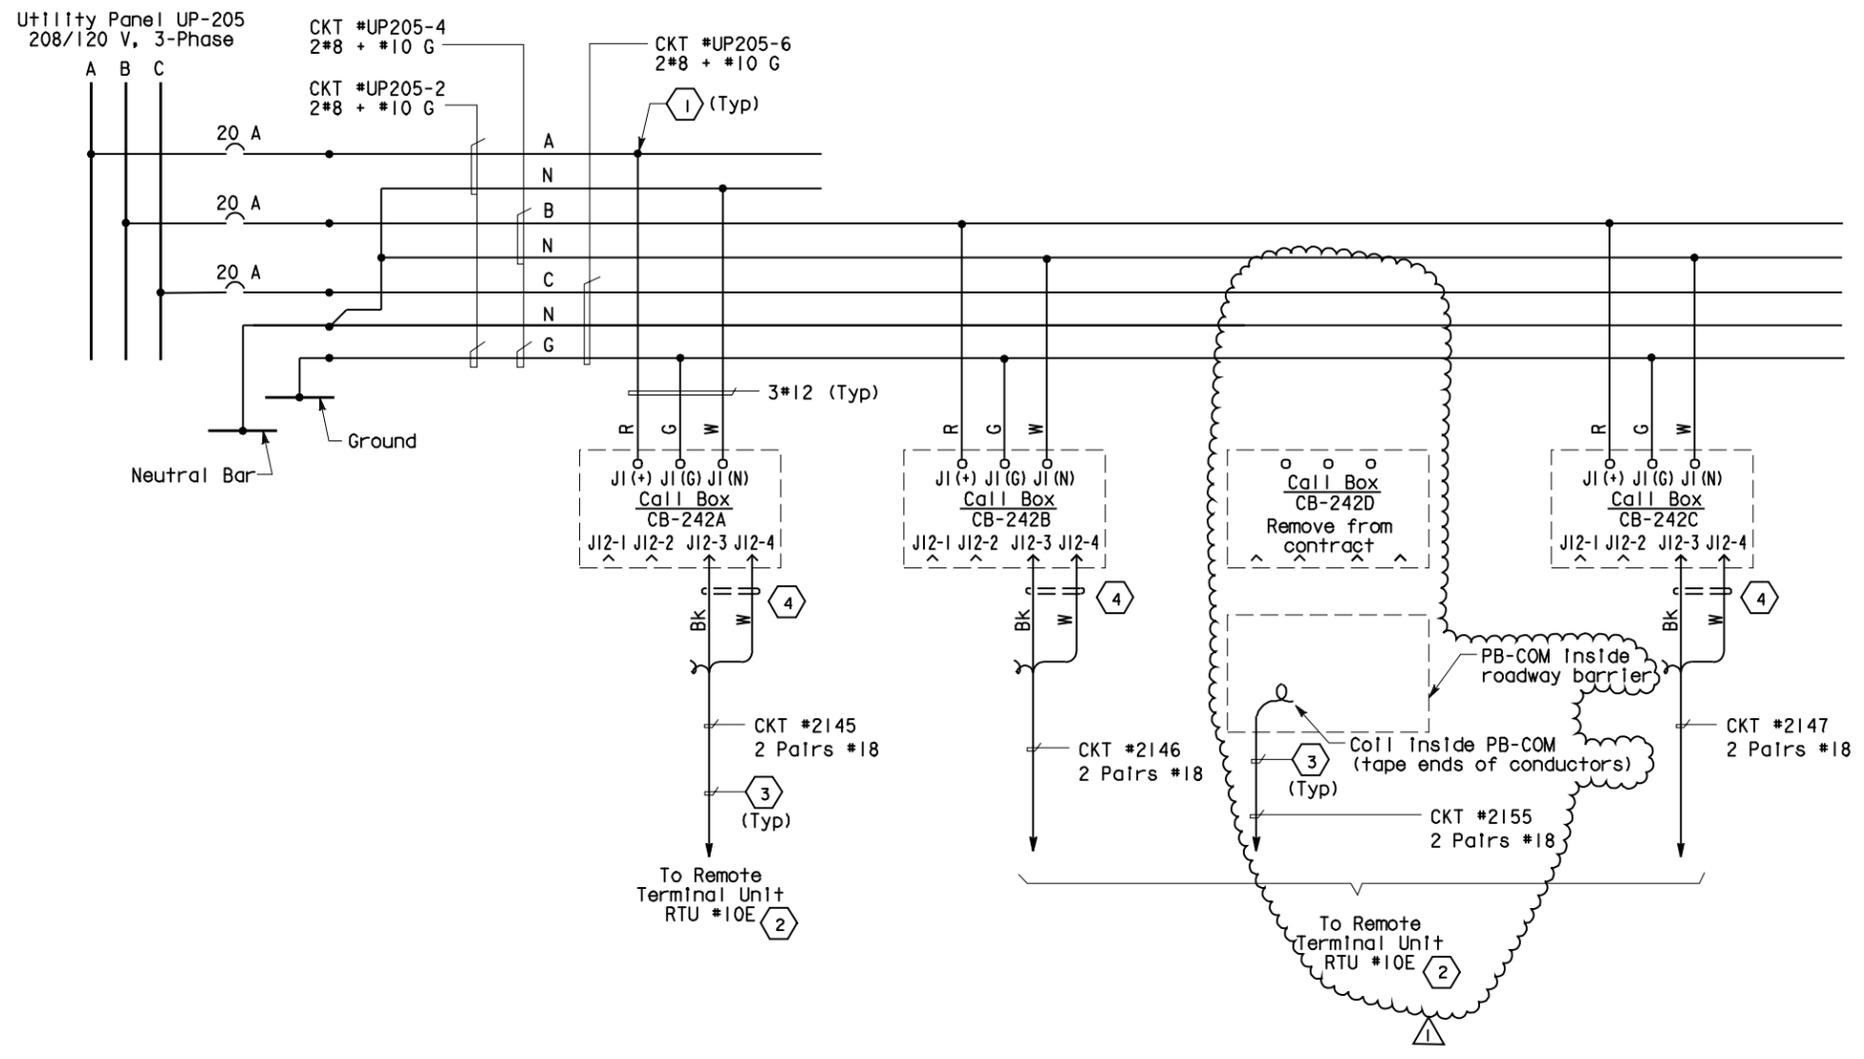

- SHEET NOTES:**
- Conductors spliced inside PB-Ltg.
 - For continuation, see RTU #10E connection diagrams sheet E-331.
 - Data cable 1-2 pairs #18 shielded with overall shield. Coil and tape end of pair #2 inside Call Box.
 - The Contractor shall install resistors, approximately equal to the impedance (Zo) of the twisted pairs, at the extreme ends of the multidrop network.
- NOTE:**
- References:
 - For panel schedules, see sheets E-151.
 - For circuit and conduit/cable tray schedules, see sheets starting at E-401.
 - For call boxes schedule, see sheet E-397.

EASTBOUND SAS SUPERSTRUCTURE



MARK	DATE	DESCRIPTIONS	BY	CK	CCO
Δ	8/6/07	Revision to misc. electric work, Delete call box CB-242-D per RFI-561 and RFI-591.	MP	EL	RR 42
REVISIONS					

CONTRACT CHANGE ORDER NO. 42
 SHEET X OF XX

**DETAILS
 CALL BOX SYSTEM
 CALL BOX WIRING DIAGRAM**
 NO SCALE

E-399

DATE PLOTTED => 29-AUG-2007
 TIME PLOTTED => 16:14
 LAST REVISION
 00-00-00