


DATE	REVISOR	DATE	REVISOR
08/02	IAH	08/02	IAH
FK	IAH	FK	IAH
CALCULATED/DESIGNED BY	CHECKED BY	CALCULATED/DESIGNED BY	CHECKED BY

DESIGN OVERSIGHT
BEHZAD GOLEMOHAMMADI


STATE OF CALIFORNIA - DEPARTMENT OF TRANSPORTATION
Caltrans

DIST	COUNTY	ROUTE	KILOMETER TOTAL PROJECT	POST TOTAL PROJECT	SHEET No	TOTAL SHEETS
04	SF	80	13.2/13.9		176 R1	1204

REGISTERED ELECTRICAL ENGINEER DATE 12/19/02
 REGISTERED ELECTRICAL ENGINEER JENS ERLINGSSON No. 8249 Exp. 9/30/06 ELECTRICAL STATE OF CALIFORNIA
 PLANS APPROVAL DATE 12/6/04
 PB POWER, Inc.
 A Parsons Brinckerhoff Company
 303 Second St., Suite 700N
 San Francisco, CA 94107-1317
 The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.
 To get to the web site, go to: <http://www.dot.ca.gov>

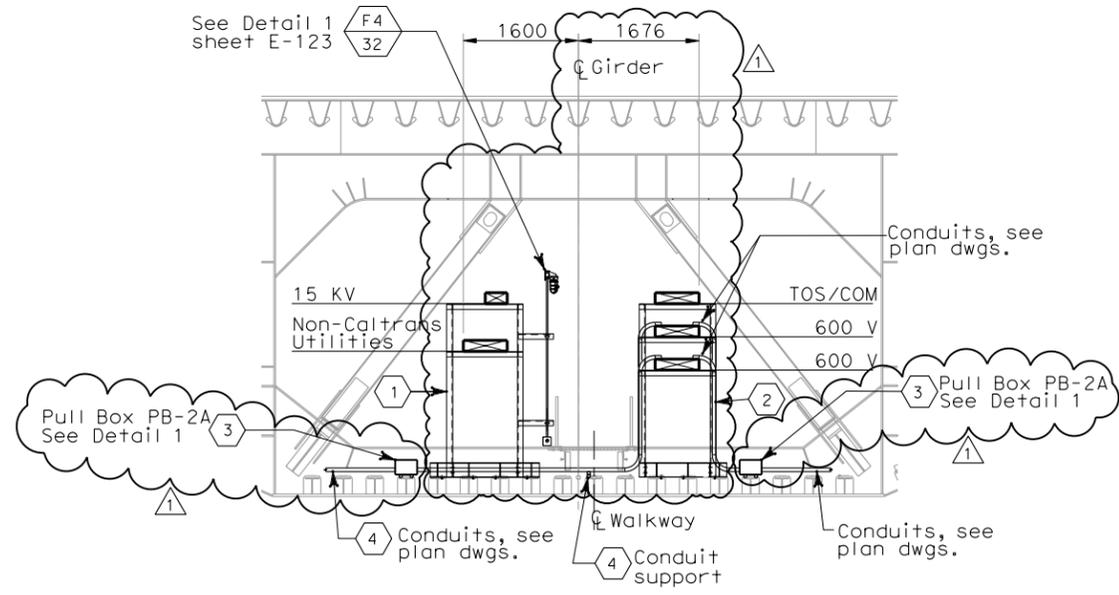

DETAIL-TYPICAL CABLE TRAY SUPPORT AND PULL BOX LOCATION
SECTION A-A
 SCALE 1:50
 (E-96, E-124A, E-124B)

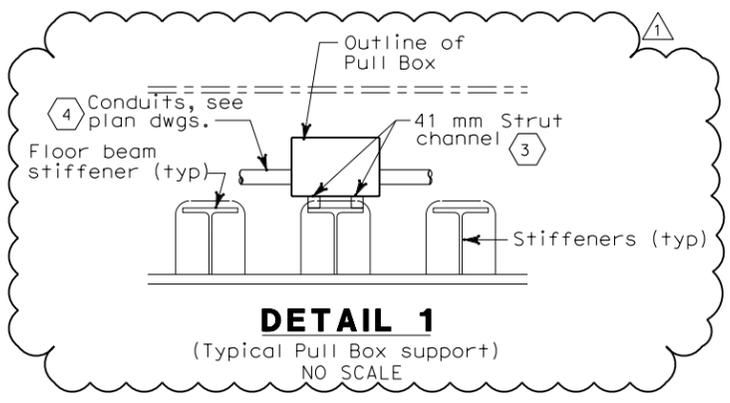

DETAIL 1
 (Typical Pull Box support)
 NO SCALE





FOR REVISION ONLY

REQUEST FOR INFORMATION NOT ADDRESSED IN THIS CCO REMAIN IN FORCE					
1	02/25/08	CABLE TRAY CHANGES	TW	RG	42S1
MARK	DATE	DESCRIPTIONS	BY	CH'D	CCO#
REVISIONS					

CONTRACT CHANGE ORDER NO. _____
 SHEET _____ OF _____

SHEET NOTES:

- 1 Type I, for cable tray supports details, see AS sheets.
- 2 Type II, for cable tray supports details, see AS sheets.
- 3 Pull Box PB-2A shall be located on top of stiffener. The Contractor shall provide strut channel for support installed in field.
- 4 The Contractor shall install in the field strut channel on top of stiffener for conduit support.

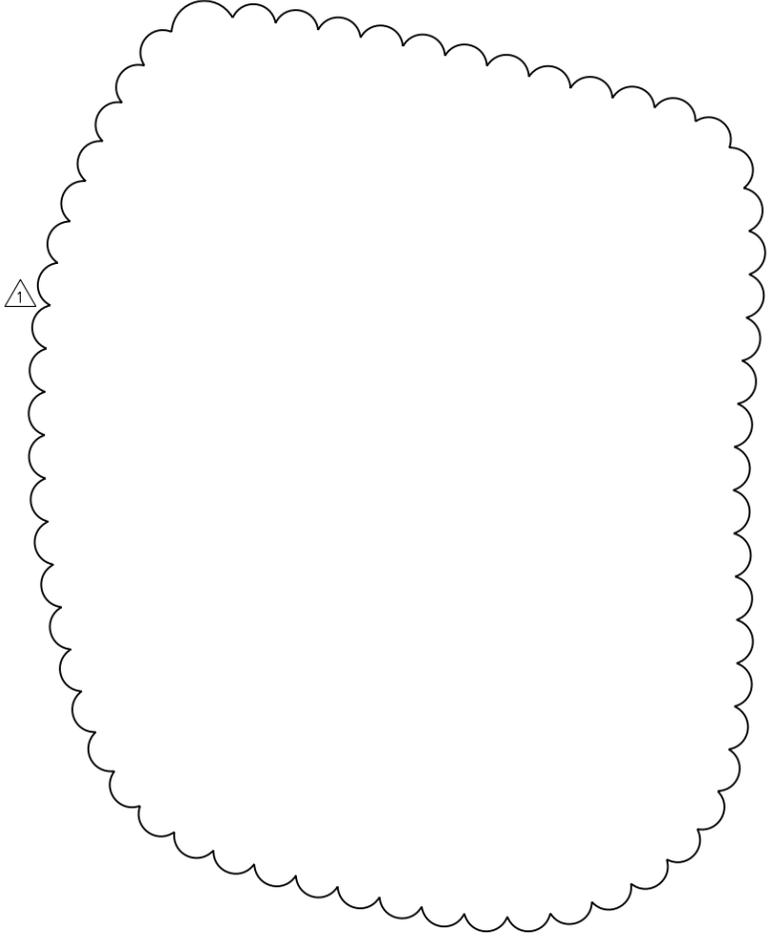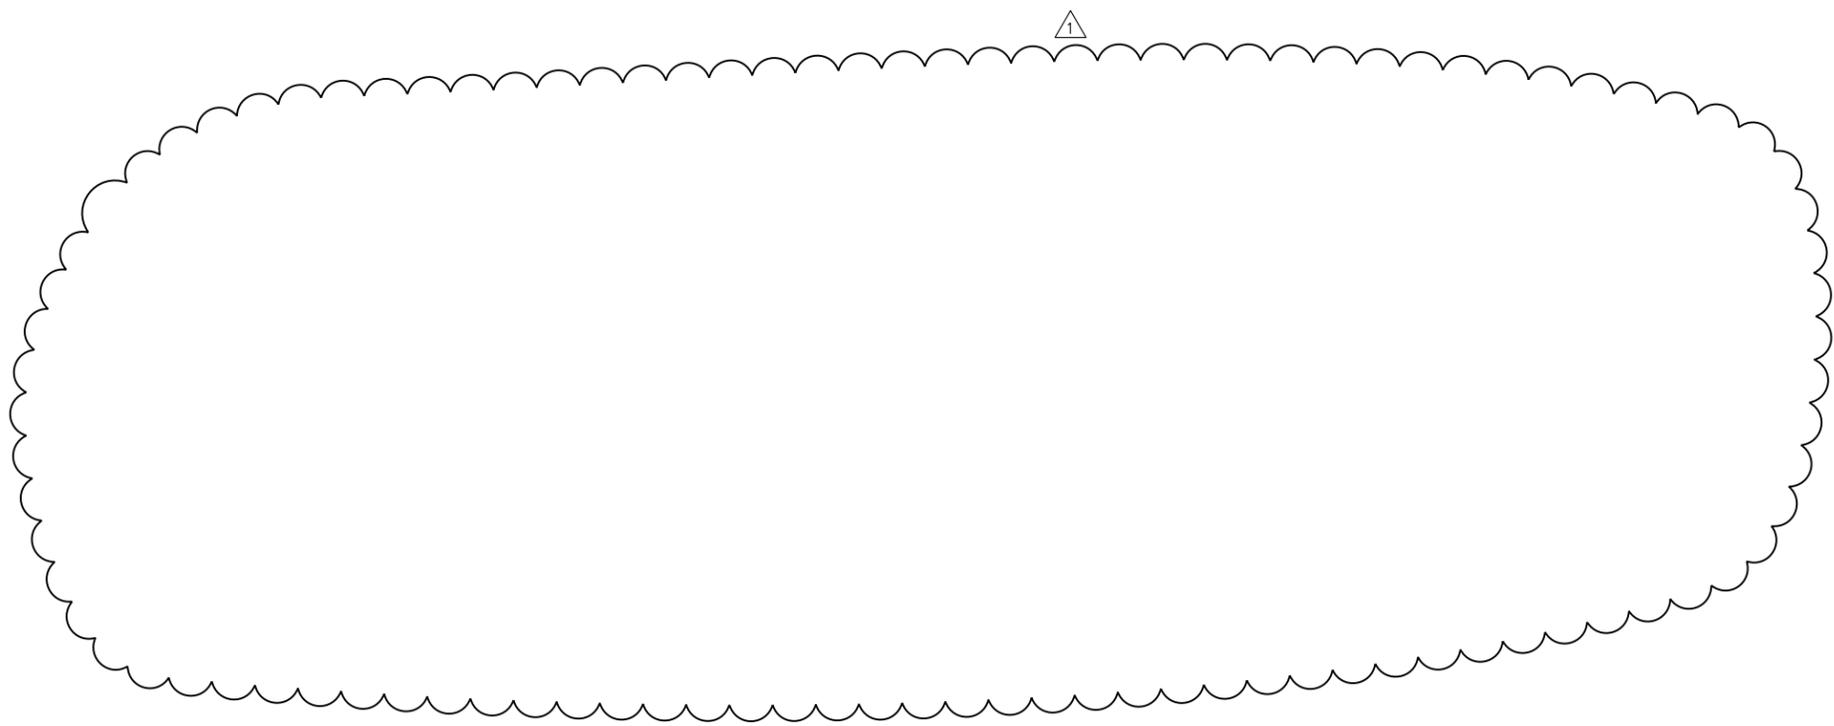


DETAILS
SAS SUPERSTRUCTURE GIRDER WESTBOUND
TYPICAL TRAY AND CONDUIT INSTALLATION
 SCALE AS NOTED

E-124

THIS PLAN ACCURATE FOR ELECTRICAL WORK ONLY.

FOR REDUCED PLANS ORIGINAL SCALE IS IN MILLIMETERS

ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN



DGN FILE => T:\13103\MS\pse\SAS Struc\CCO\SAS CC04251\04-0120F1_0176R01.dgn
 USERNAME => kurnovskaya CU 04251

EA 0120F1

DATE PLOTTED => 2/26/2008
 TIME PLOTTED => 1:34:36 PM
 00-00-00