





DIST	COUNTY	ROUTE	KILOMETER TOTAL PROJECT	POST PROJECT	SHEET No	TOTAL SHEETS
04	SF	80	13.2/13.9		235 S1	1204

REGISTERED ELECTRICAL ENGINEER DATE 2/22/08
 S. A. ESTOQUE, JR.
 No. E-10151
 Exp. 12/31/2008
 ELECTRICAL
 STATE OF CALIFORNIA

PLANS APPROVAL DATE
 PB AMERICAS, Inc.
 A Parsons Brinckerhoff Company
 303 Second St., Suite 700N
 San Francisco, CA 94107-1317

The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.

Caltrans now has a web site! To get to the web site, go to <http://www.dot.ca.gov>

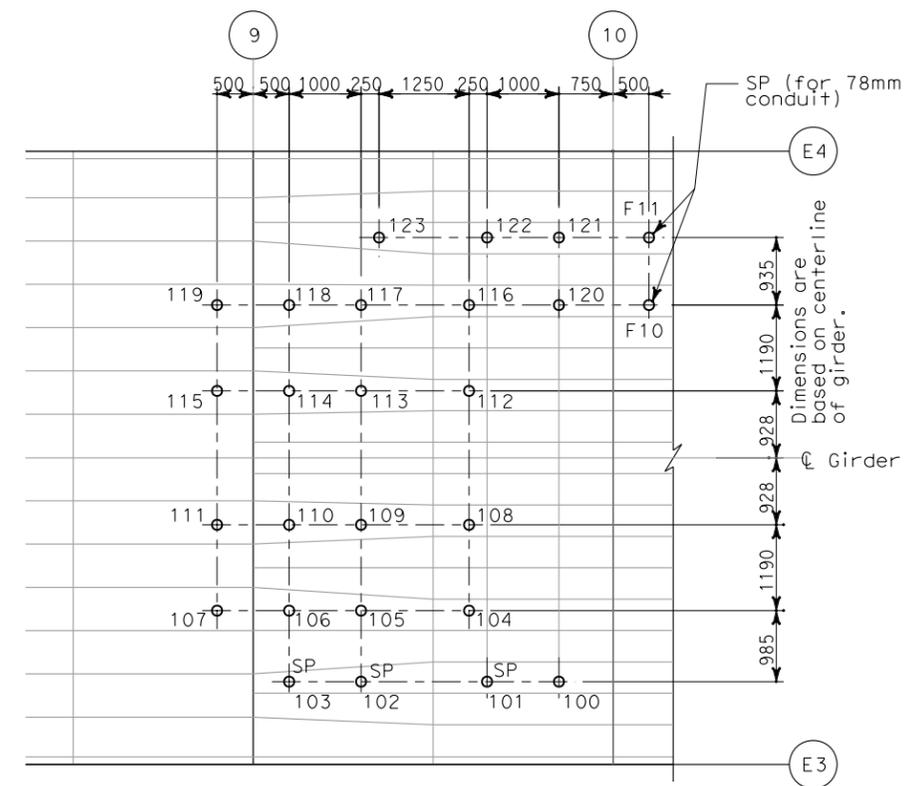
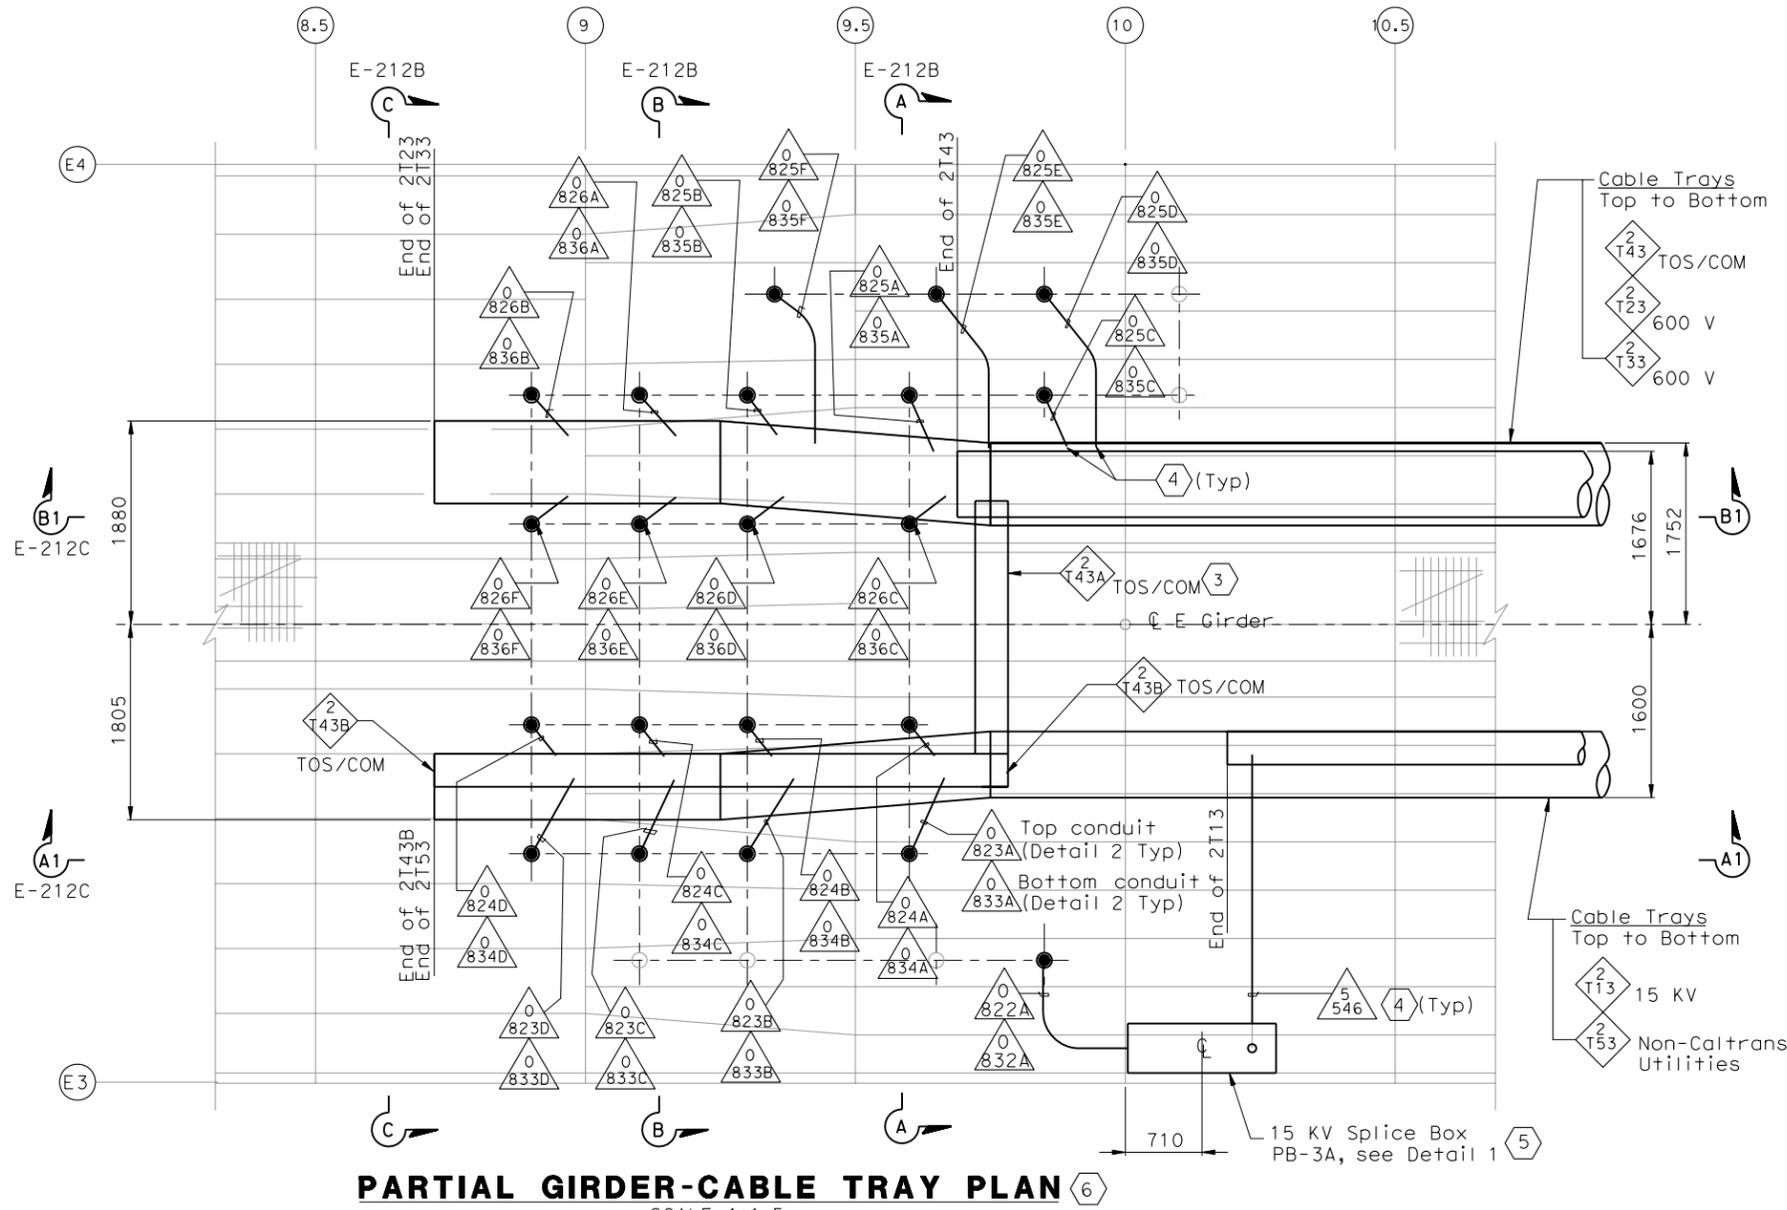


SHEET NOTES:

- 1 To prevent moisture from entering inside the conduit, Contractor to seal the end of conduit after cables are pulled.
- 2 Down to cable tray, for continuation see sheet E-212.
- 3 Provide drop out tray fitting.
- 4 Provide insulated ground bushing at end of conduit.
- 5 15 KV splice box is bolted to longitudinal shear plate and installed by field.
- 6 See table A, sheet E-212B.

NOTES:

1. References:
- For circuit and conduit/cable tray schedules, see sheets starting at E-401.
2. (SP) Denotes spare pipe sleeve for future 103 mm conduit. Contractor to provide threaded cap at exterior end (Unless Otherwise Noted).
3. For cable tray supports details, see AS sheets.
4. Cable tray fittings shall be 610 radius.

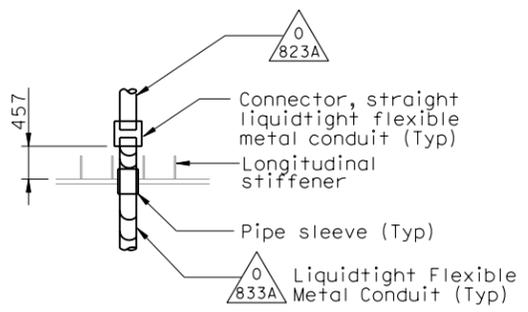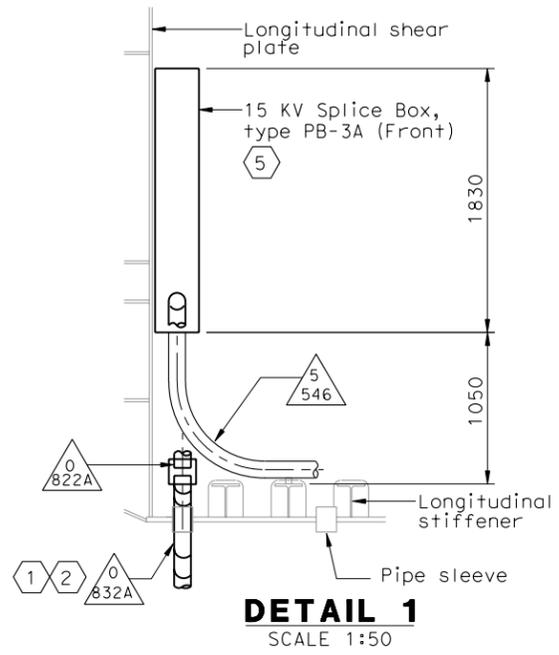

REQUEST FOR INFORMATION NOT ADDRESSED IN THIS CCO REMAIN IN FORCE			
△	02/25/08	CABLE TRAY CHANGES	TW MP RG SE 42S1
MARK	DATE	DESCRIPTIONS	BY CH'D CCO#
REVISIONS			

CONTRACT CHANGE ORDER NO. _____
SHEET _____ OF _____

DETAILS
SAS SUPERSTRUCTURE GIRDER EASTBOUND
CABLE TRAY AND CONDUIT AT PIER W2E
SCALE AS NOTED

E-212A

STATE OF CALIFORNIA - DEPARTMENT OF TRANSPORTATION
 DESIGN OVERSIGHT
 BEHZAD GOLEMOHAMMADI
 REVISIONS
 DATE REVISIONS BY DATE REVISIONS BY
 CALCULATED/DESIGNED BY CHECKED BY
 Caltrans

THIS PLAN ACCURATE FOR ELECTRICAL WORK ONLY.

ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN
 FOR REDUCED PLANS ORIGINAL SCALE 15 IN MILLIMETERS

DGN FILE => T:\13103\MS\pse\SAS Struc\CCO\SAS CC04251\04-0120F1_0235501.dgn
 USERNAME => ilorico
 CU 04251

EA 0120F1

DATE PLOTTED => 4/18/2008
 TIME PLOTTED => 5:20:38 PM
 LAST REVISION 00-00-00