





DIST	COUNTY	ROUTE	KILOMETER POST TOTAL PROJECT	SHEET No	TOTAL SHEETS
04	SF	80	13.2/13.9	232 R1	1204

11/27/02  
 REGISTERED ELECTRICAL ENGINEER DATE  
 JENS ERLINGSSON  
 No. 8249  
 Exp. 9/30/06  
 ELECTRICAL  
 STATE OF CALIFORNIA

PLANS APPROVAL DATE  
 PB POWER, Inc.  
 A Parsons Brinckerhoff Company  
 303 Second St., Suite 700N  
 San Francisco, CA 94107-1317

The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.  
 Caltrans now has a web site! To get to the web site, go to <http://www.dot.ca.gov>

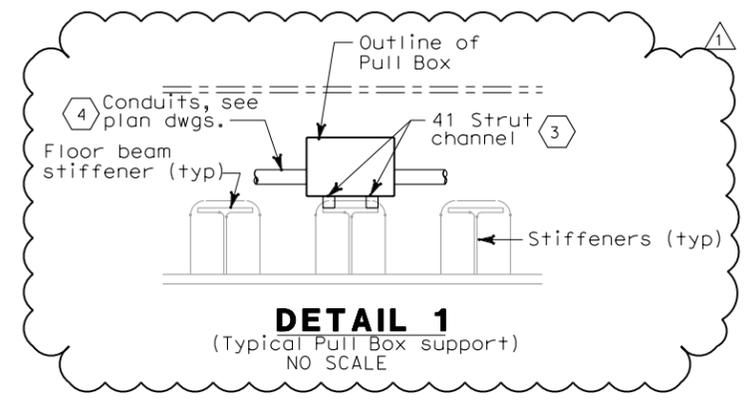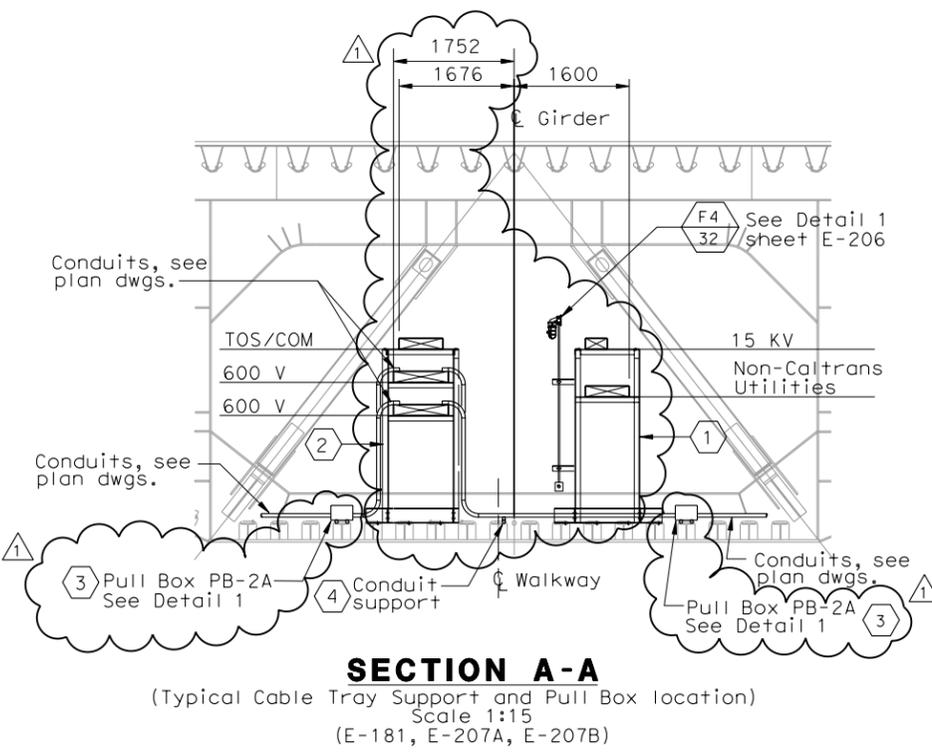



FOR REVISION ONLY

REQUEST FOR INFORMATION NOT ADDRESSED IN THIS CCO REMAIN IN FORCE					
△	02/25/08	CABLE TRAY CHANGES	TW	RG SE	42S1
MARK	DATE	DESCRIPTIONS	BY	CH'D	CCO#
REVISIONS					

CONTRACT CHANGE ORDER NO. \_\_\_\_\_  
 SHEET \_\_\_\_\_ OF \_\_\_\_\_

**SHEET NOTES:**

- ① Type I, for cable tray supports details, see AS sheets.
- ② Type II, for cable tray supports details, see AS sheets.
- ③ Pull Box PB-2A shall be located on top of stiffener. The Contractor shall provide strut channel for support installed in field.
- ④ The Contractor shall provide strut channel on top of stiffener for conduit support and installed in field.

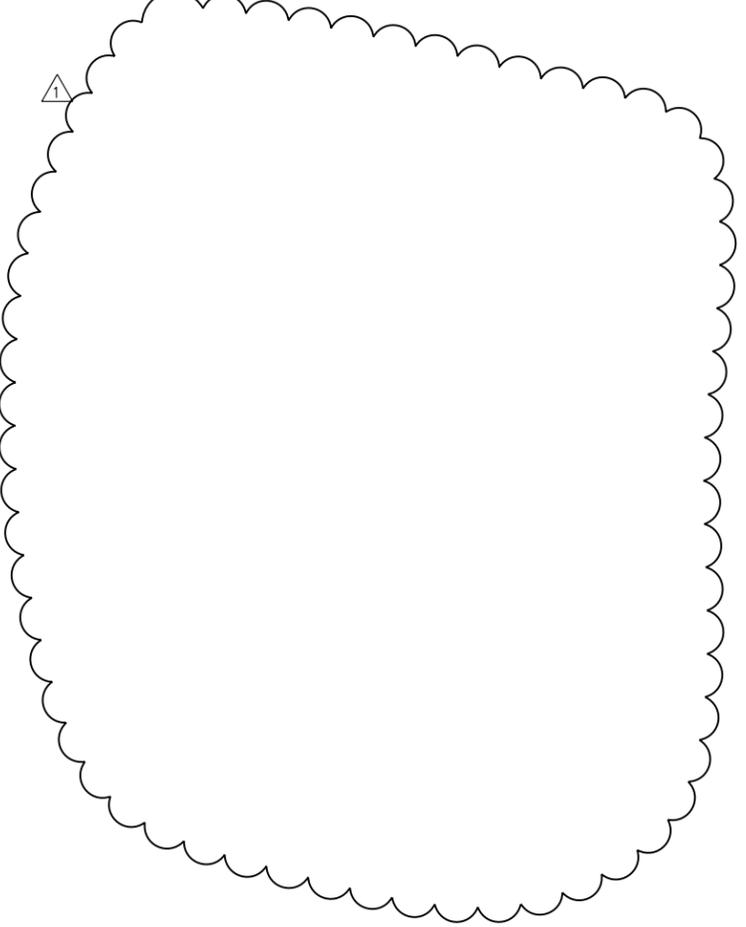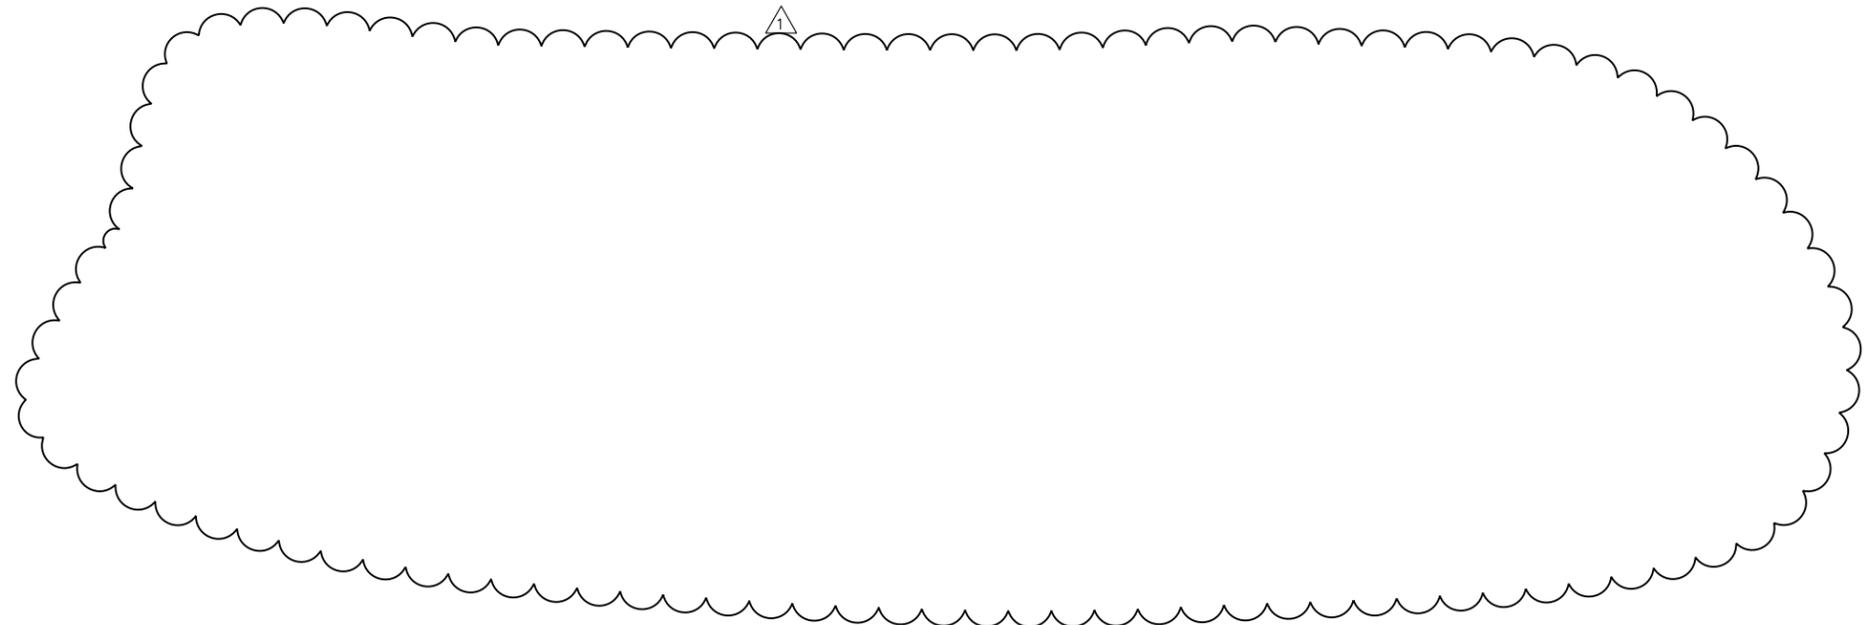

DESIGN OVERSIGHT  
BEHZAD GOLEMOHAMMADI

STATE OF CALIFORNIA - DEPARTMENT OF TRANSPORTATION  
Caltrans

**DETAILS**  
**SAS SUPERSTRUCTURE GIRDER EASTBOUND**  
**TYPICAL TRAY AND CONDUIT INSTALLATION**  
 SCALE AS NOTED

**3 REVISED PER ADDENDUM NO. 3 DATED NOVEMBER 7, 2005**

**E-207**

THIS PLAN ACCURATE FOR ELECTRICAL WORK ONLY.

