



STATE OF CALIFORNIA - DEPARTMENT OF TRANSPORTATION
Caltrans
 DESIGN OVERSIGHT
 BEHZAD GOLEMOHAMMADI

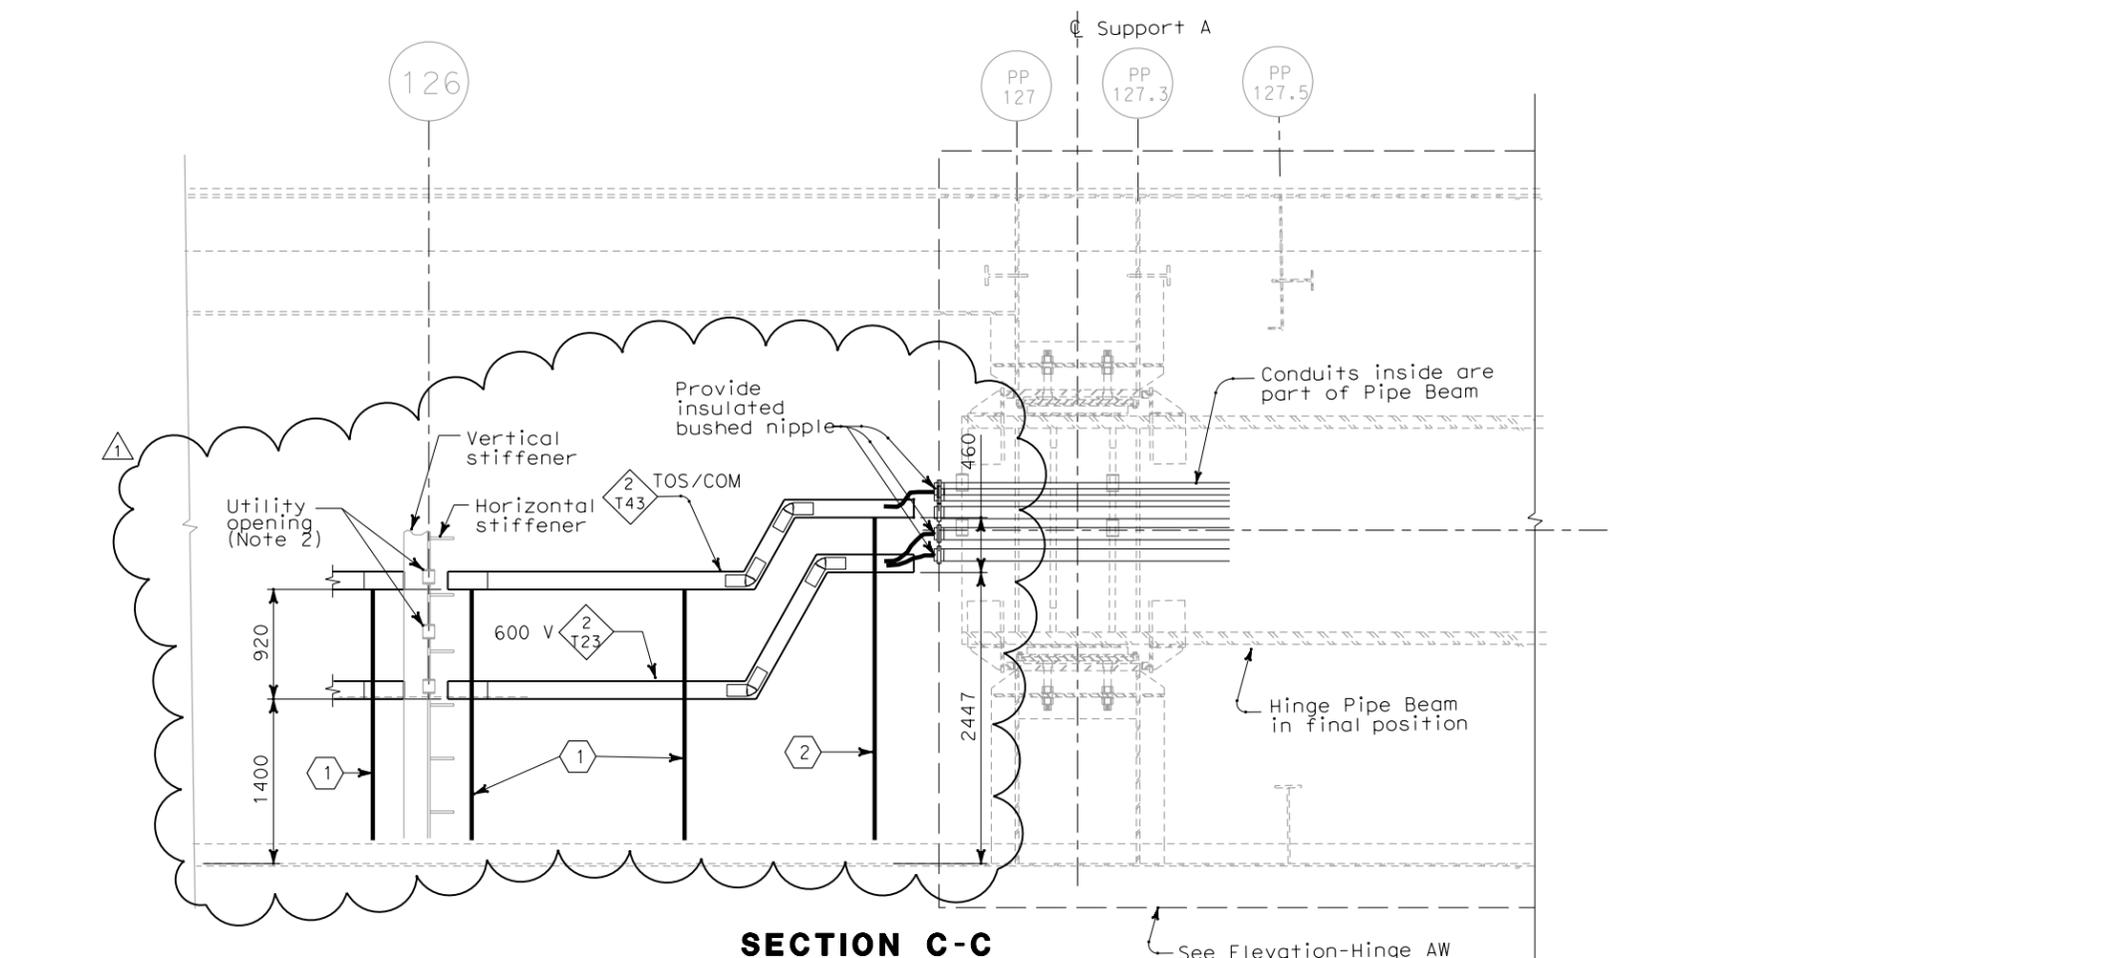


SECTION C-C
 (SEE SHEET E-220)
 SCALE 1:30

See Elevation-Hinge AW
 Sheet E-221A

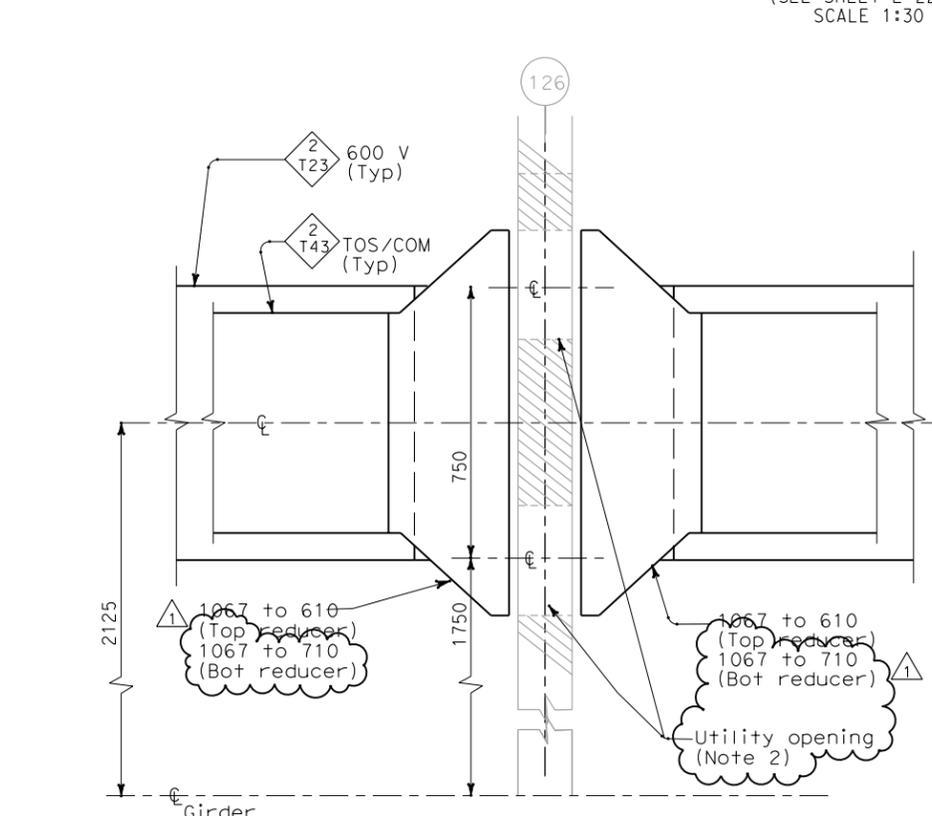

DETAIL 2
 (SEE SHEET E-220)
 SCALE 1:10

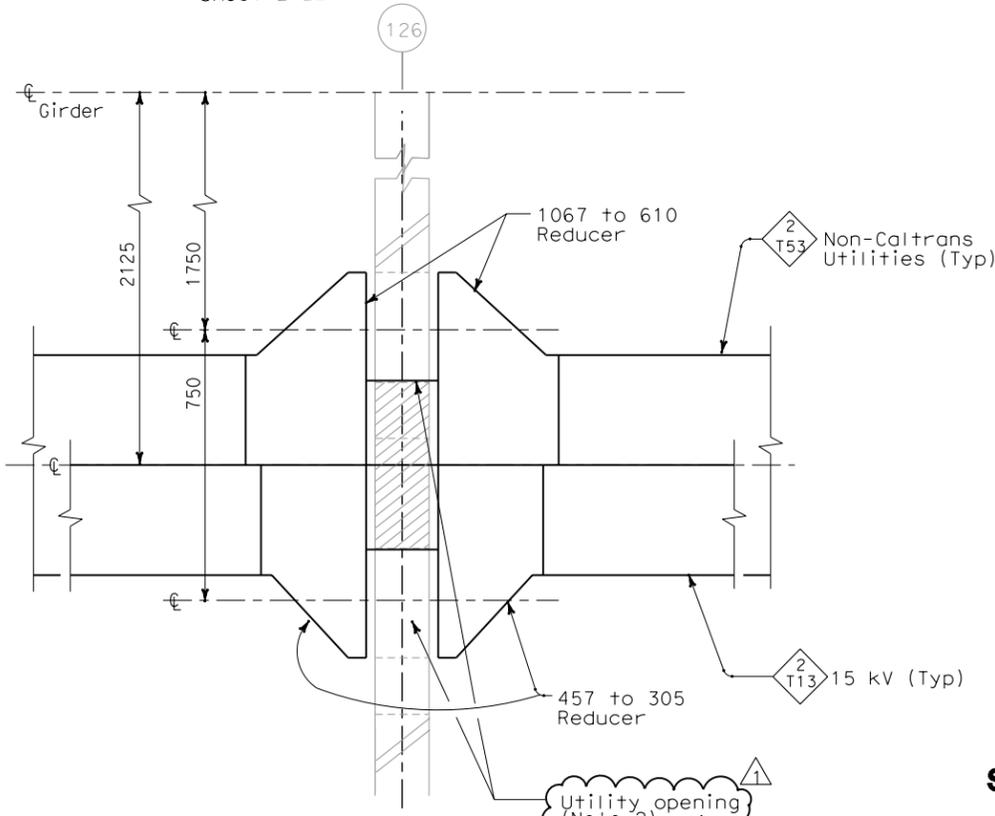


DETAIL 4
 (SEE SHEET E-220)
 SCALE 1:10



DIST	COUNTY	ROUTE	KILOMETER TOTAL PROJECT	POST TOTAL PROJECT	SHEET No	TOTAL SHEETS
04	SF	80	13.2/13.9		240 R1	1204

Jens Erlingsson 12/19/02
 REGISTERED ELECTRICAL ENGINEER DATE
 12-6-04
 PLANS APPROVAL DATE
 PB POWER, Inc.
 A Parsons Brinckerhoff Company
 303 Second St., Suite 700N
 San Francisco, CA 94107-1317
 The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.
 Caltrans now has a web site! To get to the web site, go to <http://www.dot.ca.gov>



NOTES:

1. For utility opening details at panel point 126, see Structural sheets.
2. Install grommet of neoprene rubber or similar materials to protect cable insulation from sharp metallic edges.

SHEET NOTES:

- 1 For Type IX cable tray support structure, see AS-15.
- 2 For Type VIII cable tray support structure, see AS-15.



Stokey
 FOR REVISION ONLY

REQUEST FOR INFORMATION NOT ADDRESSED IN THIS CCO REMAIN IN FORCE						
1	02/25/08	CABLE TRAY CHANGES	MP	RG	42S1	
MARK	DATE	DESCRIPTIONS	BY	CH'D	CCO#	
REVISIONS						


CONTRACT CHANGE ORDER NO. _____
 SHEET _____ OF _____

DETAILS
SAS SUPERSTRUCTURE GIRDER EASTBOUND
HINGE AE
 SCALE AS NOTED

E-221

THIS PLAN ACCURATE FOR ELECTRICAL WORK ONLY.

ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN



DGN FILE =>T:\13103\MS\pse\SAS Struc\CCO\SAS CC042S1\CCO 42S1 Final Submittal 2008-07-11\04-0120f1_0240R01.dgn
 USERNAME =>llorico
 CU 04251 EA 0120F1

DATE PLOTTED => 7/11/2008
 TIME PLOTTED => 3:01:43 PM
 00-00-00