

THIS PLAN IS ACCURATE FOR ELECTRICAL WORK ONLY.


FOR REVISION ONLY



2	11-30-07	Barrier Modifications.	J5	RG	44
1	8-06-07	Electrical modifications.	BM	EL	42
MARK	DATE	DESCRIPTIONS	BY	CK	CCO
REVISIONS					

CONTRACT CHANGE ORDER NO. 44
 SHEET OF

CONDUIT PLAN

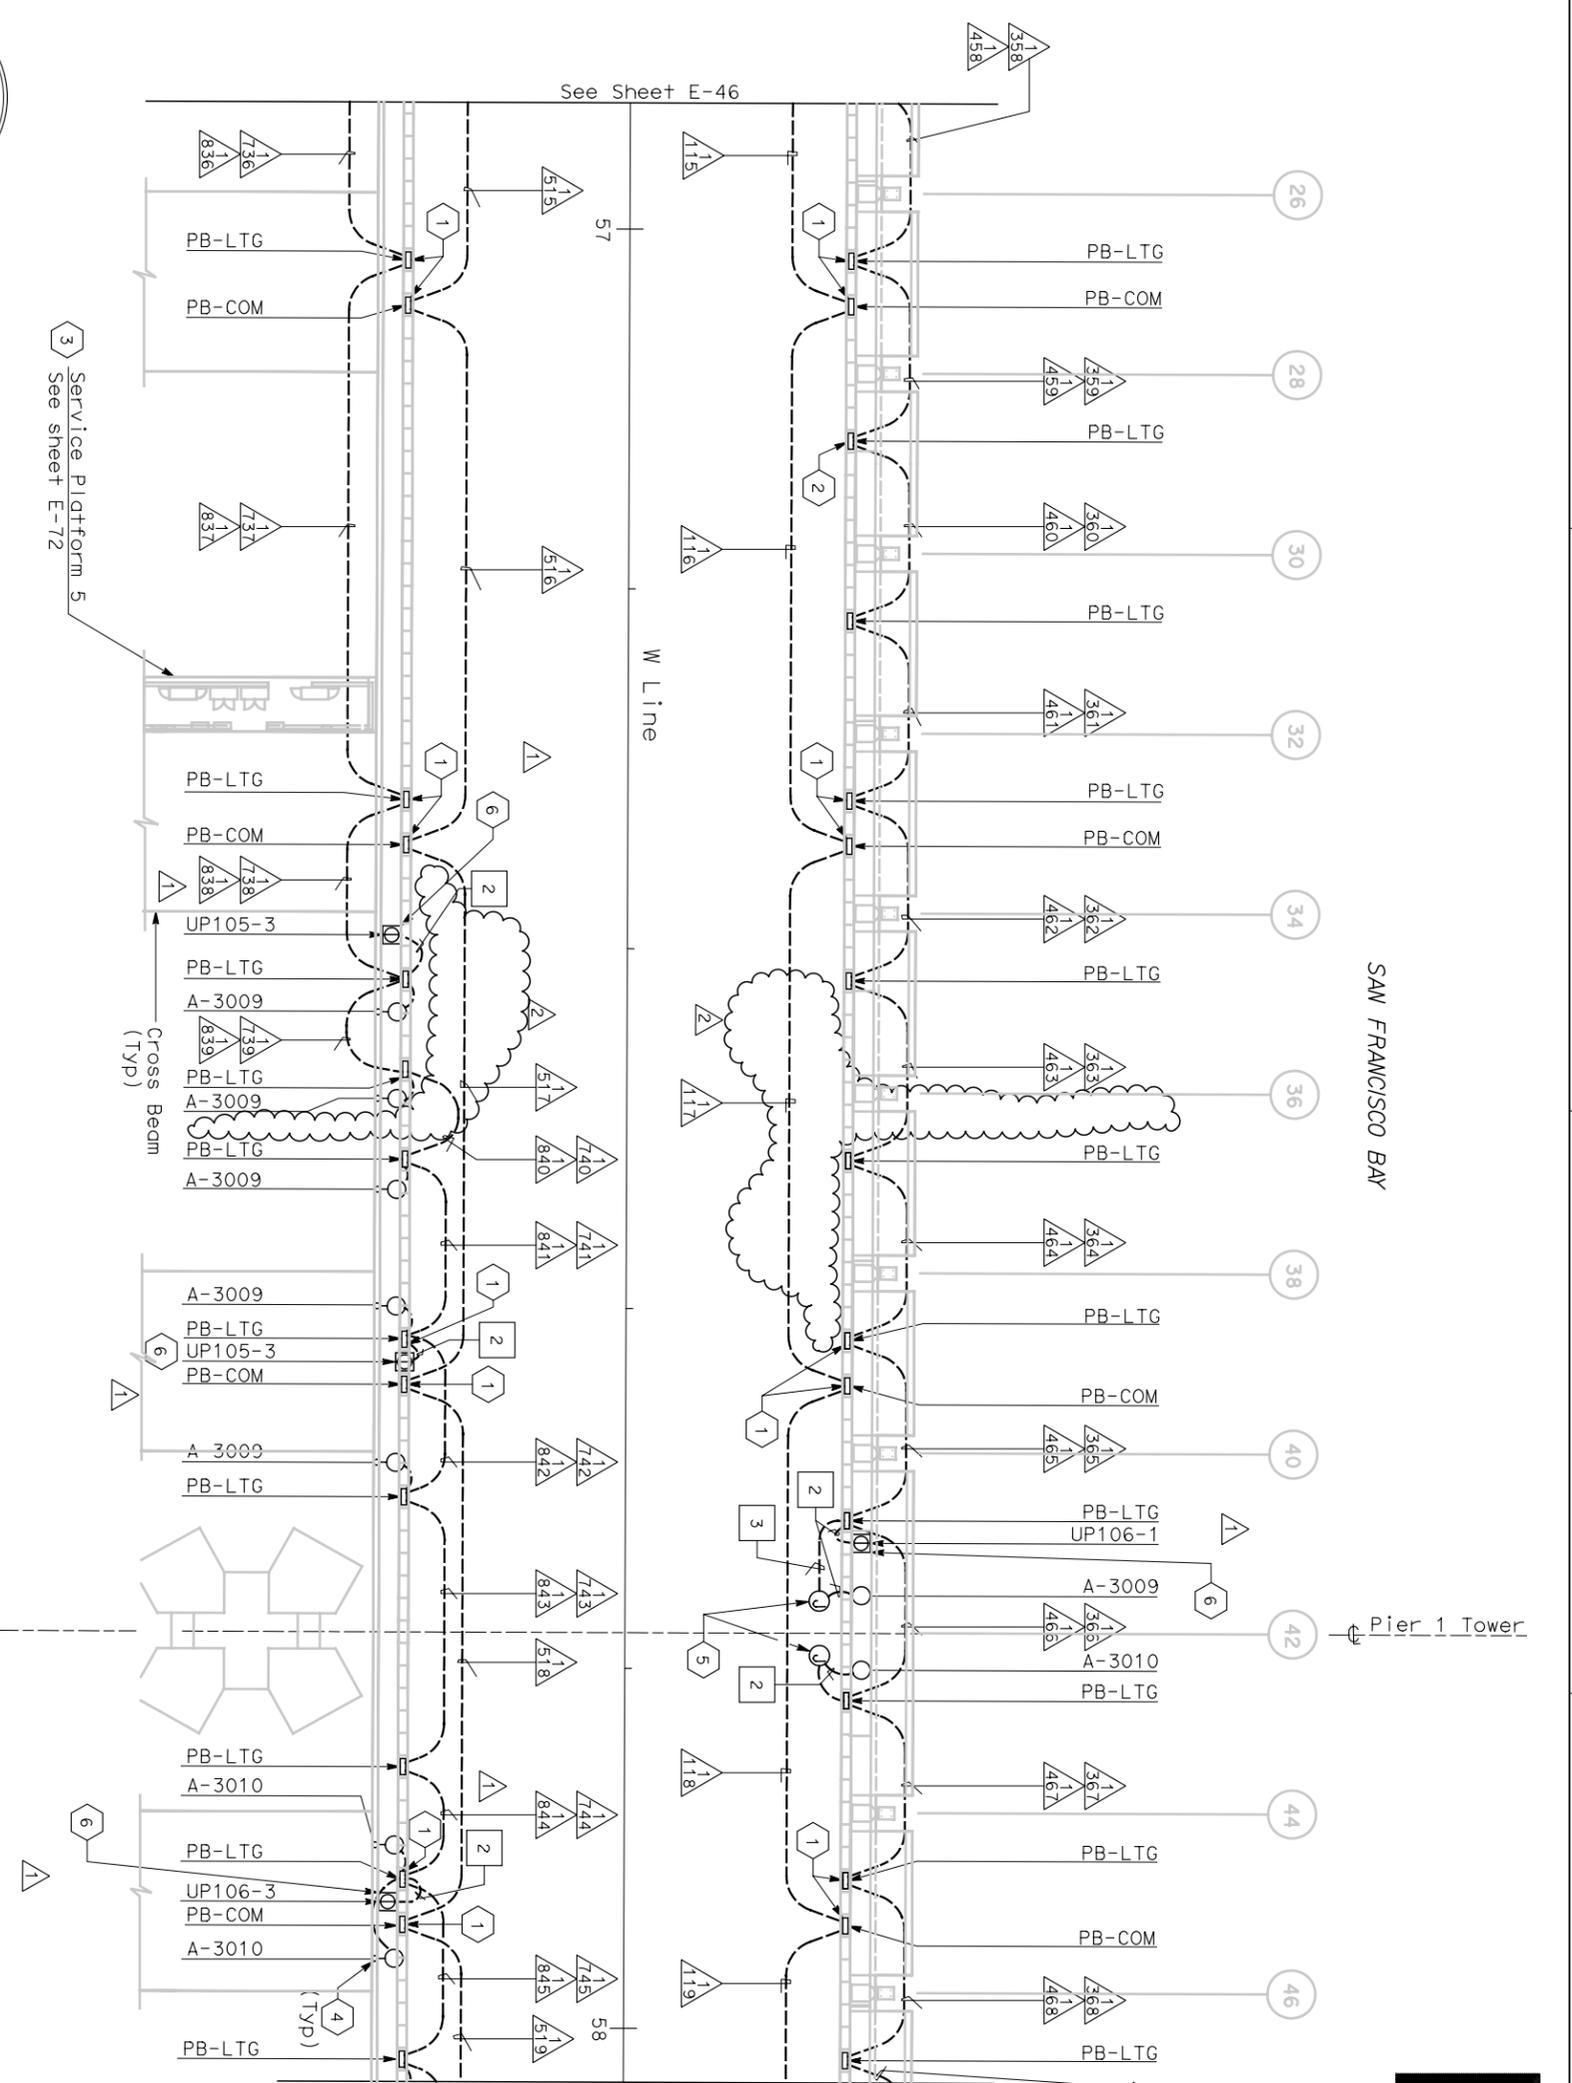

SAN FRANCISCO BAY



DIST	COUNTY	ROUTE	KILOMETER TOTAL PROJECT	POST MILE TOTAL PROJECT	SHEET NO.	TOTAL SHEETS
04	SF	80	13.2/13.9	11.8R2	1204	1204
REGISTERED ELECTRICAL ENGINEER DATE: 12/19/02 JENS ERLINGSSON NO. 8249 EXP. 9/30/08 STATE OF CALIFORNIA						
12-6-04 PB POWER, Inc. A Parsons Brinckerhoff Company 303 Second St., Suite 700N San Francisco, CA 94107-1317						
The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet. Caltrans now has a web site. To get to the web site, go to http://www.dot.ca.gov						

SHEET NOTES:

- Conduit from barrier pullbox or other equipment down into girder, See sheet E-97.
- For conduit to Suspend Lighting, See sheet E-227. TYP for all PB-LTG located on the north side of the roadway.
- Contractor shall furnish and install UP-105 per sheet E-72. For complete scope of work on platform and other related work not shown on this sheet, see Electrical Special Provisions.
- See sheet E-67 for pylon flood light conduit location.
- Type PB-1C junction box is used on suspender brackets.
- Roadway Barrier Receptacle, see Detail 1, sheet E-68.

NOTES:

- References:
 - For typical details and locations of conduit connections to light poles, barrier outlet boxes, call boxes, overhead sign lighting, CCTV and WDS, see sheets E-67, E-68 and E-68.
 - TOS equipment is shown for conduit routing only. For typical details of TOS controller and devices, see sheets E-344 through E-357.
 - For types of pullboxes, splice boxes and enclosures, see sheet E-83.
 - For circuit and conduit/cable tray schedules, see sheets starting at E-401. E-396.
- For Roadway Call Boxes, refer to sheet E-396.
- For Roadway Level Lighting Pole Schedule, see sheet E-82.
- For Roadway Level Call Box Schedule, see sheet E-397.
- For number of lighting fixtures (main tower lights), see lighting schedule sheets E-271 and E-272.

SAS SUPERSTRUCTURE ROADWAY WESTBOUND LIGHTING AND ELECTRICAL SYSTEMS

SCALE 1:200

E-47

FOR REDUCED PLANS ORIGINAL SCALE IS IN MILLIMETERS

DGN FILE => \1\3103\ms\pse\ssds struc\cco\ssds cco44\04-0120F1_011g2.dgn
 USERNAME => rjeseal

EA 0120F1