


STATE OF CALIFORNIA - DEPARTMENT OF TRANSPORTATION
Caltrans
 DESIGN OVERSIGHT
 BEHZAD GOLEMOHAMMADI

Utility Panel UP-205
 208/120 V, 3-Phase

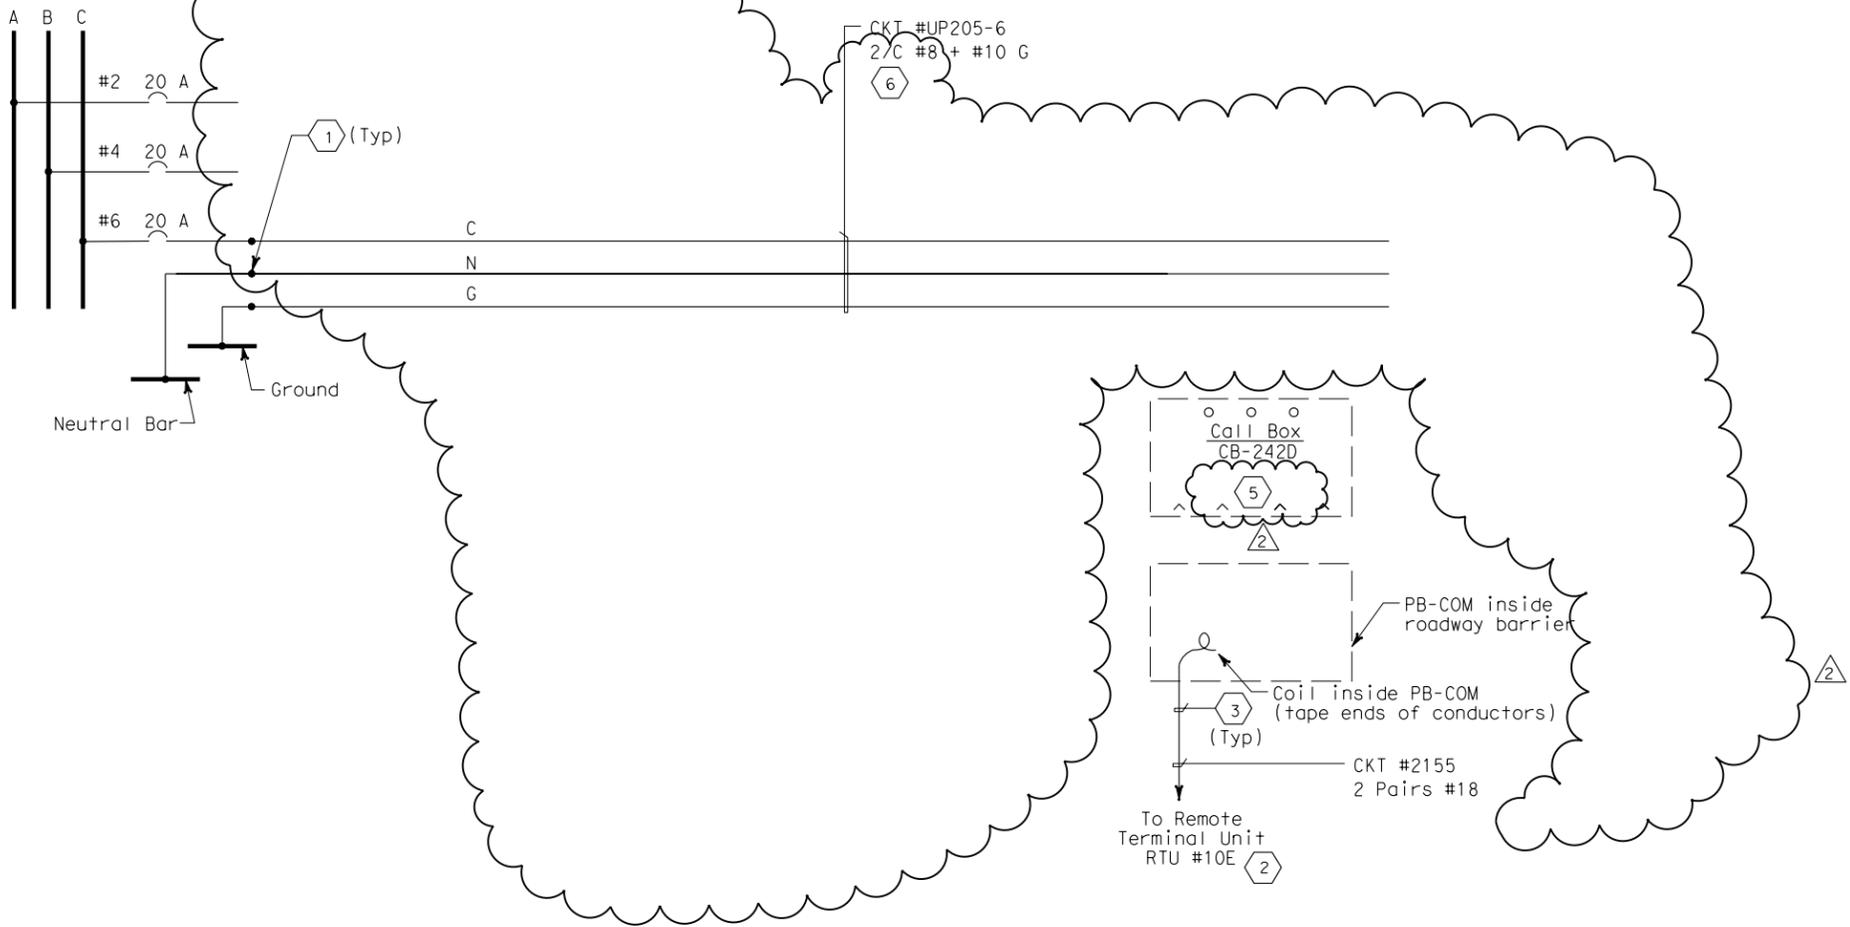

DIST	COUNTY	ROUTE	KILOMETER TOTAL PROJECT	POST TOTAL PROJECT	SHEET No	TOTAL SHEETS
04	SF	80	13.2/13.9		354 R2	1204

REGISTERED ELECTRICAL ENGINEER
 JENS ERLINGSSON
 No. 8249
 Exp. 9/30/06
 ELECTRICAL
 STATE OF CALIFORNIA

12/19/02
 REGISTERED ELECTRICAL ENGINEER DATE

12-6-04
 PLANS APPROVAL DATE

PB POWER, Inc.
 A Parsons Brinckerhoff Company
 303 Second St., Suite 700N
 San Francisco, CA 94107-1317

The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.

Caltrans now has a web site! To get to the web site, go to <http://www.dot.ca.gov>

SHEET NOTES:

- 1 Conductors spliced inside PB-Ltg.
- 2 For continuation, see RTU #10E connection diagrams sheet E-331.
- 3 Data cable 1-2 pairs #18 shielded with overall shield. Coil and tape end of pair #2 inside Call Box.
- 4 Deleted.
- 5 Not deleted from contract, state furnished and installed by others.
- 6 Cable shall be unterminated, coiled and taped at both ends until call box is installed.

NOTE:

- 1. References:
 - For panel schedules, see sheets E-151.
 - For circuit and conduit/cable tray schedules, see sheets starting at E-401.
 - For call boxes schedule, see sheet E-397.

EASTBOUND SAS SUPERSTRUCTURE



FOR REVISION ONLY

REQUEST FOR INFORMATION NOT ADDRESSED IN THIS CCO REMAIN IN FORCE					
MARK	DATE	DESCRIPTIONS	BY	CH'D	CCO#
2	03/04/08	BARRIER MODIFICATIONS	JS BM	RG SE	44
1	02/19/08	ELECTRICAL MODIFICATIONS	MP EL	RR	42

CONTRACT CHANGE ORDER NO. _____
 SHEET _____ OF _____

**DETAILS
 CALL BOX SYSTEM
 CALL BOX WIRING DIAGRAM**
 NO SCALE

E-399

THIS PLAN ACCURATE FOR ELECTRICAL WORK ONLY.

FOR REDUCED PLANS ORIGINAL SCALE IS IN MILLIMETERS

DGN FILE => T:\13103\MS\pse\SAS Struc\CCO\SAS CC044\04-0120f1_0354R02.dgn
 USERNAME => llorico
 CU 04251

EA 0120F1

DATE PLOTTED => 4/18/2008
 TIME PLOTTED => 1:42:25 PM
 00-00-00