


STATE OF CALIFORNIA - DEPARTMENT OF TRANSPORTATION
Caltrans
 DESIGN OVERSIGHT
 BEHZAD GOLEMOHAMMADI

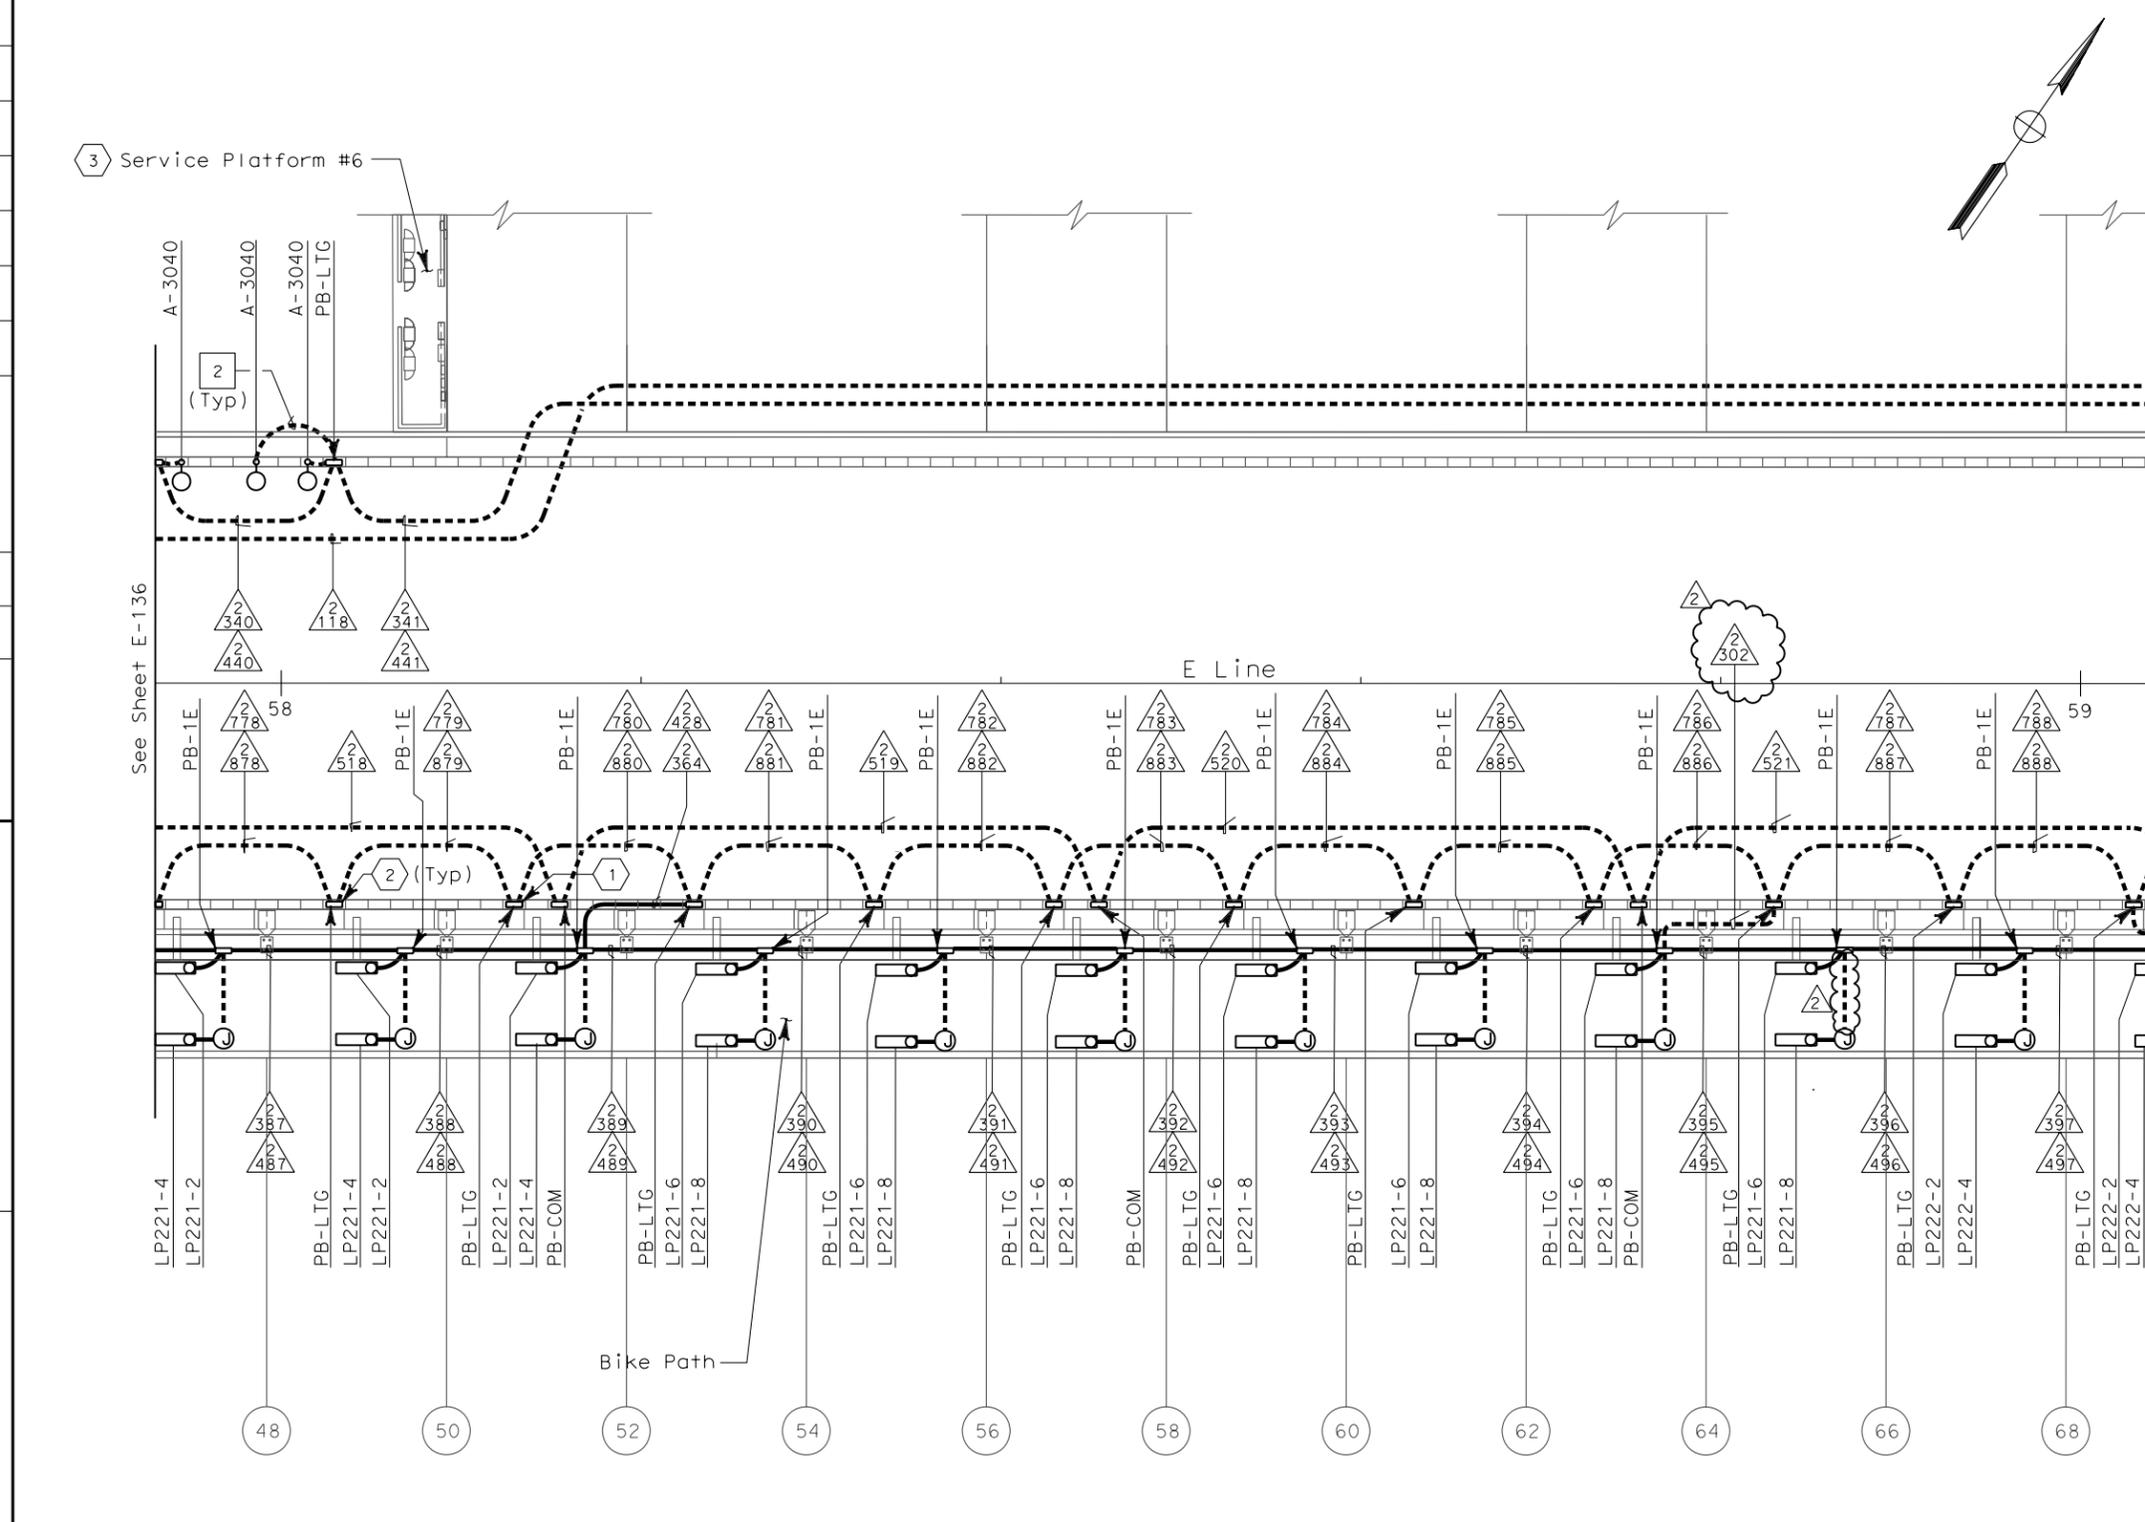

Caltrans
Metric

DIST	COUNTY	ROUTE	KILOMETER TOTAL PROJECT	POST PROJECT	SHEET No	TOTAL SHEETS
04	SF	80	13.2/13.9	190R2	1204	

REGISTERED ELECTRICAL ENGINEER
 JENS ERLINGSSON
 No. 8249
 Exp. 9/30/06
 STATE OF CALIFORNIA

12/19/02
 REGISTERED ELECTRICAL ENGINEER DATE

12-6-04
 PLANS APPROVAL DATE

PB POWER, Inc.
 A Parsons Brinckerhoff Company
 303 Second St., Suite 700N
 San Francisco, CA 94107-1317

The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.


Caltrans now has a web site! To get to the web site, go to: <http://www.dot.ca.gov>

- SHEET NOTES:**
- Conduit from barrier pullbox or other equipment down into Girder Box, see sheet E-183.
 - For conduit to tower and suspension cable lighting see sheet E-228.
 - Contractor shall furnish and install UP-206 and LP-221 per sheet E-73. For complete scope of work on platform and other related work not shown on this sheet, see Electrical Special Provisions.
 - Roadway Barrier Receptacle, see Detail 1, sheet E-162.

- NOTES:**
- References:
 - For typical details and locations of conduit connections to light poles, barrier outlet boxes, call boxes, overhead sign lighting, CMS, CCTV and MVDS, see sheets E-160 thru E-162 and E-169.
 - TOS equipment is shown for conduit routing only. For typical details of TOS controller and devices, see sheets E-344 through E-357.
 - For types of pull boxes, splice boxes and enclosures, see sheet E-169.
 - For circuit and conduit/cable tray schedules, see sheets starting at E-401.
 - For Roadway Level Call Boxes, refer to sheet E-396.
 - For Roadway level, Bike Path and Belvedere Lighting Fixture Schedules, see sheets E-146, E-147 and E-165.
 - For Roadway level and Bike Path Call Box Schedule, see sheet E-397.
 - For number of lighting fixtures (main tower lights) see lighting schedule sheets E-271 and E-272.
 - All conduits and fittings routed exposed between the Bike Path and the roadway shall be galvanized rigid steel, PVC coated.
 - See sheets E-160 thru E-165 for conduit locations.

SAS SUPERSTRUCTURE - CONDUIT PLAN

SAS SUPERSTRUCTURE ROADWAY EASTBOUND LIGHTING AND ELECTRICAL SYSTEMS
 SCALE 1:200



REQUEST FOR INFORMATION NOT ADDRESSED IN THIS CCO REMAIN IN FORCE					
MARK	DATE	DESCRIPTIONS	BY	CH'D	CCO#
2	03/04/08	BARRIER MODIFICATIONS	TW	RG	44
1	02/19/08	ELECTRICAL MODIFICATIONS	MP	RR	42

CONTRACT CHANGE ORDER NO. _____
 SHEET _____ OF _____

FOR REVISION ONLY

THIS PLAN ACCURATE FOR ELECTRICAL WORK ONLY.

ALL DIMENSIONS ARE IN METERS UNLESS OTHERWISE SHOWN
 FOR REDUCED PLANS ORIGINAL SCALE IS IN MILLIMETERS

DGN FILE => T:\13103\MS\pse\SAS Struc\CCO\SAS CC044\04-0120F1_0190R2.dgn
 USERNAME => Ilorico
 CU 04251

EA 0120F1

DATE PLOTTED => 5/22/2008
 TIME PLOTTED => 10:49:59 AM
 LAST REVISION 00-00-00