


STATE OF CALIFORNIA - DEPARTMENT OF TRANSPORTATION  
**Caltrans**  
 DESIGN OVERSIGHT  
 BEHZAD GOLEMOHAMMADI

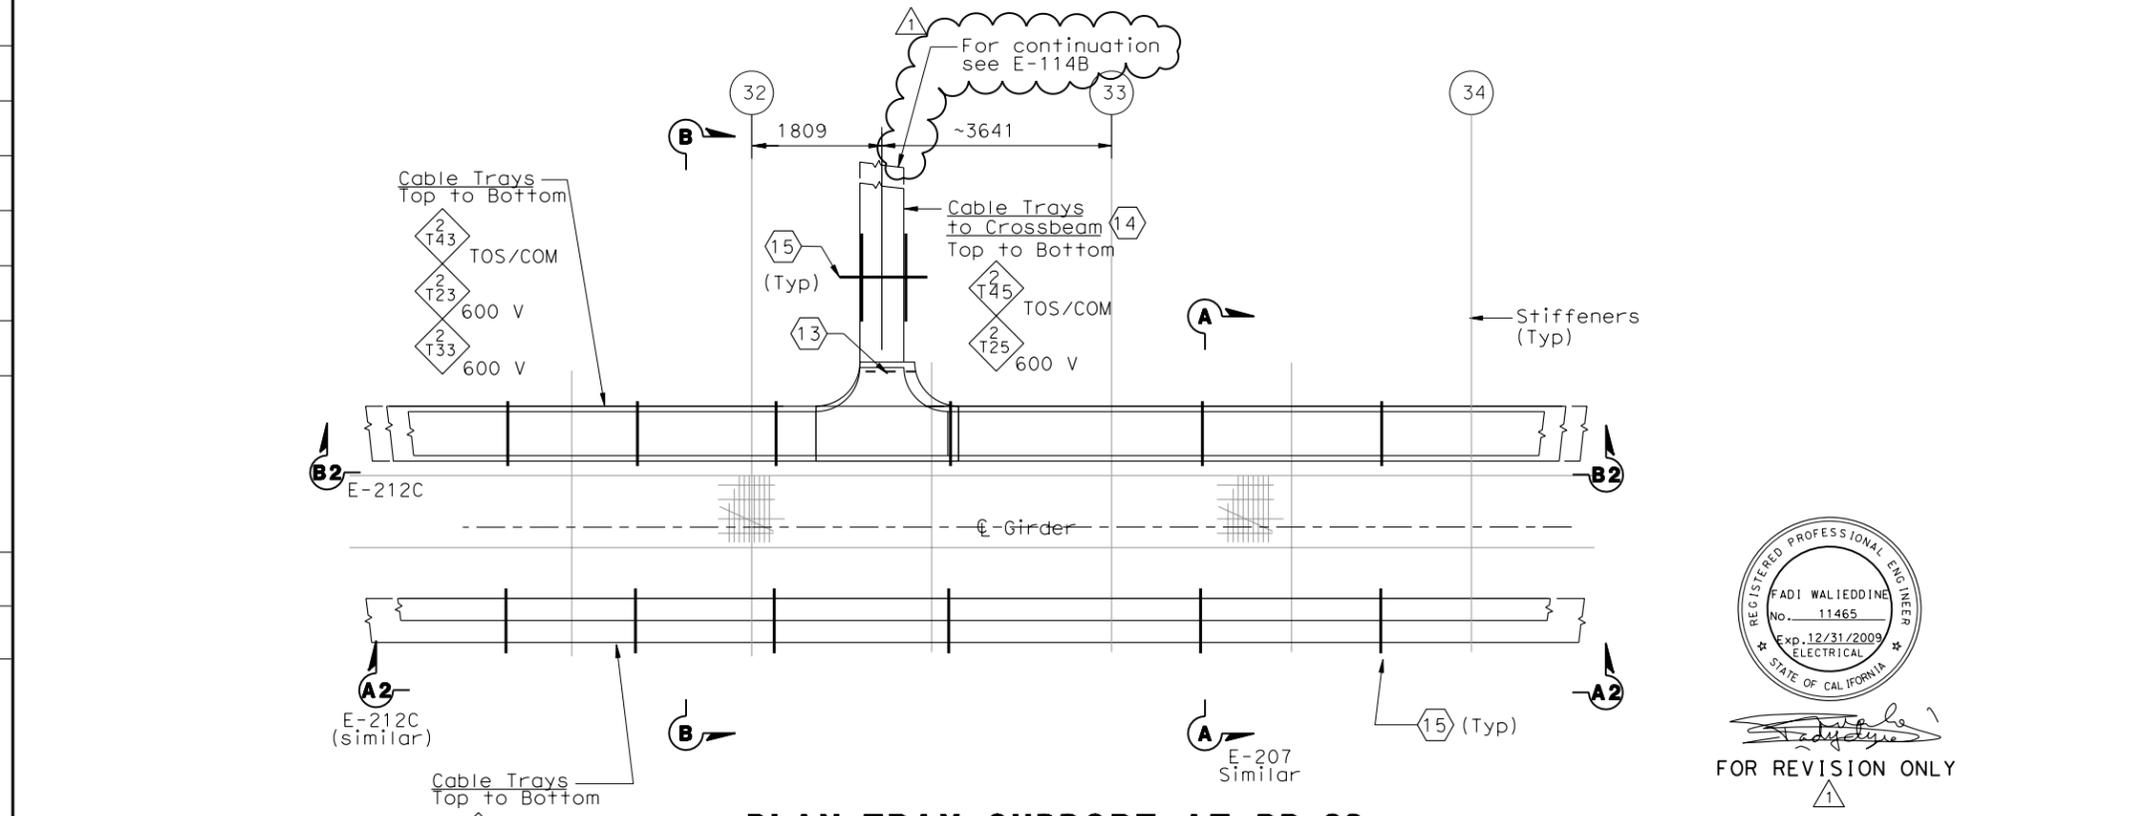

**PLAN-TRAY SUPPORT AT PP-32**  
 (SIMILAR FOR LOCATION AT PP 50, PP 80 and PP-110)  
 Scale 1:50

**Caltrans**  
**Metric**

DIST	COUNTY	ROUTE	KILOMETER TOTAL PROJECT	POST PROJECT	SHEET No	TOTAL SHEETS
04	SF	80	13.2/13.9		232 S2R1	1204

REGISTERED ELECTRICAL ENGINEER DATE 2/22/08  
 S. A. ESTOQUE, JR.  
 No. E-10151  
 Exp. 12/31/2009  
 ELECTRICAL  
 STATE OF CALIFORNIA

PLANS APPROVAL DATE  
 PB AMERICAS, Inc.  
 A Parsons Brinckerhoff Company  
 303 Second St., Suite 700N  
 San Francisco, CA 94107-1317

The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.  
 Caltrans now has a web site! To get to the web site, go to <http://www.dot.ca.gov>


- SHEET NOTES:**
- Type I, for cable tray supports details, see AS sheets.
  - Type II, for cable tray supports details, see AS sheets.
  - Type V, for cable tray supports details, see AS sheets.
  - Type VI, for cable tray supports details, see AS sheets.
  - The Contractor to provide cable tray support at each end of cable tray fitting as required.
  - Type VII, for cable tray supports details, see AS sheets.
  - Type VIIA, for cable tray supports details, see AS sheets.
  - Type VIIB, for cable tray supports details, see AS sheets.
  - Deleted.
  - Pull Box PB-2A shall be located on top of stiffener. The Contractor shall provide strut channel for support installed in field.
  - The Contractor shall provide strut channel on top of stiffener for conduit support and installed in field.
  - The Contractor to provide insulated grounding bushing at each end of the conduit.
  - The Contractor to provide secondary support installed in field, see Detail 3 on dwg. E-207D.
  - For cable tray numbers to PP 50, PP 80 and PP 110, see sheet E-114B.
  - For cable tray support see AS-Sheets.

REGISTERED PROFESSIONAL ENGINEER  
 FADI WALIEDDINE  
 No. 11465  
 Exp. 12/31/2009  
 ELECTRICAL  
 STATE OF CALIFORNIA

FOR REVISION ONLY

REQUEST FOR INFORMATION NOT ADDRESSED IN THIS CCO REMAIN IN FORCE					
MARK	DATE	DESCRIPTIONS	BY	CH'D	CCO#
△	03/30/09	SERVICE PLATFORM ELECTRICAL CHANGES	RG	FW	55
△	02/25/08	CABLE TRAY CHANGES	TW	RG SE	42S1
REVISIONS					

CONTRACT CHANGE ORDER NO. \_\_\_\_\_  
 SHEET \_\_\_\_\_ OF \_\_\_\_\_

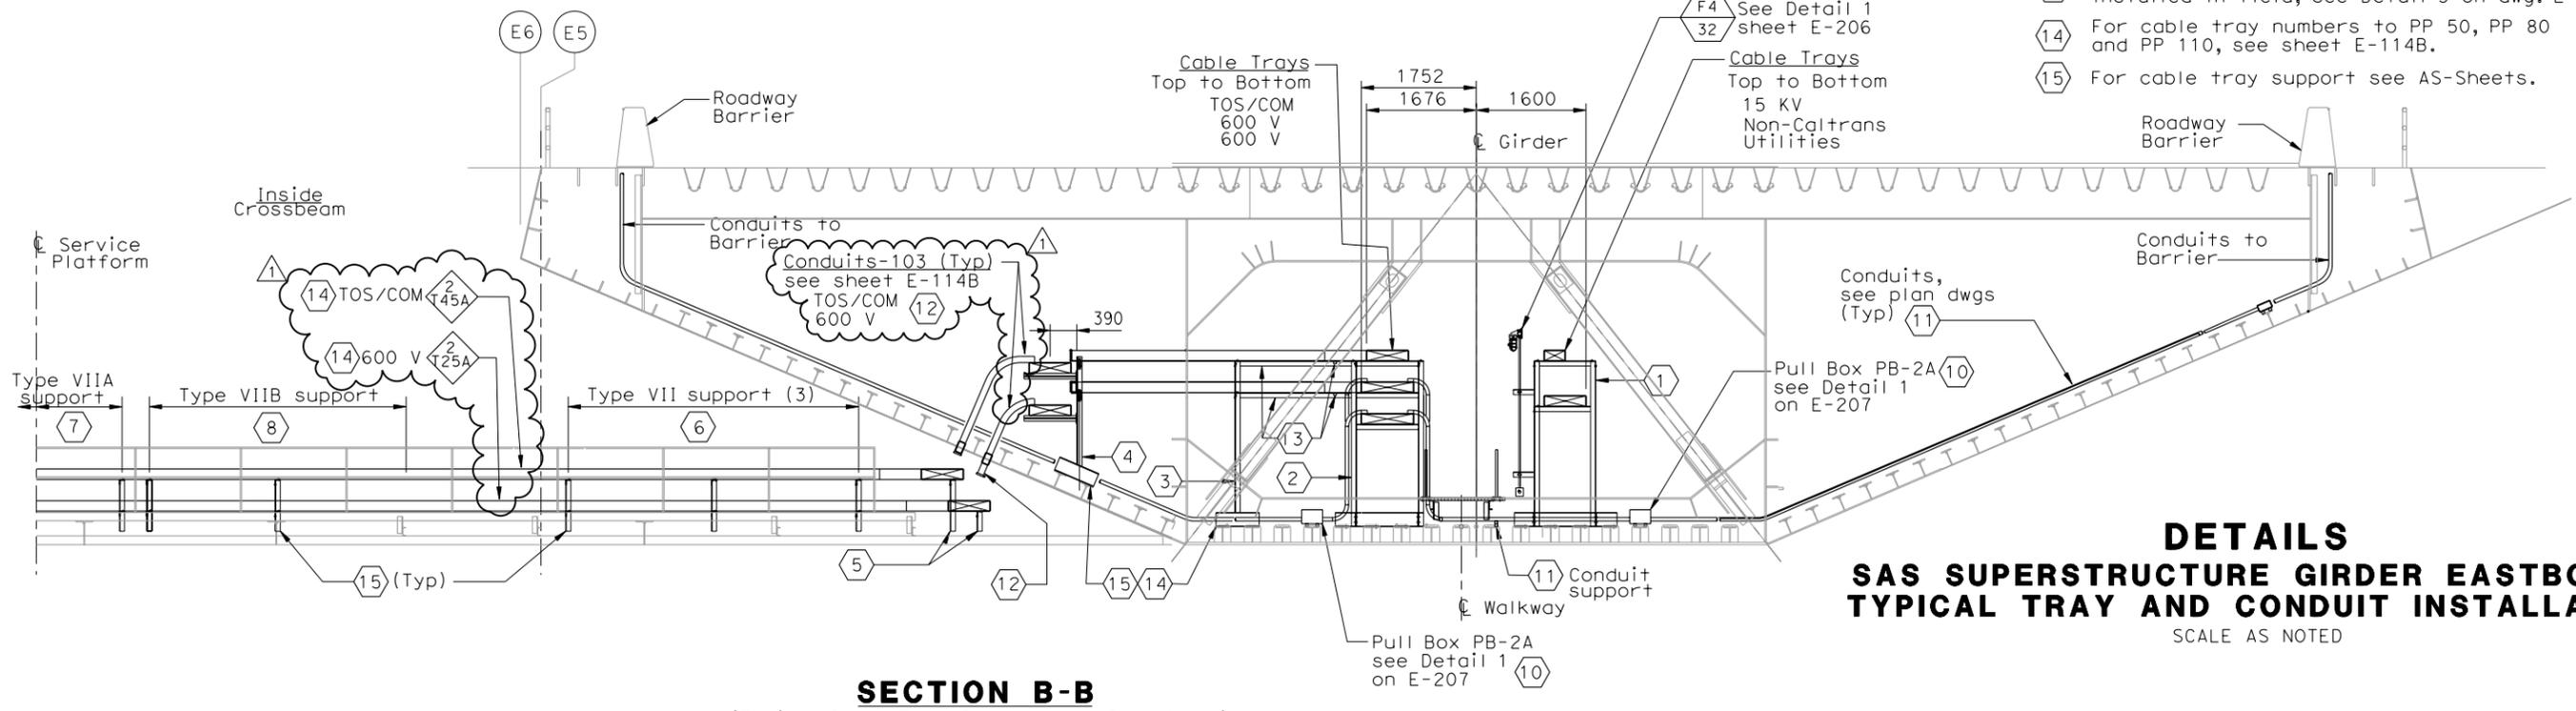

**SECTION B-B**  
 (Typical Cable Tray Support and Crossbeam)  
 PP 32, PP 50, PP 80 and PP-110  
 Scale 1:50

**DETAILS**  
**SAS SUPERSTRUCTURE GIRDER EASTBOUND**  
**TYPICAL TRAY AND CONDUIT INSTALLATION**  
 SCALE AS NOTED

**E-207B**

THIS PLAN ACCURATE FOR ELECTRICAL WORK ONLY.

ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN.  
 FOR REDUCED PLANS ORIGINAL SCALE 15 IN MILLIMETERS  
 DGN FILE => T:\13103\MS\pse\SAS Struc\CCO\SAS CC055\04-0120F1\_0232502R01.dgn  
 USERNAME => garciar  
 CU 04251

EA 0120F1

DATE PLOTTED => 3/31/2009  
 TIME PLOTTED => 2:39:36 PM  
 LAST REVISION 00-00-00