




DIST	COUNTY	ROUTE	KILOMETER POST TOTAL PROJECT	SHEET No	TOTAL SHEETS
04	SF	80	13.2/13.9	137 S1	1204

6/12/08
 REGISTERED ELECTRICAL ENGINEER DATE
 FADI WALIEDDINE
 No. 11465
 Exp. 12/31/2009
 ELECTRICAL
 STATE OF CALIFORNIA

PLANS APPROVAL DATE
 PB AMERICAS, Inc.
 A Parsons Brinckerhoff Company
 303 Second St., Suite 700N
 San Francisco, CA 94107-1317

The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.

Caltrans now has a web site! To get to the web site, go to <http://www.dot.ca.gov>

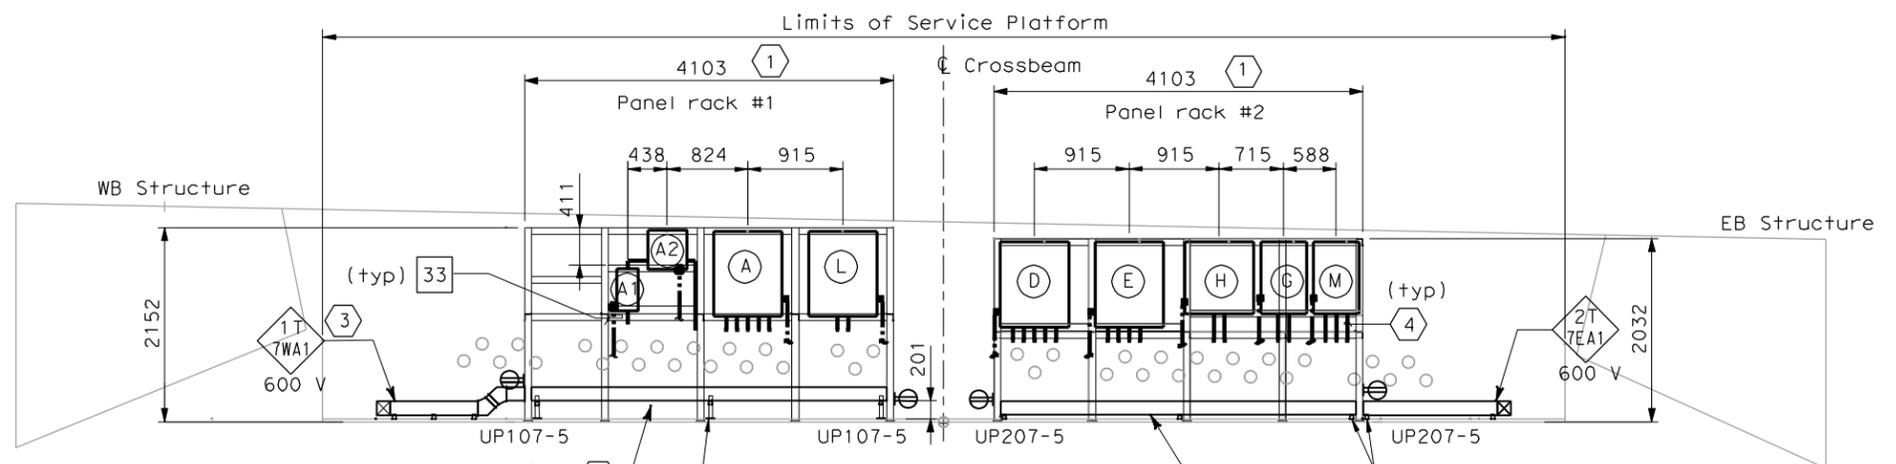

ELEVATION X-X
SCALE 1:40


WESTBOUND	CONDUIT NUMBERS
(A) Utility Panel, UP-107	4/263D, 4/264A, 4/076, 4/077, 4/078
(A1) Main Breaker for (A2)	4/263A, 4/263B
(A2) 15 kVA Transformer	4/263B, 4/263C
(L) TOS/COM-7WA Pull Box	4/265A, 4/266A
EASTBOUND	CONDUIT NUMBERS
(D) Utility Panel, UP-207	5/263D, 5/264A, 5/076, 5/077, 5/078
(D1) Main Breaker for (D2)	5/263A, 5/263B
(D2) 15 kVA Transformer	5/263B, 5/263C
(D3) Feeder Breaker for (D)	5/263C, 5/263E
(E) Lighting Panel LP-222	5/265D, 5/079, 5/080, 5/081
(E1) Main Breaker for (E2)	5/265A, 5/265B
(E2) 15 kVA Transformer	5/265B, 5/265C
(E3) Feeder Breaker for (E)	5/265C, 5/265E
(G) Telephone Terminal Box #TEL-7	5/270A, 5/271A
(H) Communication Terminal Box #COM-7	5/267A, 5/271A
(M) TOS/COM-7EA Pull Box	5/272A, 5/266A, 5/273A

SHEET NOTES:

- 1 For electrical panel support details, see AS-sheets, AS-13, AS-13A, and AS-13B
- 2 Cable trays shall be without cover located below panel racks #1 and #2.
- 3 600 V Stainless steel wireway with cover.
- 4 To prevent moisture from entering the enclosures, contractor to seal the end of conduit with an approved type of sealing compound after all cables are pulled. Empty conduit shall be capped for future use.
- 5 See Detail 1 on Sheet E-71A.

NOTES:


- 1. Equipment dimensions mounted at panel racks shall be verified by Contractor prior to purchase and installation.
- 2. The Contractor to provide fabricated tray cover over the conduits from cabinets. See sheet E-117 for locations.
- 3. (SP) Denotes spare pipe sleeve for 78 mm conduit. Contractor to provide plug at each ends.

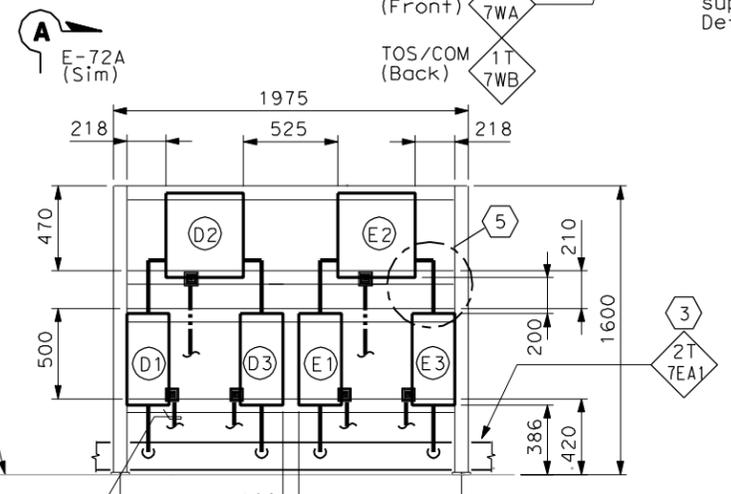

ELEVATION Z-Z
SCALE 1:20

REQUEST FOR INFORMATION NOT ADDRESSED IN THIS CCO REMAIN IN FORCE					
MARK	DATE	DESCRIPTIONS	RR MP	RG FW	CCO#
Δ	10/30/08	SERVICE PLATFORM ELECTRICAL CHANGES			55
		REVISIONS	BY	CH'D	CCO#

CONTRACT CHANGE ORDER NO. _____
SHEET _____ OF _____

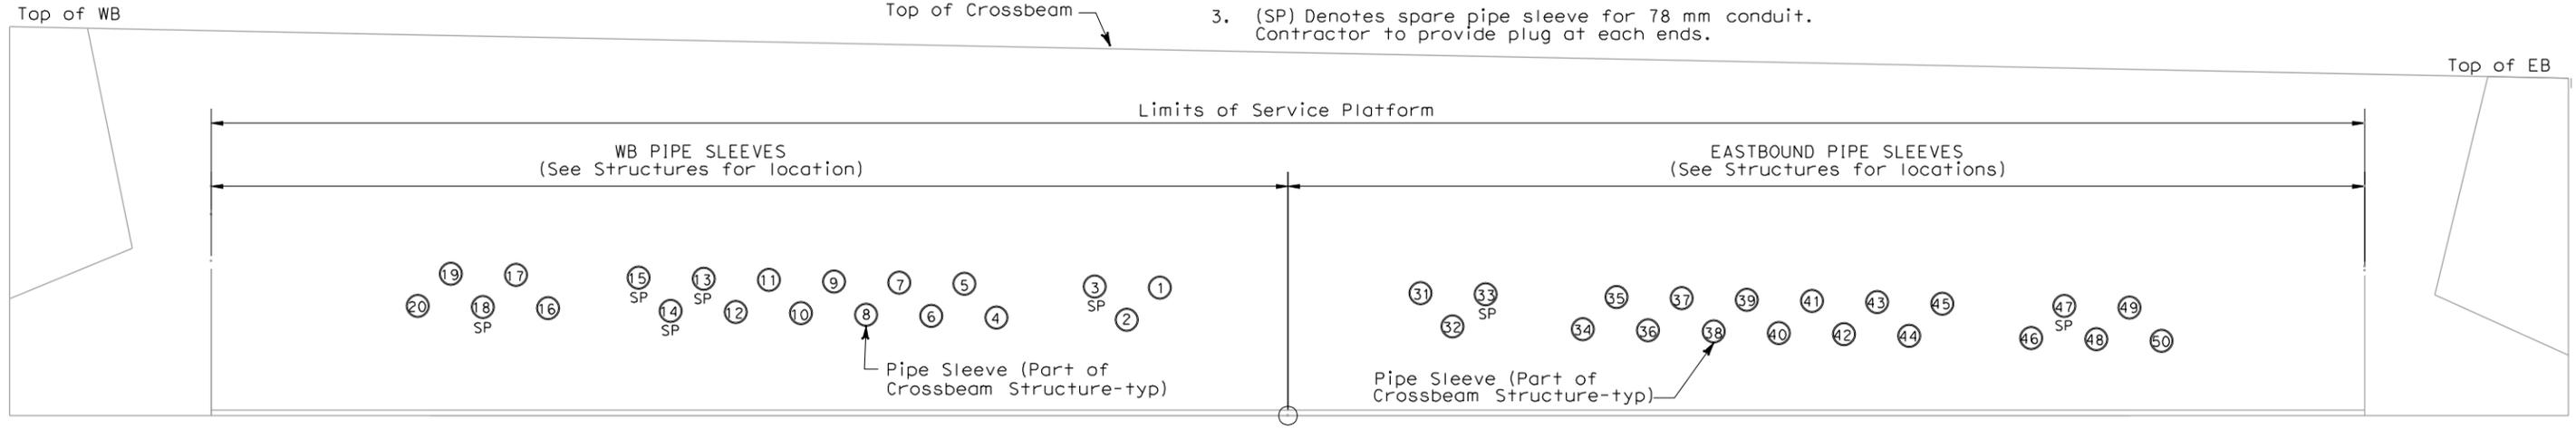

PIPE SLEEVE ELEVATION Y-Y
SCALE 1:20

DETAILS
SAS SUPERSTRUCTURE ROADWAY WESTBOUND
PLATFORM 7 ARRANGEMENT
SCALE AS NOTED

THIS PLAN IS ACCURATE FOR ELECTRICAL WORK ONLY.

ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN.



DGN FILE => T:\13103\MS\pse\SAS Struc\CCO\SAS CC05\2008-10-10_Issued for Submit\04-0120f1_0137S01.dgn
 USERNAME => Ilorico
 CU 04251 EA 0120F1

E-74A

STATE OF CALIFORNIA - DEPARTMENT OF TRANSPORTATION
 DESIGN OVERSIGHT
 BEHZAD GOLEMOHAMMADI
 REVISIONS
 DATE
 REVISOR
 DATE
 CHECKED BY
 BEHZAD GOLEMOHAMMADI

DATE PLOTTED => 10/29/2008
 TIME PLOTTED => 2:07:49 PM
 00-00-00