DIST	COUNTY	ROUTE	KILOMETER POST TOTAL PROJECT	SHEET No	TOTAL SHEETS
04	SF, Ala	80	12.2/14.3 0.0/4.0	407a 06S68	1204

Syn Yee Chin 03/08/10
REGISTERED ELECTRICAL ENGINEER DATE

05-06-2010
PLANS APPROVAL DATE

REGISTERED PROFESSIONAL ENGINEER
SYN YEE CHIN
No. 18186
Exp. 09/30/2011
ELECTRICAL
STATE OF CALIFORNIA

PB AMERICAS, Inc.
A Parsons Brinckerhoff Company
303 Second St., Suite 700N
San Francisco, CA 94107-1317

The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.

Caltrans now has a web site! To get to the web site, go to http://www.dot.ca.gov

Caltrans Metric

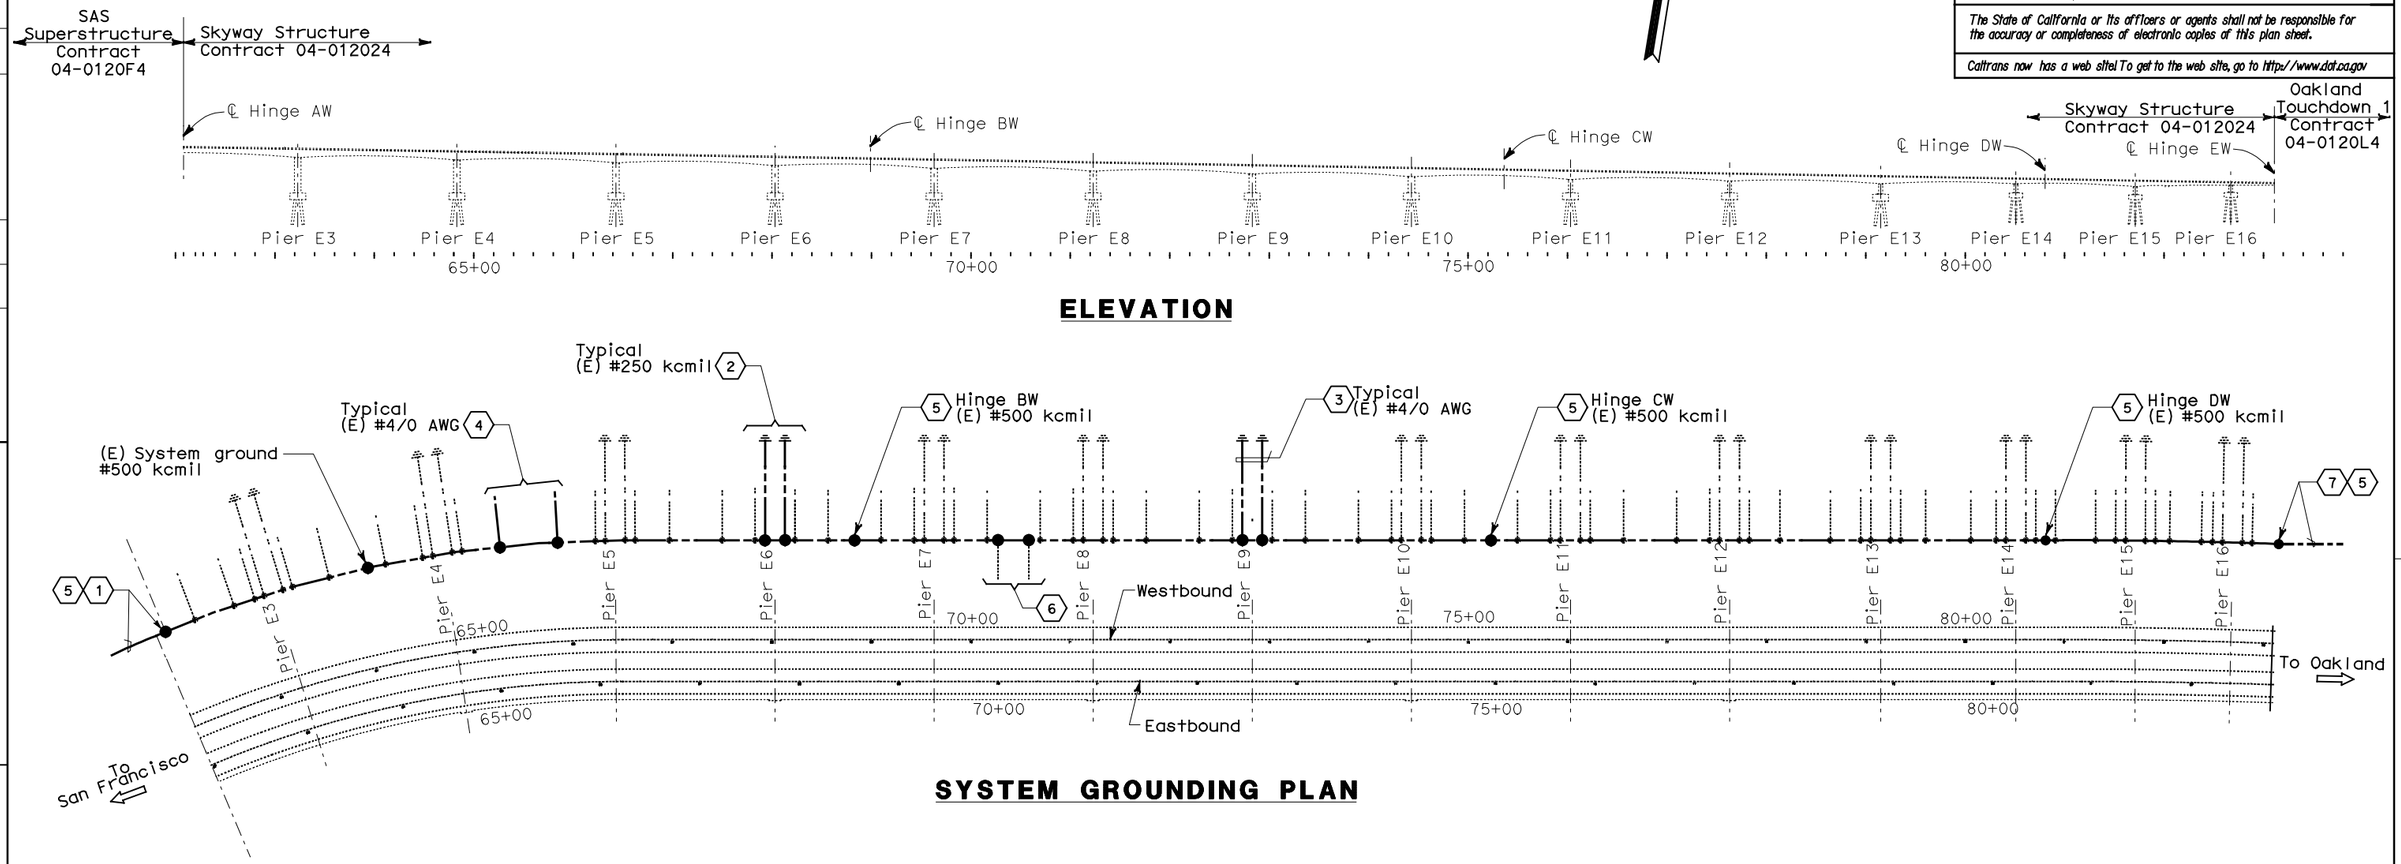

NOTES:

1. References:
   - For applicable details see Grounding Detail sheet E-667.
2. The system ground shall be continuously and mechanically connected as noted on the sheet notes. The Contractor shall provide the inspection report to the Engineer.

SHEET NOTES:

(1) The Contractor shall connect the system ground provided by Skyway contract. The system ground #500 kcmil shall be exothermically connected from SAS contract.

(2) The Contractor shall visually inspect the ground connection to the pier column. The ground connection is #250 kcmil to the system ground.

(3) The Contractor shall visually inspect the ground connection to the service platform. The ground connection is #4/0 AWG, routed inside an existing conduit to the system ground.

SHEET NOTES:

(4) The Contractor shall visually inspect the ground connection the cable tray racks. The ground connection is #4/0 AWG, located 1/3 the distance between pier columns.

(5) The Contractor shall disconnect and remove the connected system ground routed inside the existing hinge conduits. This ground conductor shall be re-installed together with 15 kV feeder cable. The ground conductors shall be exothermically re-connected.

(6) The Contractor shall visually inspect the ground connections to the ground bar inside the substation. The bar is connected to the system ground.

(7) The Contractor shall connect the system ground provided by Oakland Touchdown OTD-1 contract. The system ground #500 kcmil provided by Skyway contract shall be exothermically connected by this Contractor.

REQUEST FOR INFORMATION NOT ADDRESSED IN THIS CCO REMAIN IN FORCE

MARK	DATE	DESCRIPTIONS	BY	CH'D	CCO#
0	03/08/10	MEP INTEGRATION	SYC	FW	110

REVISIONS

CONTRACT CHANGE ORDER NO._____
SHEET _____ OF _____

DETAILS
BRIDGE STRUCTURES GIRDER WESTBOUND MAIN BRIDGE SYSTEM GROUNDING-WB
SCALE: 1:3000

E-666

THIS PLAN ACCURATE FOR ELECTRICAL WORK ONLY.

ALL DIMENSIONS ARE IN METERS UNLESS OTHERWISE SHOWN

FOR REDUCED PLANS ORIGINAL SCALE IS IN MILLIMETERS 0 20 40 60 80

DGN FILE =>04-0120f1_E-666.dgn
USERNAME =>llorico

CU 04251 EA 0120F1

DESIGN OVERSIGHT: BEHZAD GOLEMOHAMMADI

STATE OF CALIFORNIA - DEPARTMENT OF TRANSPORTATION

CALCULATED/DESIGNED BY	SYC	DATE 01/10	REVISED BY
CHECKED BY	FW	01/10	DATE REVISED

LAST REVISION 00-00-00

DATE PLOTTED => 06-MAY-2010
TIME PLOTTED => 18:09