



DIST	COUNTY	ROUTE	KILOMETER TOTAL PROJECT	POST TOTAL PROJECT	SHEET No	TOTAL SHEETS
04	SF	80	13.2/13.9		349 R2	1204


Jens Erlingsson 12/19/02
REGISTERED ELECTRICAL ENGINEER DATE

12-6-04
PLANS APPROVAL DATE

PB POWER, Inc.
A Parsons Brinckerhoff Company
303 Second St., Suite 700N
San Francisco, CA 94107-1317

The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.

Caltrans now has a web site To get to the web site, go to <http://www.dot.ca.gov>



SHEET NOTES:

- ① Strong Motion sensor cable Type SSC, unless otherwise indicated.
- ② Strong Motion Recorder #2 Box A consists of two 18-channel recorders and one 12-channel recorder, connected to a total of 35 sensors.
- ③ Sensor enclosure with identification number as shown.
- ④ Strong Motion Recorder #2 Box B consist of one 18-channel recorder connected to a total of 12 sensors.


NOTES:

- 1. For other related work not shown on this drawing, see Electrical Special Provisions.
- 2. References:
 - For general notes of the strong motion detection system, see sheet E-361.
 - For circuit and conduit/cable tray schedules, see sheets starting at E-401.
- 3. All conduits and fittings located outside or inside pier shall be galvanized rigid steel, PVC coated.
- 4. Secure enclosure to concrete with manufacturer's recommended mounting and approved by the Engineer.
- 5. Strong motion recorder #2 box A and box B located on service platform 5, see sheet E-72.

REQUEST FOR INFORMATION NOT ADDRESSED IN THIS CCO REMAIN IN FORCE

MARK	DATE	DESCRIPTIONS	BY	CH'D	CCO#
②	10/23/13	ADDITIONAL SAS MISCELLANEOUS ELECTRICAL CHANGES		RR	RG 191S2
①	10/03/08	STRONG MOTION SYSTEM		RG	FW 74
		REVISIONS			

CONTRACT CHANGE ORDER NO. _____ SHEET _____ OF _____

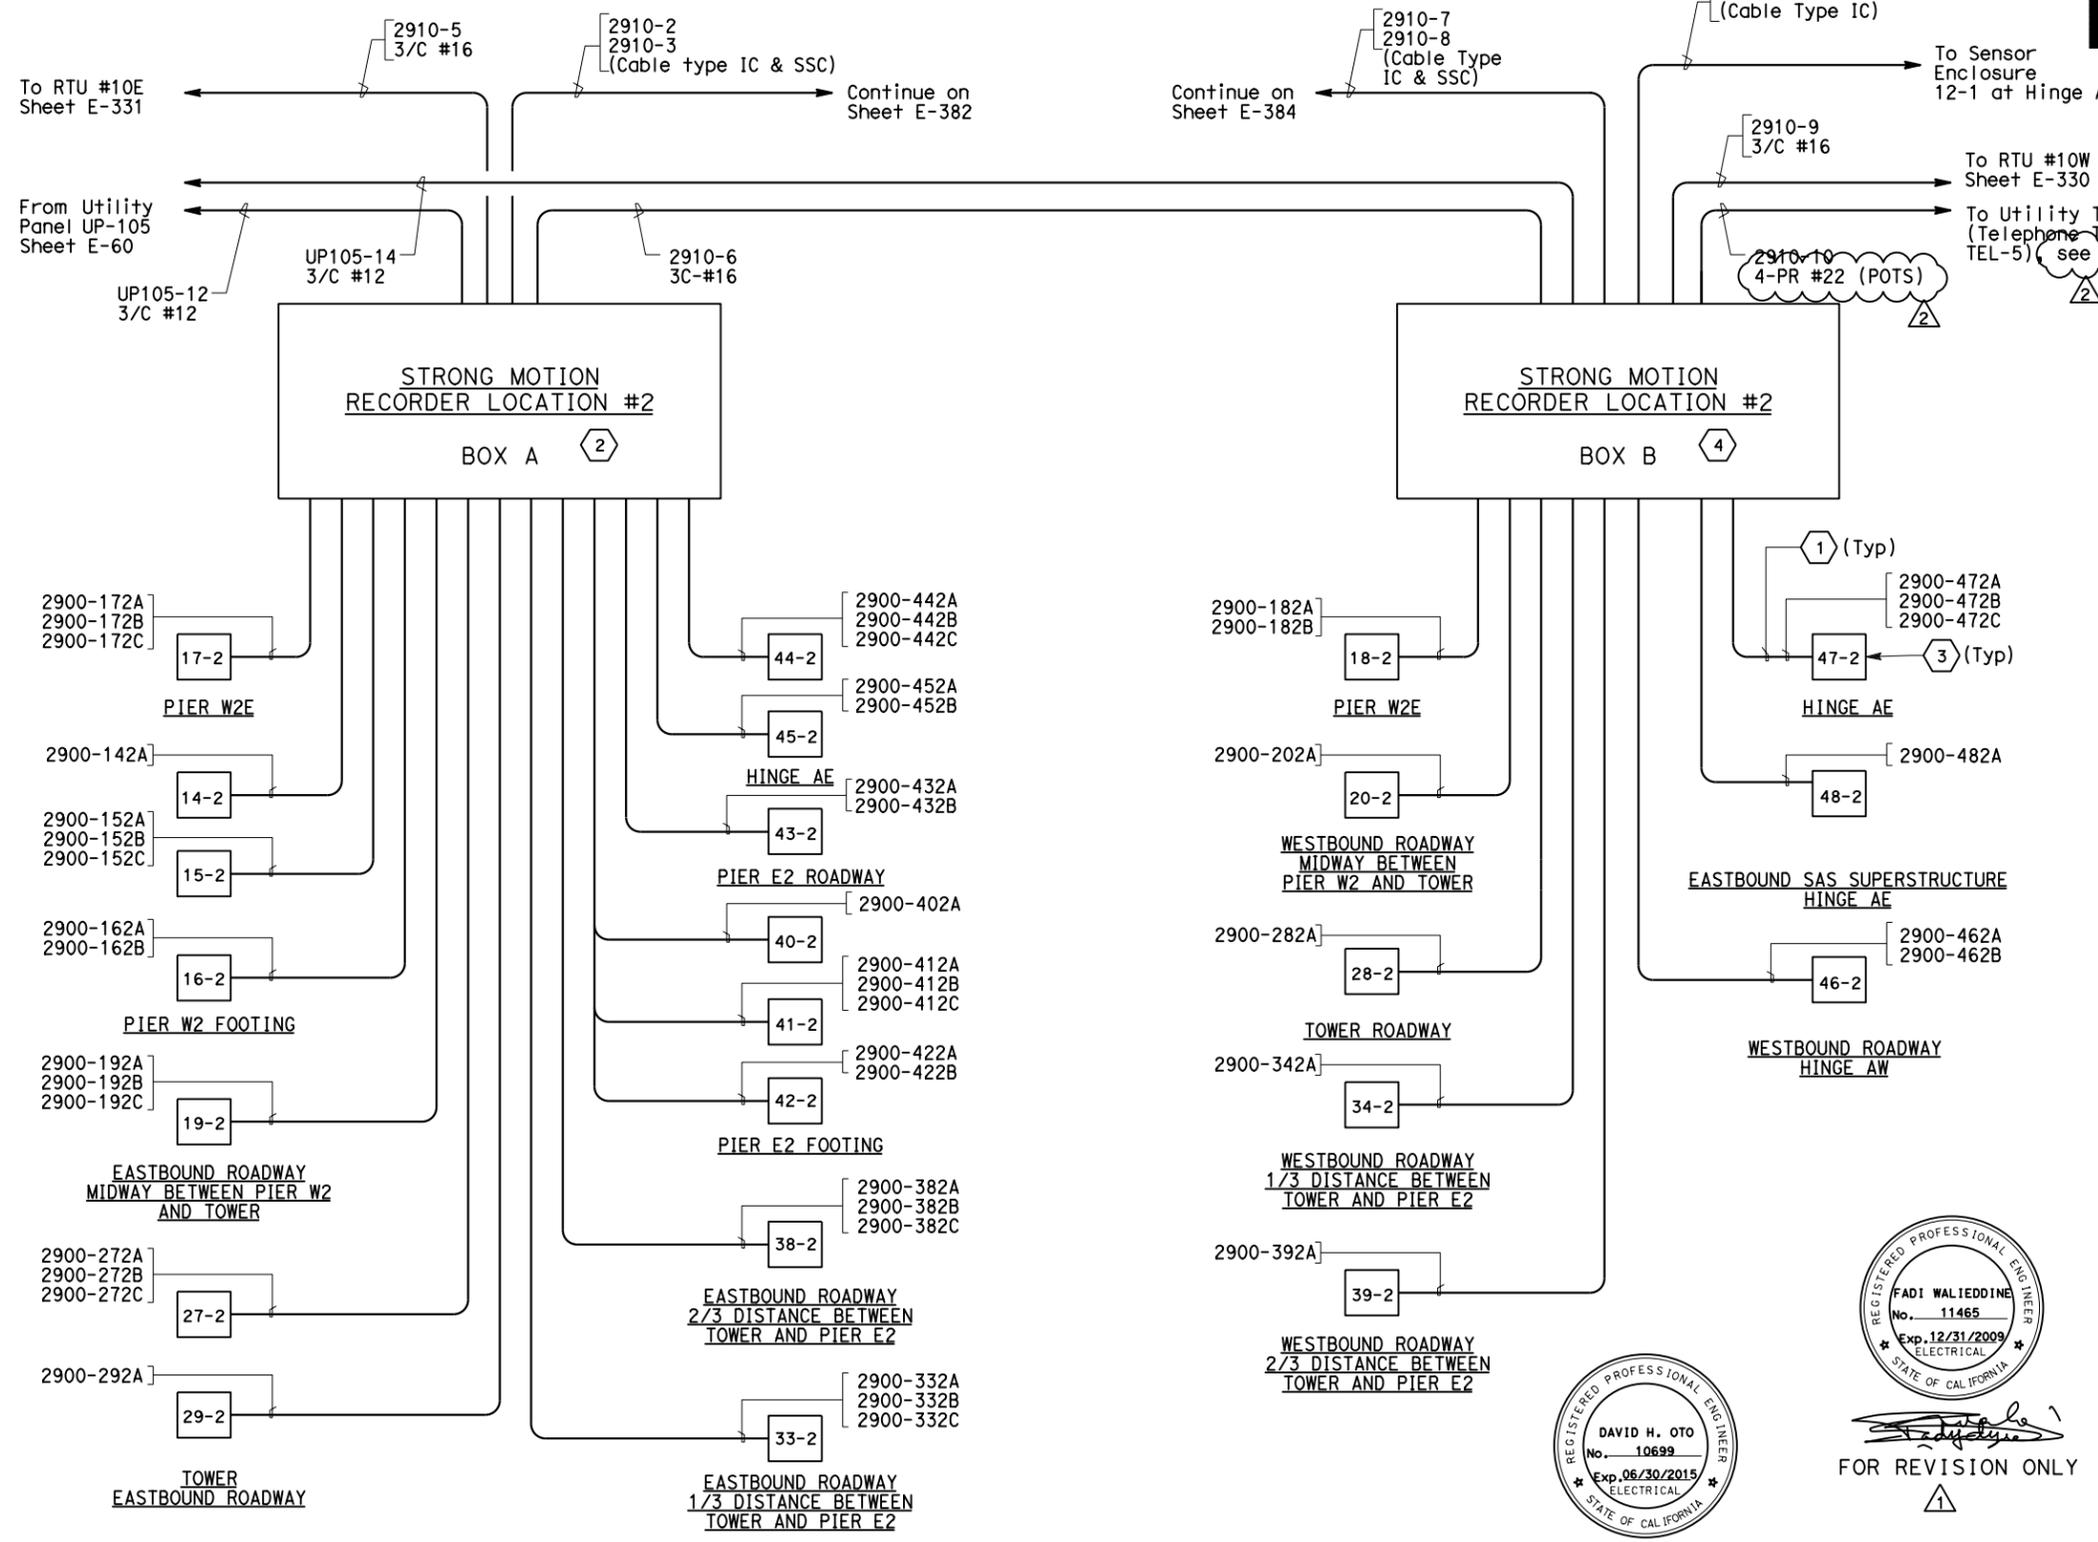

David H. Oto
FOR REVISION ONLY ②



Fadi Walieddine
FOR REVISION ONLY ①

**DETAILS
STRONG MOTION DETECTION SYSTEM
CABLE BLOCK DIAGRAM**

NO SCALE

DESIGNED BY: BEHZAD GOLEMOHAMMADI
CHECKED BY: _____
DATE: 02/02
REVISIONS: _____

THIS PLAN IS ACCURATE FOR ELECTRICAL WORK ONLY.

FOR REDUCED PLANS ORIGINAL SCALE IS IN MILLIMETERS

DGN FILE => 04-0120f1_0349r02.dgn
USERNAME => Llorico

DATE PLOTTED => 21-OCT-2013
TIME PLOTTED => 16:53
LAST REVISION 10-23-13