





DIST	COUNTY	ROUTE	KILOMETER POST TOTAL PROJECT	SHEET No	TOTAL SHEETS
04	SF	80	13.2/13.9	9852 R1	1204
 REGISTERED ELECTRICAL ENGINEER DATE 07/05/11					
PLANS APPROVAL DATE					
PB AMERICAS, Inc. A Parsons Brinckerhoff Company 303 Second St., Suite 700N San Francisco, CA 94107-1317					
The State of California or its officers or agents shall not be responsible for the accuracy or completeness of electronic copies of this plan sheet.					
Caltrans now has a web site! To get to the web site, go to http://www.dot.ca.gov					

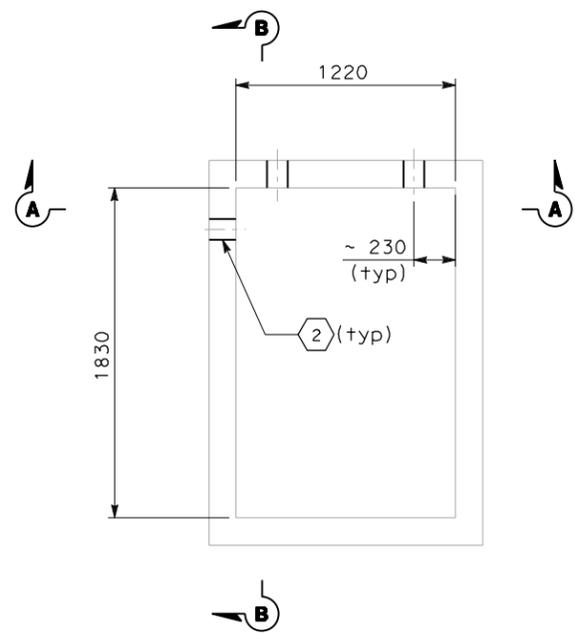

PLAN-(E) MANHOLE
ATT SB

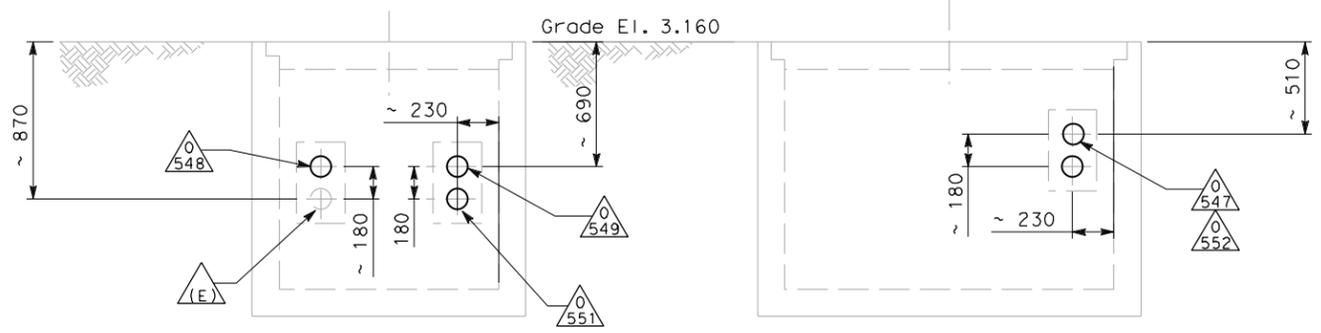

SECTION A-A

SECTION B-B

NOTES:

- References:
 - For duct banks and manhole plan, see sheet E-11A.
 - For typical manhole details, see sheet E-17.
 - For duct bank sections, see sheets U-4 and E-19B.
 - For circuit and conduit/cable tray schedules, see sheets starting at E-401
- For other related work, not shown on this sheet, see Electrical Special Provisions.


SHEET NOTES:

- Dimensions shown (~) are field survey. The Contractor is to verify to ensure the existing conduit is the reference for the actual location of the new conduits.
- Contractor to ensure the conduit entering the (E) Manhole shall be seal watertight.

REVISOR	DATE	BY	REASON

DESIGNED BY	CHECKED BY
EL	RG

DESIGN OVERSIGHT
BEHZAD GOLEMOHAMMADI

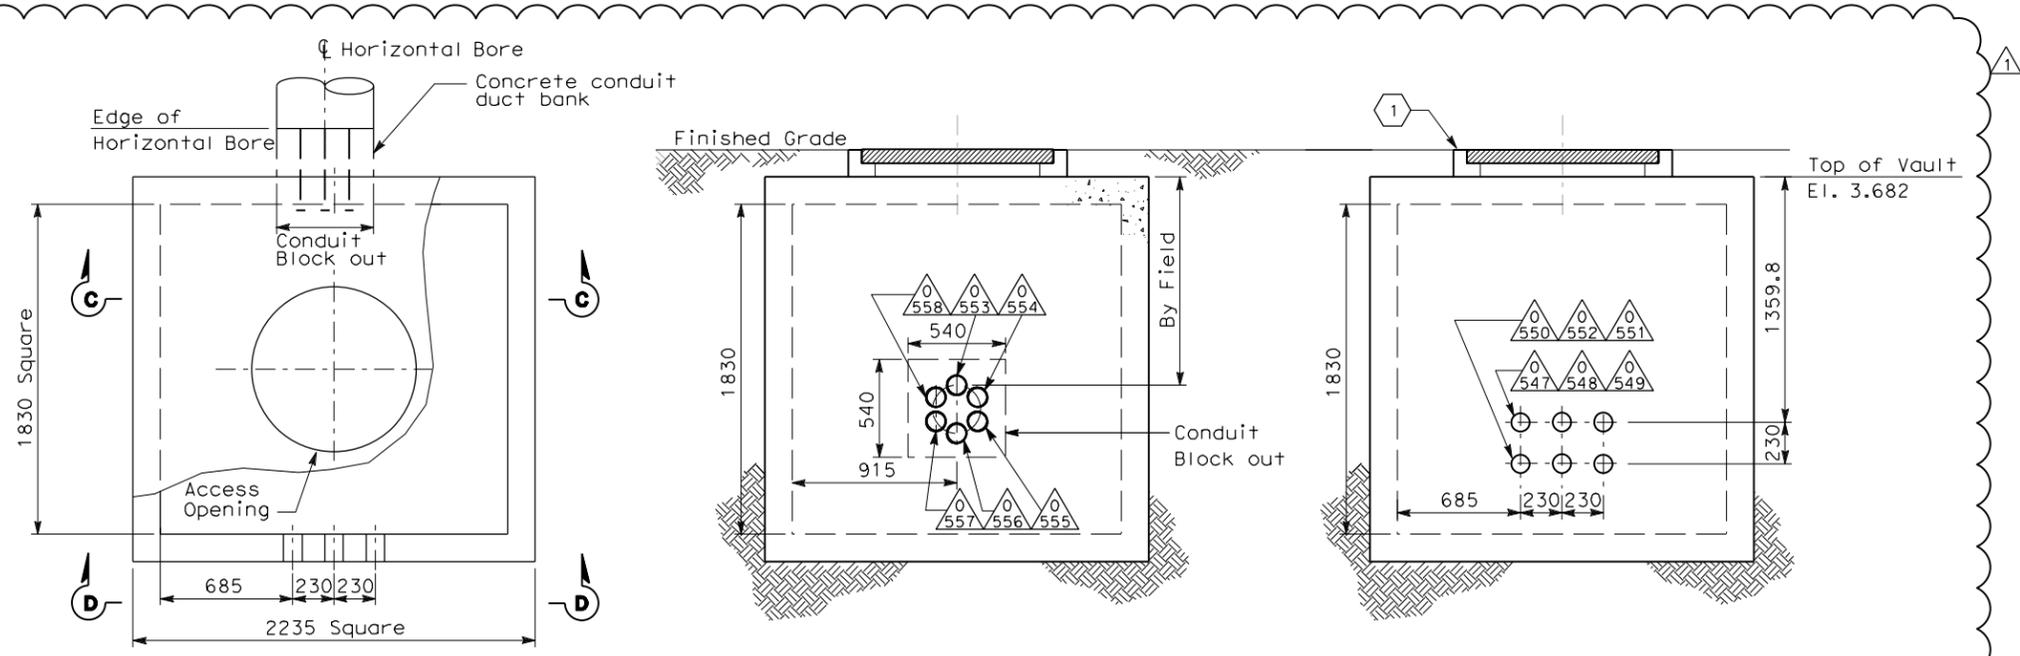

PLAN-MANHOLE-28C
SCALE: 1:20 (Non-Caltrans Utilities)

SECTION C-C
SCALE: 1:20

SECTION D-D
SCALE: 1:20


REQUEST FOR INFORMATION NOT ADDRESSED IN THIS CCO REMAIN IN FORCE					
MARK	DATE	DESCRIPTIONS	BY	CH'D	CCO#
1	12/05/11	W2 DUCT BANKS RE INFORCEMENT	MG	DO	205
0	08/08/11	W2 DUCT BANKS RE INFORCEMENT	EJL TW	RG	205

CONTRACT CHANGE ORDER NO. _____
SHEET _____ OF _____

DETAILS
UNDERGROUND
MANHOLE PLAN AND SECTIONS
SCALE: NONE

ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN

FOR REDUCED PLANS ORIGINAL SCALE 15 IN MILLIMETERS



DGN FILE => 04-0120f1_0098502R01.dgn
USERNAME => fusco

CU 04251

EA 0120F1

DATE PLOTTED => 12/16/2011
TIME PLOTTED => 2:21:56 PM
LAST REVISION 00-00-00

THIS PLAN ACCURATE FOR ELECTRICAL WORK ONLY.

