

Job Stamp 04-0120F4 SFOBB SAS

Construction Calendar no.	610		
Project working days no.	820		
Date	08/14/2008		
Inspectors Hours	Start	6:30	Stop 15:00
Shift Hours	Start	6:30	Stop 15:00

Assistant Structure Rep.'s Daily Report

Location & Description of Operation	SAS-Temporary towers, Tower A & B Erection
Weather	HI: 71 F Low: 56 F Partly cloudy

Equipment and/or labor			Hours – ITEM no.						Remarks
Equip no.	# personnel	Description (of equipment or labor)	Regular	OT	DT	Rental		IDLE	
	C	Liebherr LR 1300	8						ABF
006-18-4293	C	Ingresoll Compressor	8						ABF
481-93-6013	R	Gnie Boom lift	2						ABF
544D-10	R	Gradall Forklift	2						ABF
	1	Dale Thomas	8						Operator
	1	Doug Greene	8						Oilee
	1	Ed Meyer	8						Foreman
	1	Matt Chamberlain	8						Iron worker
	1	James Sturgeon	8						Iron worker
	1	Serina Lafleur	8						Iron worker
	1	David Lucero	8						Iron worker
	1	Jerry Kubala, Jr.	8						Iron worker

Description of Operation:

- Daily activity of contractors (ABF)
 - Continued to assemble upper portion of the tower AE and pretensioned bolts at splice zone circled in Fig. 1 on the ground. See Figs 1 through 3.
 - Erected the upper portion of the tower ^{AE}BE, which is shown in Figs 1. See Figs 4 through 7 for the erection sequences.
 - Pretensioned bolts at north column splice and two diagonal brace splices after the erection (see Figs 8 through 10).
 - See Art Pannu's diary for additional contractors' activities and comments.

- Note
 - Superintendent Dan is on site from 10:30 to 11:30 and 13:30 to 14:00.
 - ABF iron worker drilled a hole little bit more. So, Tony and I checked the diameter of the hole (see Figs 11 and 12). It is within the tolerance.
 - Dan mentioned that Caltrans inspector couldn't use any contractor equipment. I informed Art regarding this issue.
 - Tony from SE company is on-site all day.
 - Attend T.T. design meeting from 15:00 to 15:30.

- Punch list
 - The right top bolt of the east side plate of the tower A west line should be turned more (see 07/22/08 diary for more information).
 - The bolts at the top and bottom of the diagonal bracing splices of the tower B west line are short (see Appendix #1 of 07/29/08 diary for more information)

REC'D *08 SEP-27 #006769

Upper portion of the tower AE

4" bolt, 1/3 turn, washer one side
Pretensioned on ground

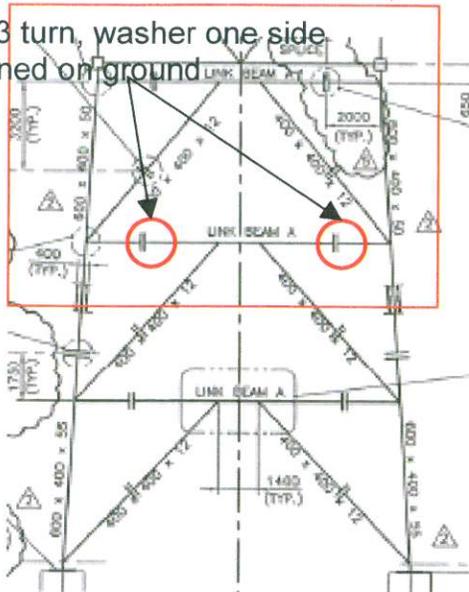


Fig 1



Fig 2



Fig 3



Fig 4



Fig 5



Fig 6

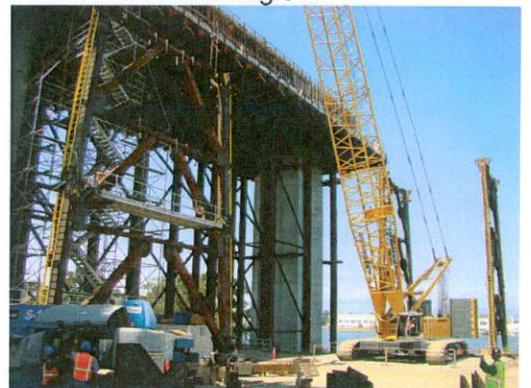


Fig 7

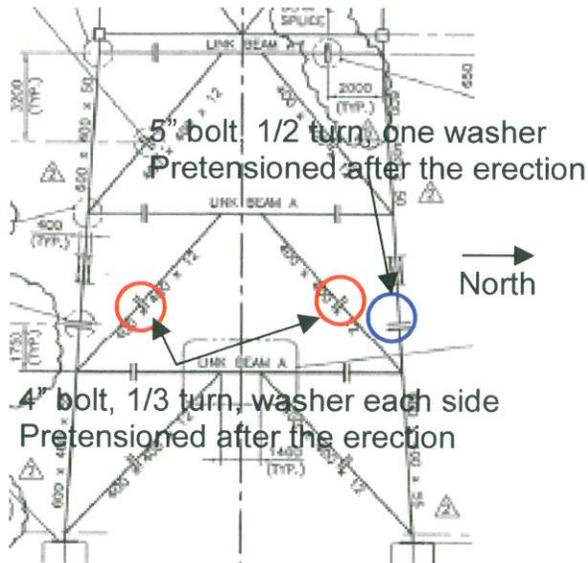


Fig 8



Fig 9



Fig 10

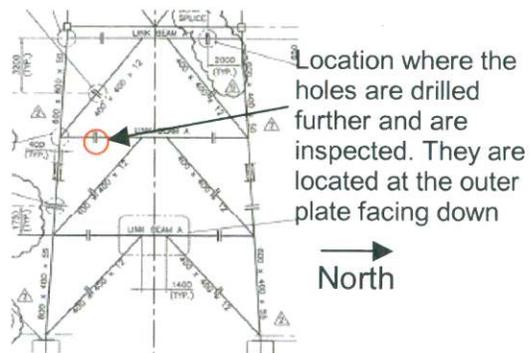


Fig 11



Fig 12

Inspector:
SeongHyeok Song

Trans Engineer (Civil) / Asst. Struct. Rep