

DEPARTMENT OF TRANSPORTATION

DIVISION OF ENGINEERING SERVICES

Office of Structural Materials

Quality Assurance and Source Inspection



Bay Area Branch
690 Walnut Ave. St. 150
Vallejo, CA 94592-1133
(707) 649-5453
(707) 649-5493

Contract #: 04-0120F4Cty: SF/ALA Rte: 80 PM: 13.2/13.9File #: 70.28**WELDING INSPECTION REPORT****Resident Engineer:** Pursell, Gary**Address:** 333 Burma Road**City:** Oakland, CA 94607**Report No:** WIR-003184**Date Inspected:** 08-Jul-2008**Project Name:** SAS Superstructure**OSM Arrival Time:** 2300**Prime Contractor:** American Bridge/Fluor Enterprises, a JV**OSM Departure Time:** 700**Contractor:** Japan Steel Works**Location:** Muroran, Japan**CWI Name:** Makhmud Ashadi**CWI Present:** Yes No**Inspected CWI report:** Yes No N/A**Rod Oven in Use:** Yes No N/A**Electrode to specification:** Yes No N/A**Weld Procedures Followed:** Yes No N/A**Qualified Welders:** Yes No N/A**Verified Joint Fit-up:** Yes No N/A**Approved Drawings:** Yes No N/A**Approved WPS:** Yes No N/A**Delayed / Cancelled:** Yes No N/A**Bridge No:** 34-0006**Component:** West Deviation Saddle, W2E1**Summary of Items Observed:**

On this date OSM Quality Assurance (QA) Representative Daniel L. Reyes was present during the welding of the structural steel components for the West Deviation Saddles relative to this project. The following was observed:

Fabrication Shop # 4

At the start of the C-shift the QA inspector traveled to the Fabrication Shop # 4 to observe the continued Partial Joint Penetration (PJP) groove welding of the structural steel plate components for the West Deviation Saddle identified as W2E1. The West Deviation Saddle is no longer mounted on the positioner and is now located at Lane B between column lines B5 and C5. The Welding Procedure Specification (WPS) SJ-3011-4 and the Distortion Control Plan, Document Number SJ-3109 Rev. 1 was utilized by the Japan Steel Works, Ltd. (JSW) personnel during the performance of the production welding of the stem plate to end plate connections. The WPS was also used as a reference by the QC inspector during the verification of the welding parameters. The welding was performed in the Flat Position (1G) with the work in the horizontal plane and the weld metal deposited from above. The gas shielded Flux Cored Arc Welding (FCAW-G) process was utilized and the welding performed by JSW personnel Makoto-Kato ID 08-5016 and Satoru-Watanabe ID 08-5159. The PJP welding appeared to be performed as per Step 5, Attachment 6 of the JSW Distortion Control Plan Revision 1.

The consumable utilized by the welding personnel appeared to be a Hobart Brothers Product and the trade name was identified as TM 95K2 which appeared to comply with the AWS Specification A5.29 and the AWS Classification E90T5-K2C H4. The size of the electrode was 1.6 mm in diameter.

The Quality Control (QC) inspection was performed by Intertek Testing Services personnel Makhmud Ashadi. The QC inspector verified the preheat temperatures, the Direct Current (DC) welding parameters and performed the in process weld inspection during this shift. The QC inspector was also assisted, at random intervals by the

WELDING INSPECTION REPORT

(Continued Page 2 of 3)

JSW Welding Engineer, Kou-Aoki during the verification process.

The QC inspector verified the minimum preheat temperatures of 160 degrees Celsius and at the conclusion of verifying the preheat temperatures the QC inspector verified the DC welding parameters and was observed as follows for the welder Makoto-Kato, 340 amps and 35.0 volts with a travel speed measured at 269 mm/m and the calculated heat input appeared to be 2.65 Kj/mm and for the Satoru-Watanabe welder the welding parameters were observed as follows, 330 amps and 35.0 volts with a travel speed measured at 260 mm/m and the calculated heat input at 2.67 Kj/mm.


The welding, inspection and the verification tasks were performed on the weld joints identified as E1Y-4V and E1Y-17V. The welding of step # 5 was completed as per JSW Distortion Control Plan during this shift on this date.

The QA inspector's observations were performed at random intervals during the shift. The QA inspector noted that it appeared the approved and latest revised WPS's were posted at the welding station and that each approved welder was entered in the latest revised Welding Personnel Log issued by Japan Steel Works, Ltd. The welding parameters, preheat and interpass temperatures were verified by the QA inspector utilizing a Fluke 337 clamp meter for the electrical welding parameters and Tempilstik temperature indicators for the surface temperatures. The filler metal utilized by the JSW welding personnel was also verified. The QC inspector ITS personnel, Anthony Corrado appeared to perform the visual weld examinations, monitoring of the welding and the verification of the welding parameters in accordance with the contract documents.

Foundry Shop

The QA inspector observed that no welding was performed on the saddle casting identified as W2E1 during this shift on this date.

The following digital photograph illustrates the observations of the activities performed on this date.

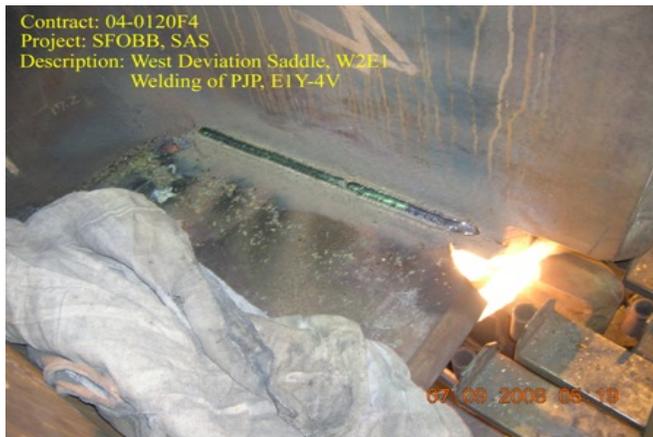

Summary of Conversations:

There were no pertinent conversations relative to the project discussed during this shift on this date.

Comments

This report is for the purpose of determining conformance with the contract documents and is not for the purpose of making repair or fit for purpose recommendations. Should you require recommendations concerning repairs or remedial efforts please contact Venkatesh Iyer, (858) 967-6363, who represents the Office of Structural Materials for your project.

WELDING INSPECTION REPORT

(Continued Page 3 of 3)

Inspected By: Reyes,Danny

Quality Assurance Inspector

Reviewed By: Lanz,Joe

QA Reviewer