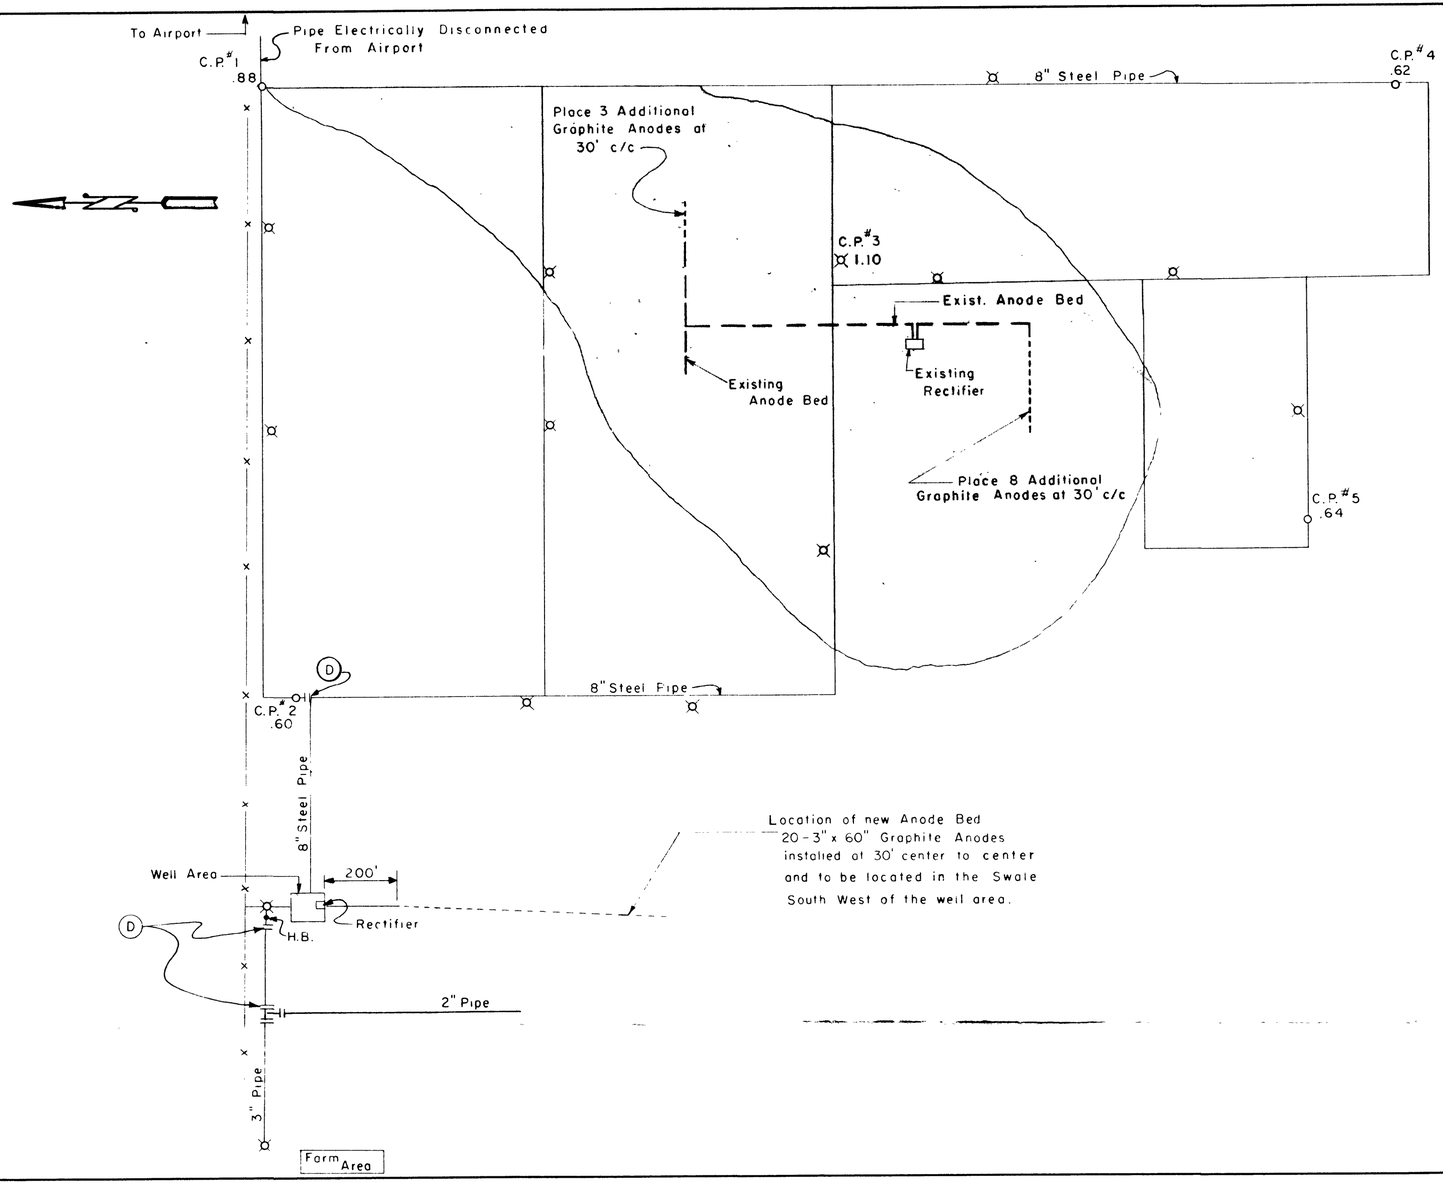

LEGEND

O - C.P.	Check Point for Pipe to Soil Potential Measurement
—||—	Elect. Discontinuity (D)
⌘	Fire Hydrant
⬭	Pipe Protected in this area

NOTE:
Potentials are referenced to a saturated copper sulfate half-cell

EXHIBIT II

LIMITS of EXISTING CATHODIC PROTECTION SYSTEM

PASO ROBLE SCHOOL FOR BOYS

Scale 1" = 200'

STATE of CALIFORNIA DIVISION OF HIGHWAYS

MATERIALS & RESEARCH DEPARTMENT

Sept 1960

ClibPDF - www.fastio.com